


# Transmission System Representation changes for 2013 IRM Study/2012 RNA - Summer Emergency Ratings (MW)


## New York Control Area (NYCA) – Draft For Discussion Only 5/18/2012

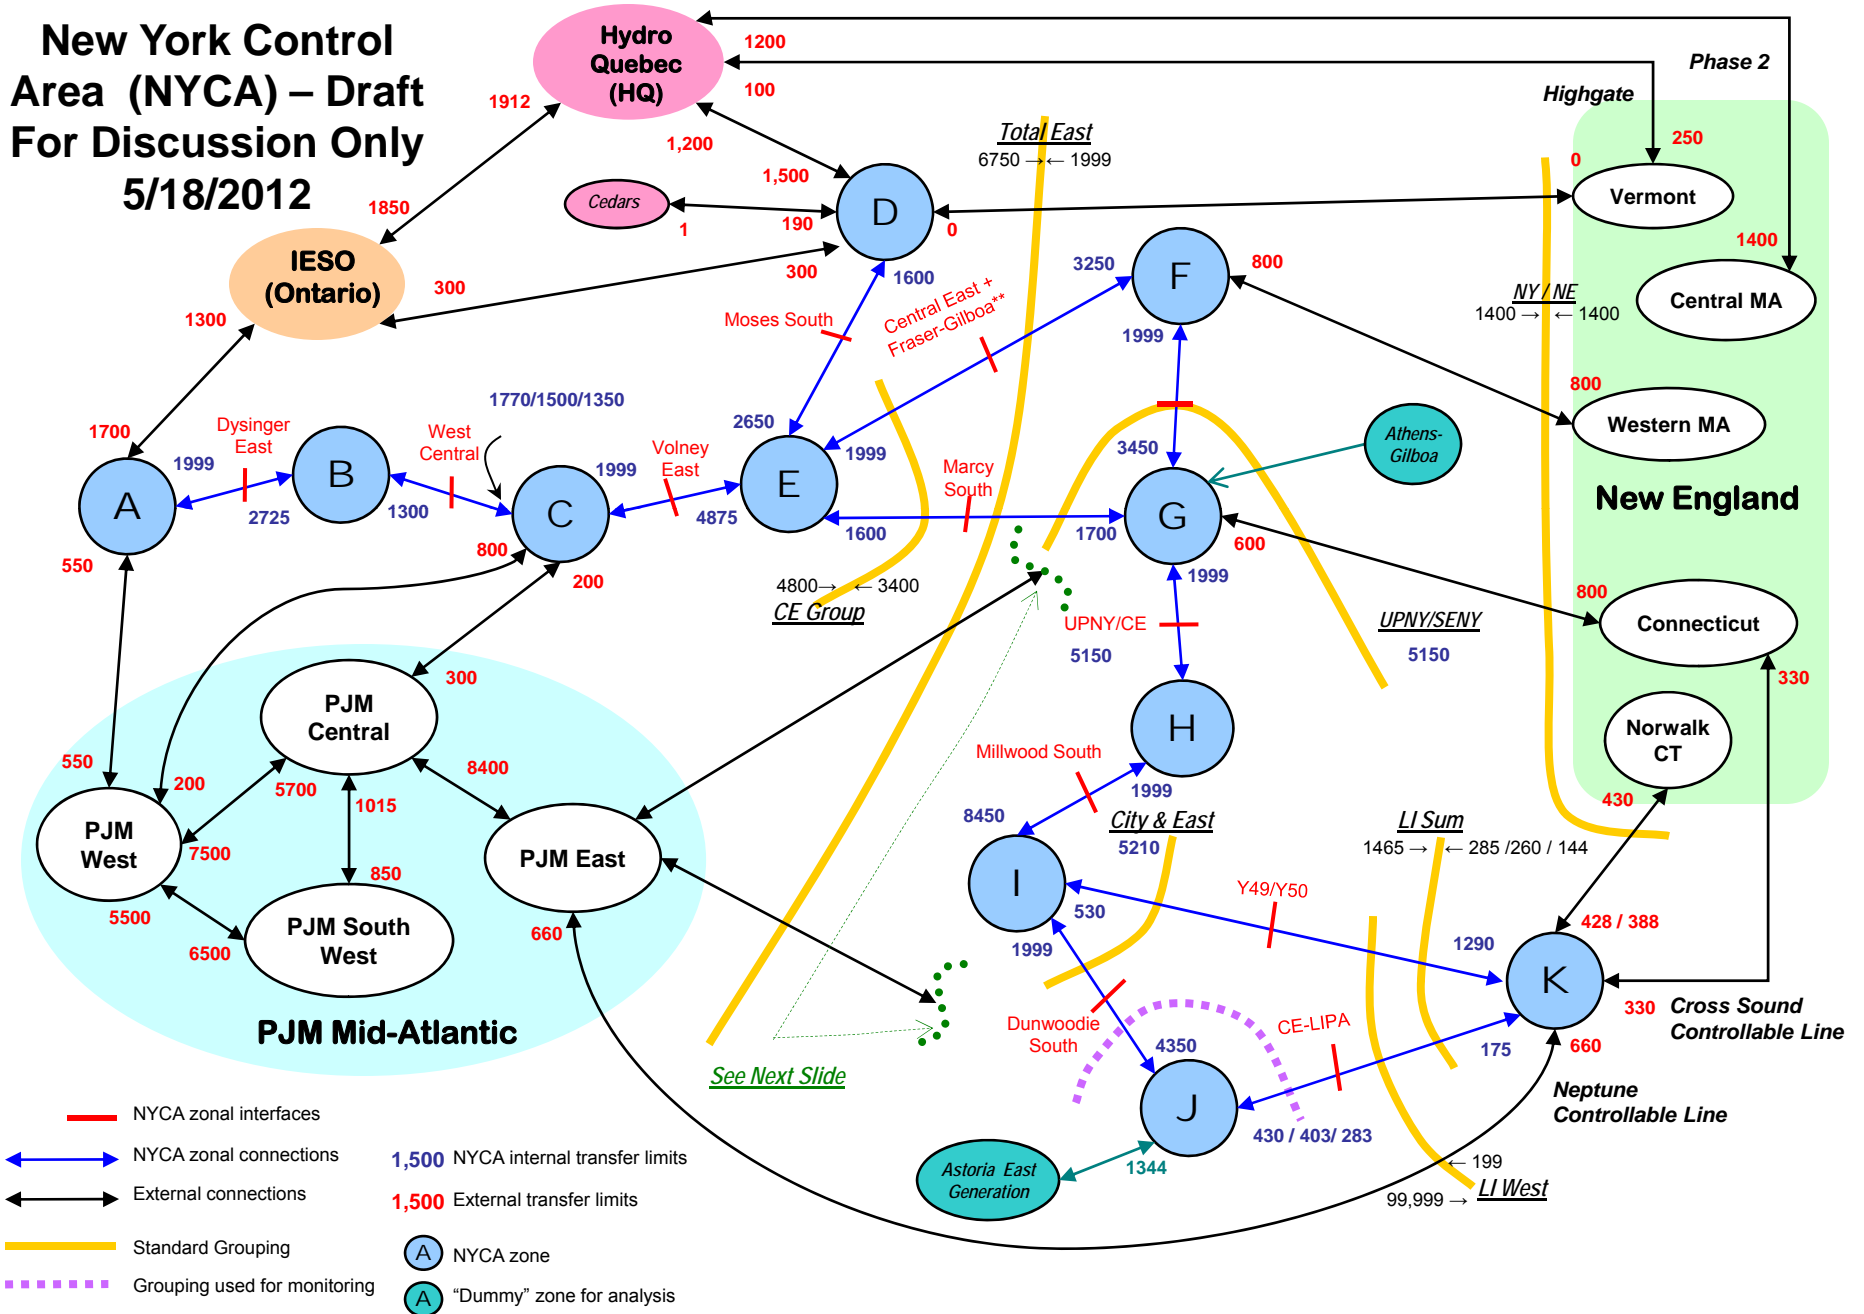

# Transmission System Representation changes for 2013 IRM Study/2012 RNA - Summer Emergency Ratings (MW)

## 2012 PJM-SENY MARS Model

Draft for discussion only – 5/18/2012

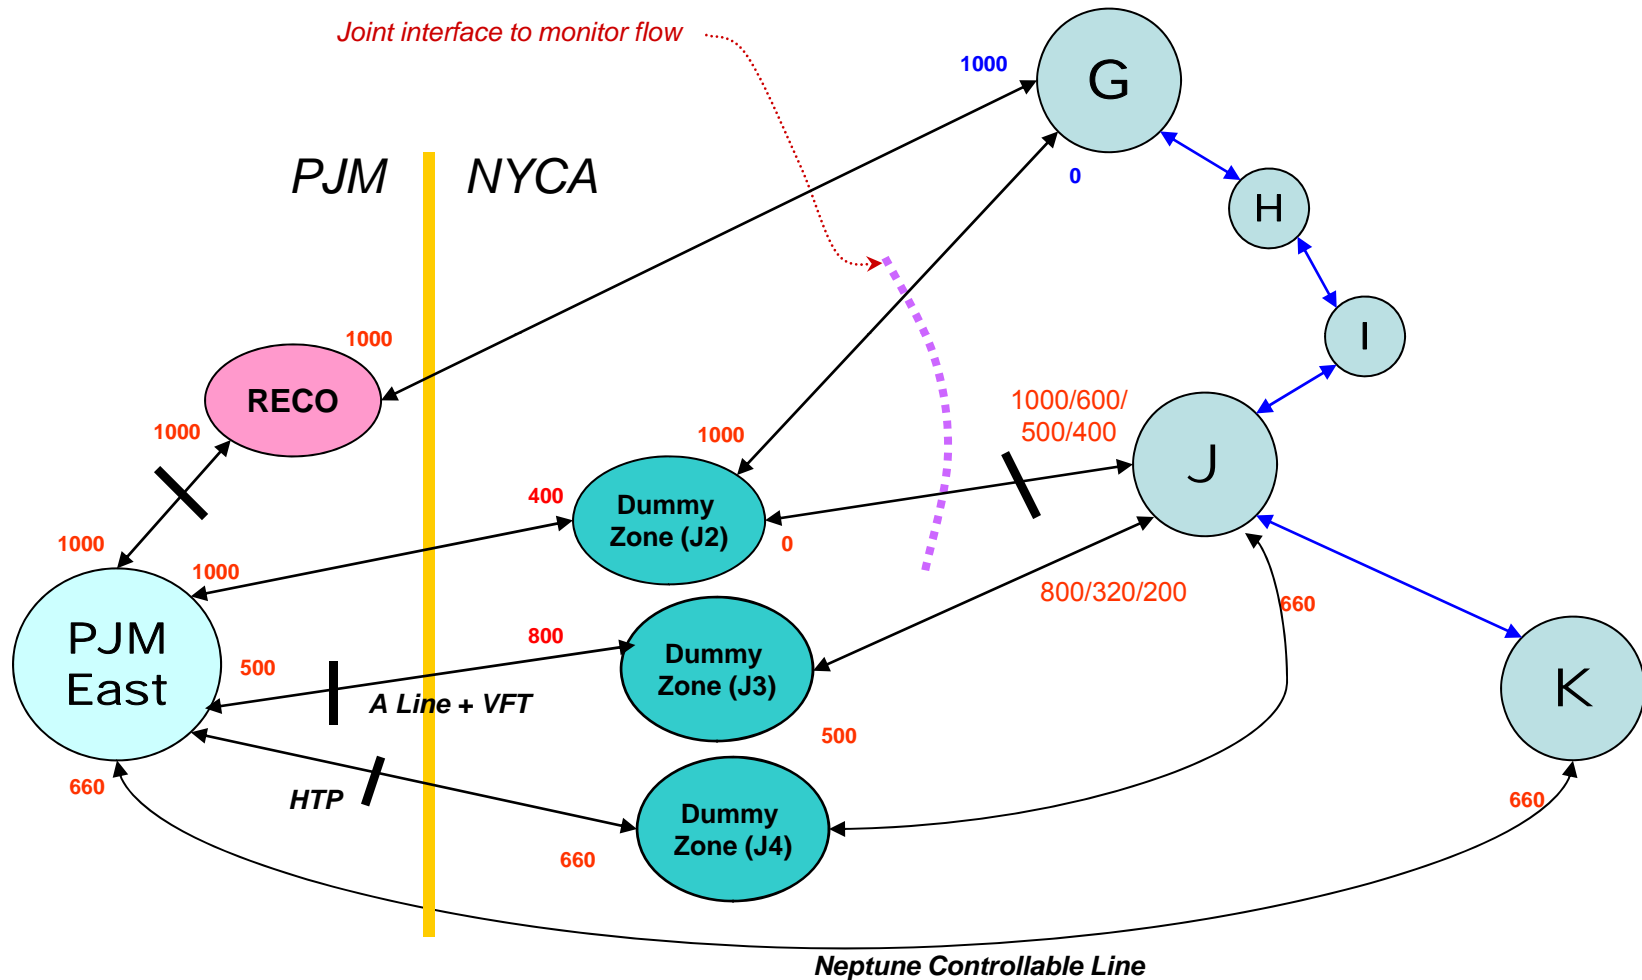

$(PJM\ East\ to\ RECO) + (J2\ to\ J) + (PJM\ East\ to\ J3) + (PJM\ East\ to\ J4) = 2000\ MW$

With the retirement of Hudson 1 and other changes in 2011 PJM RTEP, it was determined that this total interface can be supported to a flow of 2000 MW. This interface grouping contains those interfaces with the Bold hash mark. MARS will distribute this flow accordingly. This will change when additional transmission and generation comes into service in 2014 and 2015 up to 2340.