


Operations Report

June 26 & 27, 2003

Greg Campoli

NYISO Loads

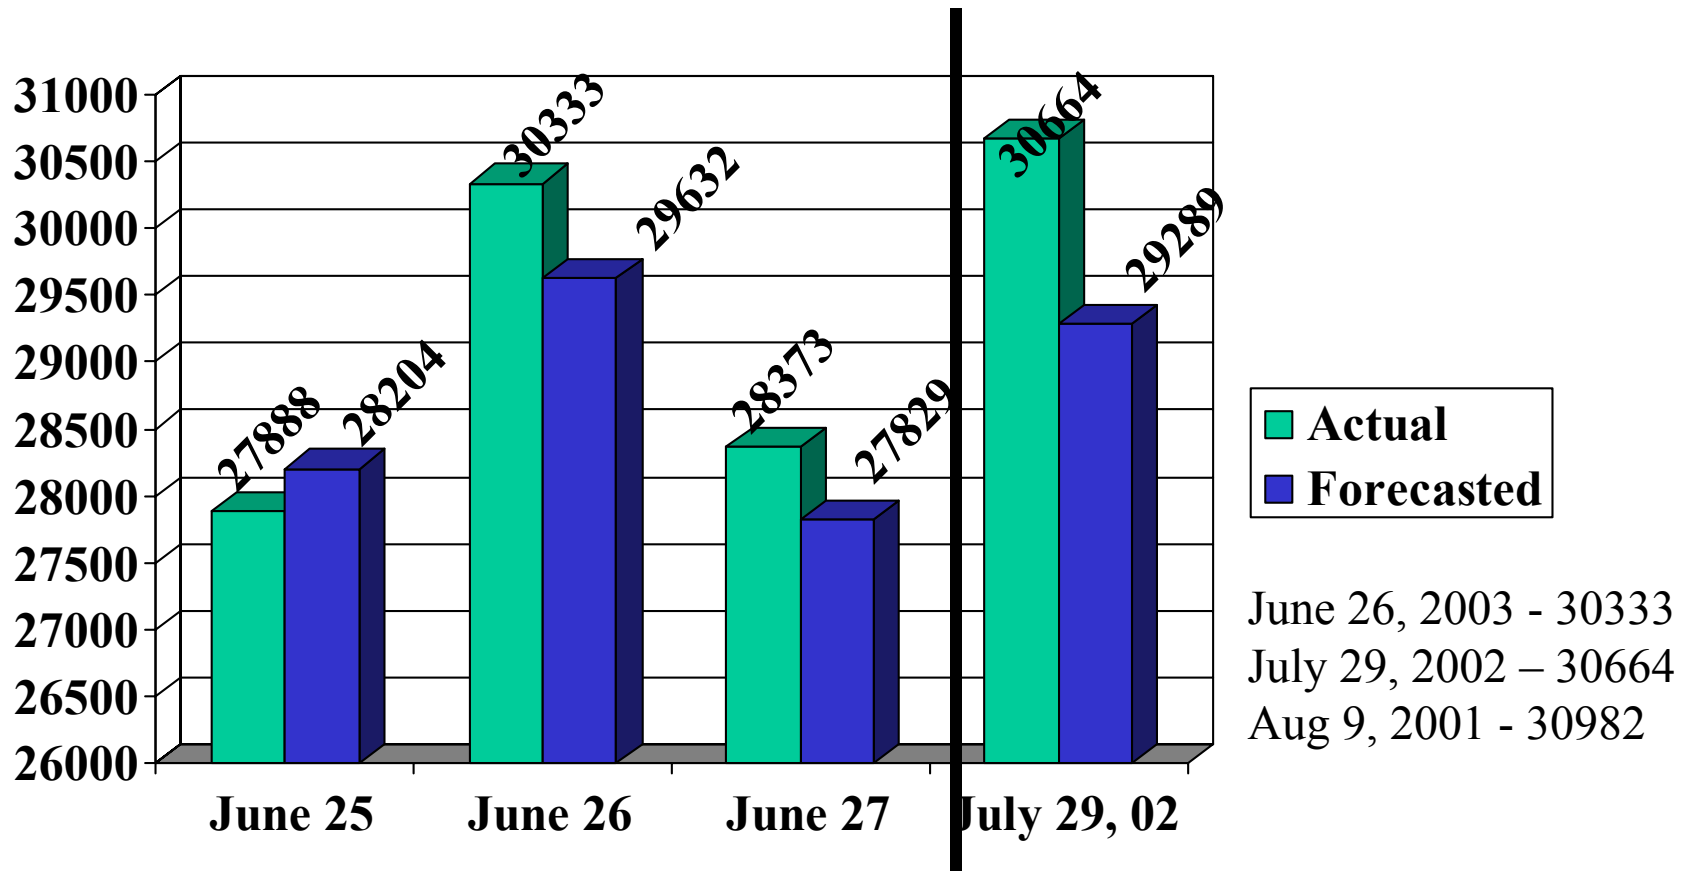

NYISO Operations

June 26

- **2:30 - Voltage Problems at Oakdale**
- **8:30 – 2 x RPU’s**
- **12:00 -Voltage Problems**
- **14:14 - RPU**
- **15:00 - Counting Exports as Reserves**
- **17:00 normal operations**


June 27

- **3:10 – Voltage Problems at Oakdale**
- **7:30 - ME Declared, UPNY Coned TS Limit**
- **9:40 – Alert State for Oakdale Voltage**
- **10:00 – Alert State for Oakdale Voltage**
- **13:00 – Thermal Overloads on Leeds-PV, reduce C/E**
- **13:50 - RPU**


Actions taken for Voltage Problems

	June 26	June 27
Adjust PARS	✓	✓
MAX Vars in the West		✓
Limit Imports/Exports	✓	✓
Use SVC's for Var Support	✓	✓
Reduce Transfers – C/E and UPNY ConEd	✓	✓
Capacitors on System	✓	✓
Request Voltage Support from Neighbors	✓	✓

NYISO Operating Reserve June 26, 2003

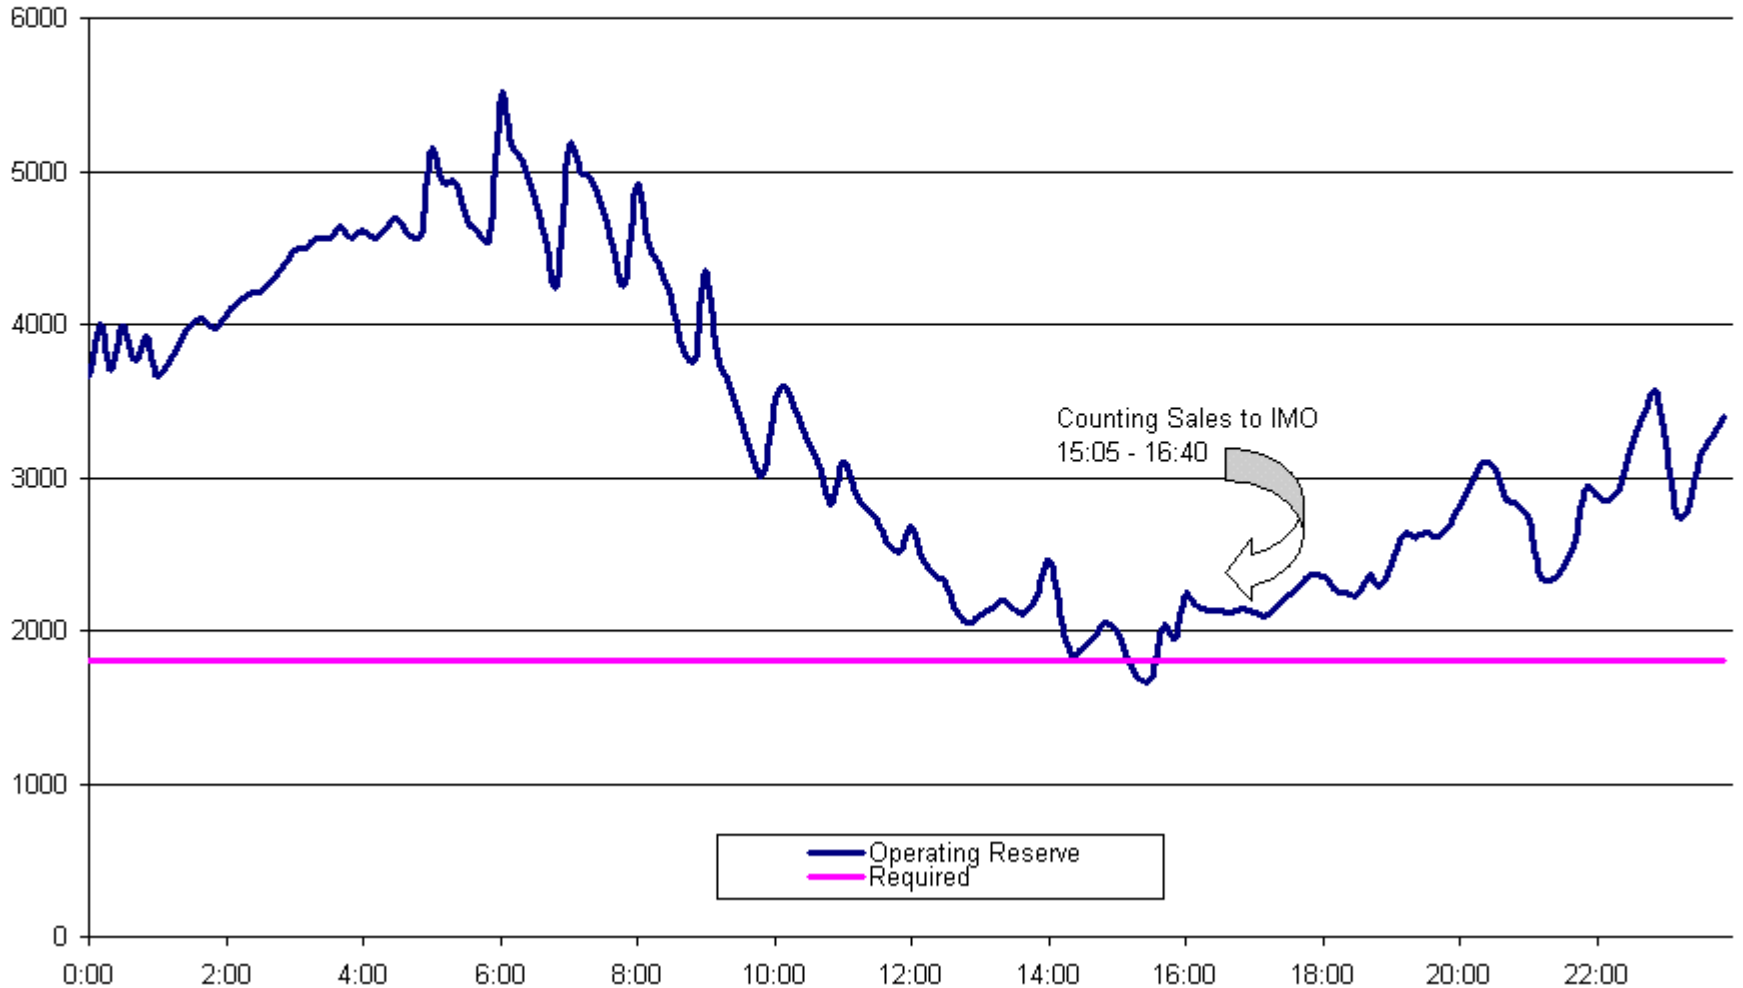


NYISO Interchange

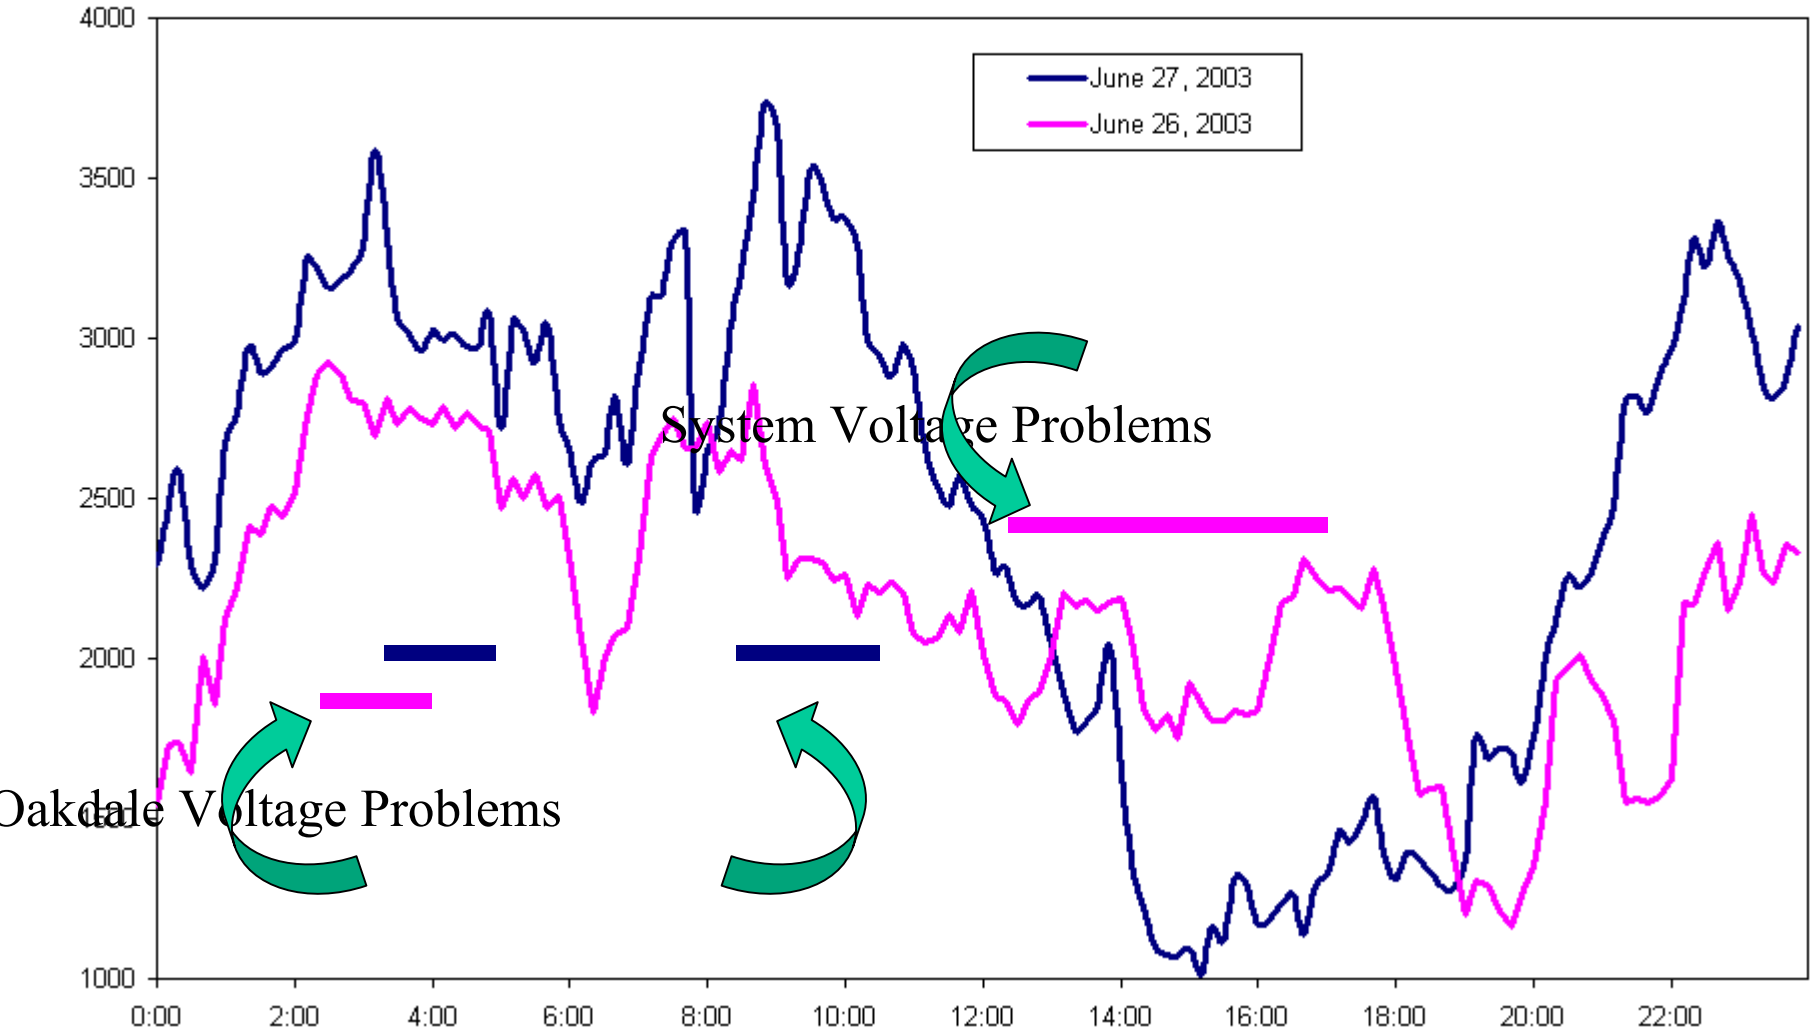

Var Loadings on Transformers

June 26, 2003 / July 29, 2002

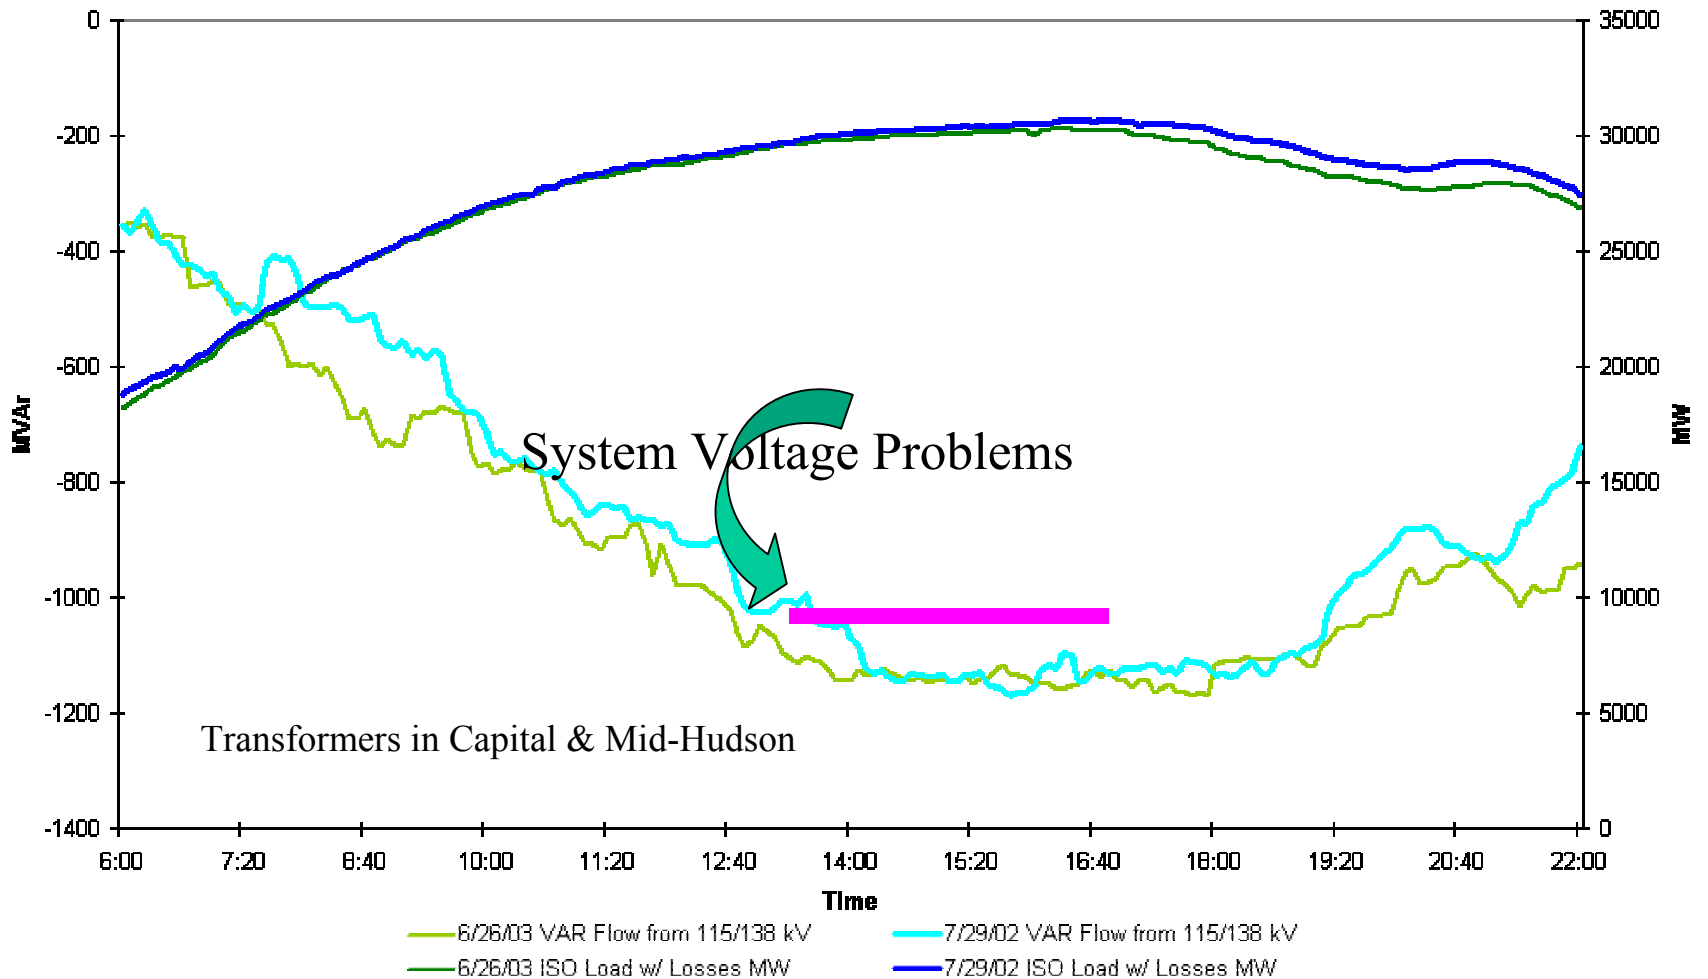

SRE's

June 26

- **1 - 24 SRE for Local Reliability**
- **2 - SRE's to cover over midnight**
- **1 - SRE for Voltage Support in the West**

June 27

- **2 – SRE's to cover over midnight**
- **3 – 24 SRE's for local reliability**