

# Independent Study to Establish Parameters of the ICAP Demand Curve for the New York Independent System Operator



**Draft**  
**July 1, 2010**

## **Project Team**

NERA Economic Consulting

Gene Meehan – Senior Vice President

Jonathan Falk – Vice President

Anthony Schmitz – Associate Analyst

Sargent & Lundy

Christopher Ungate – Senior Principal Management Consultant

David S. Helm - Consultant

Thomas J. Muszalski – Consultant

Matthew B. Thomas - Consultant

John Wroble – Senior Consultant

Richard W. Knoebel – Senior Vice President

NERA Economic Consulting

1255 23rd Street NW

Washington, DC 20037

Tel: +1 202 466 3510

Fax: +1 202 466 3605

### **LEGAL NOTICE**

This report was prepared by NERA Economic Consulting (NERA) and by Sargent & Lundy LLC, hereafter referred to as Sargent & Lundy, expressly for NERA in accordance with Contract No. SA-27605 and in compliance with the New York Independent System Operator Code of Conduct. Neither NERA nor Sargent & Lundy nor any person acting on their behalf (a) makes any warranty, express or implied, with respect to the use of any information or methods disclosed in this report or (b) assumes any liability with respect to the use of any information or methods disclosed in this report.

## Table of Contents

Table of Contents .....	iv
I. Executive Summary .....	6
II. Technology Choice and Construction Cost .....	14
A. Tariff Requirements .....	14
B. Alternate Technologies Examined .....	15
1. 7FA .....	16
2. LM6000 .....	16
3. LMS100 .....	17
4. Trent 60 .....	17
5. Comparison .....	18
C. Technology Choice by Region .....	19
D. Construction Schedule and Costs .....	21
1. Principal Assumptions .....	22
2. Capital Investment Costs .....	25
E. Other Plant Costs .....	27
1. Fixed O&M Costs .....	28
2. Variable O&M Costs .....	31
3. Fuel Costs .....	33
F. Development of Real Levelized Carrying Charges .....	35
1. Income Tax Assumptions .....	35
2. Financing Assumptions .....	36
3. Levelized Cost Results .....	37
III. Estimating Energy Net Operating Revenues .....	40
A. Overview of Approach .....	40
B. Data .....	43
C. Statistical Estimation .....	43
D. Price Estimates .....	45
E. Hypothetical Dispatch .....	46
F. Results .....	47
G. Other Considerations: Lake Erie Loop Flow and Recession/Weather Effects on Load and Other Miscellaneous Potential Adjustments .....	48
1. Overview of Other Considerations .....	48
2. Lake Erie Loop Flow Reversal .....	48
3. Gas Prices .....	49
4. Recession/Cool Weather Adjustments .....	50
5. Summary with Respect to Lake Erie Loop Flow, Gas Price and Recession/Cool Weather Adjustments .....	51
6. New York City Adjustments .....	51
H. Calibration .....	52
IV. Developing the Demand Curves and Calculating Carrying Charges .....	54

A.	Approach Overview .....	54
B.	Financial Parameters .....	55
C.	Model Description .....	63
D.	Model Inputs .....	64
E.	Analysis of Results .....	68
F.	Demand Curve Shape and Slope Recommendations.....	68
V.	Sensitivity Analyses.....	71
VI.	Appendices.....	73

## I. Executive Summary

In 2003, the NYISO implemented an Installed Capacity<sup>1</sup> (ICAP) Demand Curve mechanism. The ICAP Demand Curve is used in the ICAP Spot Market Auction conducted for each month. The ICAP Demand Curves act as offers to buy capacity in the ICAP Spot Market Auctions.

The NYISO updated the Demand Curves in 2004 for the 2005/06, 2006/07 and 2007/08 Capability Years. That update was based upon an independent study conducted by Levitan & Associates, Inc. (LAI), input from the NYISO Market Advisor and input from stakeholders. The NYISO updated the Demand Curves again in 2007 for the 2008/09, 2009/10 and 2010/11 Capability Years. That update was based upon an independent study conducted by NERA Economic Consulting (NERA) assisted by Sargent & Lundy LLC (S&L) and input from the NYISO Market Advisor and input from stakeholders. The Demand Curve process calls for the Demand Curves to be updated every three years. The NYISO again retained NERA assisted by S&L to perform an independent Demand Curve parameter update study applicable to Capability Years 2011/12, 2012/13 and 2013/14.

NERA was responsible for the overall conduct of the study and led the effort with respect to formulating the financial assumptions, estimating energy and ancillary services net revenues and developing the recommended Demand Curves. S&L was primarily responsible for developing construction cost estimates, operating cost data and plant operating characteristics. NERA and S&L collaborated to identify the potential technology choice for each region<sup>2</sup>.

In considering the study, the Services Tariff was the primary guide. In particular, we relied on Section 5.14.1(b) of that Tariff. That section of the Tariff specifies that the update shall be based upon and consider the following:

---

<sup>1</sup> Terms with initial capitalization used but not defined herein have the meaning set forth in the NYISO's Market Administration and Control Area Services Tariff (Services Tariff) or if not defined in the Services Tariff, as defined in the Open Access Transmission Tariff.

<sup>2</sup> The Demand Curve process calls for a Demand Curve for New York City (NYC), Long Island (LI) and the New York Control Area (NYCA). NERA and S&L developed the net cost of new entry for NYC, LI, the Capital Region, the Central Region and the lower Hudson valley (Lower Hudson Valley). For the NYCA the Capital Region has been used. The Lower Hudson Valley estimate is for informational purposes only. ROS is the term used herein to refer to supply in the part of the New York Control Area that does not include the New York City and Long Island Localities and to the NYCA Demand Curve.

- the current localized levelized embedded cost of a peaking unit in each NYCA Locality and the Rest of State to meet minimum capacity requirements;
- the likely projected annual Energy and Ancillary Services revenues of the peaking unit over the period covered by the adjusted ICAP Demand Curves, net of the costs of producing such Energy and Ancillary Services, under conditions in which the available capacity would equal or slightly exceed the minimum Installed Capacity requirement;
- the appropriate shape and slope of the ICAP Demand Curves, and the associated point at which the dollar value of the ICAP Demand Curves should decline to zero; and
- the appropriate translation of the annual net revenue requirement of the peaking unit determined from the factors specified above, into monthly values that take into account seasonal differences in the amount of capacity available in the ICAP Spot Market Auctions.

The Services Tariff further specifies that:

“a peaking unit is defined as the unit with technology that results in the lowest fixed costs and highest variable costs among all other units’ technology that are economically viable.”

It is clear that the Services Tariff requires the update to identify the peaking unit with the lowest fixed costs and highest variable costs that is economically viable. This unit will not necessarily be the lowest “net-cost”<sup>3</sup> unit under current conditions. It is possible that a more expensive capital cost unit with a lower variable or operating cost would have a lower net cost. For example, a combined cycle unit may have a lower net cost as a result of higher energy net revenues. The Tariff, however, does not call for the lowest net-cost unit. Rather, it requires that the update be based upon the net-cost of the lowest capital cost and highest operating cost unit that is economically viable.

As part of this study, we assumed that only a unit that could be practically constructed in a particular location would qualify. We further assumed the Tariff to apply to reasonably large scale generating facilities that are standard and replicable, which excludes dispersed generators and Special Case Resources. Through the stakeholder process, the prevalent understanding was that in

---

<sup>3</sup> Net-cost refers to the difference between the annual fixed cost and annual energy and ancillary service net revenues.

the next reset, NYISO would consider whether Special Case Resources should be considered as the possible peaking unit.

This study examines three types of units, which between them represent two technology options. The first technology options are frame units, specifically the Frame 7FA. These are large scale combustion turbines with low capital costs and high operating costs. They are relatively inflexible with respect to starts and stops. The second are aeroderivatives – the Rolls Royce Trent, GE LM6000 and GE LMS100. These units are more flexible combustion turbines, but have higher per kilowatt capital costs than frame units and have lower operating costs.

A review of these units showed the following:

1. The Frame 7FA has lower capital and higher operating costs than the LMS100. The LMS100 has lower capital and lower operating costs than the Trent or LM6000.
2. The Frame 7FA would not practically be constructed as a peaking unit in the Lower Hudson Valley, NYC or LI. This is the case because in those particular locations a selective catalytic reduction (SCR) would be required to avoid severe operating restrictions and when operated in simple cycle mode; the Frame 7FA exhaust temperature is too hot for an SCR. Hence, a Frame 7 is not a practical choice in the Lower Hudson Valley, NYC and LI regions. The LMS100 has become a more mature technology with numerous North American and worldwide installations.

Based on the above, the Frame 7FA was selected as the peaking unit for the ROS area and the LMS100 was selected as the peaking unit for NYC and LI. A comparison of results for the first year of the current update to the Demand Curve to the last year of the previous update period is presented below.



**Table I-1**

Demand Curve Values at Reference Point:						
Values for Capacity Years 2011/2012						
	<i>2007 DC Value for 2010/2011 2010 dollars/kW-year</i>			<i>2010 Update for 2011/2012 2011 dollars/kW-year</i>		
	Annual Fixed Cost	Energy and AS Net Revenues	Net Costs	Annual Fixed Cost	Energy and AS Net Revenues	Net Costs
ROS Frame 7	107.33	10.87	<b>96.46</b>	120.05	30.17	<b>89.88</b>
ROS Frame 7 (w/ Deliverability)				146.67	30.17	<b>116.50</b>
NYC LMS100	218.55	75.41	<b>143.15</b>	269.80	125.48	<b>144.32</b>
NYC LMS100 (w/o Abatement)				345.25	125.48	<b>219.77</b>
LI LMS100	194.05	104.56	<b>89.47</b>	277.91	199.64	<b>78.27</b>

We present the values above in 2010 dollars for the current curve and 2011 dollars for the updated curve as the curves are stated on that basis. As can be seen above, all else equal, the Demand Curves have declined in real terms, but are reasonably stable absent changes for deliverability and in NYC for tax abatement. This result is attributable to a combination of factors including:

1. an increase in construction and equipment costs somewhat beyond that assumed in the prior reset;
2. more than offsetting increases in energy and ancillary services net revenues resulting from market experience over the past three years.

Note that the table above provides options with respect to inter zonal deliverability and the NYC property tax abatement. In particular we have been requested by NYISO to provide updated Demand Curves with and without inter zonal deliverability and with and without NYC property tax abatement.

The Demand Curves were developed explicitly analyzing risks. Risks that could reasonably be considered to be symmetrical have no impact on expected value and were not considered in the risk analysis. Risks that were not symmetrical were analyzed in a Monte Carlo risk analysis model described later in the report and made available to stakeholders in executable form.


The model recognizes that the NYISO has in place planning and response procedures to prevent capacity from falling short. Hence, over time, there should be a bias toward surplus capacity conditions. If there is expected to be surplus capacity, the Demand Curve should be adjusted to reflect the fact that over time the expected clearing price would be below the target reserve point. Absent such an adjustment, the Demand Curve would not produce adequate expected revenues to recover cost and would not induce the proper level of investment. The model we have developed to set the Demand Curve accounts for these factors.

When using the risk model, the slope of the Demand Curve has a measurable influence on the levelization and the Demand Curve reference point. With a bias toward excess capacity, a steep slope requires a higher reference point if there is to be an expectation of full cost recovery. In surplus capacity periods, the Demand Curve will clear below the reference price, and if there is a steep slope, revenues will decline more rapidly than if there is flatter slope. To provide the same expected revenue over the life of the investment, a higher reference point must accompany a steeper slope. For example, if the NYC x-intercept was applied to the NYCA Demand Curve, the reference value would fall by \$5.05 per kW-year.


The recommended Demand Curves are presented below. For each region the chart shows the current Demand Curve and the 2011/12 recommendation for the Demand Curve. With and without tax abatement curves are shown for NYC and with and without inter zonal deliverability curves are shown for ROS.

NERA examined the issue of the Demand Curve slope, which is a function of the zero crossing point and shape. The current curves have a single linear slope from the reference value at the target reserve level to zero at 112% of the minimum requirement for ROS and 118% of the minimum requirement for NYC and LI. As will be addressed in more detail later, we recommend retaining the current shape and slope. The current outlook for the at least the next five years is for significant capacity surpluses. If the shape and slope were altered at a time when the effect was clearly a


reduction in capacity compensation, we believe this would be viewed as opportunistic, would significantly increase the risk perceived by entrants and significantly raise the levelized costs of entry. However, quantification of these effects is difficult and uncertain and while any revision to the shape and slope would need to account for these effects, such accounting would be largely guesswork at this time. To the extent that a change in the shape and or slope is desirable, and we see no case that it is, such a change is best made when there is not a chronic surplus and when the impact of the change is more likely to be neutral.

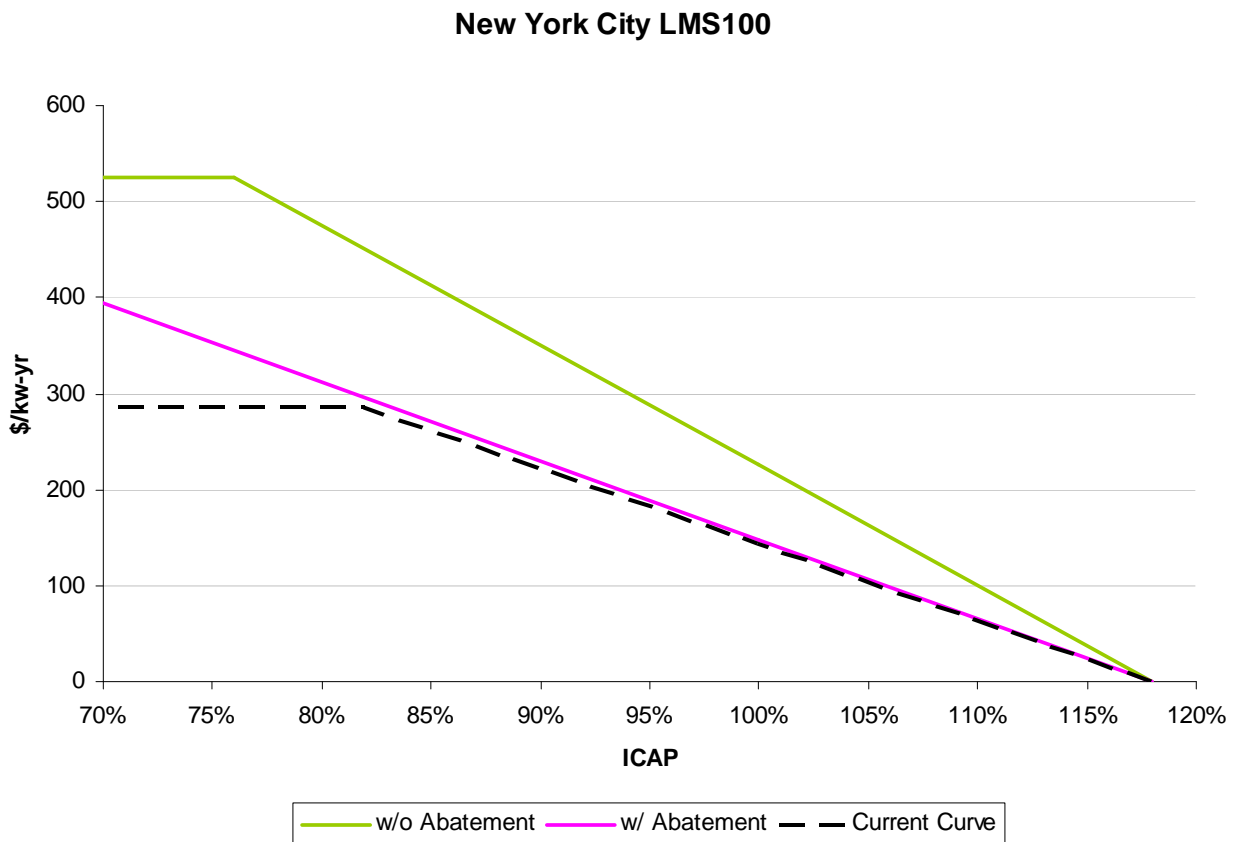

### Rest of State (Capital) Frame 7

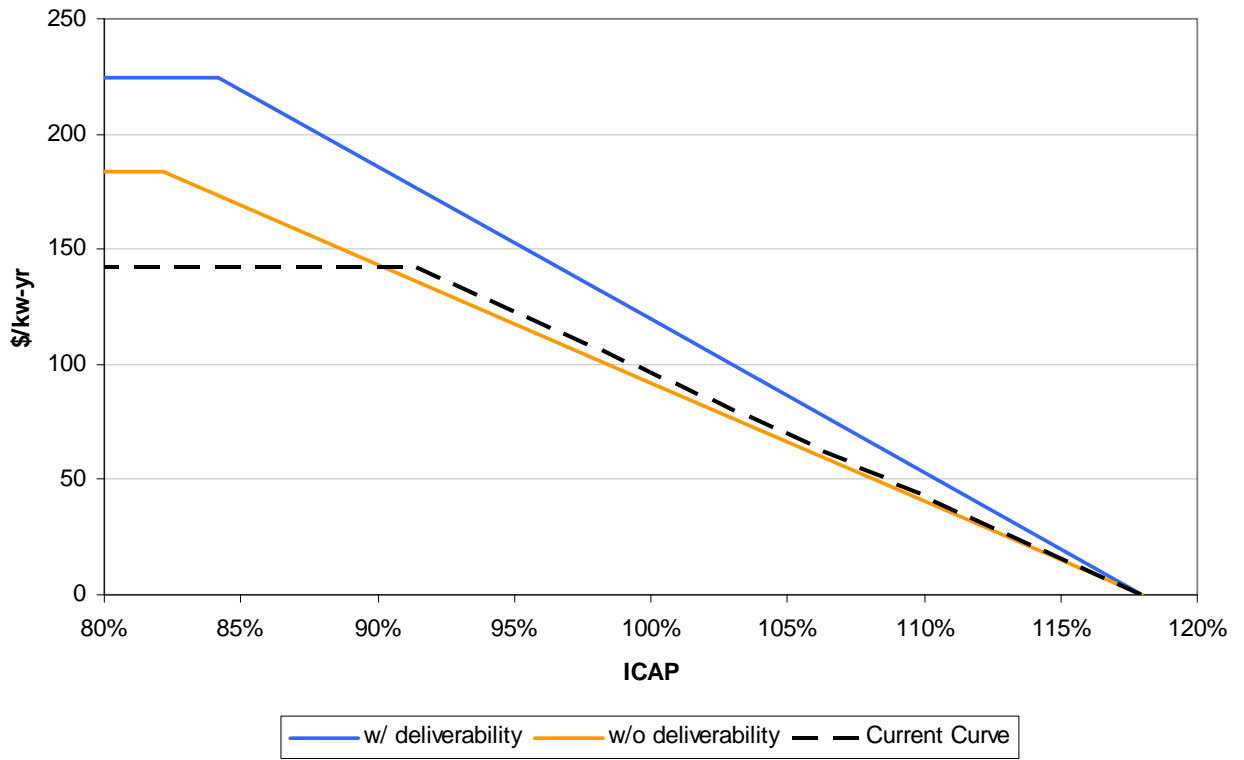

### Long Island LMS100

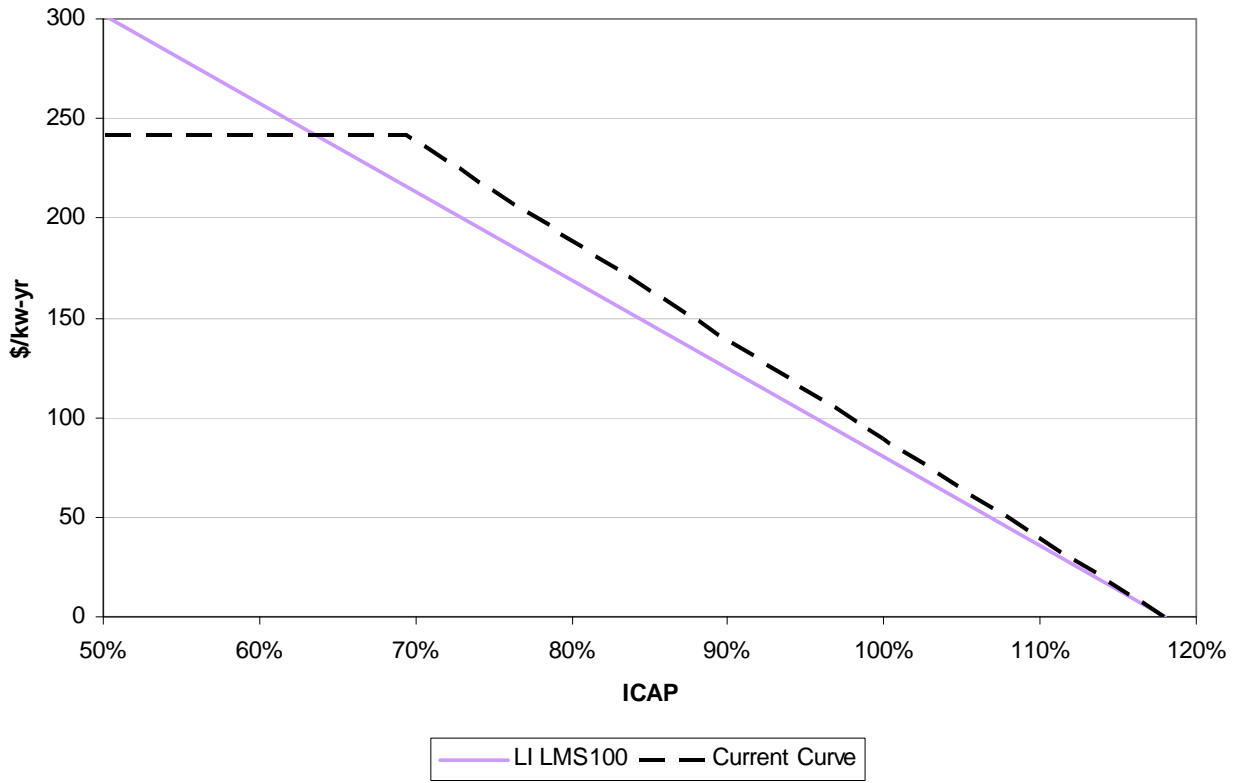

## **II. Technology Choice and Construction Cost**

The ICAP Demand Curve is derived from the levelized cost of a hypothetical new peaking unit at various locations throughout the State of New York. The reference peaking facility is a gas-fired combustion turbine operating in simple-cycle mode. A range of combustion turbine options, based upon recent peaking applications and design requirements, were evaluated at each location. The levelized cost analysis described in this section accounts for the location-specific factors affecting the total capital investment, the cost inputs and economic parameter inputs for the levelized cost analysis, and the annual operating cost and performance characteristics for each technology.

Levelized costs generally refer to the capital-related carrying charges, operation and maintenance (O&M), and fuel costs incurred over the plant operating life. For the ICAP Demand Curve analysis, costs are divided into variable costs (those that vary with operation) and non-variable (fixed) costs. The Demand Curve analysis uses the fixed cost components, consisting of the capital-related carrying charges, property taxes, insurance, and fixed O&M. Variable costs, consisting of fuel and variable O&M, are used to develop net energy and ancillary service revenues in NERA's econometric model of NYISO market prices. Once the levelized annual fixed costs for the unit are established, they indicate a reference point in the Demand Curve at which the net revenues from the energy and ancillary service markets offset the fixed costs. Input assumptions for the cost components are described in the following subsections.

### **A. Tariff Requirements**

The Services Tariff states that the periodic review of the ICAP Demand Curves shall assess “the current localized levelized cost of a peaking unit in each NYCA Locality and the Rest of State to meet minimum capacity requirements.” The Services Tariff defines a peaking unit as “the unit with technology that results in the lowest fixed costs and the highest variable costs among all other units' technology that are economically viable.”

It is clear from the Tariff language that the requirement is to identify the lowest fixed cost, highest variable cost peaking unit that is economically viable. This unit will not necessarily be the lowest “net-cost” unit under current conditions. It is possible that a more expensive capital cost unit with a

lower variable or operating cost would have a lower net cost. For example, a combined-cycle unit may have a lower net cost as a result of higher energy net revenues.

The Tariff, however, does not call for the lowest net-cost unit. Rather, it requires that the update be based upon the net-cost of the lowest capital cost and highest operating cost unit that is economically viable. For the purposes of this study, we assumed that only a unit that realistically could be constructed in a locality would qualify. We also assumed the Services Tariff to apply to reasonably large scale generating facilities that are standard and replaceable. This excludes dispersed generators and Special Case Resources.

## **B. Alternate Technologies Examined**

In conducting the study, one heavy-duty frame unit, the 7FA, and three aeroderivative peaking units, the LM6000, LMS100, and the Trent 60, were examined.<sup>4</sup>

Heavy-duty frame units such as the 7FA are large-scale combustion turbines oriented to industrial applications with lower capital costs (on a \$/kW basis) and higher operating costs (on a \$/MWh basis). Maintenance costs are affected by the duty cycle experienced in operations. As a unit is subjected to more starts and stops, the time between major overhauls decreases. Nitrogen oxide (NO<sub>x</sub>) emissions are reduced by equipping the units with dry low NO<sub>x</sub> (DLN) combustors. The use of selective catalytic reduction (SCR) technology for NO<sub>x</sub> control is problematic because exhaust gas temperatures in simple-cycle mode exceed 850°F, above which the catalyst is damaged irreversibly. It is technically feasible to design and install a system of ductwork, and air dampers to lower the exhaust temperature of an “F” class turbine by mixing it with ambient air before introducing the exhaust air to an SCR sized to handle the larger gas flow rate. There are very few examples of SCRs installed on “F” class turbines in simple cycle, and few if any of these have been

---

<sup>4</sup> Three of the four peaking technologies examined in this study are manufactured by GE Energy. The selection of the units for the study was based on the units that were studied in the last Demand Curve review, technologies currently being developed for participation in the NYISO markets, and the comments and suggestions of ICAP Working Group members during the conduct of the study. Based on data from Platts, approximately 56% of combustion turbine capacity in the United States and 56% of combustion turbine capacity in the NYCA was manufactured by GE. There are several competing manufacturers and models for “F” frame machines and aeroderivatives. The units chosen for the study have representative cost and performance characteristics of similar products from other manufacturers. The choice of frame and aeroderivative units in this study does not constitute a recommendation by Sargent & Lundy to choose any specific manufacturer or model for projects.

operating successfully.<sup>5</sup> The efficiency of frame units can be improved by configuring units in a combined-cycle mode, where the exhaust of one or more units is directed to a heat recovery steam generator, which drives another steam turbine. This configuration was not evaluated in the study.

Aeroderivative units such as the LM6000, LMS100 and Trent 60 are derived from aircraft engines and have operating characteristics that better match the needs of aircraft owners. Aeroderivatives are more efficient (lower heat rate) and are maintained based on hours of operations regardless of the number of starts and stops, but have higher capital costs (on a \$/kW basis). NO<sub>x</sub> emissions can be reduced by injecting water into the combustion zone; however, aeroderivative exhaust temperatures are low enough to permit use of SCR for NO<sub>x</sub> control. Dry low NO<sub>x</sub> combustion is available on aeroderivative units to reduce the amount of water used in the NO<sub>x</sub> emissions control process. However, the models examined fitted with dry low NO<sub>x</sub> combustion do not support dual fuel operation.

### **1. 7FA**

General Electric's installed fleet of more than 950 "F" technology combustion turbines has reached 27 million hours of commercial operation in power plants worldwide. The F technology combustion turbines were introduced in 1988. The 7FA.05 combustion turbine, with a nominal rating of 200 MW, is capable of operating on 100% natural gas or 100% diesel fuel. DLN combustors reduce NO<sub>x</sub> emissions. Water injection is used for NO<sub>x</sub> control in the combustion process when firing fuel oil. The wide range of power generation applications for the 7FA gas turbine include combined cycle, cogeneration, simple-cycle peaking and integrated gasification combined cycle (IGCC) in both cyclic and baseload operation with a wide range of fuels. The reliability of the 7FA gas turbine has been consistently 98% or better.

### **2. LM6000**

Since the introduction of the LM6000 into GE's aeroderivative combustion turbine product line, GE has produced more than 600 units with an operating history of 10 million hours. Engine reliability is 98% or better. Units are typically fired on natural gas, but can be fired with fuel oil for backup. The LM6000 is a dual-rotor, "direct drive" combustion turbine, which was derived from GE's CF6-80C2, high-bypass, turbofan aircraft engine. For this study, the LM6000 was configured with

---

<sup>5</sup> Permit to Construct Application, Bridgeport Peaking Station, Bridgeport, CT, prepared for Bridgeport Energy II, LLC, by Earth Tech, Inc., June 2007, pages 4-6 to 4-7.



SPRINT™ (Spray Inter-cooled Turbine) technology to significantly enhance power. Both the PG model, which reduces NO<sub>x</sub> emissions levels by using water injection, and the PH model, which uses dry low NO<sub>x</sub> combustion, were examined in this study.

### **3. LMS100**

The LMS100 is a General Electric aeroderivative combustion turbine that combines the technology of heavy-duty frame engines and aeroderivative turbines to provide cycling capability without the maintenance impact experienced by frame machines; higher simple-cycle efficiency than current aeroderivative machines; fast starts (10 minutes); and high availability and reliability. The LMS100™ system, developed by General Electric in 2004, combines the 6FA compressor technology with CF6®/LM6000™ technology. The airflow from the low pressure compressor enters an intercooler, which reduces the temperature of the airflow before it enters the high-pressure compressor (HPC). Consequently, the HPC discharges into the combustor at ~250°F (140°C) lower than the LM6000™ aeroderivative gas turbine. The combination of lower inlet temperature and less work per unit of mass flow results in a higher pressure ratio and lower discharge temperature, providing significant margin for existing material limits and higher efficiency. The HPC airfoils and casing have been strengthened for this high-pressure condition.

Since the first unit was commissioned in 2006, there are now over 20 LMS100s installed with 35,000+ cumulative hours as of end of 2009. Both wet low NO<sub>x</sub> combustion (the PA model) and dry low NO<sub>x</sub> combustion (the PB model) are available. All of the currently installed LMS100s are the PA model. For this study, only the PA model was examined.

### **4. Trent 60**

The Trent 60 gas turbine, manufactured by Rolls Royce, has a high degree of commonality with its aero parent, the Trent 800, which uses three-shaft technology and has over 14 million hours in aircraft service. The Trent 60 engine retains the core of the aero engine - the IP and HP compressors and turbines. The industrial design first entered service in 1998 for base load and peaking power production.

The Trent 60 was initially launched with a dry low emissions (DLE) combustor system. A water injection (WLE) option was developed in 2005 for dual fuel operation. The first Trent 60 in the U.S. began operation in late 2008 in Lowell, MA. The number of Trent 60s sold or reserved by operators now totals 78 in 19 countries, for both power generation and oil and gas installations, with 31 engines in service in 11 countries.

## 5. Comparison

The key characteristics of the four technologies evaluated for this study are shown below. The direct costs are the costs typically within the scope of engineer, procure, and construct (EPC) contracts, and do not include owner's costs, financing costs, or working capital and inventories.

**Table II-1 Key Characteristics of Evaluated Technologies<sup>6</sup>**

Technology	Frame	Aeroderivative			Trent 60
	7FA.05	LM6000 PG Sprint	LM6000 PH Sprint	LMS100 PA	
Zones	C, F	J	C, F, G, K	C, F, G, J, K	G, J, K
Capacity of a 2-Unit Addition	413	104	96	195	117
Total Cost (\$M)	308-310	200	137-188	235-324	174-205
Total Cost (\$/kW)	818-820	2099	1592-2168	1294-1797	1637-1920
Heat Rate (Btu/kWh HHV)	10,206	10,102	9,475	9,023	9,548
Pressure Ratio	17.8:1	30:1	32.1:1	43.3:1	,37.9:1
Exhaust Temperature (°F)	1109	885	885	769	378
Water Use (gpm)	30	50	50	60	75

The direct cost (\$/kW) and heat rate data show that the LMS100 had lower capital and operating cost than other aeroderivative technologies. The 7FA has lower capital and higher fuel and operating costs than the LMS100. Appendix 1 shows more detailed information on the cost and


<sup>6</sup> Based on 90% Load, ISO Conditions (59F, 60% RH, 14.7 psia), Evaporative cooling, 0.85 Power Factor

performance characteristics of the LMS100, LM6000, Trent 60, and 7FA technologies. The following section addresses the impact of emissions limitations on technology choice.

**C. Technology Choice by Region**

All four technologies are considered to be a major source subject to Title V regulations (operating permits) and because they are subject to Title IV Acid Rain (applies to each generator that is greater than 25 MW in capacity). The chart below shows the status of ozone nonattainment areas in New York State<sup>7</sup>. The amount of emissions that triggers meeting the Lowest Achievable Emissions Rates (LAER) is 25 tons per year (NO<sub>x</sub>) in New York City, Long Island and two counties of the Lower Hudson Valley (Westchester County and lower Rockland County). The threshold is 100 tons per year in other locations. SO<sub>2</sub> emissions are not significant from turbines using natural gas, and there no longer are carbon monoxide attainment issues in New York.

**Figure II-1 — Ozone Non-attainment Areas in New York State**

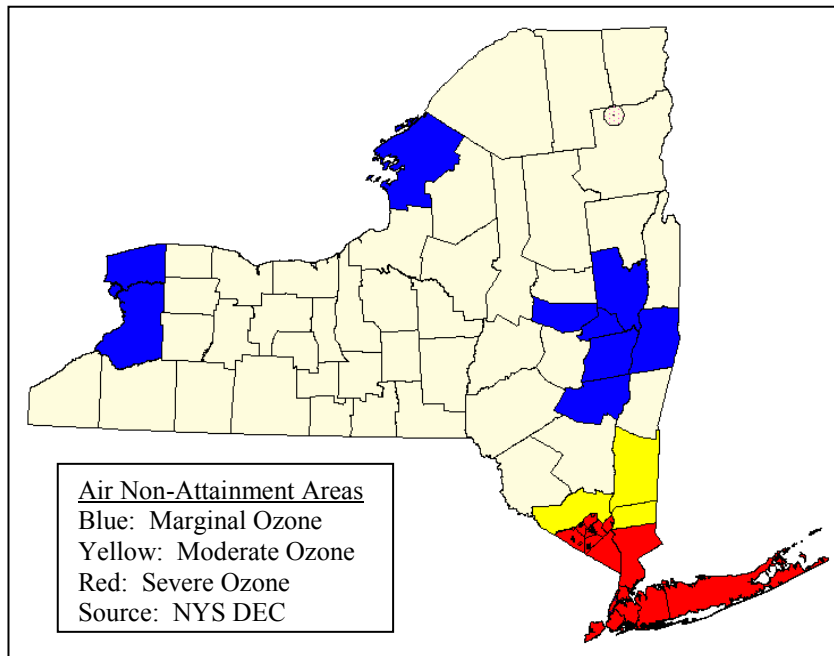

The table below shows estimates of the maximum annual hours of operation for the each of the technologies by zone configured to meet emissions requirements. Use of an SCR on a simple-cycle

<sup>7</sup> Personal communication, NYS DEC, February 5, 2007.

7FA is not economically or technically practical.<sup>8</sup> Current, proven, SCR catalyst has a maximum operating temperature of approximately 850°F.<sup>9 10</sup> 7FA gas temperatures are in excess of 1100°F (see Table II-1). To reduce the temperature entering the SCR to 850°F, approximately 1,000,000 lb/hr of dilution air (at 59°F) would be required. The total flow entering the SCR would result in approximately 30% increased size of the SCR. Costs would increase due to the larger SCR, dilution fan, dilution ductwork and dampers, and associated controls. The dilution air fan would be about a 2 MW addition to the auxiliary power load. This additional auxiliary power, in addition to reducing unit output, increases the net heat rate by around 150 Btu/kWh.

**Table II-2 — Estimated Maximum Annual Hours of Operation for LM6000, LMS100, Trent 60, and 7FA**

		LM6000	LMS100	RR Trent	7FA SC	7FA CC
Syracuse Zone C	SCR	no	no		no	
	Oxidation Catalyst	no	no		no	
	Maximum Hours (hrs)	2,477	3,072		3,669	
	Maximum CF (%)	28%	35%		42%	
Albany Zone F	SCR	no	no		no	yes
	Oxidation Catalyst	no	no		no	yes
	Maximum Hours (hrs)	2,464	3,075		3,653	5,018
	Maximum CF (%)	28%	35%		42%	57%
Hudson Valley Zone G	SCR	yes	yes	yes		
	Oxidation Catalyst	yes	no	no		
	Maximum Hours (hrs)	4,304	1,546 <sup>1</sup>	2,390 <sup>1</sup>		
	Maximum CF (%)	49%	18%	27%		
New York City Zone J	SCR	yes	yes	yes		yes
	Oxidation Catalyst	yes	no	no		yes
	Maximum Hours (hrs)	4,278	1,532 <sup>1</sup>	2,390 <sup>1</sup>		5,017
	Maximum CF (%)	49%	17%	27%		57%
Long Island Zone K	SCR	yes	yes	yes		
	Oxidation Catalyst	yes	no	no		
	Maximum Hours (hrs)	4,275	1,528 <sup>1</sup>	2,390 <sup>1</sup>		
	Maximum CF (%)	49%	17%	27%		

1. Cost of ERCs added to increase CF to 40%

A 7FA without an SCR sited downstate would be severely restricted in operating hours, but could be operated upstate with a capacity factor as high as 42%. Operation of a simple cycle 7FA as a peaker with a 25 Ton Limit on NO<sub>x</sub> emissions would result in very low allowed hours of operation.

<sup>8</sup> Refer to Footnote 5 on page 16.

<sup>9</sup> US. Environmental Protection Agency, Air Pollution Control Technology Fact Sheet, EPA-452/F-03-032

<sup>10</sup> GE Power Generation, "Gas Turbine NO<sub>x</sub> Emissions Approaching Zero—Is it Worth the Price?" GER4172, September 1999.


Hence, we considered it impractical to construct a 7FA as a peaker in the Lower Hudson Valley, New York City, and Long Island.

An LMS100 or LM6000 can be operated without an SCR upstate with a capacity factor as high as 28% and 35%, respectively. In the Lower Hudson Valley, New York City, and Long Island, the LM6000, LMS100 or the Trent 60 can be operated as peaking units with appropriate controls. All technologies require an SCR. The LM6000 is configured with an Oxidation Catalyst (OC) to reduce carbon monoxide (CO) emissions. Emissions Reductions Credits (ERCs) were included in the costs of the LMS100 and Trent 60 to increase operating hours to the level of a 40% capacity factor.

#### **D. Construction Schedule and Costs**

Cost estimates were prepared for the construction of a new greenfield two-unit simple-cycle combustion turbine peaking plant at each of five New York load zones: C, F, G, J, and K. Figure II-2 shows the location of these zones.

Figure II-2 — Map of New York Control Area Load Zones

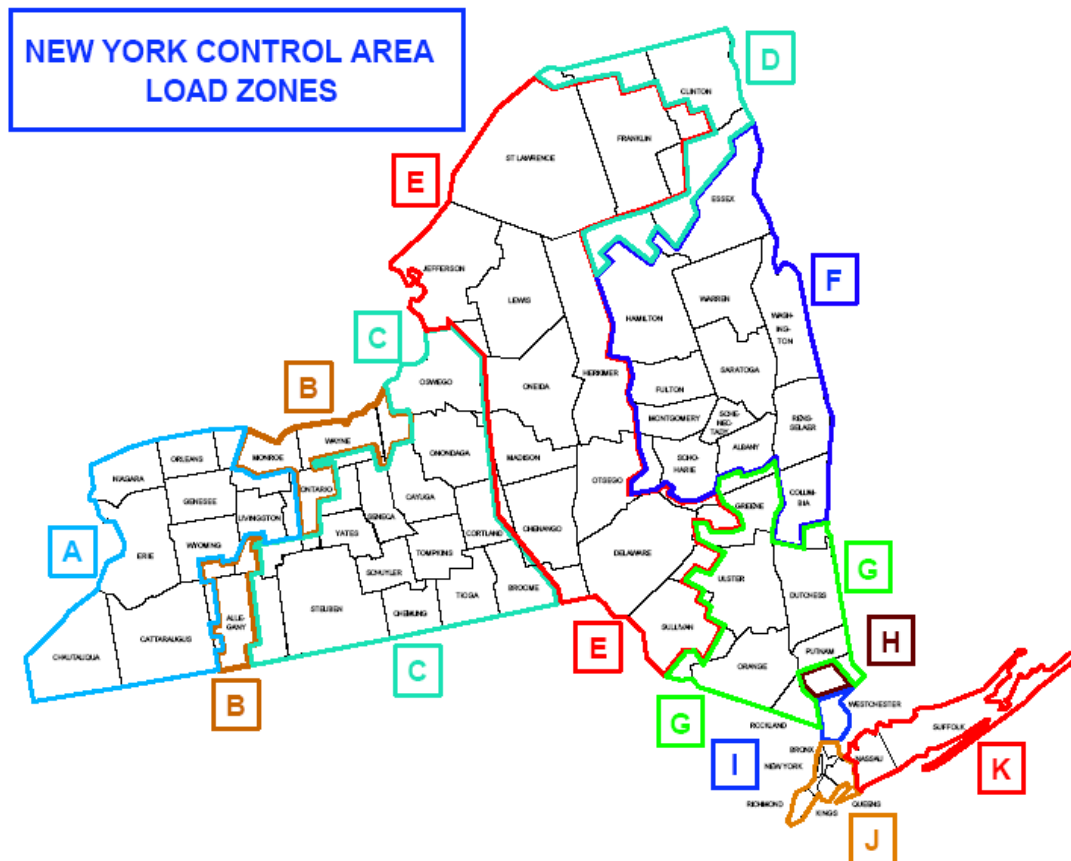

These estimates reflect plant features typically found in modern peaking facilities and are intended to reflect representative costs for new plants of their type, in year 2010 dollars. The estimates are conceptual and are not based on preliminary engineering activities for any specific site. The estimates reflect projects awarded on an Engineering, Procurement, and Construction (EPC) basis, with combustion turbines and SCR systems (if included) purchased directly by the owner. The scope includes all site facilities for power generation and distribution, including a 345-kV switchyard (138-kV switchyard in New York City) and interconnection costs.

## 1. Principal Assumptions

The key assumptions are discussed below.

### a. Technology and SCR Systems

Pursuant to the discussion in the previous section, estimates were prepared using LM6000, LMS100 and Trent 60 technologies with an SCR at Zones G, J, and K, and with LM6000, LMS100, and 7FA

technologies without an SCR in Zones C and F. CO catalyst was included on only the LM6000 in Zones G, J, and K.

#### **b. Greenfield Conditions**

A new entrant peaking unit could be installed less expensively at an existing site where already-constructed common facilities may be utilized. Although such brownfield sites exist, the number of these is limited. The study is based on greenfield site conditions to incorporate all of the normally expected costs to develop a new entrant peaking plant. Land and water requirements for greenfield conditions are summarized in Table II-5 and Table II-1, respectively.

#### **c. Number of Units**

The cost per kilowatt of new capacity is reduced if multiple units are constructed and share the common facility costs. A two-unit addition is a reasonable tradeoff between the higher cost of adding only a single unit and the higher incremental addition of three or more units to system capacity.

#### **d. Inlet Air Cooling**

Inlet air evaporative cooling was assumed for all technologies because it increases capacity. Dry cooling was assumed for the intercooler for the LMS100. Inlet air chillers were not included in the configuration due to cost considerations.

#### **e. Dual vs. Single Fuel**

The capability to burn natural gas or fuel oil reduces the risk of not having peaking capacity available when needed due to fuel supply interruption, and adds capital cost while lowering operating costs. However, current NYISO rules do not require dual-fuel capability. Gas availability is more likely a problem in the winter when reliability is less an issue. In New York City, Consolidated Edison Service Classification No. 9 appears to require dual fuel capability to qualify for Power Generation Transportation Service<sup>11</sup>. Given that obtaining new firm gas transportation is prohibitively expensive in New York City, a new peaking unit in New York City would realistically have this capability; therefore, dual fuel capability has been assumed for Zone J. Firing only with natural gas was assumed for Long Island (Zone K) and the NYCA.

---

<sup>11</sup> Consolidated Edison Company of New York, Inc. (Con Edison), Service Classification No. 9, Transportation Service (TS), Leaf 266.

**f. Gas Compression**

Fuel gas compressors have been included based on a local supply pressure of 250 psig in New York City and 450 psig elsewhere.

**g. Contingency**

Contingency is added to cover undefined variables in both scope definition and pricing that are encountered within the original scope parameters. Contingency should always be treated as “spent money.” Examples of where it is applied would include nominal adjustments to material quantities in accordance with the final design, items clearly required by the initial design parameters that were overlooked in the original estimate detail, and pricing fluctuations like the run-up in copper prices. A contingency of 10% was applied to the total of direct and indirect project costs, which is consistent with industry custom and practice, is typical for construction projects of this type and is the same level that was used in cost of new entry estimates in PJM., which has been approved by the Federal Energy Regulatory Commission (FERC).

**h. Basis for Equipment, Materials, and Labor Costs**

All equipment and material costs are based on S&L in-house data, vendor catalogs, or publications. Labor rates have been developed based on union craft rates in 2010.<sup>12</sup> Costs have been added to cover FICA, fringe benefits, workmen’s compensation, small tools, construction equipment, and contractor site overheads. Work is assumed to be performed on a 50-hour work week by qualified craft labor available in the plant area. Labor rates are based on Onandaga County for Zone C, Albany County for Zone F, Dutchess County for Zone G, New York County for Zone J, and Suffolk County for Zone K. An allowance to attract and keep labor was included. A labor productivity adjustment of 1.40 has been applied to Zone J, 1.35 for Zone K and 1.10 for other zones.<sup>13</sup> Materials costs are based on data for Syracuse in Zone C, Albany in Zones F and G, New York City in Zone J, and Riverhead in Zone K.

**i. Miscellaneous**

Black start capability has not been included. Pile foundations were assumed for Zone J because most available sites are along the East River. Spread footing foundations were assumed elsewhere.

---

<sup>12</sup> Base pay and supplemental (fringe) benefits were obtained from the Prevailing Wage Rate Schedules – New York State Department of Labor using the latest available data as of March 2010.

<sup>13</sup> Based on ranges obtained from the 2010 Global Construction Cost Yearbook published by Compass International.



Use of rental trailer-mounted water treating equipment was assumed. Potable water is available from a municipal supply. Wastewater treatment is not included; contaminated wastewater will be collected locally for tanker truck disposal. A control/administration building is included.

## **2. Capital Investment Costs**

Capital investment costs for each peaking unit option include direct costs, owner's costs, financing costs during construction, and working capital and inventories:

- Direct costs are costs typically within the scope of an EPC contract. These costs are estimated in detail in Appendix 1.
- Owner's costs include items not covered by the EPC scope such as owner's development costs, oversight, legal fees, financing fees, startup and testing, and training. On the basis of data extracted from recent independent power projects, these costs have been estimated as 11% of direct capital costs. In addition, social justice costs were estimated to be 0.9% of EPC costs in New York City for the LM6000 and Trent 60; 0.2% of EPC costs for the LM6000, LMS100 and Trent 60 elsewhere; 0.4% of EPC costs in New York City for the 7FA; and 0.1% of EPC costs for the 7FA elsewhere.
- Financing costs during construction refer to the cost of debt and equity required over the periods from each construction expenditure date through the plant in-service date. These costs have been calculated from the monthly construction cash flows associated with the capital cost estimates in Appendix 1, and the cost of debt and equity presented in Section IV.B.. A 20-month construction period is assumed, with cash flows peaking in the 14<sup>th</sup> month. Over 70% of the total cash flow occurs in the second half of the construction period.
- Working capital and inventories refer to the initial inventories of fuel, consumables, and spare parts that are normally capitalized. It also includes working capital cash for the payment of monthly operating expenses. On the basis of recent independent power projects, these costs have been estimated as 2% of direct capital costs.

Capital investment costs for each location and combustion turbine option are summarized below in Table II-3. Capital investment costs also are shown for the following cases, which are provided for information purposes only:

- One unit LMS100 PA in New York City
- Two unit Trent 60 located in New Jersey with generator leads into a Zone J substation; and

**Table II-3 — Capital Investment Costs for Greenfield Site (2010 \$)**

	<b>Syracuse 2 x LM6000 No SCR</b>	<b>Syracuse 2 x LMS100 No SCR</b>	<b>Syracuse 2 x 7FA No SCR</b>	<b>Albany 2 x LM6000 No SCR</b>	<b>Albany 2 x LMS100 No SCR</b>	<b>Albany 2 x 7FA No SCR</b>
<b>Direct Costs</b>	115,539,000	197,595,000	259,447,000	116,556,000	199,162,000	261,488,000
Owner's Costs	12,941,000	22,131,000	28,799,000	13,053,000	22,306,000	29,027,000
Financing Costs During Construction	6,437,000	11,009,000	14,441,000	6,493,000	11,096,000	14,555,000
Working Capital and Inventories	2,311,000	3,952,000	5,189,000	2,331,000	3,983,000	5,230,000
<b>Total</b>	<b>137,228,000</b>	<b>234,687,000</b>	<b>307,876,000</b>	<b>138,433,000</b>	<b>236,547,000</b>	<b>310,300,000</b>
Net Degraded ICAP MW	86.2	181.32	376.43	86.68	182.42	378.39
\$/kW	\$1,592	\$1,294	\$818	\$1,597	\$1,297	\$820

Technology Choice and Construction Cost

	<b>Lower Hudson Valley 2 x LM6000 With SCR</b>	<b>Lower Hudson Valley 2 x LMS100 With SCR</b>	<b>Lower Hudson Valley 2 x Trent 60 With SCR</b>	<b>NYC 2 x LM6000 With SCR</b>	<b>NYC 2 x LMS100 With SCR</b>	<b>NYC 2 x Trent 60 With SCR</b>
<b>Direct Costs</b>	141,913,000	230,532,000	145,933,000	166,967,000	270,775,000	171,224,000
Owner's Costs	15,894,000	26,469,000	17,602,000	19,867,000	32,874,000	20,609,000
Financing Costs During Construction	7,906,000	12,876,000	8,193,000	9,360,000	15,213,000	9,611,000
Working Capital and Inventories	2,838,000	4,611,000	2,919,000	3,339,000	5,416,000	3,424,000
<b>Total</b>	<b>168,551,000</b>	<b>274,488,000</b>	<b>174,647,000</b>	<b>199,533,000</b>	<b>324,278,000</b>	<b>204,868,000</b>
Net Degraded ICAP MW	87.04	183.24	106.68	95.04	180.50	106.68
\$/kW	\$1,936	\$1,498	\$1,637	\$2,099	\$1,797	\$1,920
	<b>Long Island 2 x LM6000 With SCR</b>	<b>Long Island 2 x LMS100 With SCR</b>	<b>Long Island 2 x Trent 60 With SCR</b>	<b>NYC 1 x LMS100 With SCR</b>	<b>NYC (in NJ) 2 x Trent 60 With SCR</b>	
<b>Direct Costs</b>	158,576,000	256,335,000	163,155,000	159,032,000	221,277,000	
Owner's Costs	17,760,000	29,361,000	19,651,000	19,252,000	18,436,000	
Financing Costs During Construction	8,835,000	14,313,000	9,159,000	8,933,000	8,588,000	
Working Capital and Inventories	3,172,000	5,127,000	3,263,000	3,181,000	3,059,000	
<b>Total</b>	<b>188,343,000</b>	<b>305,136,000</b>	<b>195,228,000</b>	<b>190,398,000</b>	<b>251,360,000</b>	
Net Degraded ICAP MW	86.94	183.28	106.7	90.25	106.68	
\$/kW	\$2,166	\$1,665	\$1,830	\$2,110	\$2,356	

## E. Other Plant Costs

Other costs associated with each peaking unit option include fixed O&M costs, variable O&M costs, and fuel costs. These costs are estimated in detail in Appendix 1, Table A-2. The basis for these estimates is described in the following subsections.

## 1. Fixed O&M Costs

Fixed O&M costs include costs directly related to the turbine design (labor, materials, contract services for routine O&M, and administrative and general costs) and other fixed operating costs related to the location (site leasing costs, property taxes, and insurance). Design-related costs were derived from a variety of sources, including the State-of-the-Art Power Plant Combustion Turbine Workstation, v 8.0, developed by the Electric Power Research Institute (EPRI), data for existing plants reported on FERC Form 1, and confidential data from other operating plants. The resulting cost assumptions are summarized in Table II-4.

**Table II-4 — Fixed O&M Assumptions (2010 \$)**

	Long Island, NYC	Long Island, NYC	Long Island, NYC
	LM6000 PG or PH Sprint	LMS100 PA	Trent 60
Average Labor Rate, incl. Benefits (\$/hour)	\$67.00	\$67.00	\$67.00
Operating Staff (full-time equivalents)	4	4	4
Maintenance Staff (full-time equivalents)	3	3	3
Routine Materials and Contract Services	\$250,000	\$320,000	\$270,000
Administrative and General	\$350,000	\$350,000	\$350,000

	Lower Hudson Valley	ROS	ROS	ROS
	Trent 60	LM6000 PH Sprint	LMS100 PA	GE 7FA.05 Simple Cycle
Average Labor Rate, incl. Benefits (\$/hour)	\$54.00	\$54.00	\$54.00	\$54.00
Operating Staff (full-time equivalents)	4	4	4	4
Maintenance Staff (full-time equivalents)	3	3	3	3

	Lower Hudson Valley	ROS	ROS	ROS
Routine Materials and Contract Services	\$270,000	\$250,000	\$320,000	\$390,000
Administrative and General	\$350,000	\$350,000	\$350,000	\$350,000

Other fixed operating costs are described below and summarized in Table II-5.

**a. Site Leasing Costs**

Site leasing costs are equal to the annual lease rate (\$/acre-year) multiplied by the land requirement in acres. The values used were from the 2007 Demand Curve reset study, escalated by inflation.

**b. Property Taxes and Insurance**

Property taxes are equal to the unadjusted property tax rate for the given jurisdiction, multiplied by an assessment ratio, and multiplied by the market value of the plant. The assessment ratio is the percentage of market value applied in the tax calculation. The property tax rates and assessment ratios for this analysis were selected as typical values currently in effect for jurisdictions in each location, as follows:

NYC: (City of New York website), Class 4 Property (10.426%) x 45% assessment ratio = 4.69% effective rate. Power plant equipment that is not rate regulated by the New York Public Service Commission should be treated as general commercial real property (Class 4).<sup>14</sup>

LI: According to Suffolk County website, each town sets its own property tax rate. The limit on the effective rate is 1.5% in the county, but villages have a 2.0% limit, and towns have no limit. An effective value of 2.00% was chosen as representative for LI.

ROS: From the wide range of values posted for Ulster County (in the Hudson Valley) and Onondaga County (Syracuse area) on their websites, a typical rate and assessment ratio of: 4.0% and 50%, respectively, were chosen for a 2.00% effective rate.

<sup>14</sup> In the Matter of Astoria Gas Turbine Power, LLC v. Tax Commission of City of New York, 7 NY3d 451, 857 N.E.2d 510, 824 N.Y.S.2d 189 (2006).

There currently are no tax abatement programs specifically applicable to peaking generation projects in New York State. The New York City Economic Development Corporation is currently considering a replacement program to the now expired Industrial and Commercial Incentive Program (ICIP) for new peaking units constructed in New York City. Under the ICIP, an approved project was granted a property tax exemption for the first 11 years, followed by a 20% decline in the exemption each year for four years, with full taxes due in the 16<sup>th</sup> year and thereafter. A New York State court ruled that power plants in New York City qualified for the ICIP as commercial improvement work. To illustrate the impact of the potential tax abatement in New York City, the levelized cost analysis has been performed both with and without tax abatement using the former ICIP formulas as an example.

Insurance costs are estimated to be 0.30% of the initial capital investment, escalating each year with inflation, on the basis of actual data for recent independent power projects.

Property taxes and insurance are commonly considered to be part of the carrying charge rate because their value is directly related to the plant capital cost. The carrying charge rates in Section II.F.3 of this report are derived both with and without property taxes and insurance.

**Table II-5 — Other Fixed Operating Cost Assumptions (2010 \$)**

	NYC	Long Island	ROS
Land Requirement - Simple Cycle (acres)	3.5	4.5	4.5
Land Requirement - 2 x LMS100 PA (acres)	6.0	6.0	6.0
Lease Rate (\$/acre-year)	129,000	22,000	18,000
Property Tax Rate	10.426%	2.00%	4.00%
Assessment Ratio	45.00%	100.00%	50.00%
Effective Property Tax Rate	4.69% *	2.00%	2.00%
Insurance Rate	0.30%	0.30%	0.30%

\* The effective property tax rate excluding the ICIP property tax exemption granted during the first 15 years of operation.

## 2. Variable O&M Costs

Over the long-term operating life of a peaking facility, the largest component of variable O&M is the allowance for major maintenance expenses. Each major maintenance cycle for a combustion turbine typically includes regular combustor inspections, periodic hot gas path inspections, and one major overhaul. For the aeroderivative units, a major maintenance overhaul every 50,000 factored operating hours was assumed. For the frame units, major overhauls are every 48,000 operating hours or 2,400 factored starts, whichever occurs first. Normal operating hours and normal starts are factored, that is, increased to account for severe operating conditions. For example, operating hours are factored for operation on fuel oil instead of natural gas and starts are factored as a result of trips or emergency starts. For peaking duty, major maintenance intervals thus tend to be hours-based for the aeroderivative units and starts-based for the frame units.

Since major maintenance activities and costs are spaced irregularly over the long-term, the cost in a given year represents an annual accrual for future major maintenance. The average variable O&M cost for major maintenance is thus equal to the total cost of parts and labor over a complete major maintenance interval divided by the factored operating hours between overhauls, divided by the unit capacity in megawatts. Other variable O&M costs are directly proportional to plant generating output, such as unscheduled maintenance, SCR catalyst and ammonia, water, and other chemicals and consumables. An SCR is required in ozone non-attainment areas, which applies to all study locations except Albany and Syracuse. An Oxidation Catalyst was applied to the LM6000 in Zones G, J, and K to reduce CO emissions. Variable O&M assumptions for each turbine model and location are summarized in Table II-6.

**Table II-6 — Variable O&M Assumptions (2010 \$)**

Technology Choice and Construction Cost

	<b>Albany Syracuse</b>	<b>Lower Hudson Valley Long Island</b>	<b>NYC</b>	<b>Albany Syracuse</b>
	<b>2 x LM6000 PH Sprint</b>	<b>2 x LM6000 PH Sprint</b>	<b>2 x LM6000 PG Sprint</b>	<b>2 x LMS100 PA</b>
Major Maintenance Interval (Operating Hours)	50,000	50,000	50,000	50,000
Major Maintenance Interval (Factored Starts)	N/A	N/A	N/A	N/A
Cost of Parts Required for Complete Major Maintenance Interval				
- Combustion Turbines (per turbine) *	7,435,000	7,435,000	7,435,000	12,167,000
- Balance of Plant	0	0	0	0
Labor-Hours Required for Complete Major Maintenance Interval *				
- Combustion Turbines (per turbine) *	12,000	12,000	12,000	14,000
- Balance of Plant	0	0	0	0
Unscheduled Maintenance (\$/MWh)	0.81	0.81	0.81	0.81
SCR Catalyst and Ammonia (\$/MWh)	0.00	1.00	1.00	0.00
CO Oxidation Catalyst (\$/MWh)	0.00	0.35	0.35	0.00
Other Chemicals and Consumables (\$/MWh)	0.18	0.18	0.18	0.18
Water (\$/MWh)	0.75	0.75	0.70	0.07

- Includes combustion inspections, hot gas path inspections, and major inspection required, on average, for one complete interval.



	<b>Lower Hudson Valley Long Island NYC  2 x LMS100 PA</b>	<b>Lower Hudson Valley Long Island NYC  2 x Trent 60</b>	<b>Albany Syracuse  2 x 7FA</b>
Major Maintenance Interval (Operating Hours)	50,000	50,000	48,000
Major Maintenance Interval (Factored Starts)	N/A	N/A	2400

Cost of Parts Required for Complete Major Maintenance Interval

- Combustion Turbines (per turbine) *	12,167,000	8,900,000	20,812,000
- Balance of Plant	0	0	0

-Hours Required for Complete Major Maintenance Interval \*

- Combustion Turbines (per turbine) *	14,000	13,000	15,000
- Balance of Plant	0	0	0
Unscheduled Maintenance (\$/MWh)	0.81	0.81	0.55
SCR Catalyst and Ammonia (\$/MWh)	1.00	1.00	0.00
CO Oxidation Catalyst (\$/MWh)	0.00	0.00	0.00
Other Chemicals and Consumables (\$/MWh)	0.18	0.18	0.18
Water (\$/MWh)	0.07	0.62	0.14

- Includes combustion inspections, hot gas path inspections, and major inspection required, on average, for one complete interval.

### 3. Fuel Costs

The fuel costs for each peaking unit option are derived from the delivered price of fuel in each region, the net plant heat rate, and the plant dispatch. Fuel prices are derived on a statistical basis, using the historical correlation between daily New York gas costs by location and load and electricity price, as presented in Section III. The statistical approach is used to capture the effects of extreme conditions in the electricity markets on daily and seasonal gas prices. This approach

incorporates fuel prices that are consistent with the hours of the year the peaking unit is actually dispatched.

The fuel price forecasts in Section III account for the transportation cost differences by location. These prices are tied to commodity pricing at delivery points in New York from a major interstate pipeline system that transports natural gas from producing regions along the U.S. Gulf Coast. Local fuel transportation charges were added to the price at the nearest trading point. The applicable local transportation rates include the rate set forth in the following gas distribution company tariff leaves: Con Edison PSC No. 9-Gas (Leaf 277) for New York City, and Keyspan Energy Delivery (Keyspan) PSC No. 1-Gas, Service Classification No. 14 (Leaf 189) for Long Island. In those two regions, the total delivered fuel price to an end user for interruptible service is the sum of the following:

- Texas Eastern Transmission Market Area 3 (TET-M3)
- System Cost Component
- Marginal Cost Component
- Value Added Charge
- Taxes
- Imbalance Charges

The System Cost Component, Marginal Cost Component, Value Added Charge, and Taxes are all subject to a minimum monthly bill that is based upon a 50% capacity factor. According to discussions with representatives from Con Edison and National Grid (in respect of its Keyspan New York City tariffs), the Imbalance Charges are minimal in the day-ahead market. Those same representatives indicated that firm transportation service is not commonly provided because of the prohibitive costs of system reinforcement. Interruptible service gives Con Edison and National Grid (in NYC) the right to curtail gas supply up to 720 hours per year. The risk of gas supply interruption is greatest in the winter months when electric system reliability is less of an issue.

Local fuel transportation charges for the Rest of State were estimated from data for various existing plants in the Northeast. The estimated rates for each study region are summarized in Table II-7.

**Table II-7 — Fuel Transportation Charges (2010 \$)**

	NYC	Long Island	ROS
Gas Transportation Service (\$/mmBtu) *			
System Cost Component	0.100	0.100	0.100
Marginal Cost Component	0.092	0.140	0.170
Value Added Charge	0.005	0.005	—
Taxes	0.007	0.008	—

\* The minimum bill must be based on a capacity factor of 50%. For a peaking unit, the effective \$/mmBtu cost is thus higher than the indicated rates.

The net plant heat rates and startup fuel consumption rates for each peaking unit option are summarized in Appendix 1, Table A-2.

The modeling of the peaking unit dispatch in connection with the derivation of energy and ancillary service revenues, and the associated fuel consumption and costs, are discussed in Section III.

## **F. Development of Real Levelized Carrying Charges**

Capital investment costs are converted to annual capacity charges using annual carrying charge rates. The annual carrying charge rate multiplied by the original capital investment yields the annual carrying charges. Carrying charges typically include all annual costs that are a direct function of the capital investment amount: principal and interest payments on project debt, equity returns, income taxes, property taxes, and insurance. The assumptions used for property taxes were discussed above. Income tax and financing assumptions are presented in the following subsections.

### **1. Income Tax Assumptions**

Income taxes are a significant component of carrying charge rates. A portion of these charges must be grossed up to account for the income taxes due on plant revenues such that the desired return on equity is achieved. Income taxes include the federal corporate tax rate of 35.00%, the New York State corporate tax rate of 7.50%, and the New York City income tax rate of 8.85%. The composite tax rate is the sum of these rates, reduced by the portion that is deductible from taxable income.

Income tax assumptions for each region are summarized in Table II-8.

**Table II-8 — Income Tax Assumptions**

	NYC	Long Island and ROS
Federal Tax Rate	35.00%	35.00%
State Tax Rate	7.10%	7.10%
City Tax Rate	8.85%	0.00%
Composite Tax Rate *	45.37%	39.62%

\* Federal tax rate + State tax rate + City tax rate – [Federal tax rate x (State tax rate + City tax rate)], to account for the deductibility of state and local taxes from federal taxable income.

## 2. Financing Assumptions

Financing assumptions for each region are discussed in Section IV.B and summarized in Table II-9. The values are identical for each region except for the after-tax weighted average cost of capital, which is lower in New York City because of the city income tax. The costs of debt and equity are shown on a nominal basis and a real basis. Real rates are derived by removing the inflation component of 2.40%, and are subsequently used to calculate the real weighted average cost of capital (WACC) and the real levelized carrying charge rates.

**Table II-9 — Financing Assumptions**

	NYC	Long Island and ROS
Equity Fraction	0.50	0.50
Debt Fraction	0.50	0.50
Cost of Equity (nominal)	12.48%	12.48%
Cost of Debt (nominal)	7.25%	7.25%
Cost of Equity (real)	9.84%	9.84%
Cost of Debt (real)	4.74%	4.74%
Weighted Average Cost of Capital *		
Before-Tax (nominal)	9.87%	9.87%
After-Tax (nominal)	8.43%	8.43%

Before-Tax (real)	7.29%	7.29%
After-Tax (real)	6.35%	6.35%
Tax Depreciation **	15-year MACRS	15-year MACRS
Inflation Rate	2.40%	2.40%

\* (Equity Fraction x Cost of Equity) + (Debt Fraction x Cost of Debt), before tax; and (Equity Fraction x Cost of Equity) + [(Debt Fraction x Cost of Debt) x (1 – Composite Tax Rate)], after tax.

\*\* Federal tax code schedule (Modified Accelerated Cost Recovery System or MACRS) for a simple-cycle combustion turbine, adjusted for residual depreciation if the amortization period is less than 15 years.

Consistent with the 2007 Demand Reset Study, this study uses a methodology that determines a separate amortization period for each region. The difference by region considers the risk of excess capacity, the slope of the Demand Curve, and the slope of the energy and ancillary service net revenue function. This method from the prior Demand Curve reset ties together the risk and the slope of the Demand Curve and provides for an internally consistent consideration of the Demand Curve slope, which affects risk, and the amortization period.

### 3. Levelized Cost Results

For each case, the annual carrying charges were calculated over the amortization period. Annual carrying charges are equal to the sum of the following components:

- **Principal.** Based upon mortgage style amortization.
- **Interest.** Equal to the cost of debt multiplied by the loan balance for the given year.
- **Target Cash Flow to Equity.** Equal to the initial equity investment multiplied by an annuity factor over the amortization period, using the cost of equity as the annuity rate.
- **Income Taxes.** Calculated by the formula:  $[t/(1-t)] \times [\text{Target Cash Flow to Equity} + \text{Principal} - \text{Annual Tax Depreciation}]$ , where  $t = \text{Composite Tax Rate}$ . Annual tax depreciation is based on 15-year MACRS depreciation in accordance with the federal tax code for a simple-cycle combustion turbine.

- **Property Taxes.** The effective property tax rate multiplied by the original capital investment amount, escalating year with inflation.
- **Insurance.** The insurance rate multiplied by the original capital investment amount, escalating each year with inflation.

Annual carrying charge rates on a hypothetical \$1,000,000 capital investment are derived in Appendix 2, Table B-1. Carrying charges derived on this basis result in the specified target cash flow to equity, as verified by the income statement shown in Table II-10.

**Table II-10 — Income Statement**

	<b>Carrying Charges</b>
minus	Tax Depreciation
minus	Interest
=	Taxable Income
minus	Taxes
minus	Principal
Add back	Depreciation
<b>=</b>	<b>Target Cash Flow to Equity</b>

The levelized carrying charge is equal to the annual carrying charges over the amortization period converted to an annuity using the after-tax WACC. In other words, the annual carrying charges are considered to be “revenue requirements” that are discounted at the after-tax WACC. The real levelized carrying charges are expressed in reference year price levels. Nominal carrying charge rates for future years are equal to the reference year real rate escalated by the inflation rate of 2.40%/year.

The real levelized carrying charge rates as a function of amortization period are summarized in Table II-11. The rates are shown without property taxes and insurance. For reference, the rates in NYC with property taxes and tax abatement using the former ICIP formulas are shown.

**Table II-11 — Real Levelized Carrying Charge Rates**

Technology Choice and Construction Cost

Levelized Carrying Charge Rates – Without Property Taxes and Insurance Unless Indicated:	Long Island ROS	NYC	NYC with Property Taxes and ICIP
10-year amortization	16.89	17.53	17.53
15-year amortization	13.16	13.68	14.10
20-year amortization	11.27	11.69	12.76
25-year amortization	10.20	10.57	12.00
30-year amortization	9.54	9.88	11.53
35-year amortization	9.11	9.42	11.22

In addition to the effects of region and property taxes and insurance, the sensitivity of the carrying charge rates over a range of amortization periods (10 to 35 years) and for higher costs of debt and equity (base case, base case + 200 basis points, and base case + 400 basis points) are shown in Appendix 2, Table B-2.

### III. Estimating Energy Net Operating Revenues

The next task is to estimate the annual net operating revenues of the hypothetical peaker. The net operating revenues are required by the Tariff to be based on “conditions in which the available capacity would equal or slightly exceed the minimum Installed Capacity requirement.”<sup>15</sup>

#### A. Overview of Approach

We have used historical data for zonal Day-Ahead and Real Time LBMP values from November 1, 2006 through October 31, 2009 to benchmark the operation of the NYISO system. We then statistically estimate the effect of various cost drivers, including installed reserve margin, on the observed zonal LBMP values. This statistical model allows us to conceptually vary any causal variable to create an estimate of price under different conditions with respect to that variable. We start with estimates of prices analyzed under various levels of installed capacity including the specified Services Tariff conditions in which capacity would equal or slightly exceed the minimum Installed Capacity requirement.

We then use these prices to dispatch the hypothetical unit, calculating both Day-Ahead and real-time energy revenues. In so doing we must create a hypothetical operating strategy for this unit and make decisions as to the degree of foresight the unit operator will have in choosing between commitments to the Day-Ahead Market versus opportunistic behaviour in the Real-Time Market. In addition, we must be mindful of real operating constraints on the unit with regards to startup cost and start times. These calculations are carried out by zone.

We considered and rejected the other prominent competing method for estimating net operating revenues, namely production cost modelling. There are two prominent problems with this approach. The first is that production cost modelling may not mirror actual price experience, especially at peak loads under tight supply conditions, without undue effort devoted to calibration. Production cost models by their very nature tend to understate actual prices in deregulated markets at these times, since they reflect a system which always behaves optimally, never has to adjust for unexpected contingencies in real time and may not reflect difficult to analyze costs such as the probability of damaging equipment by operating at high loading levels. These adjustments have

---

<sup>15</sup> Seventh Revised Sheet 157



real costs, and these costs are often substantial. The second problem is that for practical purposes, production cost models must be run at expected conditions and cannot be run as a system actually runs, *i.e.* with widely varying gas prices, weather and demand conditions and transient transmission irregularities. The effect of these things are not linear, particularly under peak conditions and thus do not average out.

Thus, our approach assumes that the best evidence on what electric prices will be is what electric prices have been. We note that there is no perfect method to generate these results. Because the net revenue calculation is a hypothetical abstraction, we strive to model the important parts of the problem, but recognize that there are numerous small effects which are not modelled and which, by the law of large numbers, should roughly cancel one another out. Excessive focus on particular small issues raise the possibility of an unbalanced look at the problem in which the noise generating by the estimation process exceeds the signal generated. Consequently, the generation of net revenue estimates, while scientific, nonetheless calls for the exercise of professional judgment, as does almost any hypothetical modelling.

Looming even larger (at least in this reset) is the question of what should be controlled for and what should not. In particular, commenters in the review process have focused on three issues which will be discussed in more detail below: adjustments for changes in gas prices, adjustments for the “Lake Erie Loop Flow” problem from January-July 2008, and adjustments for low load levels in 2009 caused by recession and mild weather.

Our basic philosophical approach is not to make any adjustments except for reserve margin, *ie*, to adjust only for the main thing that the Services Tariff requires. The basic principles which underlie this theory are as follows:

- Large measurable effects may not even out over a three year period, but they will even out over the long run. Unique events which have large impact (positive or negative) on price will go away over time, perhaps being replaced by large effects which go the other way. Hence, limiting adjustments contributes to a measure of stability.
- Such adjustments are complex and call for substantial analytical judgment. For example, how should we adjust for unanticipated changes in load in the historic period due to weather

and recession? There are literally hundreds of ways to do so, each of which involves the estimation of some new model of what demand *ought* to have been in the 2006-2009 period and then substituting those new demands for the ones actually observed. These models themselves are likely to be contentious, and their application into the overarching model adds model prediction error to the problem which could well outstrip the supposed error for which it is intended to correct. Adjustment for anomalous periods, like the Lake Erie Loop flow problem, would also be subject to considerable judgment. Simply dropping the period from the analysis, explicitly or implicitly, while leaving in the 2009 period loads which were affected by the recession and mild summer weather would provide for a partial and biased adjustment.

That said, there is at least one adjustment which we feel compelled to make: the historic period contains no adjustment to Real-Time LBMPs for times at which Special Case Resources are called. These resources, which when called will affect prices significantly, would not be called given the capacity excesses in the historic period. The obligation to reflect the market that will prevail at or slightly above the minimum installed capacity level requires that we consider, however imperfectly, the impact of this market change.

By making no other adjustments other than for Installed Capacity levels, however, we are effectively using econometrics to answer the question “what would peaker unit net revenues have been for the three year historic period had the system been at capacity levels equal to or slightly in excess of the minimum Installed Capacity requirement?” We do so understanding that the next three years will not precisely mirror the last three. However, each adjustment that could be made, whether it be for gas price, weather, economic conditions or specific operating conditions is of uncertain accuracy and has the possibility of introducing error. As only so many adjustments are feasible, some not made may include those that would counteract those that have been made, thereby introducing bias. We believe not adjusting to attempt to normalize out potential anomalies or more exactly predict conditions for the next three years provides the most objective set of net revenue parameters, reduces estimation errors and should be expected to smooth out so that over time the estimates based on historic data adjusted only for Installed Capacity levels are the best estimates of the net operating revenues that will prevail over the future at or near the minimum installed capacity level. Using actual experienced conditions tracks, albeit with a lag, the revenue opportunities that existing generators actually encountered. An entrant can be assured that the net

revenues used in setting the Demand Curve will over time reflect events in the market, whether increasing or decreasing net revenues that it will be able to experience and will not face the uncertainty of judgmental adjustments to “normal conditions” or “forecast conditions”. This is precisely the methodology followed in the 2007 Demand Reset process, and we recommend it as the most accurate way, on balance, of applying the Demand Curve Tariff provisions.

## **B. Data**

The hourly Day-Ahead and real-time hourly integrated zonal LBMPs are publicly available at the NYISO website, as are zonal loads. These prices were augmented by daily gas prices taken from Bloomberg (Texas Eastern Transmission M3 price for all but New York City and Long Island, and by Transco Z6 prices for NYC and Long Island) which were then linearly interpolated across non-trading days. Temperatures used were from data supplied by National Oceanic and Atmospheric Administration. Long Island and New York temperatures were taken at JFK airport. Rest of State temperatures were taken at Albany Airport. The final addition was a series of excess purchases of capacity, by month, supplied by the NYISO in three capacity regions: New York City, Long Island, and the New York Control Area. Gas transportation costs were taken from Table A-2, except in New York City. For New York City, the Transco Z6 prices were raised by 4 percent to reflect fuel taxes and another 20 cents/MMBTU for local transportation.

## **C. Statistical Estimation**

The fitting of a statistical equation to predict electricity prices is a reasonably straightforward exercise. Electricity price in any hour in any zone is determined by the intersection of offers to supply power and the estimated (if Day Ahead) or actual (if real time) demand for power, adjusted for limitations, if any, of the transmission system to minimize total resource costs. The supply curve of electricity is largely fixed, but moves somewhat from hour to hour as transmission conditions change, the availability of units change, and from other transient factors, *e.g.*, temperature. If, as a first approximation, we regard the supply curve is fixed, then varying demand traces out the supply curve. Thus, our estimation strategy is to use load to identify the supply curve while varying the supply curve from hour-to-hour to reflect underlying technical supply differentials. The remainder of unmeasured effects, which are substantial, are left as residuals in the underlying model. Thus,

$\text{Log}(\text{LBMP}_{hz}) = f(\text{NYCA Load, Zonal Load, Attributes of Hour } h, \text{ Attributes of Zone } z, \text{ Gas Price, Reserve Margin, Temperature}) + \varepsilon$

We choose to use the logarithm of LBMP rather than raw LBMP (which represents a change from the 2007 update) for several reasons:

- Prices are normally thought of as behaving multiplicatively – external drivers on price are, for the most part, expected to affect those prices in percentage terms rather than absolute terms, and a logarithmic specification reflects this.
- Logarithmic specifications reduce inherent issues in heteroskedasticity in the observed data, in which large errors are far more likely at high prices than at low prices.
- Logarithmic models prevent the estimation of prices below zero. While the LBMP can in theory fall below zero, it did not in the reference period and is unlikely to in the structure of the NYISO market. Even very good regressions in levels have the undesirable (though not for our purposes, fatal) objection that they occasionally predict substantial negative prices. This effect is particularly prevalent when the regression has underpredicted price and the observed absolute residual is applied to a hypothetical variation around that price.

The complete specification is given in Appendix 3. The standard indicia of model fit are quite good. The basic regression model explains about 88 percent of the underlying variation in electric prices<sup>16</sup>. This result implies that given the zone, the hour, the NYCA and zonal load, Gas Price, reserve margin and temperature, we can capture about 88 percent of the variation in electricity price around its mean. The remaining 12 percent of the variation that is unexplained are implicitly accounted for by a combination of variables excluded from the estimation process; these might include levels of outages, transient system conditions among other qualitative and quantitative factors.

Almost all causal factors work as expected. Thus, for example, price increases as load increases, and increases faster the more load increases<sup>17</sup>. Prices are generally higher on the weekends and in

---

<sup>16</sup> The equivalent figure for the similarly structured 2007 model was 83 percent.

<sup>17</sup> This follows from the strongly positive effects on the cube of load.

the shoulder months (adjusting for load differences) to reflect outage patterns on deferrable maintenance. Temperature has a slightly anomalous effect, in that one would expect high temperatures to lead to higher prices. Instead, there is a moderately small effect in which higher minimum temperatures lead to lower prices, while the maximum temperature effect is small and insignificant. Finally, and most important, prices fall as reserve margins rise: at the margin, a one percentage point rise in excess margin yields a one percent decrease in price.

## **D. Price Estimates**

The Services Tariff requires conditions at or slightly above minimum Installed Capacity requirement. In the period observed, requirements were usually substantially in excess of the requirement. Thus, to estimate what prices would have been at the required Services Tariff conditions, we can recalculate prices using the statistical equation to calculate the change in prices attributable to a shrinking (or growth) of the observed reserve margin holding all other factors constant. We should note in particular that holding all other factors constant necessitates holding the unmeasured factors constant as well. Thus, we do not set the error terms (which reflect the unmeasured factors) to their average level of zero, but allow them to take whatever value they actually took in the data. This approach is important as peaker net operating revenues could be understated if we were to smooth prices out by not reflecting the variability that gives rise to the error terms.

Gas prices average around \$8/MMBTU over the study period, which is somewhat above currently-observed forward prices for natural gas over the forecast period, though there were certainly periods in the historic period considerably higher than currently forecast. This data also can have important implications for peaker net revenues, as will be discussed below.

Having produced estimates of Day-Ahead prices, we now need to make equivalent estimates of real-time prices. We do this by adding the change in Day-Ahead prices to the observed Real-Time integrated LBMP. The obvious alternative, proportional changes in the real-time price is problematic, as it causes enormous changes in the real-time which are probably not justifiable; for example, if the Day-Ahead price were \$45 and the predicted change were to \$60, we would add \$15 to the real-time price; in a period in which, for some reason, the observed real-time price were \$300, \$315 is a much more reasonable estimate of the effect of new LBMP than \$400. Even worse effects

which are trivial at very small Day-Ahead prices would enormously inflate any real-time prices which happened to spike in those hours. This follows the assumption that substantial divergences between real-time and Day-Ahead price are probably due to system conditions, *e.g.* thunderstorm activity, which is largely unrelated to the level of Day-Ahead prices at the time.

One additional adjustment is made to real-time prices to reflect a program not operating in the historic period which will operate in the forecast period: a Special Case Resource adjustment to the Real-Time LBMP. We adjust Real-Time LBMPs upward by an amount which reflects the mean expected adjustment in the 500 highest load hours in each zone. These hours are adjusted upward by the difference between the estimated LBMP and \$500 (if the LBMP is not already above \$500.) This difference is then discounted by the probability that this hour is Special Case Resource adjusted hour, which is an exponential function of reserve margin, calibrated so that at the Installed Capacity requirement, 110 hours are called out of the top 500 hours. The 110 hour estimate is based on the 2009 New York State Reliability Council Installed Reserve Margin study and reflects over 2500 MW of Special Case Resources. While we recognize that Special Case Resource calls would be expected to increase and more revenue expected to be shifted to the energy market as Special Case Resource penetration increases, those increases will materialize over time and be recognized over time.

### **E. Hypothetical Dispatch**

We have assumed that the peaking unit is bid into the Day-Ahead Market at a price which reflects the observed daily gas price and estimated variable O&M. If taken, the unit runs in those hours and earns operating net revenue equal to the difference between price and cost. We separately count starts and reduce net operating revenues by a startup gas cost.

In line with the engineering assumptions, we have assumed that the overhaul maintenance costs are captured in a variable O&M value, which implies that the maintenance is largely hours of operation, not starts per se. This assumption is not appropriate for the Frame 7 units upstate which run at capacity factors far more consistent with a dollars-per-start criterion. We have used \$15,289 per start to reflect the various possibilities for these units. In the Day-Ahead Market, any block of operating hours which fail to earn back this startup cost earn zero net revenues, reflecting either a rejection of the unit in that block of hours for Day-Ahead operation, or inclusion with a production cost guarantee to bring the unit to zero net revenues.

In the hours in which the unit is not dispatched in the Day-Ahead Market, it considers operation in the Real-Time Market. Hours accepted in the Day-Ahead Market are not available to accept a real-time price. We then calculate for other hours whether a profit could be earned on the real-time price, using daily gas prices just as in the day-ahead calculations.

We next adjust for startup time. If the unit was operating day-ahead in the previous hour, we allow it to continue running without an incremental start if the operating profit from the real-time price is positive, and allow it to continue running as long as the real-time profit is positive. If, however, the unit was not running in the first hour of positive net revenues, we again allow it to continue running for contiguous blocks of profitable operation, but subtract startup fuel costs and reduce the expected net revenue in the first hour by 50 percent in New York City and Long Island to reflect a 30 minute startup time. If the total value of the contiguous block is positive, we include those hourly net revenues.

This logic is not appropriate for the Frame 7 units owing to their high startup costs and the methods of guaranteed commitment at the NYISO. We have modified the commitment logic to reflect these factors. For blocks which abut a Day-Ahead commitment period, there is no change. For blocks which consist entirely of real-time hours, however, the block does not start until the entirety of startup costs is recouped in an hour.

Finally, we have included adjustments for ancillary service revenues for reserves and voltage support. The NYISO supplied us with average Ancillary Service revenues over the last several years. We have added these values in. They total about \$3.50/kW-yr. in NYC and about one third that Rest of State.

## **F. Results**

The results, excluding Ancillary Service revenues, are summarized in the Excel model, on the tab labelled “Energy Curve Raw”. Presented are the unit type and region, the margin above or below the capacity requirement, and aggregate net revenues, which can be broken down into real time and net Day-Ahead revenues, where startup costs are netted out of gross net revenues. The value for “tprofit” is the annual net energy operating revenue estimated per MW per year assuming constant annual capability. The adjustments further made to these values are as follows: 1) the values are

multiplied by the average of the summer and winter capability over the ICAP capability to adjust for the fact that all costs are stated per kW of ICAP and the unit will participate in energy markets at higher levels; 2) the energy profits which are from 2006 to 2009 are adjusted for three years of assumed inflation; 3) profits are reduced by the Equivalent Forced Outage Rate (EFORd); and, 4) the Ancillary Services revenues are added to the energy profits.

## **G. Other Considerations: Lake Erie Loop Flow and Recession/Weather Effects on Load and Other Miscellaneous Potential Adjustments**

### **1. Overview of Other Considerations**

In this section we will discuss several suggested adjustments raised during the stakeholder process. We determined that these adjustments were inappropriate, as an unadjusted quantification is superior to an adjusted quantification for the reasons discussed above. Nonetheless, in this section we discuss the specific proposed adjustments as they were raised during the stakeholder process and, although contrary to our recommendation that adjustments not be made to normalize or forecast, alternate views on that fundamental issue may well be held be reasonably held.

### **2. Lake Erie Loop Flow Reversal**

Some stakeholders have argued that the extraordinary conditions in the first half of 2008 resulting from scheduling patterns which caused Lake Erie loop flow to reverse ought to be adjusted for. The rationale is that the event was so extraordinary it will never be repeated. While that event may never be repeated, we hesitate to adjust even if we were inclined to make an adjustment. First, there is no obvious way to adjust. Second, extraordinary though the effects were, it is unclear that they were the cause of any material rise in compensation to peaking units upstate.

#### **a. How to Adjust**

The NYISO report and accompanying report from its market monitor give no insight as to how to adjust prices for this phenomenon. The reports discuss changes in uplift, not LBMPs. The Lake Erie loop flow reversal apparently affected mostly real-time prices in the early part of period, and Day-Ahead prices in the latter part of the period, with no clear line of demarcation. Hence, there is no obvious adjustment.



### **b. Would Adjustment be Significant?**

While it is true that May - July 2008 is the only May - July period with significant Day-Ahead revenues, the average Day-Ahead net revenues, even including this assumedly anomalous period, is only \$1/kw-yr. It certainly plausible that revenues this high in the Day-Ahead Market could possibly be this high absent the anomaly.

In the Real-Time Market, outcomes also are not clear cut. March and April 2008 had lower real-time expected net revenues than did the corresponding months in 2007, while January, February and May 2008 were larger than the corresponding months in 2007. While this data suggests that scheduling problems might have affected the markets, it is far from conclusive proof that other “anomalies” might not await in the future. Moreover, existing capacity cannot be prejudiced by not normalizing for this event as it was there to experience the event. New capacity will not be discouraged by not normalizing as it will be confident that events in the future, even ones in the opposite price-effect direction, will not be normalized, but that the Demand Curve will reflect actual market conditions as they evolve over time.

### **3. Gas Prices**

Gas prices in the historic period average \$8.00/MMBTU. This level is considerably above the average gas prices observed in the currently observed futures data, which suggests average prices in the next three years of approximately \$6.70/MMBTU. Some stakeholders have argued that we should adjust for this effect by using forward gas prices in the regression to simulate future price conditions in the market. They expressed this desire with an intuition that lower gas prices would lower profits.

We have experimented with implementing the requested change in gas prices and the results are just the reverse, at least for the Frame 7 units upstate. For the LMS100 units in New York City and Long Island, there is very little difference.

First it should be noted that adjusting prices hour-by-hour is not an uncontroversial process by itself. The obvious alternative is to simply substitute expected November 2010 gas prices for November 2006 prices, December 2010 gas prices for December 2006, and so forth. The problem here is that it actually matters. Looking at the futures, the highest expected future prices are three years out, while the lowest historic prices are in 2009. Thus, direct substitution creates a mix of

changes in which 2009 gas prices are raised quite a bit while 2006 and 2007 prices fall substantially. This alternative method creates changes in LBMPs which increase in some periods and fall in others. For peaking units which are highly sensitive to high gas prices, the effects are mixed.

Second, there is no measure of intramonth price volatility. The most sensible adjustment is to simply replicate the observed proportional pricing relative to the mean. This adjustment has the effect, however, of halving the standard deviation of gas prices and there is no obvious solution to this problem.

Third, the regression estimates demonstrate quite conclusively that the elasticity of LBMP changes with respect to gas price changes is clearly lower than one, so that a ten percent reduction in gas price yields much less than a ten percent reduction in LBMP. Thus, in high-priced hours in which peakers were earning profits before, reduction in gas prices increases profits substantially.

Fourth, while the regression results with respect to gas prices are quite sensible generally, the regression makes an odd prediction for November. For whatever reason, November LBMPs on average do not respond to gas prices at all, and in the early morning hours, the (insignificant) results are actually negative, in which higher gas prices lead to lower LBMPs. This problem is fairly easy to fix by constraining the November changes to zero, but represents yet another adjustment.

Adjusting LBMPs for changes in gas prices appears to be a mistake. What the experiment does demonstrate, however, is that the host of decisions which must be made to make *any* such adjustment ought to be approached with extreme caution, and fully justifies our decision in 2007 and revisited and applied again here, to make no adjustments other than adjustments to the observed reserve margin and the change to adjust for Special Case Resources which cannot be observed at excess reserve levels in the historic data.

#### **4. Recession/Cool Weather Adjustments**

While the adjustments to gas prices and for the Lake Erie scheduling effect promoted by stakeholders anticipating it would result in a decrease in expected profits, on the other side, stakeholders have argued for adjusting loads to reflect milder than expected summers in 2008 and 2009 and to adjust loads for the recession of 2009.

While it is clearly possible to imagine modelling which would elicit these effects, we are firmly of the belief that such adjustments cannot be implemented objectively enough to introduce additional clarity to the estimates. That said, we do believe that if we are going to make some adjustments, we probably should make all the adjustments we are capable of making, and it is certainly feasible to substitute higher loads, with concomitantly higher prices and profits into the equation, possibly by adjusting every hour's load upward by an amount representing some estimated shortfall from a long-term trendline.

We choose not to do so for exactly the same reasons we choose not to make any of the other adjustments we have discussed here.

### **5. Summary with Respect to Lake Erie Loop Flow, Gas Price and Recession/Cool Weather Adjustments**

While we recommend that none of these adjustments be made, we do note that if made the adjustments would go in both directions. It is unlikely that the net effect would be material and there would be considerable uncertainty with respect to the accuracy of such adjustments.

### **6. New York City Adjustments**

In the 2007 reset, several market participants raised the issue that the larger size of the LMS100 vis-à-vis the LM6000 makes it more likely that it will collapse prices in New York City load pockets if such a plant is built in a load pocket, and that these load pockets substantially contribute to the high level of prices in NYC. Thus, to simulate this effect, we have assumed that an LMS100, if built, will be connected at a 345kV bus and earn these rates rather than the average NYC zonal rate. Using Poletti as a 345kV connection (as did the market monitoring report) we find that prices in the 345kV system are, on average \$1.54/MWh lower than the NYC zonal price, so we have adjusted LMS100 dispatch to reflect this lower rate. Note that this adjustment does not mean that an LMS100 would necessarily be constructed to directly inter-tie with the 345kV system, only that wherever it chooses to locate, such prices would be likely to follow. We have continued this effect in the current reset procedure.

We have assumed that the units in NYC are dual-fuelled. We have once again ignored that distinction in our net revenue modelling. Fuel switching is an example of the phenomenon cited above in which more detail will not necessarily make the estimate more precise, but instead will

likely simply raise the noise level of the estimate. First, we have no idea how often generators will in fact be restricted from using gas; even if we knew, the results may be site-specific. Second, the shift to oil physically necessitates shutdown on conversion back to gas in order to clean the generating unit. Against this, there is a benefit from economic switching to oil should prices of oil fall sufficiently relative to gas prices. While in concept all of these (and other effects) might be measured, we have no confidence that our measurement of them would illuminate the ultimate question: what is the net energy revenue of a peaking unit in New York City? Errors in any part of these calculations are far more likely to introduce error than they are to improve the expected value of the estimate.

**Table III-1. Variables in the Regression Model**

lbmp      Zonal LBMP in \$/MWh

**Independent Variables:**

_cons	Indicator variable =1
dow	Indicator variable for day of week, 1=Monday, etc.
zone	Indicator variable for zone, 1=Capital, 2=Central, 3=Dunwood, 4=Genesee, 5=Hudson Valley, 6= Long Island, 7=Mohawk Valley, 8=Millwood, 9=NYC, 10=North, 11=West
tmin	Daily minimum temperature in degrees Fahrenheit
tmax	Daily maximum temperature in degrees Fahrenheit
load	Hourly zonal load for the hour in MW
aggload	Aggregate hourly NYISO load in MW
aggload2	aggload <sup>2</sup> divided by 10 <sup>8</sup>
aggload3	aggload <sup>3</sup> divided by 10 <sup>12</sup>
region	Indicator variable for region, 0=Rest of State, 1=NYC, 2=Long Island
h	Indicator variable for hour: 1=Midnight-1 am, 2=1 am-2am, etc.
m	Indicator variable for month: 1= January, etc.
lgasp	Natural logarithm of gasp price plus gas transportation cost in log \$/MMBTU
rm	Supplied reserves divided by required reserves, measured monthly

## H. Calibration

While there is no direct calibration available for the results, there are some comparisons we can make to test the reasonableness. First, the results are broadly similar to the results reported by the Market Monitoring Unit in its most recent State of the Market Report. The second is a comparison to PJM. PJM uses a three year historical period and actual prices. PJM measures over \$ 40 per kW

year in energy and ancillary service net revenues for a Frame 7 with an SCR and higher heat rate than that used in this study. While it is true that PJM's method makes no effort to dispatch considering risks of startup cost recovery, the result would indicate that the estimate we have developed is certainly in the zone of reasonableness. Third, the NYISO has had tight capacity years in the past; one such year was 2002. We have taken actual 2002 LBMPs and daily gas prices and determined the resulting net energy revenue for the 7FA unit. In this case, the Frame 7 Capital unit would have earned over \$23/kW-yr in the Day-Ahead Market alone. When a reasonable allowance is added for real time net revenue, this would further indicate that our total Day-Ahead and real time net operating revenue of \$ 25 per kW year is in the zone of reasonableness. In short, actual NYISO experience in a period with a relatively tight capacity market confirms that the Frame 7 net energy revenue estimate we make is reasonable.

## IV. Developing the Demand Curves and Calculating Carrying Charges

### A. Approach Overview

The Demand Curve Model is designed to find the annual CONE at the reference point that will provide for the full recovery of capital costs over a thirty-year capital recovery period, using the financial assumptions of a 50%/50% capital structure and 7.25%/12.48% debt/equity cost. The CONE consists of two items. First, an implied annual capital cost that will provide for the full recovery described above, recognizing that there will be a tendency to clear at capacity values above the reference value and at prices below the reference value, as well as a tendency in the long term to earn energy revenues consistent with a degree of excess capacity. And second, an energy offset based on energy revenues over the three-year reset period, assuming capacity levels at one-half of one percent above the minimum or target<sup>18</sup> capacity level.

The model allows for a wide array of scenarios by incorporating numerous variables that can be changed to accommodate different market conditions, target levels of capacity and Demand Curve shapes (intercept and kink). In addition, various regions (*e.g.*, New York City, Capital) and two types of generator units (LMS100 or Frame 7) can be simulated. This flexibility allows the user to compare the effect of a variable over multiple scenarios.

The model includes results for the Lower Hudson Valley. The Lower Hudson Valley is not a capacity zone and hence we have not incorporated results for the Lower Hudson Valley in this report. Were the Lower Hudson valley a capacity zone, the demand curve would be higher than the NYCA demand curve and lower than the New York City demand curve. Results for the Lower Hudson Valley are available in the model provided to all market participants. Interestingly, results for the LMS100 in the Lower Hudson Valley and the Frame 7 in the Capital Region with inter-zonal deliverability impacts added are very similar.

The model reports the CONE at the reference point, the implied annual capital cost, the carrying charge and the implied amortization period. The zero crossing point affects all these values. A lower zero crossing point (*i.e.*, closer to 100%) produces a shorter amortization period and higher carrying charge, as demand revenues go down faster for a given level of excess capacity.

---

<sup>18</sup> We use the terms minimum and target interchangeably when referring to installed capacity or installed reserve levels.

Many of the inputs to the Demand Curve Model requirements are based on judgment. The inputs used will be described below. As a result of the judgmental nature of the inputs, it is important to note that in selecting inputs, we are guided also by the result produced. The results produced using the current shape and slope of the Demand Curve show implied amortization periods of just over 20 years in ROS, just over 17 years in NYC and just over 15 years in LI. These results reflect measurable, but not extreme implied merchant risks. Were the zero crossing points closer to the origin, the amortization periods would decrease, raising the reference point to reflect added merchant risk.

## **B. Financial Parameters**

The development of financial parameters, the capital structure and costs of capital was an issue that received significant attention at the stakeholder meetings and that remains an area on which there is not a consensus. The review with stakeholders started at the April 22, 2010 ICAP Working Group meeting, where NERA proposed using a weighted average cost of capital (WACC) of 9.50% for merchant generators to establish the Demand Curve. This WACC was based on an assumed corporate capital structure for a generation company consisting of 50% debt and 50% equity with a 7.0% cost of debt and a 12.0% cost of equity.

The cost of debt was based upon a range of 6.50%<sup>19</sup> to 7.25%<sup>20</sup>, which reflected the average yield on long-term BBB and BB corporate bonds of 6.28% and 7.04%, respectively, as of April 15, 2010, adjusted upward slightly to reflect the likelihood that a merchant generator would be at the lower end of either ratings level.

The cost of equity was based upon a range of 10.33% to 13.26% derived using the capital asset pricing model (CAPM). The low end of this range was based upon a risk-free rate of 3.86% (10-year US treasury yield as of April 15, 2010) and an equity beta of 1.0 (equal to the beta used in the 2007 demand curve). The high end of the range was based upon a risk-free rate of 4.72% (30-year

---

<sup>19</sup> Federal Reserve Statistical Release. Selected Interest Rates (daily); Release Date April 16, 2010. Available at <http://www.federalreserve.gov/releases/h15/update/>.

<sup>20</sup> Factset, Barclays BB index US corporate bond yield (April 15, 2010).

US treasury yield) and an estimated equity beta of 1.32 for a generation company with 50% debt leverage. A market risk premium of 6.47% was used in each of the CAPM calculations<sup>21</sup>.

The 1.32 equity beta used for the high end of the range was based on the equity betas reported in the Value Line Investment Survey for AES, NRG, and RRI<sup>22</sup>. The Value Line beta for each of these companies was converted to an equity beta by adjusting to remove the effects of the actual financial leverage employed by each company. The average asset beta was then re-levered assuming a 50% debt ratio to determine the estimated equity beta consistent with the BBB credit rating assumption. The stakeholders have raised a number of issues concerning specific assumptions used in NERA's initial (April 22, 2010) proposal.

US Power Generating Company, NRG Energy (NRG), and TC Ravenswood (the "Responding Generators") contend that the cost of capital should be based upon a B credit rating to reflect the assumed rating for a stand-alone project, significant upfront fees should be included in the cost of debt, debt amortization should be sufficient to leave only \$150-\$200/kW of debt outstanding after a 7-year debt maturity, and the implied cost of equity after risk adjustments should be in the range of 16-18%.

The Transmission Owners, New York Power Authority, and Long Island Power Authority (the "TOs") state that the cost of capital should be based on a corporate capital structure that most likely will be used rather than a stand-alone project financing, the cost of debt should reflect a combination of bonds and lower-cost bank debt, and the equity beta should be no greater than the 1.0 used in the 2007 demand curve.

Competitive Power Ventures (CPV) believes that NERA's assumptions are reasonable for a project with a long-term power sales agreement, but asserts that a project with a shorter-term hedge (*e.g.*, 5 years) would require a lower debt amount, a higher debt cost and a higher ROE. CPV doubts that a pure merchant plant could be financed economically, if at all, due to even lower leverage potential, higher interest rates, and a higher equity return requirement.

---

<sup>21</sup> Ibbotson Associates Stocks, Bonds, Bills and Inflation 2008 Yearbook. (Long Horizon Equity Risk Premium from 1926 to 2008).

<sup>22</sup> The Value Line Investment Survey, Ratings and Reports, April 2, 2010.



Based on the feedback from the stakeholders, there were four major issues raised concerning our initial proposal. The issues, our analysis of the issues, and the approach we used in the Model are as follows:

**Corporate versus project financing** – We agree with the TOs that a merchant generator project would likely be financed on balance sheet as part of a larger corporate entity, rather than as a stand-alone project entity. Indeed, as noted by CPV, it is unlikely in the current capital market that this type of merchant project could be financed as a stand-alone project. As a result, we believe the best starting point for determining financing assumptions is to consider the capital structure and cost of capital for the publicly traded, unregulated generation companies with assets that are most similar to the demand curve unit project (*i.e.*, The AES Corporation (AES), NRG, RRI Energy (RRI), Calpine (CPN), and Mirant (MIR)). We also believe it is important to recognize, as the Responding Generators point out, that a stand-alone peaking plant is likely to involve greater business risk than the average of the assets owned by these generation companies. These business risks include development and construction risk (as compared with these generating companies, which have large portfolios of operating assets), the duty cycle of the plant (peaking unit versus portfolios of baseload, intermediate, and peaking assets), and the plant's pure market exposure (versus at least partial hedging of the power at most of the generation companies). While it is difficult to precisely determine the appropriate adjustments to recognize these risks, we recommend adopting a slightly lower debt ratio, slightly higher cost of debt, and slightly higher cost of equity than the observed values for the generation companies in order to establish the financial parameters for the peaking project that underlies the demand curve. We believe that it would not be reasonable to base the financial parameters on the narrow assumption of how a single project could be financed in isolation of a larger generation company. It is reasonable, however, to base the parameters on how a generation company could finance the project, allowing for a modicum of risk that may be unique to the peaker project. Hence, we use a merchant approach but not a stand-alone project approach. Note that we use as comparables companies that are predominantly in the electric generation business but are not affiliated with transmission and distribution companies. There are also a number of corporate developers of merchant generation that are part of entities that also have regulated transmission and distribution businesses. We do not use the generation companies that are affiliated with transmission and distribution companies as comparables because the financial parameters associated with their generation businesses cannot be observed separately in the market.

Below we provide the key financial parameters for the five publicly-traded generation companies listed above. Three of these companies have Standard & Poor's Financial Services, LLC (S&P) senior secured ratings of BB or BB+ (AES, NRG, and RRI), while the other two are very similar (CPN is B+ and MIR has a LT issuer rating of B+, equivalent to a senior secured rating of BB). We believe it is reasonable to focus on senior secured ratings since the project could be used as collateral in a bond financing. (see the Generation Company Ratings and Asset Betas table at the end of this section). These companies have an average debt ratio of 63% (excluding AES, which has a 74% debt ratio but is comprised of significant transmission and distribution utility and long-term contract assets). These debt ratios are based on market value capital structure ratios (market value of equity and, as a simplifying assumption, book value of debt). The average market value debt ratio is somewhat higher than the average debt ratio on a book value basis. The market value capital structure ratios are appropriate to use since we are attempting to estimate the market-required cost of capital. We believe it is reasonable to assume that these generation companies with approximately BB ratings could finance a peaking plant on-balance sheet using 50% debt without impacting their credit ratings. Consistent with this assumption, we recommend using a debt cost of 7.25%. This cost is based on the Barclays Capital index yield for BB US corporate debt of 7.04% as of April 15, 2010, adjusted upward slightly to reflect the higher risk associated with the project.

We have reviewed the terms of the recent \$1.3 billion term loan financing obtained by Calpine to finance its acquisition of 4,490 MW of generation assets from Pepco. This transaction is a relevant comparable because the assets are at least partially dependent on revenues from the capacity market. These assets face no construction risk, but construction risk is not likely a major differentiating factor since the construction risk associated with a peaking project is lower than for many other types of generating assets. The Calpine financing is a 7-year term loan priced at LIBOR plus 550bp with a 150bp LIBOR floor. While this pricing may appear high for a 7-year term, we note that the debt appears to fund over 78% of the purchase price. Given this high leverage, we do not believe this information suggests a higher cost of debt than we assumed for the peaking unit.

The Calpine financing also includes a debt amortization schedule that will reduce debt to approximately \$160/kW at its maturity. Since we are assuming in the demand curve that the financing is accomplished through an upstream corporate entity (that is, rather than on a project basis) and is long-term, we do not believe it is necessary to adjust the amortization to achieve a target debt per kW amount at the end of a hypothetical interim debt maturity. Instead, our

assumptions result in full debt amortization over the assumed life of the asset. It is worth noting, however, that the Calpine financing would leave the debt ratio at about 44% at maturity, or only modestly lower than our proposed 50% initial debt ratio assumption. We recognize that our amortization assumption would likely not be feasible with a bank loan or to finance a stand-alone merchant project. However, we do not believe that merchant implies project finance. Instead, we believe that the least cost financing option is likely to be the addition of the peaking unit to an existing merchant portfolio, albeit with a recognition of a somewhat higher cost of capital to compensate for the incremental risks.

The TOs note that merchant generation companies typically use a combination of bank and bond financing and argue that our proposal to use only bond yields overstates the cost of debt. However, we would point out that bank financing typically has a much shorter maturity than bond financing, so including a component of bank financing would require that we also assume that up-front fees are incurred at regular intervals (*e.g.*, every 5 years or so) during the life of the project. Bank financing would also involve interest rate risk during the term of the assumed loan unless we add the cost of an interest rate swap. Finally, bank financing would require an assumption about the level of interest rates at each refinancing. Since current short-term interest rates are well below the long-term average, it would be reasonable to assume higher rates for future refinancing of bank loans. Taking these considerations into account, we believe the all-in cost differential, if any, between bank and bond financing over the life of the project is likely to be much smaller than the difference between the initial annual interest costs of the two sources of financing might suggest. Since the long-term cost of bond financing can be more easily quantified using published data, we recommend using the BB index bond yield as the basis for the cost of debt.

The TOs exclude RRI from their estimate of beta because, in their view, its high equity beta skews the sample. We do not believe RRI should be excluded merely because it has a high beta. Including RRI, the companies in our sample have an average asset beta of 0.48. However, AES is the least relevant comparable since it has significant regulated transmission and distribution utility businesses and long-term contract assets that likely contribute to a lower asset beta than a merchant generation business. Excluding AES, the average asset beta would be 0.52 for the group of companies with primarily merchant generation business with diverse portfolios and some hedged output. See the Generation Company Ratings and Asset Betas table at the end of this section. To check this result, we also looked at a sample of other companies that own both regulated

transmission and distribution companies and merchant generation assets. The average asset beta for these companies is 0.46, which suggests that an asset beta in excess of 0.50 for a company primarily in the merchant generation business appears reasonable. Since it is reasonable to assume that the demand curve project would have a riskier business profile than the average of the merchant generation companies on the Generation Company Ratings table, we propose using an asset beta of 0.60 for the project. Adjusting this asset beta for 50% debt leverage (market value basis) results in an equity beta of 1.20, and a cost of equity of 12.48%.

Assuming a corporate financing structure and a credit rating of BB, we use a 50% debt ratio, 7.25% cost of debt, 12.48% cost of equity and a resulting WACC of 9.87% as the financing assumptions for the generation project underlying the Demand Curve.

We have elected to continue to base bond yields on data from April 15, 2010. This date in retrospect seems to be a time of relative calm in capital markets. While an update could be performed easily, it would reflect the potentially transient reaction to the euro and debt crisis in Greece. Additionally, there would be moves in different directions. Risk free interest rates have fallen, which would lower equity costs, while credit spreads have widened, which would raise the cost of debt.

The components of the WACC calculation are detailed below:

Debt/Capital	50%
Debt Cost	7.25%
Asset Beta	0.60
Equity Beta	1.20
Equity Risk Premium	6.47%
Risk-Free Rate (30 yr)	4.72%
Cost of Equity	12.48%

---

## Developing the Demand Curves and Calculating Carrying Charges

WACC	9.87%
Tax Rate (illustrative)	40.0%
Pretax WACC	14.03%

We believe that several areas still are the subject of disagreements. First, the Responding Generators view their cost of equity as considerably higher than 12.5%. However, it is important to note that had we assumed the project could be financed using 63% debt (equal to the average of the sample generation companies excluding AES), the cost of equity would have been 15.21% due to the greater financial leverage. The cost of equity is very sensitive to the level of leverage. So while they may be correct that they face much higher costs of equity, we believe that leverage explains the difference. If we assumed 63% debt leverage and a 15.21 % equity costs, the pre-tax WACC (which is the value that is reflected in revenue requirements) would have been 13.95% in that case due to the lower equity component and smaller allowance for taxes. Hence to the extent that the Responding Generators concerns over the cost of equity are based on actual leverage for these companies, adjusting for the leverage and raising the costs of equity to 15.21% would in fact lower not raise carrying charges. Second, the Responding Generators remain dissatisfied with the degree to which individual merchant project risk is reflected in the financing assumptions. The TOs are also dissatisfied from the opposite perspective, suggesting that when using CAPM, all non diversifiable risk is accounted for through the observed beta. While our recommended approach relies heavily on CAPM and represents non diversifiable risks through betas, we do believe that is reasonable to allow for the peaking unit potentially adding some additional risk to the portfolio of the merchant generators that we observe. We have adjusted for this incremental risk by shading the beta to 0.6 and using the higher end of the range of BB debt costs.

## Generation Company Ratings and Asset Betas

Company	S&P LT Issuer Rating	S&P Sr. Sec. Rating	Capital structure (\$MM)					Equity Beta	Asset Beta
			Equity Mkt Cap	ST Debt	LT Debt	Total Debt	Debt/Cap		
<u>Generation Companies</u>									
AES	BB-	BB+	7,353	2,336	18,306	20,642	74%	1.20	0.32
NRG	BB-	BB+	5,474	152	7,846	7,998	59%	1.15	0.47
RRI	B+	BB	1,304	401	1,950	2,351	64%	1.65	0.59
CPN	B	B+	5,266	305	9,239	9,544	64%	1.11	0.39
MIR	B+	n/a	1,563	26	2,538	2,564	62%	1.63	0.62
Average							65%		0.48
Average ex AES							63%		0.52
<u>Hybrid Utilities/Generation Companies</u>									
AYE	BBB-		3,900	167	4,398	4,565	54%	0.95	0.44
CEG	BBB-		7,060	78	4,220	4,298	38%	0.80	0.50
D	A-		24,670	1,549	15,364	16,913	41%	0.70	0.42
EXC	BBB		28,931	1,712	11,198	12,910	31%	0.85	0.59
FE	BBB-		11,916	2,669	11,847	14,516	55%	0.80	0.36
PPL	BBB		10,472	589	7,652	8,241	44%	0.70	0.39
PEG	BBB		14,936	267	7,906	8,173	35%	0.80	0.52
Average							43%		0.46

### Notes:

- Ratings from standardandpoors.com (retrieved June 1, 2010)
- Equity market capitalization and debt from Bloomberg.com as of March 31, 2010
- Equity betas from Value Line (April 2, 2010 and May 28, 2010), except for CPN and MIR which are from Yahoo Finance (not covered by Value Line)
- Assumes debt beta = 0

### **C. Model Description**

The Demand Curve Model works by simulating revenues and expenditures given a set of input parameters, energy functions, the region and the type of unit. The revenues are cash flows that the owner of a new unit would expect to receive over the thirty-year economic life of the unit.

Similarly, the expenditures represent expenses and the required return on equity and debt. The Model solves for the Demand Curve by finding capacity payments (also referred to as demand payments in the model) that satisfy the zero supernormal profit criteria (revenues equal expenditures). Supernormal net revenues are those above the normal cost of equity capital.

A new generating unit can expect to receive revenues from two main sources. Energy and ancillary service net revenues represent sales in the NYISO energy and Ancillary Service markets. These net revenues are modeled using a Monte Carlo analysis. The model uses the user-defined expected value and standard deviation of supply to generate 100 possible values for capacity. These capacity values are put through an energy and ancillary service net revenue function. The function is region- and unit-specific and calculates expected energy and ancillary services net revenue given a level of supply. The revenues will be lower when there is surplus capacity and higher when there is not enough capacity. The model is designed to simulate this scenario and to adjust the Demand Curve so that, given an expectation of surplus capacity, the new entrant will be able to fully recover costs over thirty years.

Demand payments approximate payments the owner of a new unit could expect to make through NYISO ICAP auctions. Like the energy and ancillary service payments, they are determined through a Monte Carlo analysis. User-defined parameters are used to determine possible values for supply in the auction from which an expected capacity value payment is derived. Since these payments are simulated by the Demand Curve, which is also an output of the Model, the demand payments are endogenous to the Model. For this update we have added to the model a Summer Capability Period and Winter Capability Period demand simulator. We compute Summer and Winter demand revenues using the NYISO formula to adjust the annual Demand at Reference to a Demand Curve Monthly value. We then simulate forecast demand revenues against this curve clearing at Summer and Winter capacity values.

Expenditures are fixed O&M, property tax and insurance, and levelized fixed charges (carrying charge). Fixed O&M and property tax and insurance are defined by input parameters and the cost of new entry. The carrying charge is calculated by Sargent & Lundy assuming a 50% debt share cost of capital at 7.25% and a 50% equity share at 12.48%.

From these revenues and expenditures, a Demand Curve is derived such that revenues equal expenditures (binding constraint). As the Demand Curve in part determines demand payments, which is one of the sources of revenue, the model solves for both using a goal seek.

Once the model solves for the Demand Curve, it calculates net revenues as percentage of the cost of new entry. The model then looks up the amortization period that matches this percentage in the table of levelized fixed charges. The real levelized carrying charge is determined using this amortization period.

While the approach is complex, we believe the complexity is necessary. Although a new peaking unit will likely physically last thirty years or more, investors will use a shorter time horizon in determining the levelized cost. PJM uses a single assumption of 20 years in setting CONE. A single assumption is not suitable for the NYISO as the NYISO is commonly acknowledged by stakeholders to have a bias toward excess and that bias presents different risk depending upon the shape and slope of the Demand Curve. Hence, we believe that a model that considers the interaction between the Demand Curve shape and slope and the amortization period is required.

#### **D. Model Inputs**

The model's thirty plus variables can be broken down into the following categories:

**Demand curve** variables determine the x-axis intercept of the curve and can also be used to kink the Demand Curve.

As described later, we believe that it is appropriate to continue using the existing shape and zero crossing point and use 112% for NYCA and 118% for NYC and LI.

**Technological progress** variables can be used to determine how the cost of new entry increases or decreases over time.



The DOE forecasts roughly a minimum learning effect by 2015 for combustion turbines of 5%. This minimum per year improvement equates to an annual value of 0.325%. We round to 0.25% to allow for non technical factors that may go in the other direction.

**Plant** variables determine the location, type and performance of the generating unit and are used to select the appropriate cost of new entry from those provided by Sargent & Lundy.

**Residual value** is the value of the unit at the end of the thirty-year life. For aeroderivatives, we use a residual value of 5% of the initial investment. We use no residual value for the less efficient Frame units.

**Monte Carlo** variables are used to calculate expected values for demand payments and energy and ancillary service revenue. These values are the average percent excess and the standard deviation of that excess. We develop these values by first multiplying the ICAP of the peaking unit by 1.5 and then dividing that value by the minimum capacity requirement for the region. This results in a capacity of roughly 600 MW for ROS and 300 for NYC and LI. After dividing by the locational minimum capacity and rounding to a number in 0.5% increments, we determine a ROS average excess of 1.5%, a NYCA average excess of 3.0% and a LI average excess of 7.0%. We set the standard deviation at half these levels to reflect the assumption that there will be only a 2.5 percent probability the market will actually be short. The new element of this method is that we tie the excess percentage assumption to the size of the peaker addition. The excess percent variable is intended to model the bias toward excess associated with strong reliability signals that would prevent the market from going short on capacity. As noted above, not all RTOs have this bias. PJM has no special procedures to ensure that its RPM auctions provide for capacity above the target capacity, although PJM does set its RPM Demand Curve so that CONE is at a value 1% above the target capacity level – a value in PJM’s market roughly 1,500 MW over the required capacity level. New York has strong preference for ensuring capacity adequacy and will take measures to make sure the market is not short. We believe that it is reasonable to tie the excess to the proxy peaking unit as it is the proxy peaking unit that would represent the efficient addition to maintain reliability. We believe it is reasonable to use 1.5 times the peaking unit as the average level of excess given the conservatism attendant to ensuring that the market has at least the minimum amount of capacity. We also note that actual capacity excesses shown in the table below are much greater than the average level we assume. This modeling assumption is appropriate as we are not attempting to hold

the entrant harmless from excess capacity that results because load growth slows, developers enter the market even with an excess or technologies other than the peaker are the lowest net cost. The NYISO tendency to not allow the market to go short is the only factor we adjust for.

<b>Summer Average</b>									
<b>Monthly Excess Percent</b>									
	<b>2003</b>	<b>2004</b>	<b>2005</b>	<b>2006</b>	<b>2007</b>	<b>2008</b>	<b>2009</b>	<b>Avg</b>	<b>stddev</b>
<b>NYCA</b>	6.56%	9.63%	9.60%	6.92%	6.85%	8.45%	8.08%	8.01%	1.29%
<b>NYC</b>	0.00%	2.54%	3.50%	2.91%	3.10%	10.50%	8.54%	4.44%	3.69%
<b>LI</b>	8.70%	3.50%	3.72%	8.52%	8.63%	13.76%	12.27%	8.44%	3.87%

<b>Winter Average</b>									
<b>Monthly Excess Percent</b>									
	<b>2003</b>	<b>2004</b>	<b>2005</b>	<b>2006</b>	<b>2007</b>	<b>2008</b>	<b>2009</b>	<b>Avg</b>	<b>stddev</b>
<b>NYCA</b>	7.50%	9.45%	11.17%	9.73%	8.92%	9.33%	10.94%	9.58%	1.24%
<b>NYC</b>	6.84%	7.34%	8.88%	10.33%	11.15%	15.21%	17.62%	11.05%	4.03%
<b>LI</b>	1.82%	4.72%	7.48%	8.86%	13.07%	14.98%	19.71%	10.09%	6.20%

As can be seen from the above, NYCA (ROS) has on average been 8.75% excess. The excess parameter in the model is 1.5% with a 0.75% standard deviation. The excess adjustment is clearly not designed to compensate for actual excesses, but only for excesses that will occur near the minimum installed capacity requirement.

**Regulatory Risks** – the Demand Curve is an administered value subject to regulatory risk. We assume no percent probability that the Demand Curve will yield only 50% of the required revenue. Regulatory risks include items such as regulated rate-supported long-term contracts that may be added even when there are surpluses or to create surpluses. While regulatory risks are certainly plausible and we allow for them in the model, the NYISO Board did not believe in 2007 that such risks should be accounted for in the Demand Curve.

**Energy function** variables can be used to change the shape of the energy function and can also be used to change the way energy and ancillary service net revenues in the first three years are calculated.

The energy net revenue functions are described in Section III. In developing the recommendation, we use an energy and ancillary service net revenue offset at 100.5% of the target installed capacity level. Essentially, we assume energy net revenues at this level for the first three years. As noted

above, we have adjusted for ancillary service net revenues for voltage support by adding \$1.18 per KW year. For NYC and LI we add \$3.66 per KW year and \$1.71 per KW year to reflect slightly higher voltage support payments as well as 10 minute non spinning and for 30 minute reserves.

**Property taxes** for NYC may be used with or without tax abatement. The effect is very significant. We model the without tax abatement scenario using the ICIP tax abatement from the 2007 reset, which is 11 years of zero property tax, and a 20% per year phase in to full property tax at year 16. This scenario and the no abatement scenario use the current effective rate of 4.69% of plant value. The ICIP program no longer applies to generation units. We use it only as a proxy of potential abatement to illustrate the impact. Our understanding is that the NYC EDC is currently considering an abatement policy that may apply to new generation and that the NYISO Board will review any policy that is developed and determine its applicability to the proxy peaking units. In the event that a policy is not developed, we would anticipate that the without abatement results would apply. In the event an abatement policy is developed that would provide a different incentive than the ICIP, we anticipate that the Model would be revised to reflect the new abatement policy. To facilitate such a revision to the Model, we have added an option to the Model that allows the user to use the carrying charge input without property taxes and to input annual property taxes for 30 years. This feature enables modeling of any incentive that may be developed. It was not necessary to use this feature in developing this report.

**Deliverability** – the technology-specific estimates developed by S&L all include system upgrade costs. These costs do not, however, include deliverability including the inter-zonal deliverability associated with crossing the UPNY/SENY interface. In order to participate in the capacity market a unit must be deliverable to all zones in the Capacity Region as defined in NYISO Services Tariff Attachment S (Zone J, Zone K and all Zones other than J and K collectively as a single region). Currently new units north and west of UPNY/SENY could not deliver to Zones G to I and hence could not participate in the capacity market for ROS without obtaining deliverability. The NYISO has determined that the cost of deliverability is an investment of \$178 per kW. This is roughly 20% of the non-deliverability investment in a Frame 7 in the Capital region. The model has been constructed to add deliverability as a separate line item and we report NYCA results both with and without deliverability. We have been advised by NYISO that the decision on how deliverability will be reflected in the reset Demand Curves is under consideration by NYISO.

## **E. Analysis of Results**

The implied amortization period for ROS is 20.5 years. The implied amortization period is 17.5 years for NYC and 15.5 years for LI. For reference, the ROS carrying charge at 10 years is 19.19%. The function begins to flatten at 15 years where the value is 15.46%, but is sharply sloped prior to that point and more gradually sloped after that point, much like a mortgage. At 20 years the carrying charge is 13.57% and it declines to 11.84% at 30 years and 11.41% at 35 years. While some may argue that supplier risk should have an even greater impact on the amortization period and carrying charge than we allow, there are several factors that argue against this. First, there is the desire to maintain continuity. As the Demand Curve becomes more established and parameters are not arbitrarily or opportunistically changed, risk perceptions should decrease. An implied capital cost based on an amortization period of 20 years in ROS is consistent with relatively low risk. From the buyer's perspective, reducing risk to a reasonable level would be better than increasing price and risk. The somewhat lower amortization periods in NYC and LI are appropriate given the greater risk of smaller markets. Hence, assuming market risks are reasonably modeled the resulting amortization periods are an indication that the price result is reasonable and the system is producing a reasonable risk/price balance. Additionally, the Demand Curve must be sustainable. While the Demand Curve could be established based on a higher degree of risk and require prices that implied shorter amortization periods such as those associated with 10-year amortization, such prices would probably be unsustainable in equilibrium. For example, at a very steep slope, the amortization period would drop as low as 10 years. We see little value in developing a Demand Curve that is not reasonably sustainable. The entire package of results from this reset including the reference price levels, the shape and slope and the implied amortization levels all form a package that is sustainable and should induce entry when required.

## **F. Demand Curve Shape and Slope Recommendations**

The Demand Curves that are recommended for each technology and region have been presented in the Executive Summary. We have not recommended changing the Demand Curve zero crossing points or slopes. We use the term slope to refer to the zero crossing point.

The method that we use to develop the demand curve produces curves that contain a consistent slope and reference point that are expected to yield the same present value of revenue to generators

as any other consistent combination given the tendency toward not letting the market go short. Hence, if we increase the zero crossing point we would reduce the reference point and vice versa. These consistent combinations also yield the same expected value of payments to generators. Hence, alternate zero crossing points would all have the same price impact. As the zero crossing point is moved in towards the origin, the reference price will rise and as the zero crossing point is pushed away from the origin, the reference price will decline. With neither buyer cost nor generator revenue a deciding factor, the basis for slope selection is narrowed.

One criterion for slope selection in the past has been market power. As NYISO has made considerable progress in mitigating market power in NYC and monitoring capacity bids in other areas, we do not believe that market power is any longer a driving rationale for slope and shape determination.

We do remain concerned, however, that moving the zero crossing point towards the origin increases the importance of having accurate information on the average excess level and standard deviation. With a steep slope, if there is an understatement of the average level of excess and standard deviation, the demand curve will be under-compensatory and sufficient capacity may not develop. Similarly if there is an overstatement of the average level of excess, a steep slope will exaggerate the required increase in demand at reference. Steeper slopes increase risk and uncertainty for both the buyer and seller. Steeper slopes can also be counterproductive if a little excess in additions or a decline in growth leads to clearing at prices well below the reference point. At such prices, retaining existing plants may be difficult as the economics of mothballing and retirement could become attractive for older marginal plants. To the extent that such scenarios occur, any decrease in payments that would arise from a steeper slope may well be offset by retirements or mothballing. The same applies to Special Case Resources: in 2009 there were over 2500 MW of Special Case Resources. Capacity excess levels in 2009 were on average in excess of 9, 13 and 14 percent in ROS, NYC and LI, respectively. Changes in the slope and shape which reduce the capacity price at these excess levels would be expected to lower Special Case Resource participation.

Most importantly we look at the rationale underlying the Demand Curve construct. The Demand Curve is designed to induce new capacity when required by supplementing the shortfall in the energy market and providing a reasonably predictable stream of revenue to new generators based on the entry costs of a new peaking unit. The payment is set exactly to that level at the target capacity

level and to a linearly higher level at lower capacity values and a linearly lower value at higher capacity levels. As the value of capacity on either side of the target is not linear but exponential, the Demand Curve was clearly not constructed to approximate the value of capacity, but to reduce the volatility of capacity payments and to provide a framework for encouraging investment. Although it may be possible to change the slope and still provide proper investment signals, it would also need to be recognized that steeper slopes increase risk and entry costs. The slopes in the current demand curves are reasonable as they result in implied amortization periods just over 20, 17 and 15 years in NYCA, NYC and LI, respectively, resulting in sustainable market system. Note that despite the more gradual slope in NYC and LI, the risk evidenced by the implied amortization period is actually greater due the size of the respective markets. We hesitate to recommend slopes that yield shorter implied amortization periods. Much like a mortgage payment, the annual cost begins to flatten out at 15 years and by 20 years is in a gradual trajectory toward its lowest point. Hence, slopes that yield amortization periods of 15 to 20 years are as steep as is advisable if the point to develop a reasonable cost of entry and a sustainable market system. We note that PJM uses a single assumption of a 20 year amortization period. Hence, we conclude that the current slopes should not be increased by moving the zero crossing point toward the origin. Further, even if the amortization periods were indicating implied amortization periods that equaled or exceeded 30 years and indicated room to adjust the slope, we would not recommend such an adjustment at this time. As we show above excess capacity levels for 2009 are already near the zero crossing point. We would expect that similar levels would apply in the reset period. Adjusting the curve to steepen the slope when it is almost certain to depress revenues would appear opportunistic and would likely undermine confidence in the objectivity of the capacity market. Any significant adjustment to the slope is best done at a time when the immediate impact will be relatively neutral so that it is clear that the adjustment is being made to improve the market not to reach a desired outcome. In summary, we recommend against any adjustments to the slope of the Demand Curve as the implied amortization periods produced by the current slopes are reasonable, and would, even if the desirability of an adjustment was observed, recommend deferring it until such time as the impact would be relatively neutral.

The same applies to the shape of the curve. While a kink could be placed in the curve beyond the point where the model recognizes excess and the amortization period unaffected, a kink in the curve which would reduce capacity payments beyond the kink point would clearly be expected to

significantly lower capacity revenues during the reset period. This is the case because the average 2009 ROS excess of 9% would likely be well beyond any kink that has a zero crossing point at 12%, the average NYC and LI excesses of 13% and 16%, respectively, would be beyond any kink that has a zero crossing point of 18%. A kink would be nearly certain to lower capacity payments. As past investment was induced without such a kink we view this as opportunistic and likely to add significantly to investment risk. We recommend that the implementation of a kink be considered when the near term impact would be neutral. Further, we are concerned over the stability of the price signals particularly for Special Case Resources. The impact of a kinked Demand Curve, which could result in sharp changes in capacity clearing prices around the kinked point could result in a non stable price environment and discourage these resources. While the kink feature remains in the model, we recommend that it be used with caution as the way in which NYISO translate an annual net costs to the Demand Curve reference point with a kink is not known.

## **V. Sensitivity Analyses**

Numerous sensitivity analyses were conducted using the Demand Curve and carrying charge model in order to identify variables that would have a significant impact on results. Further, the model is available to stakeholders to conduct sensitivities. Two related variables and one interacting variable dominate the assumption sensitivities. Those variables are the standard deviation of capacity relative to the installed capacity level and the average installed capacity level relative to the required level. Relatively small changes in those variables have a significant impact on results. For all other variables, except slope, impacts are moderate.

For example, the ROS demand at the reference point with deliverability is \$116.50/kW-year using a 0.75% standard deviation and 101.5% average capacity level and the amortization period is 20.5 years. If we use a standard deviation of 1.5% and an average capacity level of 103% the price rises to \$139.15 and the amortization period changes to 14.5 years. If we use a 100.5% average capacity level and standard deviation of 0.25%, the price drops to \$104.71 and the amortization period increases to 25.5 years. While we have selected variables for these values that are both plausible and consistent with the NYISO's Reliability Needs Assessment process and that produce results that introduce a reasonable but not excessive degree of merchant risk, we do not claim that they are the only plausible values for these variables. We are guided in the selection of these variables by the results that they produce and as discussed above believe an implied amortization period of just over

20 years for ROS is sustainable. We then use the Demand Curve Model to produce results that are consistent with and responsive to other assumptions – for example, the Demand Curve zero crossing point and technical progress assumption.

We have tested all key assumptions. We provide here examples for NYCA. Moving the NYCA zero crossing point to 108% from 112% would increase the reference value by \$14.89/kW-year assuming deliverability and reduce the amortization period by 4 years. Increasing the technical progress rate to 0.5% would increase this reference point by \$3.22/kW-year. In sum, most input variables or assumptions have a moderate impact. The primary exceptions are the average capacity levels and the slope of the Demand Curve.

As we have provided the model to the stakeholders to enable them to conduct their own sensitivities, we do not summarize all the sensitivities herein.



## **VI. Appendices**

### **A. Appendix 1 – Construction Cost and Unit Operating Cost Details**

Appendix 1 provides more detailed information about the capital and operating costs and performance characteristics of the peaking technologies evaluated in this study.

Table A-1, Figures A-1 through A-9, and Table A-2 provide information on the capacity and heat rates for the LMS100, 7FA, and LM6000 PG and PH Sprint, and Trent 60 as a function of elevation, temperature, and humidity. Figures A-1 through A-9 show capacity and heat rate at 60% relative humidity and mean sea level. Table A-2 provides capacity and heat rate information by technology and by location in tabular form. It also shows data for outage rates, start fuel, annual fixed O&M cost, annual site leasing, property taxes and insurance costs, and variable O&M costs.

Tables A-3 through A-6 provide capital cost estimates for each technology by location. Cost breakdown is provided for both EPC and non-EPC costs. The definition of most cost categories is self-evident. Owner's Project Management and Miscellaneous Engineering refers to the cost of preliminary engineering, owner's engineer during construction, and general oversight. Owner's Development Costs refer to the owner's internal costs for all development activities from the initial feasibility studies through start-up. Financing Fees are sometimes built into the interest rate, but here are explicitly broken out.


Tables A-7 through A-9 provide a comparison of LM6000 and 7FA capital cost estimates for this study with the published cost estimates of the previous Demand Curve Resets (DCR) in 2007 and 2004. Cost categories from this study and the 2007 DCR have been aligned with the 2004 study report as best as possible. Table A-10 compares capital cost estimates from this study and the 2007 DCR for the LMS100 in New York City.

Tables A-11 through A-13 provide a breakdown of EPC costs for the LMS100 in New York City and Long Island and for the 7FA in Albany. The EPC Project Cost shown in Tables A-11 through A-13 correspond to the Subtotal – EPC Costs for the same estimate in Tables A-3 for the LMS100 and Table A-4 for the 7FA.


**Table A-1 — Site Assumptions for Capacity and Heat Rate Calculations**

Load Zone	Weather Basis	Elev. (Feet)	Season	Ambient Temp. °F	Relative Humidity
C - Central	Syracuse	421	Summer	79.7	67.7
			Winter	17.3	73.7
			Spring-Fall	59.0	60.0
			ICAP	90.0	70.0
F - Capital	Albany	275	Summer	80.7	67.2
			Winter	15.3	70.7
			Spring-Fall	59.0	60.0
			ICAP	90.0	70.0
G - Hudson Valley	Poughkeepsie	165	Summer	82.3	77.7
			Winter	19.3	74.0
			Spring-Fall	59.0	60.0
			ICAP	90.0	70.0
J - New York City	New York City	20	Summer	83.0	64.3
			Winter	28.0	61.7
			Spring-Fall	59.0	60.0
			ICAP	90.0	70.0
K - Long Island	Long Island	16	Summer	80.7	69.3
			Winter	28.0	66.2
			Spring-Fall	59.0	60.0
			ICAP	90.0	70.0


**Figure A-1 — LMS100 PA: Net kW vs. Ambient Temperature**  
**Average Degradation, 60% Relative Humidity**

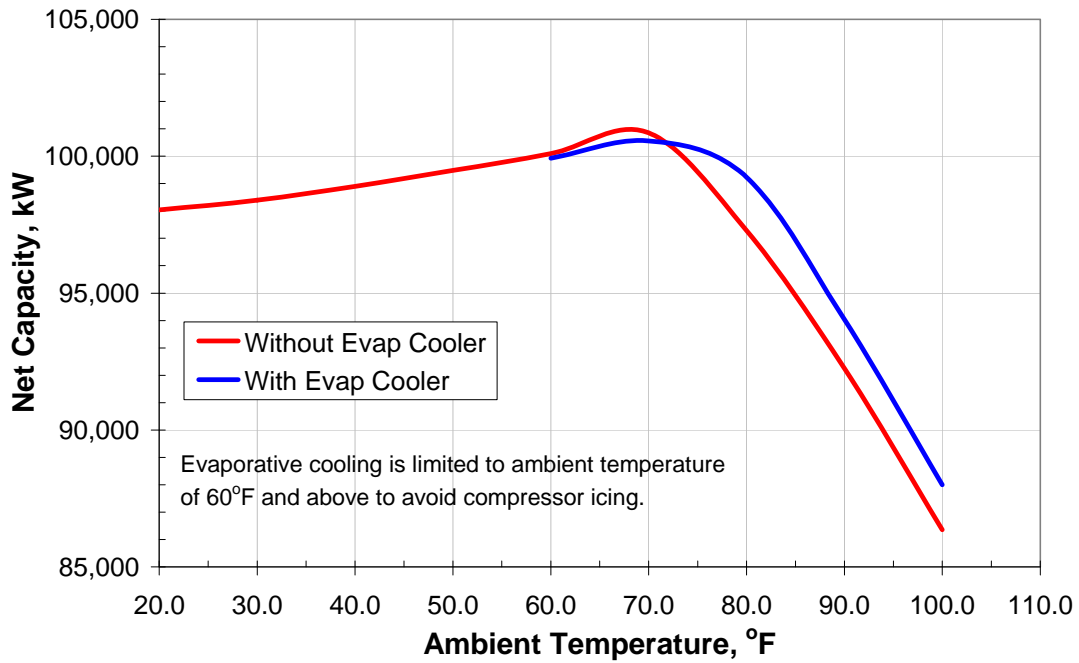


**Figure A-2 — LMS100 PA: Net Capacity vs. Net Heat Rate**  
**Average Degradation**

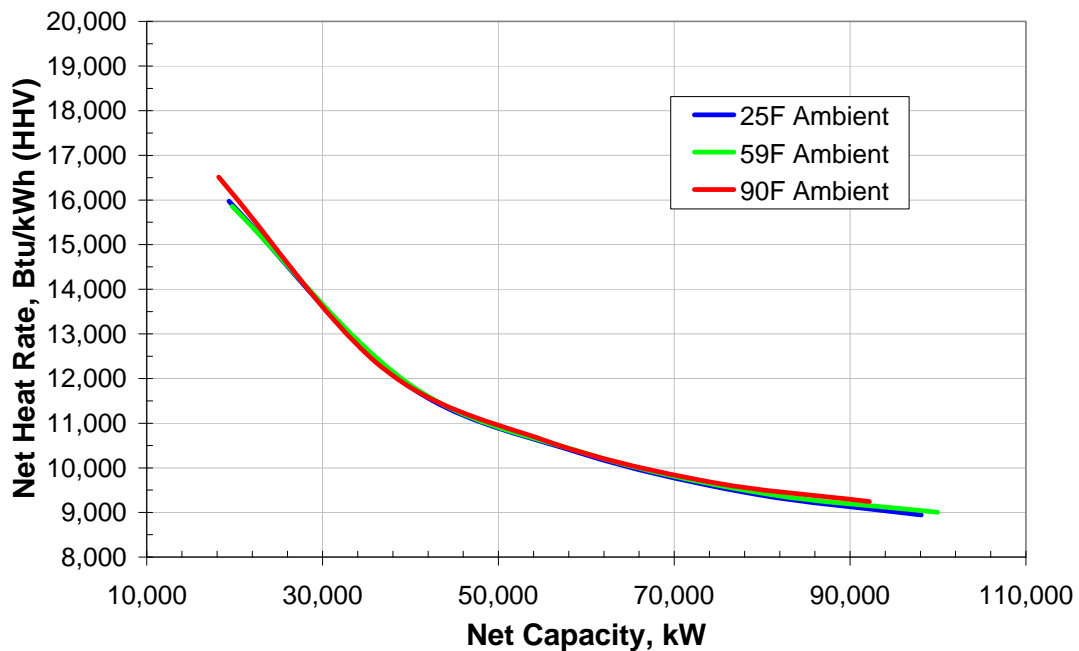


**Figure A-3 — 7FA.05: Net kW vs. Ambient Temperature**  
**Average Degradation, 60% Relative Humidity**

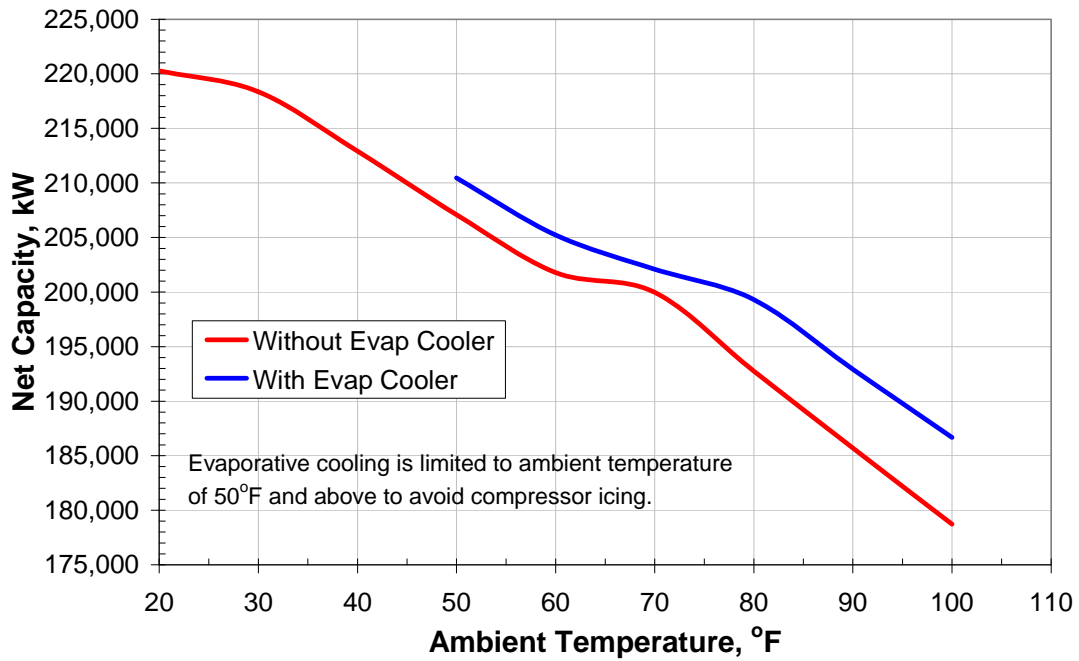


**Figure A-4 — 7FA.05: Net Capacity vs. Net Heat Rate**  
**Average Degradation**

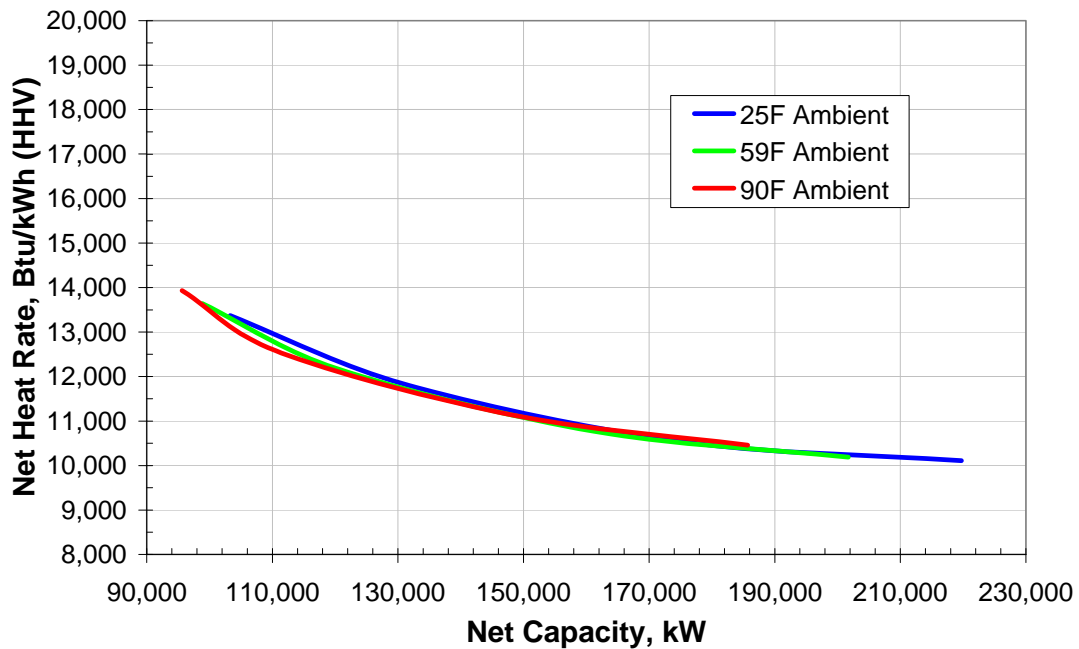


**Figure A-5 — LM6000 PG Sprint: Net kW vs. Ambient Temperature**  
**Average Degradation, 60% Relative Humidity**

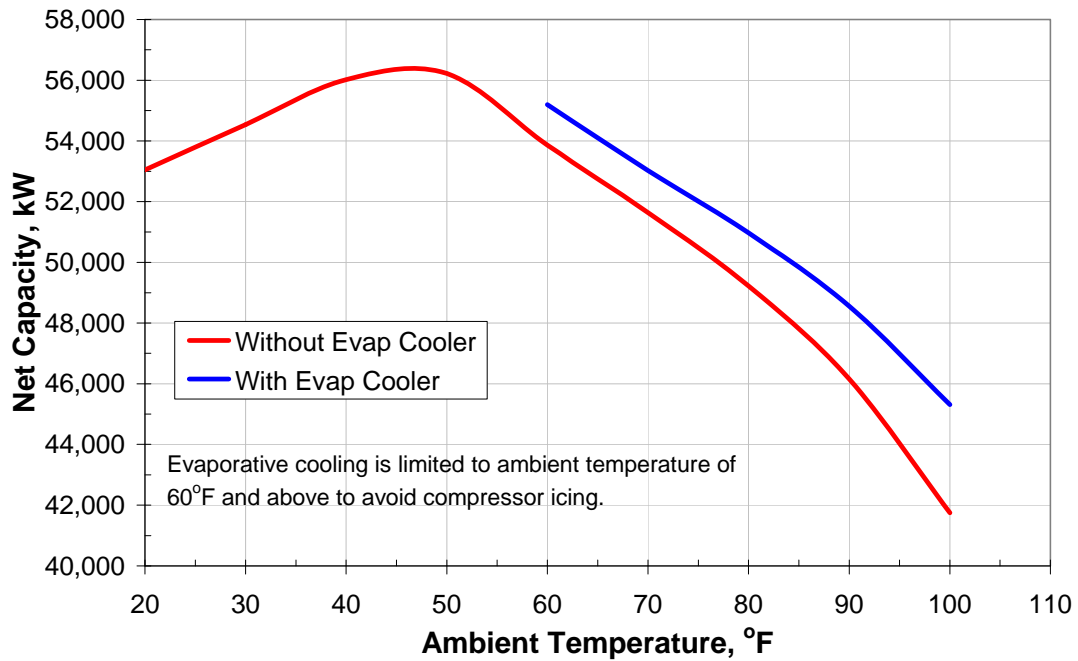

**Figure A-6 — LM6000 PG Sprint: Net Capacity vs. Net Heat Rate**  
**Average Degradation**

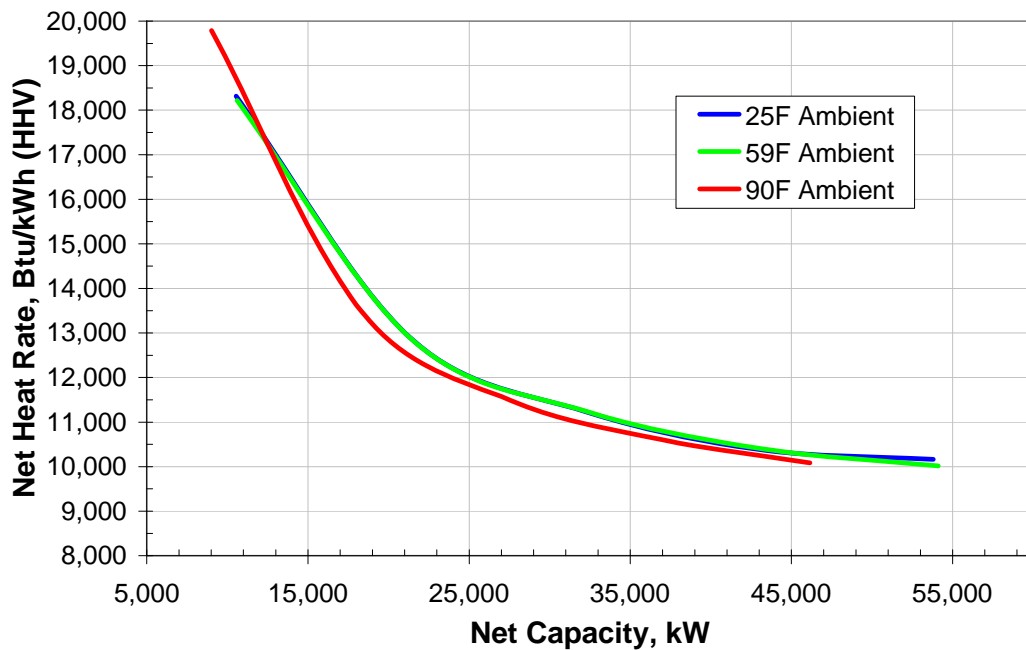


**Figure A-7 — LM6000 PH Sprint: Net kW vs. Ambient Temperature**

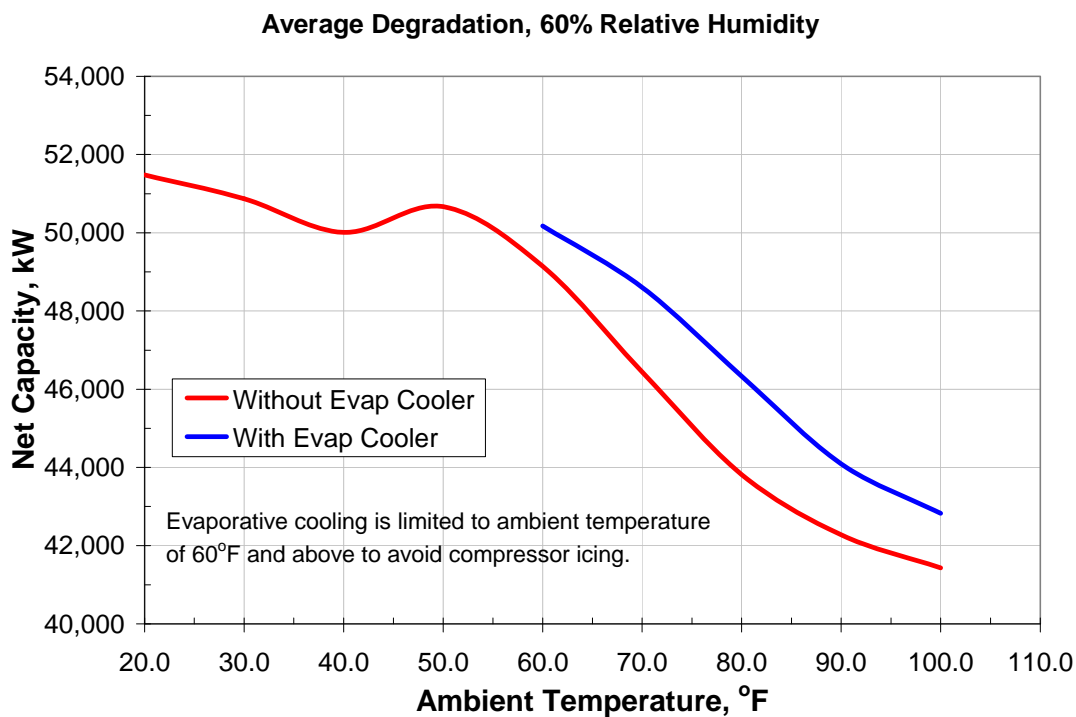


**Net Heat Rate vs. Net Capacity Curve for the LM6000 PH Sprint is not available from GE.**

**Figure A-8 — Trent 60 WLE: Net kW vs. Ambient Temperature**

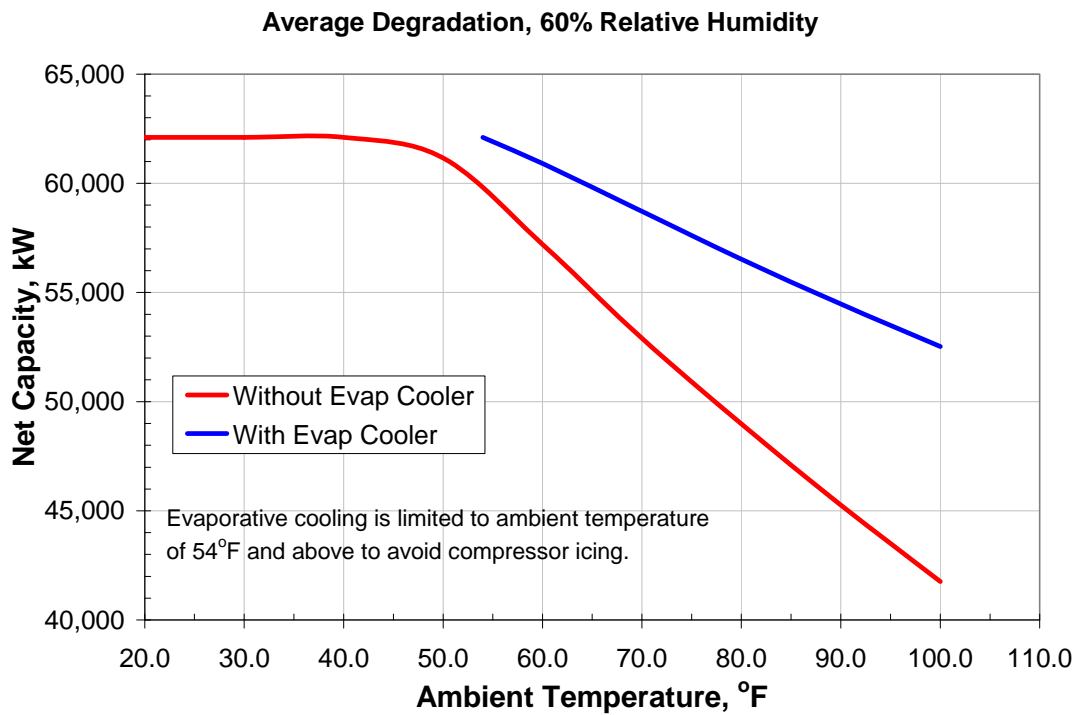

**Figure A-9 — Trent 60 WLE: Net Capacity vs. Net Heat Rate**

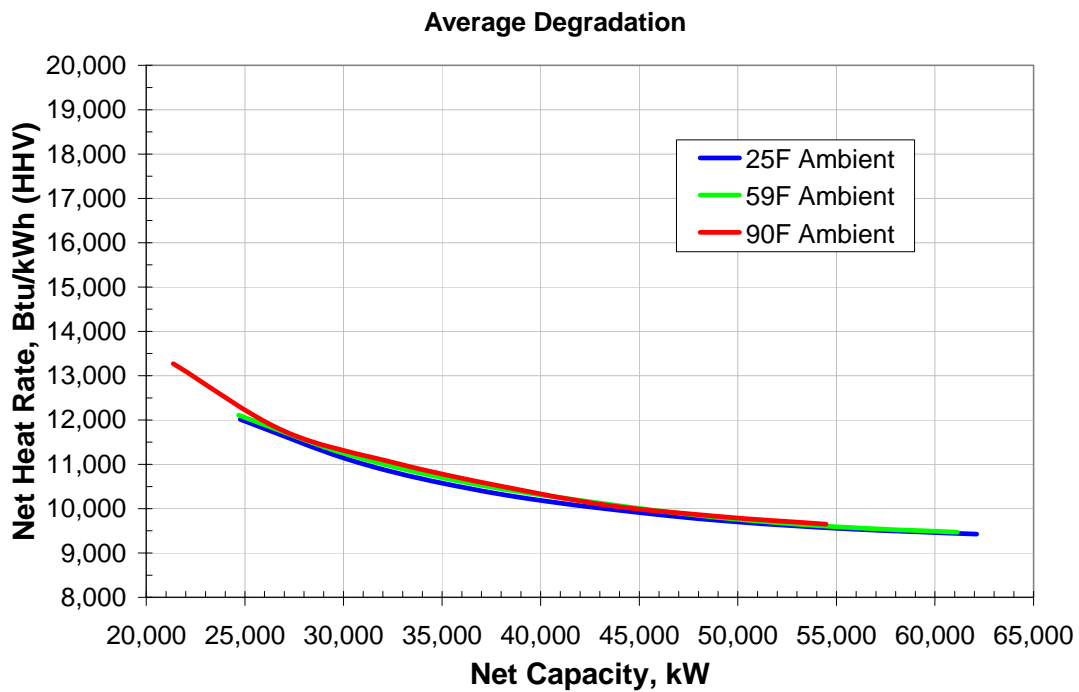

**Table A-2— Performance and Operating Cost Characteristics by Technology and Location**

	Long Island	NYC	Hudson Valley	Albany	Syracuse	Long Island	NYC	NYC	Comments
Combustion Turbine Model	LM6000 PH	LM6000 PG	LM6000 PH	LM6000 PH	LM6000 PH	LMS100 PA	LMS100 PA	LMS100 PA	
							one unit		
Plant Performance (per Unit)									
Net Plant Capacity - Summer (MW)	45.4	49.8	44.6	45.3	45.3	97.1	95.2	95.2	Avg. degraded value; with evaporative cooling.
Net Plant Capacity - Winter (MW)	50.9	54.1	51.2	51.2	50.8	98.0	98.0	98.0	Avg. degraded value; evaporative cooler off.
Net Plant Capacity – ISO Conditions (MW)	48.1	51.9	47.9	48.3	48.1	97.5	96.6	96.6	Avg. degraded value.
Net Plant Capacity - ICAP (MW)	43.5	47.5	43.5	43.3	43.1	91.6	90.3	90.3	Avg. degraded value; with evaporative cooling.
Net Plant Heat Rate - Summer (MW)	9,697	10,014	9,680	9,630	9,617	9,155	9,156	9,156	Avg. degraded value; with evaporative cooling.
Net Plant Heat Rate - Winter (MW)	9,323	10,190	9,286	9,284	9,286	8,973	8,975	8,975	Avg. degraded value; evaporative cooler off.
Net Plant Heat Rate – ISO Conditions (MW)	9,510	10,102	9,483	9,457	9,452	9,064	9,066	9,066	Avg. degraded value.
Net Plant Heat Rate - ICAP (MW)	9,806	10,032	9,736	9,742	9,742	9,259	9,261	9,261	Avg. degraded value; with evaporative cooling.
Equivalent Forced Outage Rate - Demand Based (EFORd)	3.84%	3.84%	3.84%	3.84%	3.84%	3.84%	3.84%	3.84%	Long-term average.



	Long Island	NYC	Hudson Valley	Albany	Syracuse	Long Island	NYC	NYC	Comments
Combustion Turbine Model	LM6000 PH	LM6000 PG	LM6000 PH	LM6000 PH	LM6000 PH	LMS100 PA	LMS100 PA	LMS100 PA	
							one unit		
Natural Gas Consumed During Start (mmBtu/start)	110	110	110	65	65	215	215	215	
<hr/>									
Fixed O&M (2 Units, \$/year)									
Labor - Routine O&M	976,000	976,000	786,000	786,000	786,000	976,000	976,000	976,000	
Materials and Contract Services - Routine	250,000	250,000	250,000	250,000	250,000	320,000	320,000	320,000	
Administrative and General	350,000	350,000	350,000	350,000	350,000	350,000	350,000	350,000	
Subtotal Fixed O&M	1,576,000	1,576,000	1,386,000	1,386,000	1,386,000	1,646,000	1,646,000	1,646,000	
\$/kW-year	18.13	18.13	15.92	15.99	16.08	8.98	18.24	9.12	Based on net degraded ICAP capacity.
<hr/>									
Other Fixed Costs (2 Units, \$/year)									
Site Leasing Costs	99,000	452,000	81,000	81,000	81,000	132,000	452,000	774,000	
Subtotal Fixed O&M	1,675,000	2,028,000	1,467,000	1,467,000	1,467,000	1,778,000	2,098,000	2,420,000	
\$/kW-year	19.27	21.34	16.85	16.92	17.02	9.70	23.25	13.41	Based on net degraded ICAP capacity.
<hr/>									
Property Taxes	3,767,000	9,361,000	3,371,000	2,769,000	2,745,000	6,103,000	8,933,000	15,214,000	Full amount, not accounting for the NYC phased property tax exemption with the ICIP.
Insurance	565,000	599,000	506,000	415,000	412,000	915,000	571,000	973,000	

	Long Island	NYC	Hudson Valley	Albany	Syracuse	Long Island	NYC	NYC	Comments
Combustion Turbine Model	LM6000 PH	LM6000 PG	LM6000 PH	LM6000 PH	LM6000 PH	LMS100 PA	LMS100 PA	LMS100 PA	
							one unit		
Total Fixed O&M (2 Units)	6,007,000	11,988,000	5,344,000	4,651,000	4,624,000	8,796,000	11,602,000	18,607,000	Alternatively, property taxes and insurance may be included in the fixed charge rate, which would account for the phasing of the NYC property tax exemption with the ICIP.
\$/kW-year	69.09	126.14	61.40	53.66	53.64	47.99	128.55	103.09	Based on net degraded ICAP capacity.
Variable O&M (\$/MWh)									
Major Maintenance Parts	3.09	2.86	3.11	3.08	3.09	2.49	2.52	2.52	
Major Maintenance Labor	0.33	0.31	0.27	0.27	0.27	0.19	0.19	0.19	Labor rates consistent with capital cost estimates.
Unscheduled Maintenance	0.81	0.81	0.81	0.81	0.81	0.81	0.81	0.81	
SCR Catalyst and Ammonia	1.00	1.00	1.00	0.00	0.00	1.00	1.00	1.00	
CO Oxidation Catalyst	0.35	0.35	0.35	0.00	0.00	0.00	0.00	0.00	
Other Chemicals and Consumables	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	
Water	0.75	0.70	0.76	0.75	0.76	0.07	0.07	0.07	
Total Variable O&M (\$/MWh)	6.52	6.21	6.47	5.09	5.11	4.75	4.78	4.78	Based on net degraded summer/winter avg. capacity.

	Long Island	NYC	Hudson Valley	Albany	Syracuse	Long Island	NYC	NYC	Comments
Combustion Turbine Model	LM6000 PH	LM6000 PG	LM6000 PH	LM6000 PH	LM6000 PH	LMS100 PA	LMS100 PA	LMS100 PA	
							one unit		
<u>Variable O&amp;M - Cost per Start:</u>									Excluding natural gas consumed (shown above).
Major Maintenance Parts	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	
Major Maintenance Labor	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	Labor rates consistent with capital cost estimates.
Total (\$/factored start)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	Factored starts include representative weighting factors for peaking operation.

	Hudson Valley	Albany	Syracuse	Long Island	NYC	NYC (NJ)	Hudson Valley	Albany	Syracuse	Comments
Combustion Turbine Model	LMS100 PA	LMS100 PA	LMS100 PA	Trent 60 WLE	Trent 60 WLE	Trent 60 WLE	Trent 60 WLE	7FA.05	7FA.05	
Plant Performance (per Unit)										
Net Plant Capacity - Summer (MW)	94.8	97.0	96.9	55.5	55.2	55.2	53.8	195.7	195.2	Avg. degraded value; with evaporative cooling.
Net Plant Capacity - Winter (MW)	98.7	98.9	99.3	62.1	62.1	62.1	62.1	218.3	217.1	Avg. degraded value; evaporative cooler off.
Net Plant Capacity – ISO Conditions (MW)	96.7	97.9	98.1	58.8	58.7	58.7	58.0	207.0	206.2	Avg. degraded value.
Net Plant Capacity - ICAP (MW)	91.6	91.2	90.7	53.4	53.3	53.3	53.3	189.2	188.2	Avg. degraded value; with evaporative cooling.
Net Plant Heat Rate - Summer (MW)	9,146	9,098	9,086	9,646	9,652	9,652	9,652	10,326	10,319	Avg. degraded value; with evaporative cooling.
Net Plant Heat Rate - Winter (MW)	8,896	8,882	8,867	9,473	9,473	9,473	9,392	10,088	10,091	Avg. degraded value; evaporative cooler off.
Net Plant Heat Rate – ISO Conditions (MW)	9,021	8,990	8,977	9,560	9,563	9,563	9,522	10,207	10,205	Avg. degraded value.
Net Plant Heat Rate - ICAP (MW)	9,208	9,208	9,210	9,721	9,721	9,721	9,678	10,411	10,411	Avg. degraded value; with evaporative cooling.
Equivalent Forced Outage Rate - Demand Based (EFORd)	3.84%	3.84%	3.84%	3.84%	3.84%	3.84%	3.84%	3.00%	3.00%	Long-term averages in NYCA.
Natural Gas Consumed During Start (mmBtu/start)	215	135	135	140	140	140	140	360	360	

	Hudson Valley	Albany	Syracuse	Long Island	NYC	NYC (NJ)	Hudson Valley	Albany	Syracuse	Comments
Combustion Turbine Model	LMS100 PA	LMS100 PA	LMS100 PA	Trent 60 WLE	Trent 60 WLE	Trent 60 WLE	Trent 60 WLE	7FA.05	7FA.05	
<hr/>										
Fixed O&M (2 Units, \$/year)										
Labor - Routine O&M	786,000	786,000	786,000	786,000	976,000	976,000	786,000	786,000	786,000	
Materials and Contract Services - Routine	320,000	320,000	320,000	270,000	270,000	270,000	270,000	390,000	390,000	
Administrative and General	350,000	350,000	350,000	350,000	350,000	350,000	350,000	350,000	350,000	
<hr/>										
Subtotal Fixed O&M	1,456,000	1,456,000	1,456,000	1,406,000	1,596,000	1,596,000	1,406,000	1,526,000	1,526,000	
\$/kW-year	7.95	7.98	8.03	13.18	14.96	14.96	13.18	4.03	4.05	Based on net degraded ICAP capacity.
<hr/>										
Other Fixed Costs (2 Units, \$/year)										
Site Leasing Costs	108,000	108,000	108,000	99,000	452,000	77,000	81,000	81,000	81,000	
<hr/>										
Subtotal Fixed O&M	1,564,000	1,564,000	1,564,000	1,695,000	2,048,000	1,673,000	1,487,000	1,607,000	1,607,000	
\$/kW-year	8.54	8.57	8.63	15.89	19.20	15.68	13.94	4.25	4.27	Based on net degraded ICAP capacity.
<hr/>										
Property Taxes	5,490,000	4,731,000	4,694,000	3,905,000	9,612,000	5,027,000	3,493,000	6,206,000	6,158,000	Full amount, not accounting for the NYC phased property tax exemption with the ICIP.
Insurance	823,000	710,000	704,000	586,000	615,000	754,000	524,000	931,000	924,000	
<hr/>										

	Hudson Valley	Albany	Syracuse	Long Island	NYC	NYC (NJ)	Hudson Valley	Albany	Syracuse	Comments
Combustion Turbine Model	LMS100 PA	LMS100 PA	LMS100 PA	Trent 60 WLE	Trent 60 WLE	Trent 60 WLE	Trent 60 WLE	7FA.05	7FA.05	
Total Fixed O&M (2 Units)	7,877,000	7,005,000	6,962,000	6,186,000	12,275,000	7,454,000	5,504,000	8,744,000	8,689,000	Alternatively, property taxes and insurance may be included in the fixed charge rate, which would account for the phasing of the NYC property tax exemption with the ICIP.
\$/kW-year	42.99	38.40	38.40	57.98	115.06	69.87	51.59	23.11	23.08	Based on net degraded ICAP capacity.
Variable O&M (\$/MWh)										
Major Maintenance Parts	2.52	2.48	2.48	3.03	3.03	3.03	3.07	n/a	n/a	
Major Maintenance Labor	0.16	0.15	0.15	0.30	0.30	0.30	0.24	n/a	n/a	Labor rates consistent with capital cost estimates.
Unscheduled Maintenance	0.81	0.81	0.81	0.81	0.81	0.81	0.81	0.55	0.55	
SCR Catalyst and Ammonia	1.00	0.00	0.00	1.00	1.00	1.00	1.00	0.00	0.00	
CO Oxidation Catalyst	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Other Chemicals and Consumables	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	
Water	0.07	0.07	0.07	0.62	0.62	0.62	0.63	0.14	0.14	
Total Variable O&M (\$/MWh)	4.74	3.70	3.70	3.03	3.03	3.03	3.07	n/a	n/a	Based on net degraded summer/winter avg. capacity.

	Hudson Valley	Albany	Syracuse	Long Island	NYC	NYC (NJ)	Hudson Valley	Albany	Syracuse	Comments
Combustion Turbine Model	LMS100 PA	LMS100 PA	LMS100 PA	Trent 60 WLE	Trent 60 WLE	Trent 60 WLE	Trent 60 WLE	7FA.05	7FA.05	
<u>Variable O&amp;M - Cost per Start:</u>										Excluding natural gas consumed (shown above).
Major Maintenance Parts	n/a	n/a	n/a	n/a	n/a	n/a	n/a	15,236	15,236	
Major Maintenance Labor	n/a	n/a	n/a	n/a	n/a	n/a	n/a	593	593	Labor rates consistent with capital cost estimates.
Total (\$/factored start)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	15,829	15,829	Factored starts include representative weighting factors for peaking operation.

**Table A-3 — Capital Cost Estimates for LMS100 - (2010 \$)**

	Overnight Capital Cost - 2010\$s						K - Long Island	J - NYC (two units)	G - Hudson Valley	F - Capital
	K - Long Island	J - NYC (two units)	J - NYC (one unit)	G - Hudson Valley	F - Capital	C - Central				
<b>EPC Cost Components</b>										
Equipment										
Equipment	112,005,000	115,853,000	60,672,000	112,005,000	100,926,000	100,926,000	111%	115%	111%	100%
Spare Parts	1,061,000	1,061,000	1,061,000	1,061,000	1,061,000	1,061,000	100%	100%	100%	100%
Subtotal	113,066,000	116,914,000	61,733,000	113,066,000	101,987,000	101,987,000	111%	115%	111%	100%
Construction										
Construction Labor & Materials	85,566,000	93,344,000	58,963,000	65,865,000	51,272,000	50,143,000	171%	186%	131%	102%
Electrical Connection & Substation	6,721,000	5,925,000	4,775,000	5,446,000	4,947,000	4,801,000	140%	123%	113%	103%
Electrical Interconnect & Upgrades	4,700,000	4,800,000	3,200,000	4,400,000	4,400,000	4,400,000	107%	109%	100%	100%
Gas Interconnect & Reinforcement	4,879,000	5,740,000	4,018,000	4,879,000	4,879,000	4,879,000	100%	118%	100%	100%
Site Prep	3,444,000	4,011,000	3,051,000	2,857,000	2,504,000	2,455,000	140%	163%	116%	102%
Engineering & Design	11,028,000	11,633,000	6,767,000	9,884,000	8,475,000	8,405,000	131%	138%	118%	101%
Construction Mgmt. / Field Engr.	2,757,000	2,908,000	1,692,000	2,471,000	2,119,000	2,101,000	131%	138%	118%	101%
Subtotal	119,095,000	128,361,000	82,466,000	95,802,000	78,596,000	77,184,000	154%	166%	124%	102%
Startup & Testing										
Startup & Training	1,838,000	1,939,000	1,128,000	1,647,000	1,413,000	1,401,000	131%	138%	118%	101%
Testing	-	-	-	-	-	-	N/A	N/A	N/A	N/A
Subtotal	1,838,000	1,939,000	1,128,000	1,647,000	1,413,000	1,401,000	131%	138%	118%	101%
Contingency	22,336,000	23,561,000	13,705,000	20,017,000	17,166,000	17,023,000	131%	138%	118%	101%
Subtotal - EPC Costs	256,335,000	270,775,000	159,032,000	230,532,000	199,162,000	197,595,000	130%	137%	117%	101%
<b>Non-EPC Cost Components</b>										
Owner's Costs										
Permitting	2,563,000	2,708,000	1,590,000	2,305,000	1,992,000	1,976,000	130%	137%	117%	101%
Legal	5,127,000	5,416,000	3,181,000	4,611,000	3,983,000	3,952,000	130%	137%	117%	101%
Owner's Project Mgmt. & Misc. Engr.	5,127,000	5,416,000	3,181,000	4,611,000	3,983,000	3,952,000	130%	137%	117%	101%
Social Justice	513,000	2,437,000	1,431,000	461,000	398,000	395,000	130%	617%	117%	101%
Owner's Development Costs	7,690,000	8,123,000	4,771,000	6,916,000	5,975,000	5,928,000	130%	137%	117%	101%
Financing Fees	5,127,000	5,416,000	3,181,000	4,611,000	3,983,000	3,952,000	130%	137%	117%	101%
Financial Advisory	641,000	677,000	398,000	576,000	498,000	494,000	130%	137%	117%	101%
Environmental Studies	641,000	677,000	398,000	576,000	498,000	494,000	130%	137%	117%	101%
Market Studies	641,000	677,000	398,000	576,000	498,000	494,000	130%	137%	117%	101%
Interconnection Studies	641,000	677,000	398,000	576,000	498,000	494,000	130%	137%	117%	101%
Emission Reduction Credits	650,000	650,000	325,000	650,000	0	0				
Subtotal	29,361,000	32,874,000	19,252,000	26,469,000	22,306,000	22,131,000	133%	149%	120%	101%
Financing (incl. AFUDC, IDC)										
EPC Portion	12,842,000	13,566,000	7,968,000	11,550,000	9,978,000	9,900,000	130%	137%	117%	101%
Non-EPC Portion	1,471,000	1,647,000	965,000	1,326,000	1,118,000	1,109,000	133%	149%	120%	101%
Working Capital and Inventories	5,127,000	5,416,000	3,181,000	4,611,000	3,983,000	3,952,000	130%	137%	117%	101%
Subtotal - Non-EPC Costs	48,801,000	53,503,000	31,366,000	43,956,000	37,385,000	37,092,000	132%	144%	119%	101%
<b>Total Capital Investment</b>	<b>305,136,000</b>	<b>324,278,000</b>	<b>190,398,000</b>	<b>274,488,000</b>	<b>236,547,000</b>	<b>234,687,000</b>	<b>130%</b>	<b>138%</b>	<b>117%</b>	<b>101%</b>



**Table A-4 — Capital Cost Estimates for GE 7FA - (2010 \$)**

	Overnight Capital Cost - 2010\$s		Costs as a % of Zone C
	F - Capital (SC)	C - Central	F - Capital
<b>EPC Cost Components</b>			
Equipment			
Equipment	136,922,000	136,922,000	100%
Spare Parts	1,061,000	1,061,000	100%
Subtotal	137,983,000	137,983,000	100%
Construction			
Construction Labor & Materials	66,789,000	65,267,000	102%
Electrical Connection & Substation	4,947,000	4,801,000	103%
Electrical Interconnect & Upgrades	4,200,000	4,200,000	100%
Gas Interconnect & Reinforcement	5,740,000	5,740,000	100%
Site Prep	3,129,000	3,071,000	102%
Engineering & Design	11,243,000	11,152,000	101%
Construction Mgmt. / Field Engr.	2,811,000	2,788,000	101%
Subtotal	98,859,000	97,019,000	102%
Startup & Testing			
Startup & Training	1,874,000	1,859,000	101%
Testing	-	-	N/A
Subtotal	1,874,000	1,859,000	101%
Contingency	22,772,000	22,586,000	101%
Subtotal - EPC Costs	261,488,000	259,447,000	101%
<b>Non-EPC Cost Components</b>			
Owner's Costs			
Permitting	2,615,000	2,594,000	101%
Legal	5,230,000	5,189,000	101%
Owner's Project Mgmt. & Misc. Engr.	5,230,000	5,189,000	101%
Social Justice	261,000	259,000	101%
Owner's Development Costs	7,845,000	7,783,000	101%
Financing Fees	5,230,000	5,189,000	101%
Financial Advisory	654,000	649,000	101%
Environmental Studies	654,000	649,000	101%
Market Studies	654,000	649,000	101%
Interconnection Studies	654,000	649,000	101%
Emission Reduction Credits	0	0	
Subtotal	29,027,000	28,799,000	101%
Financing (incl. AFUDC, IDC)			
EPC Portion	13,101,000	12,998,000	101%
Non-EPC Portion	1,454,000	1,443,000	101%
Working Capital and Inventories	5,230,000	5,189,000	101%
Subtotal - Non-EPC Costs	48,812,000	48,429,000	101%
<b>Total Capital Investment</b>	<b>310,300,000</b>	<b>307,876,000</b>	<b>101%</b>

**Table A-5 — Capital Cost Estimates for LM6000 - (2010 \$)**

	Overnight Capital Cost - 2010\$\$					Costs as a % of Zone C			
	K - Long Island	J - NYC (PG model)	G - Hudson Valley	F - Capital	C - Central	K - Long Island	J - NYC	G - Hudson Valley	F - Capital
<b>EPC Cost Components</b>									
Equipment									
Equipment	65,275,000	66,354,000	65,275,000	54,750,000	54,750,000	119%	121%	119%	100%
Spare Parts	1,061,000	1,061,000	1,061,000	1,061,000	1,061,000	100%	100%	100%	100%
Subtotal	66,336,000	67,415,000	66,336,000	55,811,000	55,811,000	119%	121%	119%	100%
Construction									
Construction Labor & Materials	52,821,000	58,717,000	40,483,000	30,241,000	29,542,000	179%	199%	137%	102%
Electrical Connection & Substation	5,679,000	4,775,000	4,561,000	4,124,000	3,996,000	142%	119%	114%	103%
Electrical Interconnect & Upgrades	4,700,000	4,800,000	4,400,000	4,400,000	4,400,000	107%	109%	100%	100%
Gas Interconnect & Reinforcement	3,903,000	4,592,000	3,903,000	3,903,000	3,903,000	100%	118%	100%	100%
Site Prep	2,131,000	2,487,000	1,751,000	1,516,000	1,484,000	144%	168%	118%	102%
Engineering & Design	6,684,000	7,025,000	5,950,000	4,811,000	4,766,000	140%	147%	125%	101%
Construction Mgmt. / Field Engr.	1,671,000	1,756,000	1,487,000	1,203,000	1,191,000	140%	147%	125%	101%
Subtotal	77,589,000	84,152,000	62,535,000	50,198,000	49,282,000	157%	171%	127%	102%
Startup & Testing									
Startup & Training	1,114,000	1,171,000	992,000	802,000	794,000	140%	147%	125%	101%
Testing	-	-	-	-	-	N/A	N/A	N/A	N/A
Subtotal	1,114,000	1,171,000	992,000	802,000	794,000	140%	147%	125%	101%
Contingency	13,537,000	14,229,000	12,050,000	9,745,000	9,652,000	140%	147%	125%	101%
Subtotal - EPC Costs	158,576,000	166,967,000	141,913,000	116,556,000	115,539,000	137%	145%	123%	101%
<b>Non-EPC Cost Components</b>									
Owner's Costs									
Permitting	1,586,000	1,670,000	1,419,000	1,166,000	1,155,000	137%	145%	123%	101%
Legal	3,172,000	3,339,000	2,838,000	2,331,000	2,311,000	137%	144%	123%	101%
Owner's Project Mgmt. & Misc. Engr.	3,172,000	3,339,000	2,838,000	2,331,000	2,311,000	137%	144%	123%	101%
Social Justice	317,000	1,503,000	284,000	233,000	231,000	137%	651%	123%	101%
Owner's Development Costs	4,757,000	5,009,000	4,257,000	3,497,000	3,466,000	137%	145%	123%	101%
Financing Fees	3,172,000	3,339,000	2,838,000	2,331,000	2,311,000	137%	144%	123%	101%
Financial Advisory	396,000	417,000	355,000	291,000	289,000	137%	144%	123%	101%
Environmental Studies	396,000	417,000	355,000	291,000	289,000	137%	144%	123%	101%
Market Studies	396,000	417,000	355,000	291,000	289,000	137%	144%	123%	101%
Interconnection Studies	396,000	417,000	355,000	291,000	289,000	137%	144%	123%	101%
Emission Reduction Credits	0	0	0	0	0				
Subtotal	17,760,000	19,867,000	15,894,000	13,053,000	12,941,000	137%	154%	123%	101%
Financing (incl. AFUDC, IDC)									
EPC Portion	7,945,000	8,365,000	7,110,000	5,839,000	5,789,000	137%	144%	123%	101%
Non-EPC Portion	890,000	995,000	796,000	654,000	648,000	137%	154%	123%	101%
Working Capital and Inventories	3,172,000	3,339,000	2,838,000	2,331,000	2,311,000	137%	144%	123%	101%
Subtotal - Non-EPC Costs	29,767,000	32,566,000	26,638,000	21,877,000	21,689,000	137%	150%	123%	101%
<b>Total Capital Investment</b>	<b>188,343,000</b>	<b>199,533,000</b>	<b>168,551,000</b>	<b>138,433,000</b>	<b>137,228,000</b>	<b>137%</b>	<b>145%</b>	<b>123%</b>	<b>101%</b>

**Table A-6 — Capital Cost Estimates for Trent 60 - (2010 \$)**

	Overnight Capital Cost - 2010\$s				Costs as a % of Zone G		
	NJ w/HV Cable to NYC	K - Long Island	J - NYC	G - Hudson Valley	New Jersey w/HV Cable to NYC	K - Long Island	J - NYC
<b>EPC Cost Components</b>							
Equipment							
Equipment	68,113,000	67,118,000	68,165,000	67,118,000	101%	100%	102%
Spare Parts	1,061,000	1,061,000	1,061,000	1,061,000	100%	100%	100%
Subtotal	69,174,000	68,179,000	69,226,000	68,179,000	101%	100%	102%
Construction							
Construction Labor & Materials	45,924,000	54,684,000	60,310,000	41,875,000	110%	131%	144%
Electrical Connection & Substation	4,885,000	5,679,000	4,775,000	4,561,000	107%	125%	105%
Electrical Interconnect & Upgrades	4,800,000	4,700,000	4,800,000	4,400,000	109%	107%	109%
Gas Interconnect & Reinforcement	4,098,000	4,098,000	4,822,000	4,098,000	100%	100%	118%
Site Prep	1,996,000	2,131,000	2,487,000	1,751,000	114%	122%	142%
Engineering & Design	6,419,000	6,881,000	7,206,000	6,121,000	105%	112%	118%
Construction Mgmt. / Field Engr.	1,605,000	1,720,000	1,802,000	1,530,000	105%	112%	118%
Subtotal	69,727,000	79,893,000	86,202,000	64,336,000	108%	124%	134%
Startup & Testing							
Startup & Training	1,070,000	1,147,000	1,201,000	1,020,000	105%	112%	118%
Testing		-	-	-	N/A	N/A	N/A
Subtotal	1,070,000	1,147,000	1,201,000	1,020,000	105%	112%	118%
Contingency	13,001,000	13,936,000	14,595,000	12,398,000	105%	112%	118%
Subtotal - EPC Costs	152,972,000	163,155,000	171,224,000	145,933,000	105%	112%	117%
<b>Non-EPC Cost Components</b>							
Owner's Costs							
Permitting	1,530,000	1,632,000	1,712,000	1,459,000	105%	112%	117%
Legal	3,059,000	3,263,000	3,424,000	2,919,000	105%	112%	117%
Owner's Project Mgmt. & Misc. Engr.	3,059,000	3,263,000	3,424,000	2,919,000	105%	112%	117%
Social Justice	1,377,000	1,468,000	1,541,000	1,313,000	105%	112%	117%
Owner's Development Costs	4,589,000	4,895,000	5,137,000	4,378,000	105%	112%	117%
Financing Fees	3,059,000	3,263,000	3,424,000	2,919,000	105%	112%	117%
Financial Advisory	382,000	408,000	428,000	365,000	105%	112%	117%
Environmental Studies	382,000	408,000	428,000	365,000	105%	112%	117%
Market Studies	382,000	408,000	428,000	365,000	105%	112%	117%
Interconnection Studies	382,000	408,000	428,000	365,000	105%	112%	117%
Emission Reduction Credits	235,000	235,000	235,000	235,000	100%	100%	100%
Subtotal	18,436,000	19,651,000	20,609,000	17,602,000	105%	112%	117%
Financing (incl. AFUDC, IDC)							
EPC Portion	7,664,000	8,174,000	8,578,000	7,311,000	105%	112%	117%
Non-EPC Portion	924,000	985,000	1,033,000	882,000	105%	112%	117%
Working Capital and Inventories	3,059,000	3,263,000	3,424,000	2,919,000	105%	112%	117%
Subtotal - Non-EPC Costs	30,083,000	32,073,000	33,644,000	28,714,000	105%	112%	117%
Submarine Cable Installation	68,305,000						
<b>Total Capital Investment</b>	<b>251,360,000</b>	<b>195,228,000</b>	<b>204,868,000</b>	<b>174,647,000</b>	<b>144%</b>	<b>112%</b>	<b>117%</b>

**Table A-7 — Comparison of Capital Cost Estimates – LM6000 in NYC**

	Capital Cost Comparison 2 x LM6000 Zone J - New York City					
	2010 DC Reset		2007 DC Reset <sup>1</sup>		2004 DC Review <sup>2</sup>	
	Cost (2010\$)	Non-EPC as % of EPC	Cost (2007\$)	Non-EPC as % of EPC	Cost (2004\$)	Non-EPC as % of EPC
<b>EPC Cost Components</b>						
Equipment						
Equipment	66,354,000		44,059,000		40,500,000	
Spare Parts	1,061,000		1,000,000		1,000,000	
Subtotal	67,415,000		45,059,000		41,500,000	
Construction						
Construction Labor & Materials	58,717,000		42,524,000		44,980,000	
Electrical Connection & Substation	4,775,000		3,549,000		3,500,000	
Electrical System Upgrades	4,800,000		500,000		2,500,000	
Gas Interconnect & Reinforcement	4,592,000		4,000,000		4,000,000	
Site Prep	2,487,000		1,526,000		2,200,000	
Engineering & Design	7,025,000		4,755,000		4,000,000	
Construction Mgmt. / Field Engr.	1,756,000		1,189,000		0	
Subtotal	84,152,000		58,043,000		61,180,000	
Startup & Testing						
Startup & Training	1,171,000		793,000		750,000	
Testing	-		-		250,000	
Subtotal	1,171,000		793,000		1,000,000	
Contingency	14,229,000		9,459,000		0	
Subtotal - EPC Costs	166,967,000		113,354,000		103,680,000	100%
<b>Non-EPC Cost Components</b>						
Owner's Costs						
Permitting	1,670,000	1.00%	1,134,000	1.00%	4,050,000	3.91%
Legal	3,339,000	2.00%	2,267,000	2.00%	1,285,714	1.24%
Owner's Project Mgmt. & Misc. Engr.	3,339,000	2.00%	2,267,000	2.00%	1,333,333	1.29%
Social Justice	1,503,000	0.90%	1,000,000	0.88%	500,000	0.48%
Owner's Development Costs	5,009,000	3.00%	3,401,000	3.00%	0	0.00%
Financing Fees	3,339,000	2.00%	2,267,000	2.00%	0	0.00%
Financial Advisory	417,000	0.25%	283,000	0.25%	0	0.00%
Environmental Studies	417,000	0.25%	283,000	0.25%	0	0.00%
Market Studies	417,000	0.25%	283,000	0.25%	0	0.00%
Interconnection Studies	417,000	0.25%	283,000	0.25%	0	0.00%
Emission Reduction Credits	0	0.00%	0	0.00%	0	
Subtotal	19,867,000	11.90%	13,468,000	11.88%	7,169,047	6.91%
Financing (incl. AFUDC, IDC) <sup>(2)</sup>						
EPC Portion	8,365,000	5.01%	5,158,000	4.55%	3,169,895	3.06%
Non-EPC Portion	995,000	0.60%	613,000	0.54%	0	0.00%
Working Capital and Inventories	3,339,000	2.00%	2,267,000	2.00%	0	0.00%
Subtotal - Non-EPC Costs	32,566,000	19.50%	21,506,000	18.97%	10,338,942	9.97%
<b>Total Capital Investment</b>	<b>199,533,000</b>	<b>119.50%</b>	<b>134,860,000</b>	<b>118.97%</b>	<b>114,018,942</b>	<b>109.97%</b>

**Notes:**

1. NERA Economic Consulting, "Independent Study to Establish Parameters of the ICAP Demand Curve for the New York Independent System Operation, August 15, 2007.

2. Levitan & Associates, "Independent Study to Establish Parameters of the ICAP Demand Curves for the New York Independent System Operator," August 16, 2004, p. 6, and Letter to John Charlton, NYISO, "ICAP Demand Curve Review - Capital Cost Details and Update," September 1, 2004.

**Table A-8 — Comparison of Capital Cost Estimates – LM6000 in Syracuse**

	Capital Cost Comparison 2 x LM6000 Zone C - Syracuse					
	2010 DC Reset		2007 DC Reset <sup>1</sup>		2004 DC Review <sup>2</sup>	
	Cost (2010\$)	Non-EPC as % of EPC	Cost (2007\$)	Non-EPC as % of EPC	Cost (2004\$)	Non-EPC as % of EPC
<b>EPC Cost Components</b>						
Equipment						
Equipment	54,750,000		36,072,000		40,500,000	
Spare Parts	1,061,000		1,000,000		1,000,000	
Subtotal	55,811,000		37,072,000		41,500,000	
Construction						
Construction Labor & Materials	29,542,000		21,335,000		33,960,000	
Electrical Connection & Substation	3,996,000		2,257,000		2,750,000	
Electrical System Upgrades	4,400,000		500,000		1,250,000	
Gas Interconnect & Reinforcement	3,903,000		3,400,000		3,400,000	
Site Prep	1,484,000		888,000		1,300,000	
Engineering & Design	4,766,000		3,278,000		3,000,000	
Construction Mgmt. / Field Engr.	1,191,000		819,000		0	
Subtotal	49,282,000		32,477,000		45,660,000	
Startup & Testing						
Startup & Training	794,000		546,000		750,000	
Testing	-		-		250,000	
Subtotal	794,000		546,000		1,000,000	
Contingency	9,652,000		6,520,000		0	
Subtotal - EPC Costs	115,539,000		76,615,000		88,160,000	100%
<b>Non-EPC Cost Components</b>						
Owner's Costs						
Permitting	1,155,000	1.00%	766,000	1.00%	1,050,000	1.19%
Legal	2,311,000	2.00%	1,532,000	2.00%	1,000,000	1.13%
Owner's Project Mgmt. & Misc. Engr.	2,311,000	2.00%	1,532,000	2.00%	1,000,000	1.13%
Social Justice	231,000	0.20%	125,000	0.16%	125,000	0.14%
Owner's Development Costs	3,466,000	3.00%	2,298,000	3.00%	0	0.00%
Financing Fees	2,311,000	2.00%	1,532,000	2.00%	0	0.00%
Financial Advisory	289,000	0.25%	192,000	0.25%	0	0.00%
Environmental Studies	289,000	0.25%	192,000	0.25%	0	0.00%
Market Studies	289,000	0.25%	192,000	0.25%	0	0.00%
Interconnection Studies	289,000	0.25%	192,000	0.25%	0	0.00%
Emission Reduction Credits	0	0.00%	0	0.00%	0	0.00%
Subtotal	12,941,000	11.20%	8,553,000	11.16%	3,175,000	3.60%
Financing (incl. AFUDC, IDC) <sup>(2)</sup>						
EPC Portion	5,789,000	5.01%	3,486,000	4.55%	1,899,500	2.15%
Non-EPC Portion	648,000	0.56%	389,000	0.51%	0	0.00%
Working Capital and Inventories	2,311,000	2.00%	1,532,000	2.00%	0	0.00%
Subtotal - Non-EPC Costs	21,689,000	18.77%	13,960,000	18.22%	5,074,500	5.76%
<b>Total Capital Investment</b>	<b>137,228,000</b>	<b>118.77%</b>	<b>90,575,000</b>	<b>118.22%</b>	<b>93,234,500</b>	<b>105.76%</b>

1. NERA Economic Consulting, "Independent Study to Establish Parameters of the ICAP Demand Curve for the New York Independent System Operation, August 15, 2007.

2. Levitan & Associates, "Independent Study to Establish Parameters of the ICAP Demand Curves for the New York Independent System Operator," August 16, 2004, p. 6, and Letter to John Charlton, NYISO, "ICAP Demand Curve Review - Capital Cost Details and Update," September 1, 2004.

**Table A-9 — Comparison of Capital Cost Estimates – 7FA in Syracuse**

	Capital Cost Comparison 2 x 7FA Zone C - Syracuse					
	2010 DC Reset		2007 DC Reset <sup>1</sup>		2004 DC Review <sup>2</sup>	
	Cost (2010\$)	Non-EPC as % of EPC	Cost (2007\$)	Non-EPC as % of EPC	Cost (2004\$)	Non-EPC as % of EPC
<b>EPC Cost Components</b>						
Equipment						
Equipment	136,922,000		86,652,000		118,000,000	
Spare Parts	1,061,000		1,000,000		3,500,000	
Subtotal	137,983,000		87,652,000		121,500,000	
Construction						
Construction Labor & Materials	65,267,000		46,036,000		37,935,900	
Electrical Connection & Substation	4,801,000		2,470,000		6,500,000	
Electrical System Upgrades	4,200,000		500,000		1,500,000	
Gas Interconnect & Reinforcement	5,740,000		5,000,000		6,210,709	
Site Prep	3,071,000		1,790,000		3,000,000	
Engineering & Design	11,152,000		7,413,000		7,125,000	
Construction Mgmt. / Field Engr.	2,788,000		1,853,000		0	
Subtotal	97,019,000		65,062,000		62,271,609	
Startup & Testing						
Startup & Training	1,859,000		1,235,000		1,900,000	
Testing	-		-		700,000	
Subtotal	1,859,000		1,235,000		2,600,000	
Contingency	22,586,000		14,745,000		0	
Subtotal - EPC Costs	259,447,000		168,694,000		186,371,609	100%
<b>Non-EPC Cost Components</b>						
Owner's Costs						
Permitting	2,594,000	1.00%	1,687,000	1.00%	1,697,000	0.91%
Legal	5,189,000	2.00%	3,374,000	2.00%	1,414,000	0.76%
Owner's Project Mgmt. & Misc. Engr.	5,189,000	2.00%	3,374,000	2.00%	2,239,000	1.20%
Social Justice	259,000	0.10%	125,000	0.07%	400,000	0.21%
Owner's Development Costs	7,783,000	3.00%	5,061,000	3.00%	0	0.00%
Financing Fees	5,189,000	2.00%	3,374,000	2.00%	0	0.00%
Financial Advisory	649,000	0.25%	422,000	0.25%	0	0.00%
Environmental Studies	649,000	0.25%	422,000	0.25%	0	0.00%
Market Studies	649,000	0.25%	422,000	0.25%	0	0.00%
Interconnection Studies	649,000	0.25%	422,000	0.25%	0	0.00%
Emission Reduction Credits	0	0.00%	0	0.00%	0	0.00%
Subtotal	28,799,000	11.10%	18,683,000	11.08%	5,750,000	3.09%
Financing (incl. AFUDC, IDC) <sup>(2)</sup>						
EPC Portion	12,998,000	5.01%	7,676,000	4.55%	8,333,186	4.47%
Non-EPC Portion	1,443,000	0.56%	850,000	0.50%	0	0.00%
Working Capital and Inventories	5,189,000	2.00%	3,374,000	2.00%	0	0.00%
Subtotal - Non-EPC Costs	48,429,000	18.67%	30,583,000	18.13%	14,083,186	7.56%
<b>Total Capital Investment</b>	<b>307,876,000</b>	<b>118.67%</b>	<b>199,277,000</b>	<b>118.13%</b>	<b>200,454,795</b>	<b>107.56%</b>

1. NERA Economic Consulting, "Independent Study to Establish Parameters of the ICAP Demand Curve for the New York Independent System Operation, August 15, 2007.

2. Levitan & Associates, "Independent Study to Establish Parameters of the ICAP Demand Curves for the New York Independent System Operator," August 16, 2004, p. 6, and Letter to John Charlton, NYISO, "ICAP Demand Curve Review - Capital Cost Details and Update," September 1, 2004.

**Table A-10 — Comparison of Capital Cost Estimates – LMS100 in NYC**

	Capital Cost Comparison 2 x LMS100 Zone J - NYC			
	2010 DC Reset		2007 DC Reset <sup>1</sup>	
	Cost (2010\$)	Non-EPC as % of EPC	Cost (2007\$)	Non-EPC as % of EPC
<b>EPC Cost Components</b>				
Equipment				
Equipment	115,853,000		89,050,000	
Spare Parts	1,061,000		1,000,000	
Subtotal	116,914,000		90,050,000	
Construction				
Construction Labor & Materials	93,344,000		68,129,000	
Electrical Connection & Substation	5,925,000		3,793,000	
Electrical System Upgrades	4,800,000		500,000	
Gas Interconnect & Reinforcement	5,740,000		5,000,000	
Site Prep	4,011,000		2,491,000	
Engineering & Design	11,633,000		8,562,000	
Construction Mgmt. / Field Engr.	2,908,000		2,140,000	
Subtotal	128,361,000		90,615,000	
Startup & Testing				
Startup & Training	1,939,000		1,427,000	
Testing	-		-	
Subtotal	1,939,000		1,427,000	
Contingency	23,561,000		17,031,000	
Subtotal - EPC Costs	270,775,000		199,123,000	
<b>Non-EPC Cost Components</b>				
Owner's Costs				
Permitting	2,708,000	1.00%	1,991,000	1.00%
Legal	5,416,000	2.00%	3,982,000	2.00%
Owner's Project Mgmt. & Misc. Engr.	5,416,000	2.00%	3,982,000	2.00%
Social Justice	2,437,000	0.90%	2,000,000	1.00%
Owner's Development Costs	8,123,000	3.00%	5,974,000	3.00%
Financing Fees	5,416,000	2.00%	3,982,000	2.00%
Financial Advisory	677,000	0.25%	498,000	0.25%
Environmental Studies	677,000	0.25%	498,000	0.25%
Market Studies	677,000	0.25%	498,000	0.25%
Interconnection Studies	677,000	0.25%	498,000	0.25%
Emission Reduction Credits	650,000	0.24%	0	0.00%
Subtotal	32,874,000	12.14%	23,903,000	12.00%
Financing (incl. AFUDC, IDC) <sup>(2)</sup>				
EPC Portion	13,566,000	5.01%	9,060,000	4.55%
Non-EPC Portion	1,647,000	0.61%	1,088,000	0.55%
Working Capital and Inventories	5,416,000	2.00%	3,982,000	2.00%
Subtotal - Non-EPC Costs	53,503,000	19.76%	38,033,000	19.10%
<b>Total Capital Investment</b>	<b>324,278,000</b>	<b>119.76%</b>	<b>237,156,000</b>	<b>119.10%</b>

1. NERA Economic Consulting, "Independent Study to Establish Parameters of the ICAP Demand Curve for the New York Independent System Operation, August 15, 2007.

**Table A-11 — EPC Cost Breakdown for LMS100 in New York City - (2010 \$)**

Description	Scope Definition	Total Equipment or Material Cost	Total Man-hours	Total Construction & Erection Cost	Total Projected Cost
Combustion Turbines w/ Accessories	GE LMS100-PA	85,900,000	43,400	6,585,516	92,485,516
SCR w/ Exhaust Stack		12,000,000	34,076	5,170,692	17,170,692
Aqueous Ammonia Storage & Forwarding		280,000	980	148,705	428,705
Inlet Air Chillers	Not Included	0	0	0	0
Pumps		763,000	2,654	405,566	1,168,566
Field Erected Tanks	Turnkey Subcontracts	1,820,000	0	0	1,820,000
Shop Fabricated Tanks		82,000	323	48,921	130,921
Cranes & Hoists	Allowance for Misc. Hoists Only	15,000	210	32,086	47,086
Fuel Gas Compressors	2x100% Gas Interconnection and Metering Station Assumed by Fuel Gas Supplier	3,600,000	4,200	637,308	4,237,308
Fuel Gas Supply & Metering		0	0	0	0
Fuel Gas Conditioning		1,050,000	1,064	161,451	1,211,451
Bulk Gas Storage Provisions		10,000	196	29,741	39,741
Air Compressors & Dryers		184,000	392	59,482	243,482
Water Treating	Not Included	0	0	0	0
Fire Protection	Turnkey Subcontract	450,000	0	0	450,000
B.O.P. Mechanical (Miscellaneous)		100,000	560	84,974	184,974
BOP Piping	Shop Fab LB and Field Fab SB. Includes all Hangers & Insulation	1,105,910	43,621	6,645,998	7,751,908
Valves & Specialties		477,325	1,712	270,356	747,681
Electrical Major Equipment		6,295,000	16,450	2,175,464	8,470,464
Electrical BOP		1,850,036	62,548	8,601,563	10,451,599
Instrumentation & Controls		1,185,000	6,370	890,590	2,075,590
Switchyard	Allowance - Based on 138kV 4- Breaker GIS	3,850,000	14,930	1,901,882	5,751,882
Steel	Excluding Building Framing Includes Buildings, HVAC, & Interior Finishes	185,083	1,890	307,662	492,745
Buildings	Includes Excavation and Foundation	935,900	14,248	2,161,961	3,097,861
Foundations	Pile Allowance	2,158,347	26,957	3,639,657	5,798,004
Demolition & Mods to Existing Structures	None	0	0	0	0
Site Preparation, Drainage, & Yard Work		1,281,200	16,959	2,671,929	3,953,129
Heavy Haul Subcontracts		0	0	800,000	800,000
Indirect and Startup Craft Support		0	62,148	515,916	515,916
Allowances to Attract Labor		0	30,947	8,789,741	8,789,741
Erection Contractors G&A and Profit		0	0	12,782,244	12,782,244
Total Equipment, Material and Labor Costs		<u>125,577,800</u>	<u>386,835</u>	<u>65,519,406</u>	<u>191,097,207</u>
Consumables					627,900
Freight, Duties, Taxes, Etc.	Freight Only				2,163,501
Total Direct Project Costs					<u>193,888,608</u>
Indirect Project Costs					41,724,000
Contingency & Escalation	Contingency Only				23,561,000
Spare Parts Cost					1,061,000
Electrical Interconnection & Upgrades					4,800,000
Gas Interconnect & Reinforcement					5,740,000
Total EPC Project Cost					<u>270,774,608</u>



**Table A-12 — EPC Cost Breakdown for LMS100 in Long Island - (2010 \$)**

Description	Scope Definition	Total Equipment or Material Cost	Total Man- hours	Total Construction & Erection Cost	Total Projected Cost
Combustion Turbines w/ Accessories	GE LMS100-PA	84,400,000	41,580	6,265,690	90,665,690
SCR w/ Exhaust Stack		11,500,000	32,400	4,882,356	16,382,356
Aqueous Ammonia Storage & Forwarding		280,000	945	142,402	422,402
Inlet Air Chillers	Not Included	0	0	0	0
Pumps		688,000	2,020	305,727	993,727
Field Erected Tanks	Turnkey Subcontracts	700,000	0	0	700,000
Shop Fabricated Tanks		70,000	258	38,347	108,347
Cranes & Hoists	Allowance for Misc. Hoists Only	15,000	203	30,654	45,654
Fuel Gas Compressors	2x100%	2,300,000	2,970	447,549	2,747,549
	Gas Interconnection and Metering Station Assumed by Fuel Gas Supplier	0	0	0	0
Fuel Gas Supply & Metering		1,050,000	1,026	154,608	1,204,608
Fuel Gas Conditioning		10,000	189	28,480	38,480
Bulk Gas Storage Provisions		184,000	378	56,961	240,961
Air Compressors & Dryers		0	0	0	0
Water Treating	Not Included	0	0	0	0
Fire Protection	Turnkey Subcontract	350,000	0	0	350,000
B.O.P. Mechanical (Miscellaneous)		100,000	540	81,373	181,373
	Shop Fab LB and Field Fab SB. Includes all Hangers & Insulation	1,071,110	40,524	6,008,395	7,079,505
BOP Piping		437,450	1,509	232,206	669,656
Valves & Specialties		7,195,000	15,863	1,987,766	9,182,766
Electrical Major Equipment		1,776,830	59,770	7,509,129	9,285,959
Electrical BOP		1,185,000	6,143	794,655	1,979,655
Instrumentation & Controls					
	Allowance - Based on 345kV 4- Breaker Ring Bus	2,800,000	31,253	3,794,679	6,594,679
Switchyard		171,084	1,823	293,765	464,850
Steel	Excluding Building Framing Includes Buildings, HVAC, & Interior Finishes	668,500	9,813	1,478,744	2,147,244
Buildings					
	Includes Excavation and Foundation Pile Allowance	1,788,531	23,553	2,978,605	4,767,136
Foundations		0	0	0	0
Demolition & Mods to Existing Structures	None	0	0	0	0
Site Preparation, Drainage, & Yard Work		1,201,200	15,057	2,188,988	3,390,188
Heavy Haul Subcontracts		0	0	800,000	800,000
Indirect and Startup Craft Support		0	60,963	512,346	512,346
Allowances to Attract Labor		0	30,328	8,347,156	8,347,156
Erection Contractors G&A and Profit		0	0	11,925,343	11,925,343
Total Equipment, Material and Labor Costs		<u>119,941,706</u>	<u>379,106</u>	<u>61,285,924</u>	<u>181,227,630</u>
Consumables					599,700
Freight, Duties, Taxes, Etc.	Freight Only				1,977,377
Total Direct Project Costs					<u>183,804,707</u>
Indirect Project Costs					39,554,000
Contingency & Escalation	Contingency Only				22,336,000
Spare Parts Cost					1,061,000
Electrical Interconnect & Upgrades					4,700,000
Gas Interconnect & Reinforcement					4,879,000
Total EPC Project Cost					<u>256,334,707</u>

**Table A-13 — EPC Cost Breakdown for 7FA Simple Cycle in Albany - (2010 \$)**

Description	Scope Definition	Total Equipment or Material Cost	Total Man- hours	Total Construction & Erection Cost	Total Projected Cost
Combustion Turbines w/ Accessories	GE 7FA.05	115,400,000	68,200	6,026,152	121,426,152
Simple Cycle Exhaust Stack		3,200,000	3,740	330,466	3,530,466
Aqueous Ammonia Storage & Forwarding	Not Required	0	0	0	0
Inlet Air Chillers	Not Included	0	0	0	0
Pumps		652,000	1,426	126,707	778,707
Field Erected Tanks	Turnkey Subcontracts	700,000	0	0	700,000
Shop Fabricated Tanks		70,000	210	18,814	88,814
Cranes & Hoists	Allowance for Misc. Hoists Only	15,000	165	14,665	29,665
	Not Included - Assume 450 psi				
Fuel Gas Compressors	Supply Pressure	0	0	0	0
	Gas Interconnection and Metering				
	Station Assumed by Fuel Gas				
	Supplier	0	0	0	0
Fuel Gas Supply & Metering		1,700,000	1,210	106,916	1,806,916
Fuel Gas Conditioning		10,000	154	13,607	23,607
Bulk Gas Storage Provisions		290,000	748	66,093	356,093
Air Compressors & Dryers		0	0	0	0
Water Treating	Not Included	0	0	0	0
Fire Protection	Turnkey Subcontract	500,000	0	0	500,000
B.O.P. Mechanical (Miscellaneous)		125,000	561	49,570	174,570
	Shop Fab LB and Field Fab SB.				
BOP Piping	Includes all Hangers & Insulation	1,472,550	43,923	4,072,102	5,544,652
Valves & Specialties		523,400	1,503	146,008	669,408
Electrical Major Equipment		11,580,000	16,115	1,260,044	12,840,044
Electrical BOP		2,353,843	62,656	5,256,433	7,610,275
Instrumentation & Controls		1,180,000	5,412	445,029	1,625,029
	Allowance - Based on 345kV 4-				
Switchyard	Breaker Ring Bus	2,800,000	25,465	2,021,157	4,821,157
Steel	Excluding Building Framing	212,110	1,837	192,826	404,936
	Includes Buildings, HVAC, & Interior				
Buildings	Finishes	220,000	3,194	282,257	502,257
	Includes Excavation. Piles Not				
Foundations	Included	751,816	19,296	1,565,091	2,316,906
Demolition & Mods to Existing Structures	None	0	0	0	0
Site Preparation, Drainage, & Yard Work		1,554,880	14,554	1,504,412	3,059,292
Heavy Haul Subcontracts		0	0	950,000	950,000
Indirect and Startup Craft Support		0	59,874	512,488	512,488
Allowances to Attract Labor		0	28,717	6,106,051	6,106,051
Erection Contractors G&A and Profit		0	0	8,876,623	8,876,623
Total Equipment, Material and Labor Costs		<u>145,310,598</u>	<u>358,958</u>	<u>39,943,512</u>	<u>185,254,110</u>
Consumables					726,600
Freight, Duties, Taxes, Etc.	Freight Only				1,408,977
Total Direct Project Costs					<u>187,389,687</u>
Indirect Project Costs					40,326,000
Contingency & Escalation	Contingency Only				22,772,000
Spare Parts Cost					1,061,000
Electrical Interconnect & Upgrades					4,200,000
Gas Interconnect & Reinforcement					5,740,000
Total EPC Project Cost					<u>261,488,687</u>



**Table B-2 — Real Levelized Carrying Charge Rates - Results of Sensitivity Analysis**

Amortization	Years =	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	
<b>Base Case:</b>																												
Without Property Taxes and Insurance:																												
non-NYC:	16.89%	15.89%	15.05%	14.33%	13.71%	13.16%	12.68%	12.26%	11.89%	11.56%	11.27%	11.01%	10.78%	10.57%	10.38%	10.20%	10.05%	9.90%	9.77%	9.65%	9.54%	9.44%	9.35%	9.26%	9.18%	9.11%	9.11%	
NYC:	17.53%	16.50%	15.63%	14.89%	14.24%	13.68%	13.18%	12.73%	12.34%	12.00%	11.69%	11.42%	11.17%	10.95%	10.75%	10.57%	10.41%	10.26%	10.12%	9.99%	9.88%	9.77%	9.67%	9.58%	9.50%	9.42%	9.42%	
With Property Taxes and ICIP Program; Without Insurance:																												
NYC:	17.53%	16.50%	15.69%	15.04%	14.52%	14.10%	13.76%	13.46%	13.20%	12.96%	12.76%	12.57%	12.41%	12.26%	12.12%	12.00%	11.89%	11.79%	11.69%	11.61%	11.53%	11.46%	11.39%	11.33%	11.27%	11.22%	11.22%	11.22%
<b>200 bp higher on nominal debt and equity cost:</b>																												
Without Property Taxes and Insurance:																												
non-NYC:	18.71%	17.70%	16.85%	16.13%	15.50%	14.96%	14.48%	14.06%	13.69%	13.36%	13.08%	12.82%	12.60%	12.39%	12.21%	12.05%	11.90%	11.76%	11.64%	11.53%	11.43%	11.33%	11.25%	11.17%	11.10%	11.03%	11.03%	
NYC:	19.47%	18.43%	17.55%	16.80%	16.15%	15.58%	15.07%	14.63%	14.24%	13.90%	13.59%	13.33%	13.08%	12.87%	12.68%	12.50%	12.34%	12.20%	12.07%	11.95%	11.84%	11.74%	11.65%	11.56%	11.48%	11.41%	11.41%	
With Property Taxes and ICIP Program; Without Insurance:																												
NYC:	19.47%	18.43%	17.60%	16.94%	16.40%	15.96%	15.60%	15.28%	15.00%	14.76%	14.54%	14.35%	14.18%	14.02%	13.88%	13.76%	13.65%	13.54%	13.45%	13.36%	13.28%	13.21%	13.14%	13.08%	13.03%	12.97%	12.97%	
<b>400 bp higher on nominal debt and equity cost:</b>																												
Without Property Taxes and Insurance:																												
non-NYC:	20.57%	19.56%	18.71%	17.99%	17.37%	16.83%	16.35%	15.94%	15.58%	15.26%	14.99%	14.74%	14.53%	14.33%	14.16%	14.01%	13.87%	13.74%	13.63%	13.53%	13.44%	13.35%	13.28%	13.21%	13.14%	13.09%	13.09%	
NYC:	21.47%	20.42%	19.54%	18.78%	18.13%	17.56%	17.06%	16.62%	16.23%	15.90%	15.60%	15.34%	15.11%	14.90%	14.72%	14.55%	14.40%	14.27%	14.14%	14.03%	13.93%	13.84%	13.76%	13.68%	13.61%	13.55%	13.55%	
With Property Taxes and ICIP Program; Without Insurance:																												
NYC:	21.47%	20.42%	19.58%	18.91%	18.36%	17.90%	17.53%	17.20%	16.91%	16.66%	16.44%	16.25%	16.07%	15.92%	15.78%	15.66%	15.54%	15.44%	15.35%	15.27%	15.19%	15.12%	15.06%	15.00%	14.95%	14.90%	14.90%	

## C. Appendix 3 – STATA Output

Wednesday June 30 13:56:49 2010 Page 1

/ / / / / / / /  
Statistics/Data Analysis

```

opened on: 30 Jun 2010, 13:55:20
name: <unnamed>
log: \\nera-nycfs\work\projects\energy\NYISO DEMAND CURVE UPDATE (R782) >
\Stata Files\appendix.smcl
log type: smcl
opened on: 30 Jun 2010, 13:55:20

1 anova llbmp m#zone c.load#zone c.agglload#c.load#zone c.agglload#region
   c.agglload
> ad?#region c.agglload?#region c.lgasp#m#h#rm h#m dow zone c.tmin c.tmax
Number of obs =                288002      R-squared      = 0.8843
Root MSE      = 0.162086      Adj R-squared = 0.8840

```

Source	Partial SS	df	MS	F	Prob > F
Model	57662.0275	735	78.4517381	2986.14	0.0000
m#zone	627.215038	121	5.18359536	197.31	0.0000
zone#load	56.0359586	11	5.09417806	193.90	0.0000
zone#agglload	94.0604695	11	8.55095177	325.48	0.0000
region#agglload	126.100418	3	42.0334727	1599.94	0.0000
region#agglload2	79.5568136	3	26.5189379	1009.40	0.0000
region#agglload3	50.7511624	3	16.9170541	643.92	0.0000
m#h#lgasp	18772.3405	288	65.181738	2481.04	0.0000
rm	45.0914212	1	45.0914212	1716.34	0.0000
h#m	100.064661	276	.362553118	13.80	0.0000
dow	32.7624834	6	5.4604139	207.84	0.0000
zone	97.8412245	10	9.78412245	372.42	0.0000
tmin	73.0492232	1	73.0492232	2780.51	0.0000
tmax	.029050733	1	.029050733	1.11	0.2930
Residual	7547.02773287266		.026271914		
Total	65209.0552288001		.226419545		

2 .regress

Source	SS	df	MS	Number of obs =	288002
Model	57662.0275	735	78.4517381	Prob > F	= 0.0000
Residual	7547.02773287266		.026271914	R-squared	= 0.8843
Total	65209.0552288001		.226419545	Adj R-squared	= 0.8840
				Root MSE	= 0.16209

llbmp	Coef.	Std. Err.	t	P> t	[95% Conf. Interval]
m#zone					
2 1	-.0663132	.0598947	-1.11	0.268	-.1837052 .0510788
2 2	-.0183166	.0598946	-0.31	0.760	-.1357083 .0990751
2 3	-.0555994	.0598945	-0.93	0.353	-.1729911 .0617922
2 4	.0511176	.0598948	0.85	0.393	-.0662746 .1685098
2 5	-.05263	.0598948	-0.88	0.380	-.1700221 .064762
2 6	-.0458995	.0598755	-0.77	0.443	-.1632538 .0714548
2 7	-.0265994	.0598959	-0.44	0.657	-.1439938 .0907949
2 8	-.0477646	.0598951	-0.80	0.425	-.1651573 .069628
2 9	-.0020097	.0598636	-0.03	0.973	-.1193408 .1153213
2 10	-.0287272	.0598947	-0.48	0.631	-.1461192 .0886647
2 11	.0499449	.0598946	0.83	0.404	-.0674469 .1673367
3 1	-.2088401	.055337	-3.77	0.000	-.317299 -.1003812

3	2	-.1488795	.0553401	-2.69	0.007	-.2573445	-.0404145
3	3	-.1681528	.0553363	-3.04	0.002	-.2766103	-.0596952
3	4	-.070318	.0553359	-1.27	0.204	-.1787748	.0381388
3	5	-.1716874	.0553362	-3.10	0.002	-.2801448	-.0632299
3	6	-.2350752	.0553083	-4.25	0.000	-.3434779	-.1266724
3	7	-.1606975	.0553385	-2.90	0.004	-.2691595	-.0522355
3	8	-.1504441	.055336	-2.72	0.007	-.2589011	-.0419871
3	9	-.1727743	.0553086	-3.12	0.002	-.2811777	-.0643709
3	10	-.1723419	.055337	-3.11	0.002	-.2808008	-.063883

3 11	-.0933023	.0553371	-1.69	0.092	-.2017615	.0151568
4 1	-.3066459	.0534991	-5.73	0.000	-.4115025	-.2017892
4 2	-.3318185	.0535059	-6.20	0.000	-.4366886	-.2269483
4 3	-.2851348	.0534915	-5.33	0.000	-.3899766	-.1802929
4 4	-.2528833	.0534928	-4.73	0.000	-.3577276	-.148039
4 5	-.2837251	.0534879	-5.30	0.000	-.3885599	-.1788903
4 6	-.3724472	.0534626	-6.97	0.000	-.4772324	-.267662
4 7	-.3557039	.0535094	-6.65	0.000	-.4605809	-.250827
4 8	-.2652179	.0534929	-4.96	0.000	-.3700626	-.1603733
4 9	-.284574	.0534778	-5.32	0.000	-.3893891	-.179759
4 10	-.3703778	.0534949	-6.92	0.000	-.4752264	-.2655293
4 11	-.2876753	.0534947	-5.38	0.000	-.3925233	-.1828272
5 1	-.4319526	.0533594	-8.10	0.000	-.5365356	-.3273696
5 2	-.5006263	.0533753	-9.38	0.000	-.6052404	-.3960122
5 3	-.4270369	.0533452	-8.01	0.000	-.531592	-.3224817
5 4	-.5234997	.0533537	-9.81	0.000	-.6280716	-.4189279
5 5	-.4194133	.0533452	-7.86	0.000	-.5239684	-.3148581
5 6	-.4416299	.0533629	-8.28	0.000	-.5462197	-.3370402
5 7	-.525682	.0533731	-9.85	0.000	-.6302918	-.4210723
5 8	-.4063979	.0533476	-7.62	0.000	-.5109577	-.301838
5 9	-.4752142	.0534108	-8.90	0.000	-.579898	-.3705304
5 10	-.6075374	.0533633	-11.38	0.000	-.7121281	-.5029467
5 11	-.5197413	.0533643	-9.74	0.000	-.6243338	-.4151488
6 1	-.6433682	.0522843	-12.31	0.000	-.745844	-.5408924
6 2	-.561546	.052328	-10.73	0.000	-.6641074	-.4589846
6 3	-.5843038	.0522868	-11.17	0.000	-.6867844	-.4818232
6 4	-.5319281	.0522864	-10.17	0.000	-.6344079	-.4294482
6 5	-.5801156	.0522773	-11.10	0.000	-.6825776	-.4776536
6 6	-.7105505	.0523321	-13.58	0.000	-.81312	-.6079809
6 7	-.5768685	.052295	-11.03	0.000	-.6793652	-.4743718
6 8	-.5568362	.0522858	-10.65	0.000	-.6593149	-.4543574
6 9	-.6408991	.052386	-12.23	0.000	-.7435743	-.538224
6 10	-.5556103	.0523496	-10.61	0.000	-.6582141	-.4530065
6 11	-.5155502	.0523069	-9.86	0.000	-.6180702	-.4130301
7 1	-.7643136	.0515503	-14.83	0.000	-.8653508	-.6632764
7 2	-.6529619	.0516368	-12.65	0.000	-.7541687	-.5517552
7 3	-.7507026	.051547	-14.56	0.000	-.8517333	-.6496719
7 4	-.5945354	.0515607	-11.53	0.000	-.6955929	-.4934778
7 5	-.731051	.051532	-14.19	0.000	-.8320524	-.6300496
7 6	-.8999122	.0516205	-17.43	0.000	-.1001087	-.7987375
7 7	-.6838475	.0515597	-13.26	0.000	-.7849032	-.5827918
7 8	-.7121487	.0515424	-13.82	0.000	-.8131703	-.611127
7 9	-.7994624	.0516799	-15.47	0.000	-.9007536	-.6981712
7 10	-.6392685	.0516084	-12.39	0.000	-.7404195	-.5381175
7 11	-.5733952	.0515958	-11.11	0.000	-.6745216	-.4722688
8 1	-.7494136	.0528682	-14.18	0.000	-.8530338	-.6457934
8 2	-.6053365	.0529431	-11.43	0.000	-.7091036	-.5015695
8 3	-.7275908	.0528573	-13.77	0.000	-.8311896	-.623992
8 4	-.5391464	.0528713	-10.20	0.000	-.6427726	-.4355202
8 5	-.7098064	.0528521	-13.43	0.000	-.813395	-.6062179
8 6	-.8728867	.0528989	-16.50	0.000	-.976567	-.7692064
8 7	-.635564	.0528729	-12.02	0.000	-.7391934	-.5319345
8 8	-.6979917	.0528609	-13.20	0.000	-.8015975	-.5943858
8 9	-.7904638	.0529445	-14.93	0.000	-.8942335	-.686694
8 10	-.5565269	.0529293	-10.51	0.000	-.6602669	-.4527868
8 11	-.512901	.0529001	-9.70	0.000	-.6165837	-.4092183
9 1	-.8329619	.0525908	-15.84	0.000	-.9360384	-.7298855
9 2	-.6723625	.0526472	-12.77	0.000	-.7755495	-.5691755
9 3	-.8116324	.0525946	-15.43	0.000	-.9147164	-.7085483
9 4	-.5913861	.0525904	-11.25	0.000	-.6944618	-.4883104
9 5	-.7889032	.0525879	-15.00	0.000	-.891974	-.6858324
9 6	-.8893801	.0525948	-16.91	0.000	-.9924645	-.7862957
9 7	-.6963261	.0525919	-13.24	0.000	-.7994047	-.5932474
9 8	-.7882468	.0525918	-14.99	0.000	-.8913253	-.6851683
9 9	-.8898345	.0526593	-16.90	0.000	-.9930453	-.7866236
9 10	-.6429786	.0526492	-12.21	0.000	-.7461695	-.5397876
9 11	-.5754725	.0526077	-10.94	0.000	-.6785821	-.4723629
10 1	-.9758111	.0601918	-16.21	0.000	-.1093785	-.8578367
10 2	-.876622	.0602111	-14.56	0.000	-.9946341	-.7586099

10	3	-.9715591	0601921	-16.14	0.000	-1.089534	-.8535842
10	4	-.7916039	0601891	-13.15	0.000	-.9095729	-.6736348
10	5	-.9541911	0601889	-15.85	0.000	-1.07216	-.8362226
10	6	-.9925474	0601656	-16.50	0.000	-1.11047	-.8746245
10	7	-.9008955	0601899	-14.97	0.000	-1.018866	-.7829249
10	8	-.9490612	0601916	-15.77	0.000	-1.067035	-.8310873
10	9	-1.024103	0601972	-17.01	0.000	-1.142088	-.906118
	10 10	-.9174882	0602392	-15.23	0.000	-1.035555	-.799421
	10 11	-.7760539	0601927	-12.89	0.000	-.8940298	-.6580779
11	1	2.037419	2009934	10.14	0.000	1.643477	2.431361
11	2	2.178242	2009978	10.84	0.000	1.784292	2.572193
11	3	2.061936	2009938	10.26	0.000	1.667993	2.455878
11	4	2.26635	2009932	11.28	0.000	1.872409	2.660291
11	5	2.075152	2009938	10.32	0.000	1.68121	2.469095
11	6	1.990757	2009119	9.91	0.000	1.596975	2.384539
11	7	2.171124	.200997	10.80	0.000	1.777176	2.565073
11	8	2.08122	2009936	10.35	0.000	1.687278	2.475162
11	9	2.012565	.200888	10.02	0.000	1.61883	2.4063
	11 10	2.188431	2009933	10.89	0.000	1.79449	2.582372
	11 11	2.246343	2009938	11.18	0.000	1.852401	2.640286
12	1	-.4348615	.077913	-5.58	0.000	-.5875688	-.2821542
12	2	-.3979415	0779139	-5.11	0.000	-.5506507	-.2452324
12	3	-.4312893	0779122	-5.54	0.000	-.5839951	-.2785834
12	4	-.3583009	0779123	-4.60	0.000	-.5110068	-.2055949
12	5	-.4283704	0779124	-5.50	0.000	-.5810765	-.2756642
12	6	-.4416489	0778856	-5.67	0.000	-.5943025	-.2889953
12	7	-.4097439	0779149	-5.26	0.000	-.5624549	-.2570328
12	8	-.4238704	0779113	-5.44	0.000	-.5765744	-.2711664
12	9	-.4347156	0778725	-5.58	0.000	-.5873436	-.2820876
	12 10	-.4094398	0779126	-5.26	0.000	-.5621463	-.2567333
	12 11	-.3880816	.077913	-4.98	0.000	-.540789	-.2353743
zone#c.load							
	1	.0001072	.0000274	3.91	0.000	.0000535	.0001609
	2	-.0000304	.0000231	-1.32	0.187	-.0000757	.0000148
	3	-.0007917	.0000453	-17.46	0.000	-.0008805	-.0007028
	4	-1.24e-06	.0000337	-0.04	0.971	-.0000674	.0000649
	5	-.0003671	.0000332	-11.05	0.000	-.0004322	-.0003019
	6	.000456	.0000445	10.26	0.000	.0003689	.0005432
	7	-.0002727	.0000363	-7.52	0.000	-.0003438	-.0002017
	8	-.002565	.0000705	-36.39	0.000	-.0027032	-.0024269
	9	-.0000259	.00002	-1.30	0.195	-.0000651	.0000133
	10	-.0001968	.000031	-6.36	0.000	-.0002575	-.0001361
	11	-.0000232	.0000227	-1.02	0.308	-.0000677	.0000214
zone#							
c.aggload#							
c.load							
	1	1.03e-08	9.24e-10	11.21	0.000	8.54e-09	1.22e-08
	2	1.16e-08	7.22e-10	16.11	0.000	1.02e-08	1.30e-08
	3	5.49e-08	1.55e-09	35.40	0.000	5.19e-08	5.80e-08
	4	1.78e-08	1.12e-09	15.95	0.000	1.56e-08	2.00e-08
	5	2.87e-08	1.05e-09	27.25	0.000	2.67e-08	3.08e-08
	6	-1.10e-08	2.03e-09	-5.41	0.000	-1.50e-08	-7.00e-09
	7	2.95e-08	1.32e-09	22.31	0.000	2.69e-08	3.20e-08
	8	1.42e-07	3.01e-09	47.18	0.000	1.36e-07	1.48e-07
	9	6.15e-09	9.48e-10	6.48	0.000	4.29e-09	8.00e-09
	10	4.26e-08	1.42e-09	29.99	0.000	3.98e-08	4.53e-08
	11	1.25e-08	7.31e-10	17.11	0.000	1.11e-08	1.39e-08
region#							
c.aggload							
	0	.0004559	7.01e-06	65.05	0.000	.0004421	.0004696
	1	.0004771	.0000178	26.87	0.000	.0004423	.0005119
	2	.0004835	.000017	28.46	0.000	.0004502	.0005168
region#							
c.aggload2							
	0	-.0001722	3.37e-06	-51.10	0.000	-.0001788	-.0001655



	1	-.0001794	8.67e-06	-20.69	0.000	-.0001964	-.0001624
	2	-.0001925	8.18e-06	-23.52	0.000	-.0002085	-.0001764
	regi on#						
	c. aggl oad3						
	0	.0000207	5.22e-07	39.69	0.000	.0000197	.0000217
	1	.0000203	1.31e-06	15.57	0.000	.0000178	.0000229
	2	.0000291	1.37e-06	21.28	0.000	.0000264	.0000317
	m#h#c. l gasp						
1	0	.4744123	.0211858	22.39	0.000	.4328888	.5159359
1	1	.4758305	.0211879	22.46	0.000	.4343029	.5173581
1	2	.4775311	.0211896	22.54	0.000	.4360002	.5190621
1	3	.4485093	.021191	21.17	0.000	.4069756	.490043
1	4	.4747882	.0211916	22.40	0.000	.4332533	.5163231
1	5	.4925606	.0211891	23.25	0.000	.4510306	.5340906
1	6	.4616729	.0211863	21.79	0.000	.4201484	.5031974
1	7	.5469706	.0211856	25.82	0.000	.5054473	.5884938
1	8	.5532034	.0211858	26.11	0.000	.5116799	.5947269
1	9	.5261612	.0211858	24.84	0.000	.4846377	.5676848
	1 10	.5202758	.0211857	24.56	0.000	.4787523	.5617992
	1 11	.4849116	.0211858	22.89	0.000	.443388	.5264351
	1 12	.4665506	.0211858	22.02	0.000	.4250271	.5080742
	1 13	.4551907	.0211859	21.49	0.000	.4136668	.4967145
	1 14	.4385449	.0211861	20.70	0.000	.3970208	.480069
	1 15	.4926138	.0211864	23.25	0.000	.451089	.5341386
	1 16	.5518704	.0211864	26.05	0.000	.5103456	.5933951
	1 17	.5656855	.0211875	26.70	0.000	.5241585	.6072125
	1 18	.626115	.0211884	29.55	0.000	.5845863	.6676437
	1 19	.595949	.0211885	28.13	0.000	.5544202	.6374779
	1 20	.5909292	.0211884	27.89	0.000	.5494006	.6324578
	1 21	.5212541	.021188	24.60	0.000	.4797262	.562782
	1 22	.4541145	.0211874	21.43	0.000	.4125878	.4956413
	1 23	.3891494	.0211881	18.37	0.000	.3476212	.4306775
2	0	.4521006	.0173136	26.11	0.000	.4181664	.4860347
2	1	.4494013	.0173148	25.95	0.000	.4154648	.4833379
2	2	.4394254	.0173159	25.38	0.000	.4054868	.473364
2	3	.4224633	.0173164	24.40	0.000	.3885236	.456403
2	4	.4221169	.0173162	24.38	0.000	.3881777	.4560561
2	5	.4352437	.0173143	25.14	0.000	.4013081	.4691793
2	6	.4748671	.0173137	27.43	0.000	.4409328	.5088014
2	7	.5532416	.0173146	31.95	0.000	.5193054	.5871777
2	8	.5907754	.0173151	34.12	0.000	.5568383	.6247126
2	9	.5510922	.0173161	31.83	0.000	.5171531	.5850313
	2 10	.5709906	.0173167	32.97	0.000	.5370503	.6049309
	2 11	.5559565	.0173167	32.11	0.000	.5220162	.5898967
	2 12	.543001	.0173168	31.36	0.000	.5090605	.5769415
	2 13	.52379	.0173168	30.25	0.000	.4898495	.5577305
	2 14	.5135406	.017317	29.66	0.000	.4795998	.5474815
	2 15	.5804916	.0173174	33.52	0.000	.54655	.6144332
	2 16	.625536	.0173187	36.12	0.000	.5915918	.6594803
	2 17	.6597716	.0173212	38.09	0.000	.6258225	.6937207
	2 18	.5891886	.0173216	34.01	0.000	.5552387	.6231385
	2 19	.6842569	.0173209	39.50	0.000	.6503085	.7182054
	2 20	.6307303	.0173197	36.42	0.000	.5967841	.6646765
	2 21	.5731322	.0173182	33.09	0.000	.5391891	.6070754
	2 22	.5442782	.0173162	31.43	0.000	.5103389	.5782175
	2 23	.4786485	.0173155	27.64	0.000	.4447106	.5125863
3	0	.6493234	.0143827	45.15	0.000	.6211336	.6775132
3	1	.6448974	.0143865	44.83	0.000	.6167003	.6730946
3	2	.6046497	.0146287	41.33	0.000	.575978	.6333215
3	3	.6452937	.0143908	44.84	0.000	.6170881	.6734993
3	4	.5989555	.0143896	41.62	0.000	.5707521	.6271588
3	5	.6449984	.0143836	44.84	0.000	.616807	.6731899
3	6	.5523424	.0143762	38.42	0.000	.5241655	.5805193
3	7	.6441467	.0143743	44.81	0.000	.6159735	.6723198
3	8	.7101783	.0143746	49.41	0.000	.6820046	.7383521
3	9	.6245832	.0143751	43.45	0.000	.5964084	.652758
	3 10	.6753686	.0143753	46.98	0.000	.6471934	.7035437

3 11	.6599872	.0143755	45.91	0.000	.6318116	.6881627
3 12	.6391934	.0143756	44.46	0.000	.6110177	.6673691
3 13	.6056258	.0143758	42.13	0.000	.5774497	.6338019
3 14	.5802788	.0143761	40.36	0.000	.552102	.6084555
3 15	.5713976	.0143766	39.75	0.000	.5432199	.5995753
3 16	.6023877	.0143774	41.90	0.000	.5742083	.630567
3 17	.7398354	.0143792	51.45	0.000	.7116526	.7680182
3 18	.6927777	.014383	48.17	0.000	.6645874	.720968
3 19	.6425715	.0143804	44.68	0.000	.6143864	.6707566
3 20	.681179	.0143784	47.38	0.000	.6529977	.7093602
3 21	.6390155	.0143779	44.44	0.000	.6108352	.6671959
3 22	.6488194	.014378	45.13	0.000	.6206389	.6769998
3 23	.5903332	.0143808	41.05	0.000	.5621472	.6185192
4 0	.7718174	.01269	60.82	0.000	.7469454	.7966894
4 1	.8221376	.0126906	64.78	0.000	.7972643	.8470108
4 2	.8101918	.0126912	63.84	0.000	.7853174	.8350661
4 3	.7808639	.0126916	61.53	0.000	.7559888	.8057391
4 4	.7909276	.0126915	62.32	0.000	.7660525	.8158026
4 5	.8178814	.0126906	64.45	0.000	.7930081	.8427546
4 6	.7445139	.0126892	58.67	0.000	.7196434	.7693844
4 7	.8104031	.0126885	63.87	0.000	.7855339	.8352723
4 8	.8444131	.0126884	66.55	0.000	.8195442	.869282
4 9	.8716136	.0126884	68.69	0.000	.8467446	.8964825
4 10	.8492198	.0126885	66.93	0.000	.8243507	.8740889
4 11	.8621084	.0126885	67.94	0.000	.8372393	.8869775
4 12	.8649852	.0126883	68.17	0.000	.8401164	.889854
4 13	.8424757	.0126884	66.40	0.000	.8176067	.8673446
4 14	.8304002	.0126886	65.44	0.000	.8055309	.8552696
4 15	.8347818	.0126887	65.79	0.000	.8099123	.8596512
4 16	.8299733	.0126886	65.41	0.000	.8051039	.8548427
4 17	.8228648	.0126886	64.85	0.000	.7979955	.8477341
4 18	.8499698	.0126886	66.99	0.000	.8251005	.8748391
4 19	.7998347	.0126886	63.04	0.000	.7749653	.8247041
4 20	.8574108	.0126886	67.57	0.000	.8325414	.8822802
4 21	.8527362	.0126886	67.21	0.000	.8278669	.8776054
4 22	.777246	.0126888	61.25	0.000	.7523763	.8021156
4 23	.7148541	.0126894	56.33	0.000	.6899832	.7397249
5 0	.6090425	.0122803	49.60	0.000	.5849734	.6331115
5 1	.7240093	.0122819	58.95	0.000	.6999937	.7480815
5 2	.7209412	.0122835	58.69	0.000	.696866	.7450165
5 3	.725233	.0122847	59.04	0.000	.7011553	.7493106
5 4	.7376126	.0122851	60.04	0.000	.7135341	.7616911
5 5	.7370347	.0122834	60.00	0.000	.7129595	.7611098
5 6	.7748608	.0122809	63.09	0.000	.7507905	.798931
5 7	.7274926	.0122784	59.25	0.000	.7034273	.7515579
5 8	.7683221	.0122774	62.58	0.000	.7442588	.7923854
5 9	.7977888	.012277	64.98	0.000	.7737263	.8218514
5 10	.8056901	.0122768	65.63	0.000	.781628	.8297523
5 11	.8236807	.0122767	67.09	0.000	.7996188	.8477426
5 12	.8082417	.0122766	65.84	0.000	.78418	.8323034
5 13	.7954608	.0122767	64.79	0.000	.7713989	.8195227
5 14	.7855813	.0122767	63.99	0.000	.7615193	.8096433
5 15	.7928602	.0122767	64.58	0.000	.7687983	.8169221
5 16	.7990124	.0122766	65.08	0.000	.7749506	.8230743
5 17	.7930304	.0122766	64.60	0.000	.7689685	.8170923
5 18	.7737103	.0122766	63.02	0.000	.7496484	.7977721
5 19	.784448	.0122766	63.90	0.000	.7603862	.8085099
5 20	.8278078	.0122768	67.43	0.000	.8037457	.8518699
5 21	.8091807	.012277	65.91	0.000	.7851182	.8332433
5 22	.776613	.0122778	63.25	0.000	.7525489	.8006772
5 23	.7504292	.0122794	61.11	0.000	.7263619	.7744965
6 0	.739573	.0110746	66.78	0.000	.717867	.761279
6 1	.7738024	.0110902	69.77	0.000	.7520658	.7955389
6 2	.8083546	.0111039	72.80	0.000	.7865913	.8301179
6 3	.8194371	.0111112	73.75	0.000	.7976594	.8412148
6 4	.801301	.0111078	72.14	0.000	.7795301	.8230719
6 5	.8211585	.0110895	74.05	0.000	.7994235	.8428936
6 6	.7484788	.0110629	67.66	0.000	.7267958	.7701618
6 7	.8103389	.0110496	73.34	0.000	.7886821	.8319957

6	8	.8417989	.0110476	76.20	0.000	.8201459	.863452
6	9	.8516635	.0110489	77.08	0.000	.8300079	.8733192
	6 10	.8433798	.0110508	76.32	0.000	.8217206	.865039
	6 11	.8598498	.0110527	77.80	0.000	.8381868	.8815128
	6 12	.8710438	.0110542	78.80	0.000	.8493777	.8927098
	6 13	.8763884	.0110563	79.27	0.000	.8547184	.8980585
	6 14	.8861478	.0110582	80.14	0.000	.8644741	.9078214
	6 15	.8495227	.0110596	76.81	0.000	.8278462	.8711993
	6 16	.8901696	.0110611	80.48	0.000	.8684902	.9118489
	6 17	.8616033	.01106	77.90	0.000	.839926	.8832805
	6 18	.8276618	.0110582	74.85	0.000	.8059879	.8493357
	6 19	.8214903	.0110565	74.30	0.000	.7998198	.8431607
	6 20	.8188869	.0110557	74.07	0.000	.7972182	.8405557
	6 21	.8104968	.0110573	73.30	0.000	.7888247	.8321688
	6 22	.8077511	.0110581	73.05	0.000	.7860776	.8294247
	6 23	.7911891	.0110615	71.53	0.000	.7695089	.8128694
7	0	.8322093	.0108982	76.36	0.000	.8108492	.8535695
7	1	.8768717	.0109044	80.41	0.000	.8554993	.898244
7	2	.906622	.0109123	83.08	0.000	.8852342	.9280098
7	3	.9402575	.0109184	86.12	0.000	.9188577	.9616572
7	4	.9492804	.0109177	86.95	0.000	.927882	.9706789
7	5	.9253994	.0109089	84.83	0.000	.9040183	.9467805
7	6	.8922173	.0108952	81.89	0.000	.870863	.9135716
7	7	.8660862	.0108877	79.55	0.000	.8447466	.8874259
7	8	.8875519	.0108865	81.53	0.000	.8662147	.9088891
7	9	.8843878	.0108874	81.23	0.000	.8630487	.9057269
	7 10	.912332	.0108894	83.78	0.000	.8909891	.9336749
	7 11	.9381126	.0108936	86.12	0.000	.9167614	.9594637
	7 12	.9664736	.0108992	88.67	0.000	.9451114	.9878358
	7 13	.9943319	.010906	91.17	0.000	.9729565	1.015707
	7 14	.9820511	.0109122	90.00	0.000	.9606635	1.003439
	7 15	1.001492	.0109179	91.73	0.000	.9800931	1.022891
	7 16	1.00359	.0109202	91.90	0.000	.9821866	1.024993
	7 17	.9569446	.0109154	87.67	0.000	.9355508	.9783385
	7 18	.9571474	.0109061	87.76	0.000	.9357718	.9785231
	7 19	.933618	.010901	85.65	0.000	.9122524	.9549836
	7 20	.9187317	.0108982	84.30	0.000	.8973716	.9400918
	7 21	.9221061	.0108983	84.61	0.000	.9007458	.9434663
	7 22	.8542231	.0108983	78.38	0.000	.8328627	.8755836
	7 23	.8637324	.0108974	79.26	0.000	.8423737	.8850911
8	0	.8745975	.0132531	65.99	0.000	.8486218	.9005732
8	1	.8837413	.0132541	66.68	0.000	.8577636	.9097191
8	2	.908857	.0132547	68.57	0.000	.8828781	.9348359
8	3	.9526483	.013255	71.87	0.000	.9266687	.9786278
8	4	.9639851	.013255	72.73	0.000	.9380056	.9899645
8	5	.9045721	.0132544	68.25	0.000	.8785938	.9305503
8	6	.975114	.0132529	73.58	0.000	.9491386	1.001089
8	7	.8777931	.0132518	66.24	0.000	.85182	.9037662
8	8	.8732407	.0132511	65.90	0.000	.8472689	.8992125
8	9	.8595226	.0132513	64.86	0.000	.8335505	.8854947
	8 10	.8784593	.0132521	66.29	0.000	.8524855	.9044331
	8 11	.8728471	.0132536	65.86	0.000	.8468705	.8988237
	8 12	.8788595	.0132555	66.30	0.000	.8528791	.9048399
	8 13	.9122202	.0132569	68.81	0.000	.886237	.9382034
	8 14	.9054613	.0132579	68.30	0.000	.8794762	.9314464
	8 15	.9161417	.0132583	69.10	0.000	.8901558	.9421276
	8 16	.8993348	.013257	67.84	0.000	.8733515	.9253182
	8 17	.9396071	.0132554	70.89	0.000	.913627	.9655872
	8 18	.9446355	.0132535	71.27	0.000	.918659	.970612
	8 19	.9227614	.0132533	69.62	0.000	.8967853	.9487376
	8 20	.8750034	.0132536	66.02	0.000	.8490266	.9009801
	8 21	.9094466	.0132527	68.62	0.000	.8834717	.9354216
	8 22	.8401252	.0132521	63.40	0.000	.8141513	.866099
	8 23	.8634566	.0132524	65.15	0.000	.8374822	.8894309
9	0	.9324642	.0134782	69.18	0.000	.9060472	.9588811
9	1	.8611445	.0134857	63.86	0.000	.8347128	.8875761
9	2	.9709014	.0134925	71.96	0.000	.9444564	.9973464
9	3	1.020388	.0134961	75.61	0.000	.9939357	1.04684
9	4	.9385496	.0134959	69.54	0.000	.9120981	.9650011

9	5	.8778489	.013489	65.08	0.000	.8514109	.904287
9	6	.9602968	.0134777	71.25	0.000	.9338808	.9867128
9	7	.8997686	.0134716	66.79	0.000	.8733646	.9261726
9	8	.9346233	.013469	69.39	0.000	.9082245	.9610221
9	9	.8805057	.0134688	65.37	0.000	.8541073	.9069041
	9 10	.8622697	.0134692	64.02	0.000	.8358704	.8886689
	9 11	.859572	.0134693	63.82	0.000	.8331725	.8859714
	9 12	.8529134	.0134692	63.32	0.000	.8265141	.8793128
	9 13	.8685621	.0134693	64.48	0.000	.8421626	.8949616
	9 14	.8793728	.0134696	65.29	0.000	.8529728	.9057728
	9 15	.8893887	.01347	66.03	0.000	.862988	.9157895
	9 16	.8733983	.0134703	64.84	0.000	.8469969	.8997997
	9 17	.9118276	.0134703	67.69	0.000	.8854261	.9382291
	9 18	.8753465	.0134709	64.98	0.000	.8489439	.9017491
	9 19	.8227367	.0134722	61.07	0.000	.7963317	.8491418
	9 20	.8656303	.0134709	64.26	0.000	.8392278	.8920328
	9 21	.8750559	.0134704	64.96	0.000	.8486543	.9014575
	9 22	.8505604	.0134701	63.14	0.000	.8241593	.8769614
	9 23	.9140007	.0134718	67.85	0.000	.8875962	.9404051
10	0	.9569601	.0201851	47.41	0.000	.9173978	.9965225
10	1	.8135069	.0201946	40.28	0.000	.773926	.8530878
10	2	.6718441	.020202	33.26	0.000	.6322487	.7114395
10	3	.7072993	.0202053	35.01	0.000	.6676975	.7469012
10	4	.7415897	.0202037	36.71	0.000	.7019909	.7811884
10	5	.8510584	.0201961	42.14	0.000	.8114746	.8906422
10	6	.9438482	.020181	46.77	0.000	.904294	.9834024
10	7	.8979381	.0201747	44.51	0.000	.8583963	.9374799
10	8	.9075454	.020172	44.99	0.000	.8680088	.9470819
10	9	.8466833	.0201717	41.97	0.000	.8071473	.8862193
	10 10	.8391768	.0201721	41.60	0.000	.79964	.8787136
	10 11	.8571236	.0201725	42.49	0.000	.8175861	.8966612
	10 12	.8980315	.020173	44.52	0.000	.8584929	.9375701
	10 13	.9652445	.0201738	47.85	0.000	.9257044	1.004785
	10 14	.9808336	.0201743	48.62	0.000	.9412925	1.020375
	10 15	1.001672	.0201747	49.65	0.000	.9621299	1.041213
	10 16	.9643498	.0201743	47.80	0.000	.9248087	1.003891
	10 17	.9301944	.0201731	46.11	0.000	.8906555	.9697332
	10 18	.7727468	.0201734	38.31	0.000	.7332074	.8122861
	10 19	.8196416	.0201729	40.63	0.000	.7801032	.85918
	10 20	.9431432	.0201721	46.75	0.000	.9036064	.98268
	10 21	.947514	.0201713	46.97	0.000	.9079789	.9870491
	10 22	.9261709	.0201724	45.91	0.000	.8866336	.9657083
	10 23	.996572	.0202483	49.22	0.000	.9568859	1.036258
11	0	-.8164608	.0937688	-8.71	0.000	-1.000245	-.6326767
11	1	-.1629075	.0913366	-1.78	0.074	-.3419247	.0161097
11	2	-.9889076	.0937868	-10.54	0.000	-1.172727	-.805088
11	3	-1.012014	.0937921	-10.79	0.000	-1.195844	-.8281839
11	4	-.9989093	.0937917	-10.65	0.000	-1.182738	-.8150803
11	5	-.9420065	.0937901	-10.04	0.000	-1.125833	-.7581805
11	6	-.8071879	.0937906	-8.61	0.000	-.9910149	-.623361
11	7	.004222	.0937761	0.05	0.964	-.1795766	.1880206
11	8	.0004588	.0937676	0.00	0.996	-.1833232	.1842407
11	9	-.0211052	.0937646	-0.23	0.822	-.2048812	.1626709
	11 10	-.0582631	.0937636	-0.62	0.534	-.2420371	.1255109
	11 11	.0483702	.0937633	0.52	0.606	-.1354032	.2321437
	11 12	.0104902	.0937634	0.11	0.911	-.1732834	.1942638
	11 13	.0586529	.0937643	0.63	0.532	-.1251225	.2424282
	11 14	.1823458	.0937653	1.94	0.052	-.0014317	.3661233
	11 15	.3203096	.0937667	3.42	0.001	.1365295	.5040896
	11 16	.3874305	.0937782	4.13	0.000	.2036278	.5712333
	11 17	.7334768	.0937795	7.82	0.000	.5496413	.9173123
	11 18	.4707368	.093788	5.02	0.000	.2869149	.6545587
	11 19	.2428298	.0937836	2.59	0.010	.0590166	.4266431
	11 20	.1281229	.0937777	1.37	0.172	-.0556788	.3119246
	11 21	-.0173211	.0937705	-0.18	0.853	-.2011087	.1664665
	11 22	-.2466814	.0937672	-2.63	0.009	-.4304624	-.0629004
	11 23	-.4915673	.0937714	-5.24	0.000	-.6753566	-.307778
12	0	.7147424	.0297239	24.05	0.000	.6564844	.7730004
12	1	.7794505	.0297285	26.22	0.000	.7211834	.8377176

12	2	.7522213	.0297338	25.30	0.000	.6939438	.8104988
12	3	.7668817	.0297368	25.79	0.000	.7085984	.8251649
12	4	.7910097	.029737	26.60	0.000	.732726	.8492934
12	5	.8124171	.0297319	27.32	0.000	.7541435	.8706907
12	6	.6369047	.0297264	21.43	0.000	.5786418	.6951677
12	7	.7122103	.0297231	23.96	0.000	.6539538	.7704669
12	8	.7690105	.0297219	25.87	0.000	.7107564	.8272647
12	9	.8025496	.0297219	27.00	0.000	.7442955	.8608037
	12 10	.8092657	.0297219	27.23	0.000	.7510116	.8675199
	12 11	.8015531	.0297225	26.97	0.000	.7432979	.8598084
	12 12	.8245245	.0297231	27.74	0.000	.766268	.882781
	12 13	.8327687	.0297239	28.02	0.000	.7745108	.8910267
	12 14	.804475	.0297246	27.06	0.000	.7462156	.8627345
	12 15	.8730531	.0297257	29.37	0.000	.8147915	.9313147
	12 16	.8359696	.0297268	28.12	0.000	.7777059	.8942333
	12 17	.7667593	.029728	25.79	0.000	.7084933	.8250253
	12 18	.7937698	.0297284	26.70	0.000	.735503	.8520366
	12 19	.7630419	.0297281	25.67	0.000	.7047757	.8213082
	12 20	.7835576	.0297264	26.36	0.000	.7252946	.8418205
	12 21	.8196906	.0297244	27.58	0.000	.7614317	.8779495
	12 22	.7856672	.0297236	26.43	0.000	.7274099	.8439246
	12 23	.6791589	.029725	22.85	0.000	.6208987	.7374191
	rm	-.9983449	.0240979	-41.43	0.000	-1.045576	-.9511137
	h#m						
0	2	.0992964	.0531126	1.87	0.062	-.0048028	.2033956
0	3	-.0769298	.0421355	-1.83	0.068	-.1595141	.0056545
0	4	-.0888074	.0370422	-2.40	0.017	-.1614091	-.0162058
0	5	.2815468	.0366597	7.68	0.000	.2096948	.3533987
0	6	.1700937	.0333888	5.09	0.000	.1046527	.2355348
0	7	.1207439	.0309309	3.90	0.000	.0601203	.1813676
0	8	.0232727	.0350754	0.66	0.507	-.0454741	.0920194
0	9	.0450664	.0343859	1.31	0.190	-.022329	.1124617
	0 10	.1617002	.0536787	3.01	0.003	.0564915	.2669089
	0 11	.7521408	.2762241	2.72	0.006	.2107493	1.293532
	0 12	-.015368	.0882496	-0.17	0.862	-.1883348	.1575988
1	1	-.0113033	.0655833	-0.17	0.863	-.1398447	.1172381
1	2	.1273157	.0531171	2.40	0.017	.0232077	.2314237
1	3	-.0616141	.0421474	-1.46	0.144	-.1442217	.0209935
1	4	-.1800809	.0370557	-4.86	0.000	-.2527091	-.1074527
1	5	.0585419	.0366773	1.60	0.110	-.0133445	.1304284
1	6	.0468886	.0334294	1.40	0.161	-.0186321	.1124092
1	7	-.0041224	.0309539	-0.13	0.894	-.0647913	.0565464
1	8	-.0551514	.035081	-1.57	0.116	-.1239091	.0136063
1	9	.116126	.0344096	3.37	0.001	.0486843	.1835678
	1 10	.3768763	.0537025	7.02	0.000	.2716208	.4821318
	1 11	-.6557262	.2725757	-2.41	0.016	-1.189967	-.1214854
	1 12	-.1886699	.0882606	-2.14	0.033	-.3616583	-.0156816
2	1	-.0226198	.0655868	-0.34	0.730	-.151168	.1059285
2	2	.1470043	.0531218	2.77	0.006	.042887	.2511216
2	3	.0071343	.0425286	0.17	0.867	-.0762206	.0904892
2	4	-.1667912	.03707	-4.50	0.000	-.2394473	-.0941351
2	5	.0474503	.0366969	1.29	0.196	-.0244745	.1193752
2	6	-.0555117	.0334724	-1.66	0.097	-.1211166	.0100933
2	7	-.0918608	.030982	-2.96	0.003	-.1525847	-.0311369
2	8	-.1208909	.0350861	-3.45	0.001	-.1896587	-.052123
2	9	-.1525217	.0344356	-4.43	0.000	-.2200144	-.0850289
	2 10	.5855904	.0537261	10.90	0.000	.4802887	.6908921
	2 11	1.077119	.2762523	3.90	0.000	.5356718	1.618565
	2 12	-.1494511	.0882745	-1.69	0.090	-.3224667	.0235645
3	1	.0318217	.0655895	0.49	0.628	-.0967319	.1603753
3	2	.1912328	.0531244	3.60	0.000	.0871104	.2953551
3	3	-.076514	.0421648	-1.81	0.070	-.1591558	.0061278
3	4	-.1040354	.037079	-2.81	0.005	-.1767092	-.0313616
3	5	.0349377	.0367102	0.95	0.341	-.0370133	.1068887
3	6	-.1055803	.0335001	-3.15	0.002	-.1712395	-.0399211
3	7	-.178911	.0310043	-5.77	0.000	-.2396786	-.1181434
3	8	-.2117396	.0350903	-6.03	0.000	-.2805156	-.1429636

3	9	-.2489961	.0344523	-7.23	0.000	-.3165216	-.1814706
	3 10	.5256667	.0537389	9.78	0.000	.4203399	.6309935
	3 11	1.130941	.2762615	4.09	0.000	.5894762	1.672406
	3 12	-.1765707	.088283	-2.00	0.045	-.3496028	-.0035386
4	1	-.0153076	.0655892	-0.23	0.815	-.1438607	.1132455
4	2	.1872386	.0531224	3.52	0.000	.0831202	.291357
4	3	.0312776	.0421604	0.74	0.458	-.0513556	.1139109
4	4	-.117369	.0370757	-3.17	0.002	-.1900364	-.0447016
4	5	.0355007	.0367077	0.97	0.333	-.0364454	.1074467
4	6	-.0611158	.033494	-1.82	0.068	-.126763	.0045315
4	7	-.1943547	.0310059	-6.27	0.000	-.2551254	-.1335841
4	8	-.2345498	.0350912	-6.68	0.000	-.3033275	-.1657721
4	9	-.0771548	.0344501	-2.24	0.025	-.1446761	-.0096335
	4 10	.4677028	.0537333	8.70	0.000	.3623871	.5730185
	4 11	1.090767	.2762598	3.95	0.000	.5493051	1.632228
	4 12	-.2401017	.0882814	-2.72	0.007	-.4131308	-.0670726
5	1	-.0214168	.0655835	-0.33	0.744	-.1499586	.1071251
5	2	.1806222	.0531145	3.40	0.001	.0765192	.2847252
5	3	-.026385	.0421413	-0.63	0.531	-.1089808	.0562107
5	4	-.1518971	.037054	-4.10	0.000	-.2245219	-.0792723
5	5	.0614679	.0366818	1.68	0.094	-.0104274	.1333632
5	6	-.10582	.033447	-3.16	0.002	-.1713752	-.0402649
5	7	-.1416849	.0309821	-4.57	0.000	-.2024089	-.080961
5	8	-.106135	.0350864	-3.02	0.002	-.1749034	-.0373666
5	9	.0878841	.034417	2.55	0.011	.0204277	.1553405
	5 10	.3334	.0537004	6.21	0.000	.2281486	.4386514
	5 11	1.010314	.2762467	3.66	0.000	.4688784	1.55175
	5 12	-.2348527	.0882642	-2.66	0.008	-.4078482	-.0618573
6	1	.0940604	.0655836	1.43	0.152	-.0344816	.2226025
6	2	.1474112	.0531148	2.78	0.006	.0433076	.2515147
6	3	.1998477	.0421362	4.74	0.000	.1172619	.2824335
6	4	.0678424	.0370404	1.83	0.067	-.0047557	.1404405
6	5	.0126545	.0366568	0.35	0.730	-.0591918	.0845008
6	6	.0585977	.0333849	1.76	0.079	-.0068358	.1240311
6	7	-.1066476	.0309452	-3.45	0.001	-.1672994	-.0459959
6	8	-.2531306	.0350792	-7.22	0.000	-.3218848	-.1843764
6	9	-.0152277	.034384	-0.44	0.658	-.0826194	.0521639
	6 10	.3206247	.0536717	5.97	0.000	.2154297	.4258198
	6 11	.8144121	.2762407	2.95	0.003	.272988	1.355836
	6 12	.1771196	.0882505	2.01	0.045	.004151	.3500882
7	1	-.1061878	.0655883	-1.62	0.105	-.2347391	.0223634
7	2	-.0687407	.0531187	-1.29	0.196	-.1728518	.0353705
7	3	-.0143358	.0421434	-0.34	0.734	-.0969356	.068264
7	4	-.1155836	.037041	-3.12	0.002	-.188183	-.0429842
7	5	.1158813	.0366551	3.16	0.002	.0440383	.1877243
7	6	-.06172	.0333726	-1.85	0.064	-.1271294	.0036894
7	7	-.0676844	.0309258	-2.19	0.029	-.1282981	-.0070707
7	8	-.1256294	.0350743	-3.58	0.000	-.194374	-.0568848
7	9	.0255789	.0343778	0.74	0.457	-.0418006	.0929583
	7 10	.3336444	.053674	6.22	0.000	.2284448	.4388439
	7 11	-.9246814	.2762371	-3.35	0.001	-.1.466098	-.3832644
	7 12	-.0075913	.0882499	-0.09	0.931	-.1805588	.1653761
8	1	-.1535629	.0655916	-2.34	0.019	-.2821206	-.0250053
8	2	-.1678536	.0531225	-3.16	0.002	-.2719723	-.0637349
8	3	-.1842978	.0421482	-4.37	0.000	-.2669071	-.1016885
8	4	-.1963893	.037046	-5.30	0.000	-.2689984	-.1237802
8	5	.0227522	.0366634	0.62	0.535	-.049107	.0946114
8	6	-.1255074	.0333839	-3.76	0.000	-.190939	-.0600758
8	7	-.0912013	.03093	-2.95	0.003	-.1518232	-.0305794
8	8	-.0779867	.0350743	-2.22	0.026	-.1467314	-.0092421
8	9	-.044768	.0343834	-1.30	0.193	-.1121585	.0226225
	8 10	.2654836	.0536832	4.95	0.000	.160266	.3707012
	8 11	-.9449738	.276246	-3.42	0.001	-.1.486408	-.4035392
	8 12	-.1275964	.0882521	-1.45	0.148	-.300568	.0453752
9	1	-.0929511	.065595	-1.42	0.156	-.2215154	.0356132
9	2	-.0910792	.0531248	-1.71	0.086	-.1952023	.013044
9	3	.0196922	.0421523	0.47	0.640	-.0629251	.1023095
9	4	-.2419917	.0370501	-6.53	0.000	-.314609	-.1693744
9	5	-.0318446	.036671	-0.87	0.385	-.1037188	.0400296

9	6	-.1377756	.0333971	-4.13	0.000	-.2032331	-.0723181
9	7	-.0592429	.0309415	-1.91	0.056	-.1198873	.0014015
9	8	-.0404322	.0350793	-1.15	0.249	-.1091867	.0283224
9	9	.080914	.0343924	2.35	0.019	.0135059	.1483221
	9 10	.3886842	.053692	7.24	0.000	.2834495	.493919
	9 11	-.9083293	.2762522	-3.29	0.001	-1.449776	-.3668827
	9 12	-.2056816	.0882547	-2.33	0.020	-.3786583	-.0327048
10	1	-.0931511	.0655972	-1.42	0.156	-.2217198	.0354177
10	2	-.1600513	.0531261	-3.01	0.003	-.2641771	-.0559256
10	3	-.1176484	.0421549	-2.79	0.005	-.2002708	-.035026
10	4	-.2012105	.0370525	-5.43	0.000	-.2738325	-.1285886
10	5	-.0443178	.0366761	-1.21	0.227	-.1162019	.0275662
10	6	-.0968637	.0334084	-2.90	0.004	-.1623432	-.0313843
10	7	-.0830699	.030956	-2.68	0.007	-.1437428	-.0223969
10	8	-.0500499	.0350871	-1.43	0.154	-.1188196	.0187199
10	9	.1181597	.0343994	3.43	0.001	.0507377	.0758816
	10 10	.3919112	.0536977	7.30	0.000	.2866651	.4971573
	10 11	-.8498005	.2762544	-3.08	0.002	-1.391251	-.3083496
	10 12	-.2410153	.0882567	-2.73	0.006	-.4139959	-.0680346
11	1	-.0502063	.0655981	-0.77	0.444	-.1787767	.075364
11	2	-.1661365	.0531262	-3.13	0.002	-.2702623	-.0620107
11	3	-.1171792	.0421548	-2.78	0.005	-.1998014	-.0345569
11	4	-.240647	.0370531	-6.49	0.000	-.31327	-.168024
11	5	-.0684863	.0366785	-1.87	0.062	-.1403751	.0034026
11	6	-.1087667	.0334162	-3.25	0.001	-.1742615	-.0432718
11	7	-.1190468	.0309702	-3.84	0.000	-.1797476	-.058346
11	8	-.0176854	.0350966	-0.50	0.614	-.0864737	.0511029
11	9	.1317243	.034404	3.83	0.000	.0642934	.1991553
	11 10	.3524069	.0537002	6.56	0.000	.2471561	.4576578
	11 11	-1.098486	.2762532	-3.98	0.000	-1.639935	-.5570377
	11 12	-.2598576	.0882573	-2.94	0.003	-.4328394	-.0868758
12	1	-.0576642	.065598	-0.88	0.379	-.1862344	.070906
12	2	-.1784602	.0531248	-3.36	0.001	-.2825833	-.0743371
12	3	-.1091588	.0421535	-2.59	0.010	-.1917784	-.0265392
12	4	-.2666737	.0370526	-7.20	0.000	-.3392958	-.1940515
12	5	-.0452313	.0366795	-1.23	0.218	-.117122	.0266594
12	6	-.1109116	.0334206	-3.32	0.001	-.1764151	-.0454081
12	7	-.1559441	.030981	-5.03	0.000	-.2166661	-.0952222
12	8	-.0032618	.0351055	-0.09	0.926	-.0720677	.065544
12	9	.1498718	.0344066	4.36	0.000	.0824358	.2173077
	12 10	.2563783	.0537006	4.77	0.000	.1511267	.3616299
	12 11	-1.056694	.2762506	-3.83	0.000	-1.598137	-.5152502
	12 12	-.339579	.0882567	-3.85	0.000	-.5125597	-.1665982
13	1	-.0633734	.0655976	-0.97	0.334	-.1919429	.0651961
13	2	-.1763818	.0531234	-3.32	0.001	-.2805023	-.0722614
13	3	-.0690282	.0421514	-1.64	0.102	-.1516438	.0135873
13	4	-.2249222	.0370517	-6.07	0.000	-.2975425	-.1523019
13	5	-.0124587	.0366793	-0.34	0.734	-.084349	.0594317
13	6	-.1038406	.0334241	-3.11	0.002	-.1693509	-.0383304
13	7	-.1944628	.0309908	-6.27	0.000	-.2552038	-.1337217
13	8	-.0473358	.0351133	-1.35	0.178	-.1161569	.0214853
13	9	.136494	.0344085	3.97	0.000	.0690543	.2039337
	13 10	.1320321	.0537003	2.46	0.014	.026781	.2372832
	13 11	-1.169738	.2762485	-4.23	0.000	-1.711177	-.6282983
	13 12	-.3658204	.0882559	-4.14	0.000	-.5387995	-.1928412
14	1	-.0442126	.065597	-0.67	0.500	-.172781	.0843557
14	2	-.1782288	.0531217	-3.36	0.001	-.2823459	-.0741117
14	3	-.0450617	.0421487	-1.07	0.285	-.127672	.0375485
14	4	-.2228431	.0370504	-6.01	0.000	-.2954607	-.1502254
14	5	-.0063928	.0366785	-0.17	0.862	-.0782817	.0654962
14	6	-.120671	.0334254	-3.61	0.000	-.186184	-.0551581
14	7	-.15179	.0309969	-4.90	0.000	-.2125431	-.0910369
14	8	-.026439	.0351193	-0.75	0.452	-.0952718	.0423938
14	9	.1116441	.0344088	3.24	0.001	.0442038	.1790844
	14 10	.0506324	.0536989	0.94	0.346	-.054616	.1558808
	14 11	-1.451379	.2762464	-5.25	0.000	-1.992814	-.9099435
	14 12	-.3402175	.088255	-3.85	0.000	-.5131948	-.1672401
15	1	-.1569476	.0655974	-2.39	0.017	-.2855166	-.0283785
15	2	-.3412827	.0531207	-6.42	0.000	-.4453979	-.2371675

15	3	-.0302982	.0421471	-0.72	0.472	-.1129053	.0523088
15	4	-.2418579	.0370493	-6.53	0.000	-.3144735	-.1692422
15	5	-.026944	.0366776	-0.73	0.463	-.0988311	.044943
15	6	-.0430397	.0334262	-1.29	0.198	-.1085542	.0224748
15	7	-.1777803	.0310013	-5.73	0.000	-.238542	-.1170186
15	8	-.0323263	.0351218	-0.92	0.357	-.101164	.0365114
15	9	.1093505	.0344086	3.18	0.001	.0419105	.1767904
15	10	.0135243	.0536981	0.25	0.801	-.0917225	.1187711
15	11	-1.749886	.2762477	-6.33	0.000	-2.291324	-1.208448
15	12	-.4772354	.0882552	-5.41	0.000	-.6502132	-.3042575
16	1	-.1902624	.0656011	-2.90	0.004	-.3188387	-.0616861
16	2	-.3932119	.0531221	-7.40	0.000	-.4973297	-.289094
16	3	-.0842954	.0421474	-2.00	0.045	-.166903	-.0016877
16	4	-.2300177	.0370494	-6.21	0.000	-.3026334	-.157402
16	5	-.0253662	.0366776	-0.69	0.489	-.0972533	.0465209
16	6	-.0947422	.033428	-2.83	0.005	-.1602601	-.0292243
16	7	-.171653	.0310022	-5.54	0.000	-.2324164	-.1108895
16	8	.0143942	.0351185	0.41	0.682	-.0544371	.0832254
16	9	.1619563	.0344092	4.71	0.000	.0945153	.2293973
16	10	.123407	.0536994	2.30	0.022	.0181577	.2286562
16	11	-1.768618	.2762686	-6.40	0.000	-2.310096	-1.227139
16	12	-.2577756	.08826	-2.92	0.003	-.4307627	-.0847886
17	1	-.0259954	.0656079	-0.40	0.692	-.1545851	.1025943
17	2	-.2946654	.0531288	-5.55	0.000	-.3987963	-.1905345
17	3	-.3208974	.0421489	-7.61	0.000	-.4035081	-.2382867
17	4	-.216887	.0370497	-5.85	0.000	-.2895035	-.1442706
17	5	-.0216738	.0366773	-0.59	0.555	-.0935603	.0502127
17	6	-.0663927	.0334242	-1.99	0.047	-.1319033	-.0008822
17	7	-.1203815	.0309929	-3.88	0.000	-.1811268	-.0596362
17	8	-.098381	.0351104	-2.80	0.005	-.1671963	-.0295656
17	9	.0497277	.0344079	1.45	0.148	-.0177109	.1171663
17	10	.1854453	.0537015	3.45	0.001	.080192	.2906987
17	11	-2.366232	.2763078	-8.56	0.000	-2.907787	-1.824676
17	12	.0363949	.0882683	0.41	0.680	-.1366084	.2093982
18	1	-.211818	.0656079	-3.23	0.001	-.3404077	-.0832283
18	2	-.0734175	.0531356	-1.38	0.167	-.1775618	.0307268
18	3	-.0870622	.0421519	-2.07	0.039	-.1696788	-.0044456
18	4	-.2903082	.0370492	-7.84	0.000	-.3629236	-.2176929
18	5	-.0198428	.0366752	-0.54	0.588	-.0917252	.0520395
18	6	-.0461997	.0334131	-1.38	0.167	-.1116884	.0192891
18	7	-.1724331	.030969	-5.57	0.000	-.2331315	-.1117346
18	8	-.1561681	.035098	-4.45	0.000	-.2249593	-.087377
18	9	.0830434	.0344042	2.41	0.016	.0156122	.1504747
18	10	.5850449	.0537073	10.89	0.000	.4797801	.6903098
18	11	-1.887647	.2763063	-6.83	0.000	-2.429199	-1.346094
18	12	-.0686527	.0882678	-0.78	0.437	-.2416551	.1043496
19	1	-.205984	.0656059	-3.14	0.002	-.3345697	-.0773982
19	2	-.3813923	.0531333	-7.18	0.000	-.4855322	-.2772524
19	3	.0255983	.0421588	0.61	0.544	-.0570317	.1082283
19	4	-.1196827	.0370521	-3.23	0.001	-.1923038	-.0470616
19	5	-.0322986	.0366744	-0.88	0.378	-.1041794	.0395822
19	6	-.0511244	.0334056	-1.53	0.126	-.1165985	.0143496
19	7	-.1497751	.0309515	-4.84	0.000	-.2104391	-.0891111
19	8	-.1448773	.0350923	-4.13	0.000	-.2136573	-.0760973
19	9	.2244635	.0344077	6.52	0.000	.1570253	.2919017
19	10	.53456	.0537112	9.95	0.000	.4292874	.6398325
19	11	-1.450535	.2762957	-5.25	0.000	-1.992067	-.9090029
19	12	-.0408548	.0882654	-0.46	0.643	-.2138526	.132143
20	1	-.2348955	.0656032	-3.58	0.000	-.3634759	-.1063151
20	2	-.2980902	.0531288	-5.61	0.000	-.4022212	-.1939591
20	3	-.1142982	.0421586	-2.71	0.007	-.1969279	-.0316685
20	4	-.1981389	.0370568	-5.35	0.000	-.2707692	-.1255087
20	5	-.0432268	.0366778	-1.18	0.239	-.1151142	.0286607
20	6	-.0216685	.0334058	-0.65	0.517	-.0871429	.0438058
20	7	-.1007834	.0309477	-3.26	0.001	-.16144	-.0401268
20	8	-.0292529	.0350938	-0.83	0.405	-.0980358	.03953
20	9	.1436888	.0344085	4.18	0.000	.0762491	.2111285
20	10	.1242556	.0537053	2.31	0.021	.0189948	.2295164
20	11	-1.253252	.2762787	-4.54	0.000	-1.794751	-.7117538



20	12	-.1397632	0882629	-1.58	0.113	-.312756	.0332296
21	1	-.1522248	0655986	-2.32	0.020	-.2807962	-.0236534
21	2	-.2489426	0531224	-4.69	0.000	-.353061	-.1448242
21	3	-.1157464	0421498	-2.75	0.006	-.1983588	-.033134
21	4	-.2828249	0370511	-7.63	0.000	-.355444	-.2102058
21	5	-.0884475	.036673	-2.41	0.016	-.1603256	-.0165693
21	6	-.0519476	0334027	-1.56	0.120	-.117416	.0135208
21	7	-.1331926	0309457	-4.30	0.000	-.1938452	-.0725399
21	8	-.1248997	0350862	-3.56	0.000	-.1936677	-.0561317
21	9	.0438757	0343974	1.28	0.202	-.0235423	.1112937
21	10	.0948281	0536936	1.77	0.077	-.0104098	.200066
21	11	-.9937776	2762524	-3.60	0.000	-.1535225	-.4523306
21	12	-.3050285	0882586	-3.46	0.001	-.4780129	-.1320441
22	1	-.0375811	0655911	-0.57	0.567	-.1661378	.0909757
22	2	-.1932382	0531148	-3.64	0.000	-.2973417	-.0891346
22	3	-.1936781	0421375	-4.60	0.000	-.2762665	-.1110897
22	4	-.1876114	0370414	-5.06	0.000	-.2602115	-.1150112
22	5	-.0983374	0366596	-2.68	0.007	-.1701892	-.0264857
22	6	-.0857284	0333818	-2.57	0.010	-.1511558	-.0203011
22	7	-.0326883	0309285	-1.06	0.291	-.0933074	.0279307
22	8	-.0271291	0350761	-0.77	0.439	-.0958772	.0416191
22	9	.0694397	0343833	2.02	0.043	.0020494	.13683
22	10	.1119517	0536772	2.09	0.037	.0067458	.2171575
22	11	-.5277729	2762265	-1.91	0.056	-.1069169	.0136233
22	12	-.278592	0882512	-3.16	0.002	-.4515619	-.1056221
23	1	.1397351	0655838	2.13	0.033	.0111927	.2682775
23	2	(omitted)					
23	3	(omitted)					
23	4	(omitted)					
23	5	(omitted)					
23	6	(omitted)					
23	7	(omitted)					
23	8	(omitted)					
23	9	(omitted)					
23	10	(omitted)					
23	11	(omitted)					
23	12	(omitted)					
	dow						
	1	-.0054048	.001234	-4.38	0.000	-.0078243	-.0029853
	2	-.0157742	.001258	-12.53	0.000	-.0182406	-.0133077
	3	-.0234116	.001255	-18.65	0.000	-.025872	-.0209511
	4	-.0169819	.001254	-13.54	0.000	-.0194405	-.0145232
	5	-.0011211	.001239	-0.90	0.366	-.0035513	.001309
	6	.0141294	.001141	12.38	0.000	.0118926	.0163662
			^				
	zone						
	2	-.2049195	.027796	-7.37	0.000	-.2593999	-.150439
	3	.2363038	.021504	10.99	0.000	.194156	.2784516
	4	-.3526663	.024564	-14.36	0.000	-.4008116	-.3045209
	5	.1746793	.025087	6.96	0.000	.1255088	.2238498
	6	-.3112287	.109643	-2.84	0.005	-.526127	-.0963304
	7	-.0507928	.022488	-2.26	0.024	-.0948689	-.0067167
	8	.3390985	.019393	17.49	0.000	.3010884	.3771087
	9	-.1211986	.109778	-1.10	0.270	-.3363615	.0939642
	10	-.3046407	.020369	-14.96	0.000	-.3445647	-.2647167
	11	-.4047238	.026517	-15.26	0.000	-.456698	-.3527496
			^				
	tmin	-.0038897	.000073	-52.73	0.000	-.0040343	-.0037451
	tmax	.0000665	.000063	1.05	0.293	-.0000575	.0001906
	_ cons	.166804	.073026	2.28	0.022	.0236738	.3099343

```
3 . log close
   name: <unnamed>
   log:  \\nera-nycfs\work\projects\energy\NYISO DEMAND CURVE UPDATE (R782) > \Stata
Files\appendix.smcl
log type: smcl
closed on: 30 Jun 2010, 13:56:32
```

---

## D. Appendix 4 – Guide to Demand Curve Development Model

The model is a Microsoft Excel workbook that simulates revenues and expenditures given a set of user-defined and built-in input parameters. The workbook can be divided into three parts: (1) input sheets, (2) the “Model” sheet and (3) output sheets. The input sheets supply parameters produced by outside sources. The “Model” sheet is where the actual calculations of revenues and expenditures are performed. The output sheets show the results of simulations that NERA has performed.

**Input Sheets:** The sheets to the right of the “Model” sheet (e.g. “Reference Tables”, “Energy Curve Raw”) contain functions and parameters produced by outside sources. The energy curve is the result of a simulation performed on STATA. The “Current Curve” sheet contains FERC-approved values for the current NYISO demand curve. The “Reference Tables” sheet contains levelized fixed charges and overnight capital costs calculated by Sargent & Lundy. The values in these input sheets are not meant to be changed by users.

**“Model” Sheet:** The “Model” sheet allows users to alter certain parameters and run the simulation. User-defined input parameters can be found in the tan areas of the “Model” sheet. Users can change these values to simulate different market conditions. Values in yellow are dependent on other parameters and should not be altered. Values that are shaded out are not relevant given the other parameters. For example, the “kink” variable that determines where the curve kinks is not relevant if there is no kink specified (i.e., if the x-intercept of the first and second slanted segments are identical).

To run the simulation, users click the “Calculate Demand” Button, which solves for the demand curve that allows for full cost recovery given the inputs and parameters. Values in the areas shaded blue are the results of intermediate calculations, including revenue and expenditure streams. Outputs such as the amortization period and demand curve reference values are shown in the pastel green rectangle. The supernormal net revenue variable should always be zero after clicking “Calculate Demand”.

**Output Sheets:** The “High Level Summary” and “Results Summary” sheets show the results of certain runs that NERA has performed.

The NYISO capacity model uses a Monte Carlo simulation to estimate capacity levels for demand payment and energy payment calculations. This simulation assumes capacity levels are normally distributed. In each run of the model, the normal distribution is specified by two parameters, the expected value and standard deviation assumptions. These assumptions are explained in Section IV of this report.

**New Features:** The model was enhanced from the version used in 2007 to incorporate a seasonal view of the Demand Curve. If the seasonal toggle is set to true, inputs are required for the seasonal capacity ratios that NYISO would use to develop the Demand Curve. The model will then simulate Summer Capability Period and Winter Capability Period demand revenue separately using the relevant ratio and seasonal peaking unit capacity. This feature has been used in developing this report. For 2010, the model was enhanced further to allow for an input vector of property taxes, option of deliverability and option of Summer and Winter Capability Period minimum payments. The user can elect to input a vector of property taxes by toggling the user-input property tax option and inputting the annualized tax rates into the corresponding cells indicated by year. This feature will be automatically disabled if the user attempts to activate the user-input property tax toggle in conjunction with property taxes implicit in the levelized carrying charge, however, it is possible to utilize both a fixed or extra tax in addition to the user-input property tax option.