


# 2007 ICAP Forecast

## Criterion 3 – Weather Normalized Energy


Criterion 3 is the ratio of normalized summer energy in the current year to the previous year.

# Central Hudson Weather-Adjusted Summer Energy - GWh

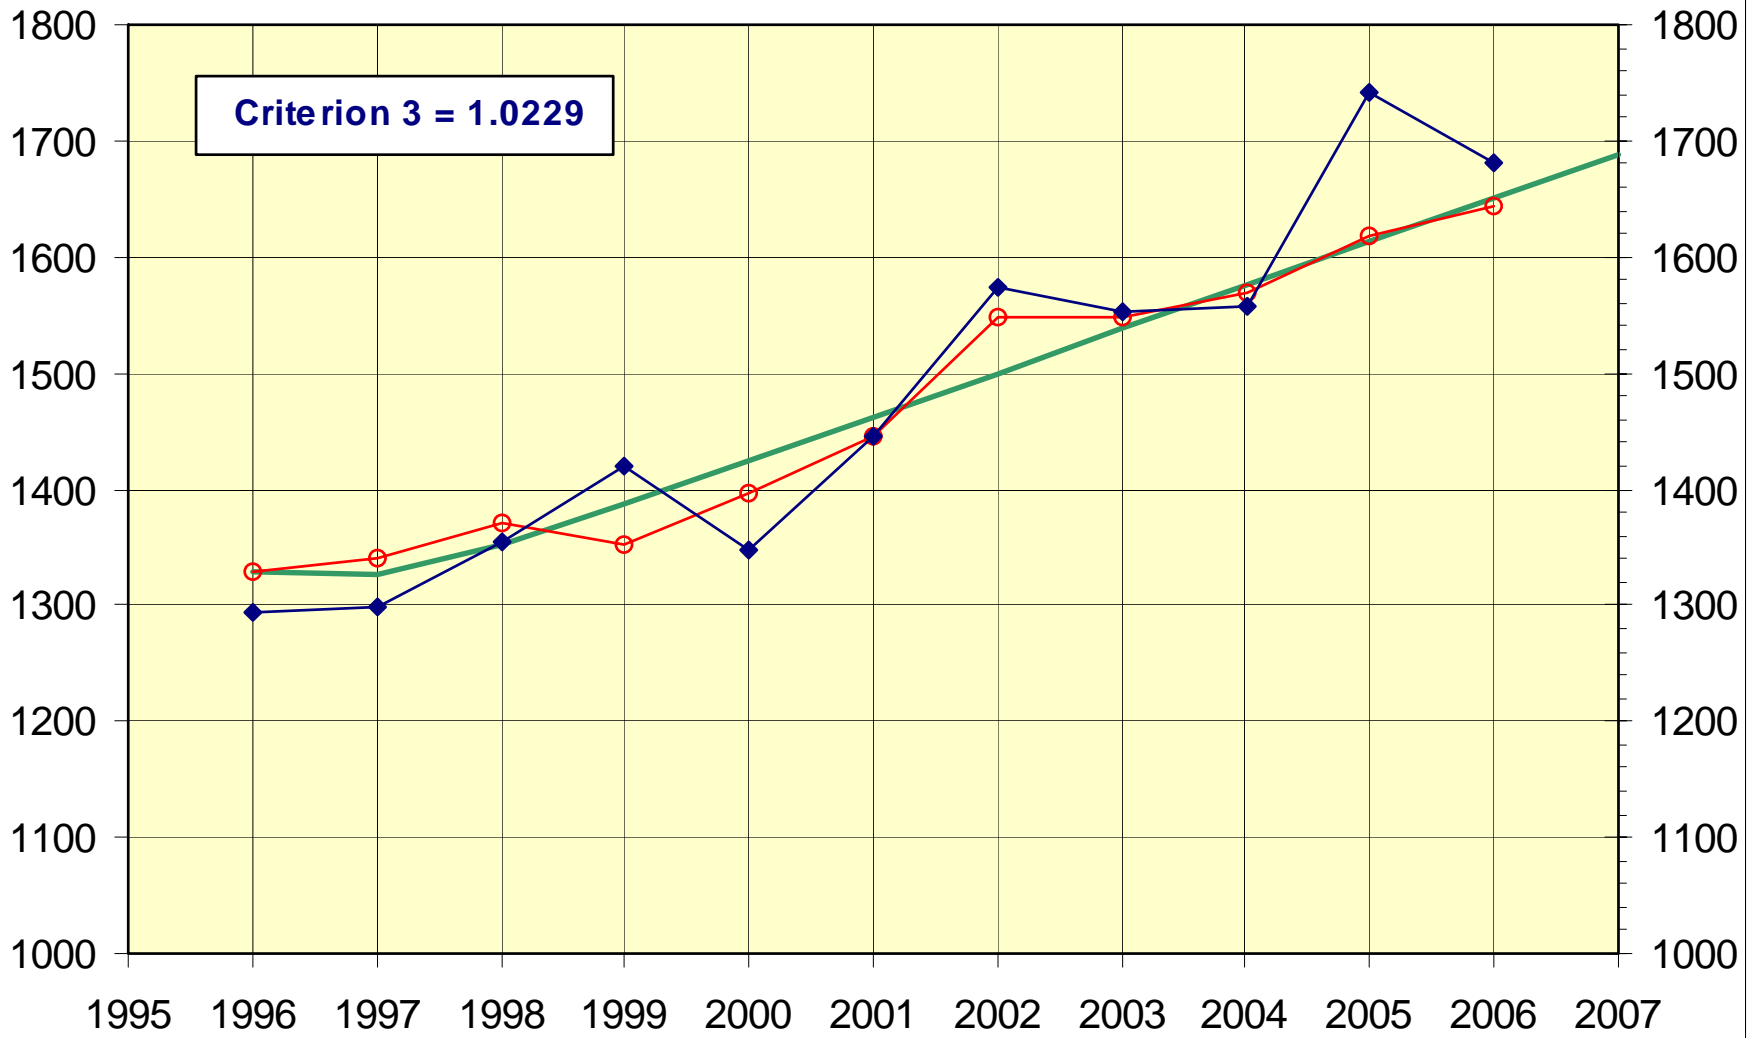


— Normal —○— Weather-Adjusted —◆— Actual GWh

### Con Edison Weather-Adjusted Summer Energy - GWh

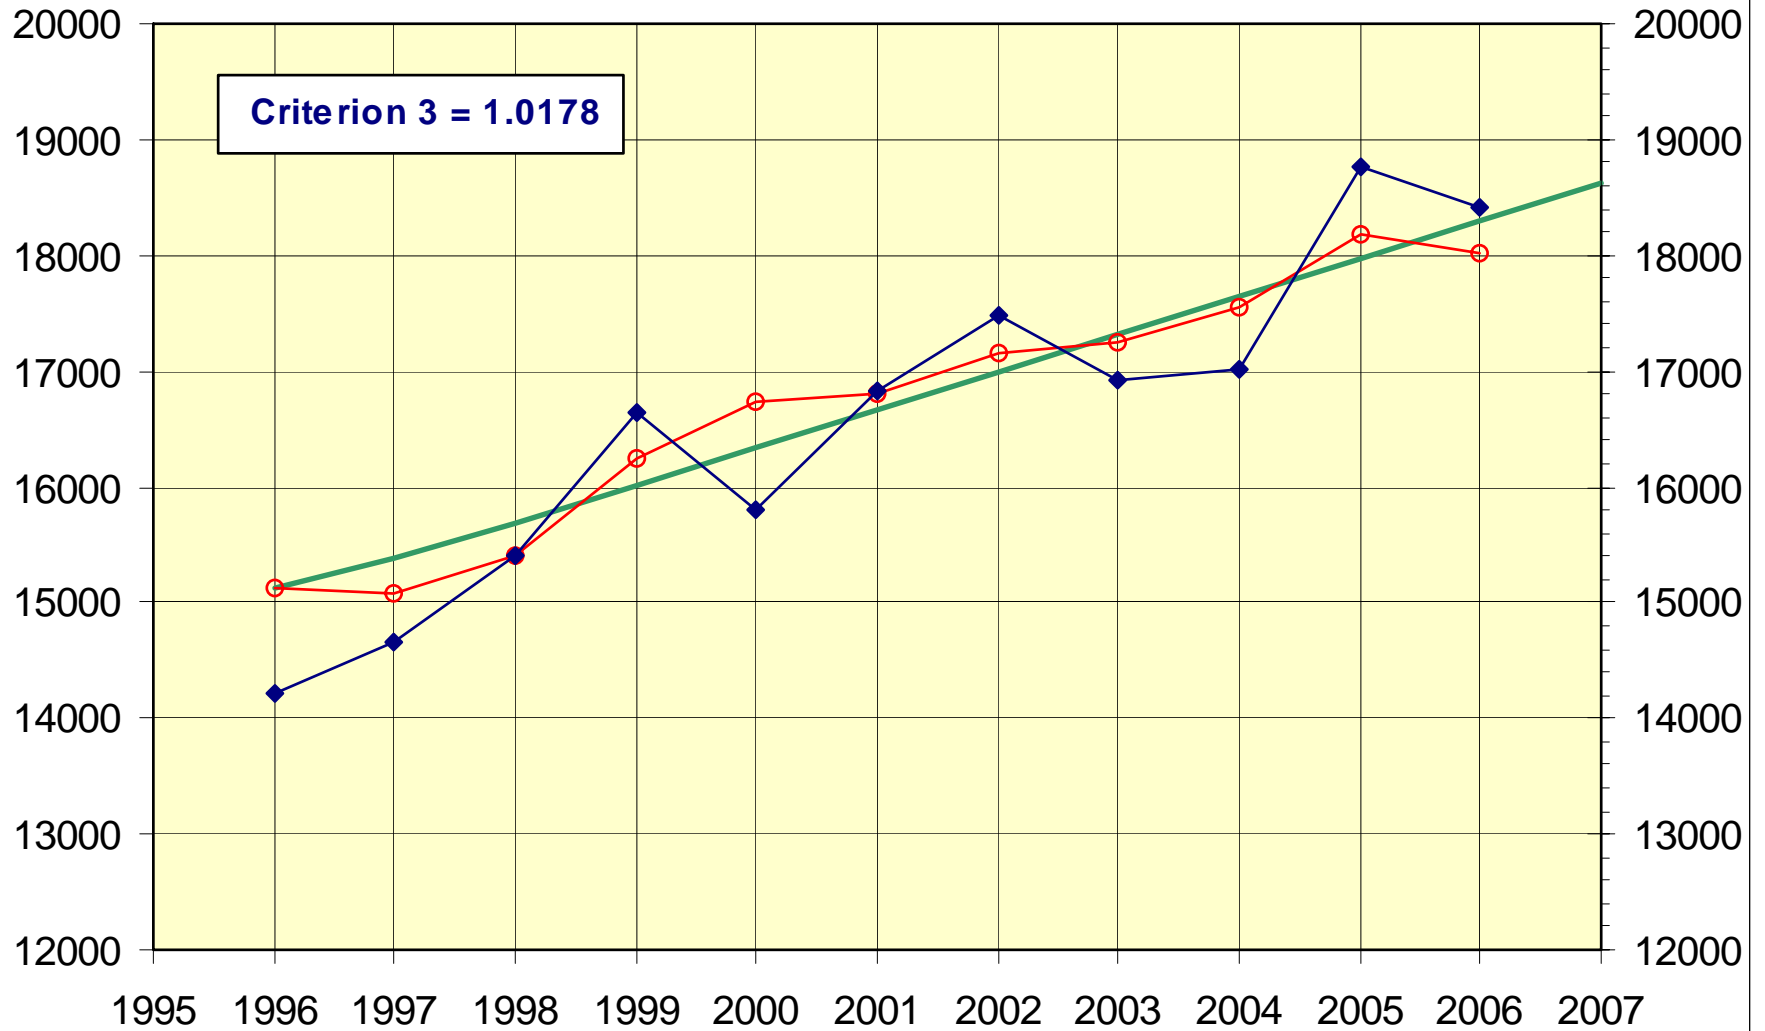


— Normal —○— Weather-Adjusted —◆— Actual GWh

### LIPA Weather-Adjusted Summer Energy - GWh

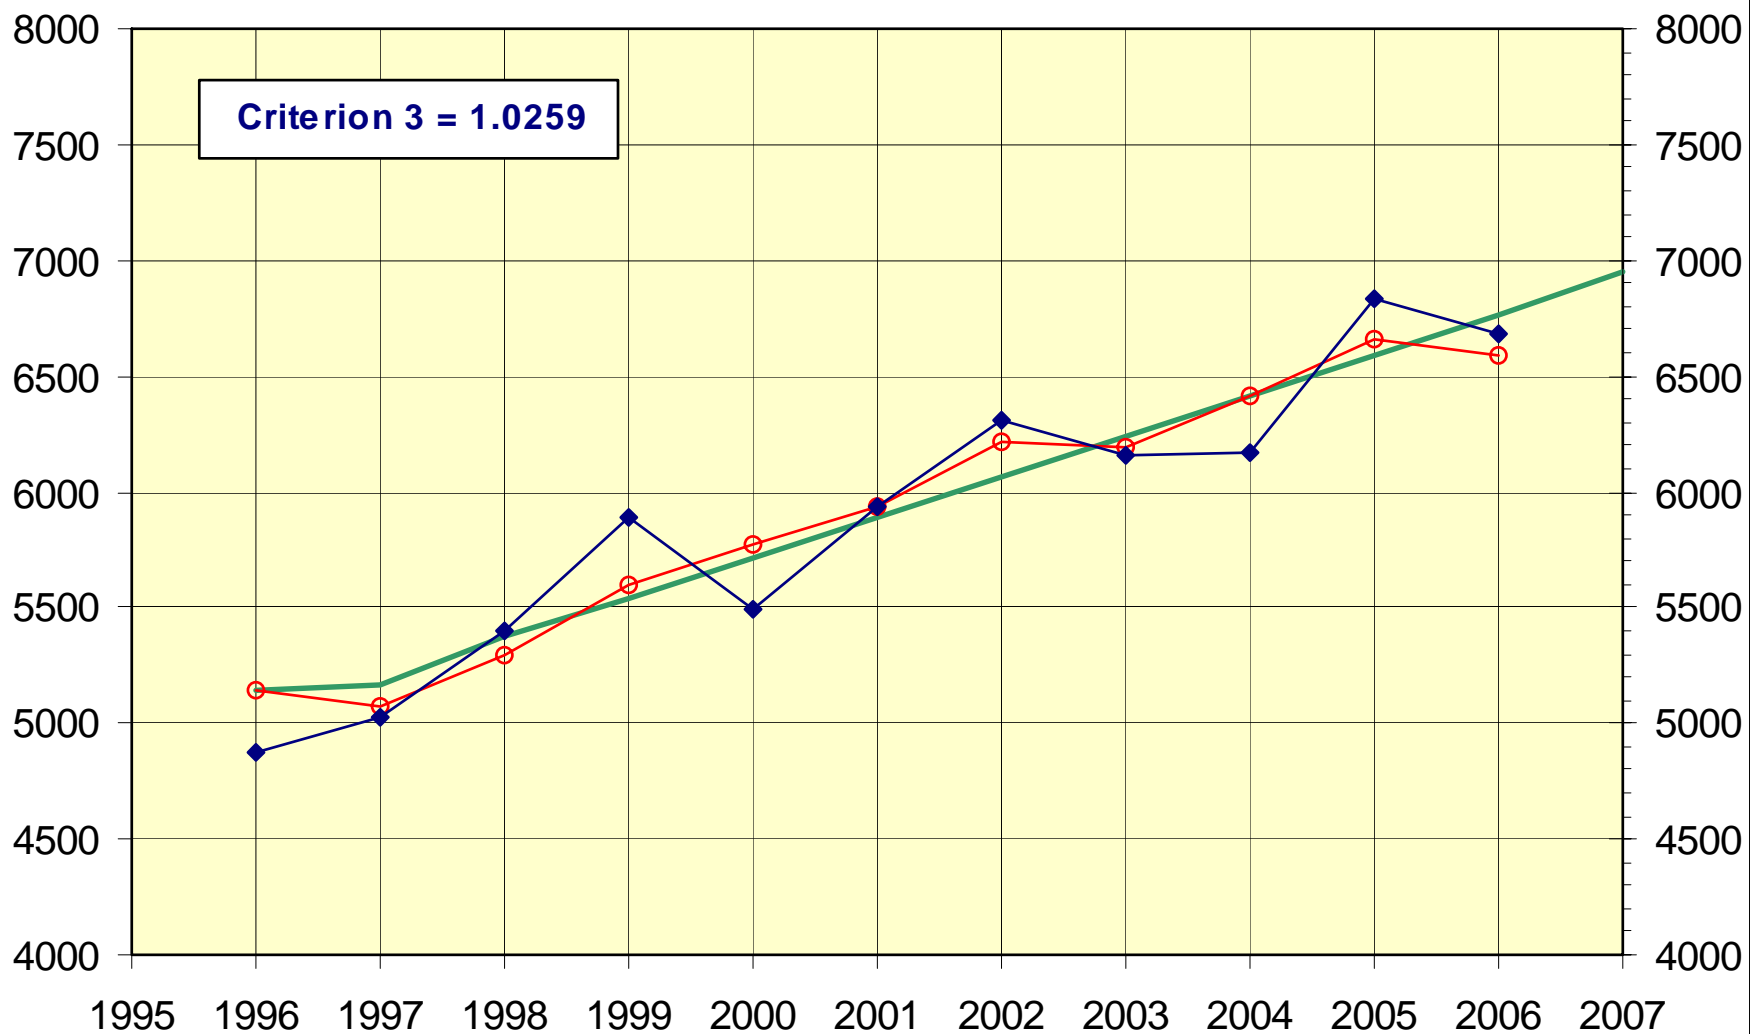


— Normal —○— Weather-Adjusted —◆— Actual GWh

# National Grid Weather-Adjusted Summer Energy - GWh

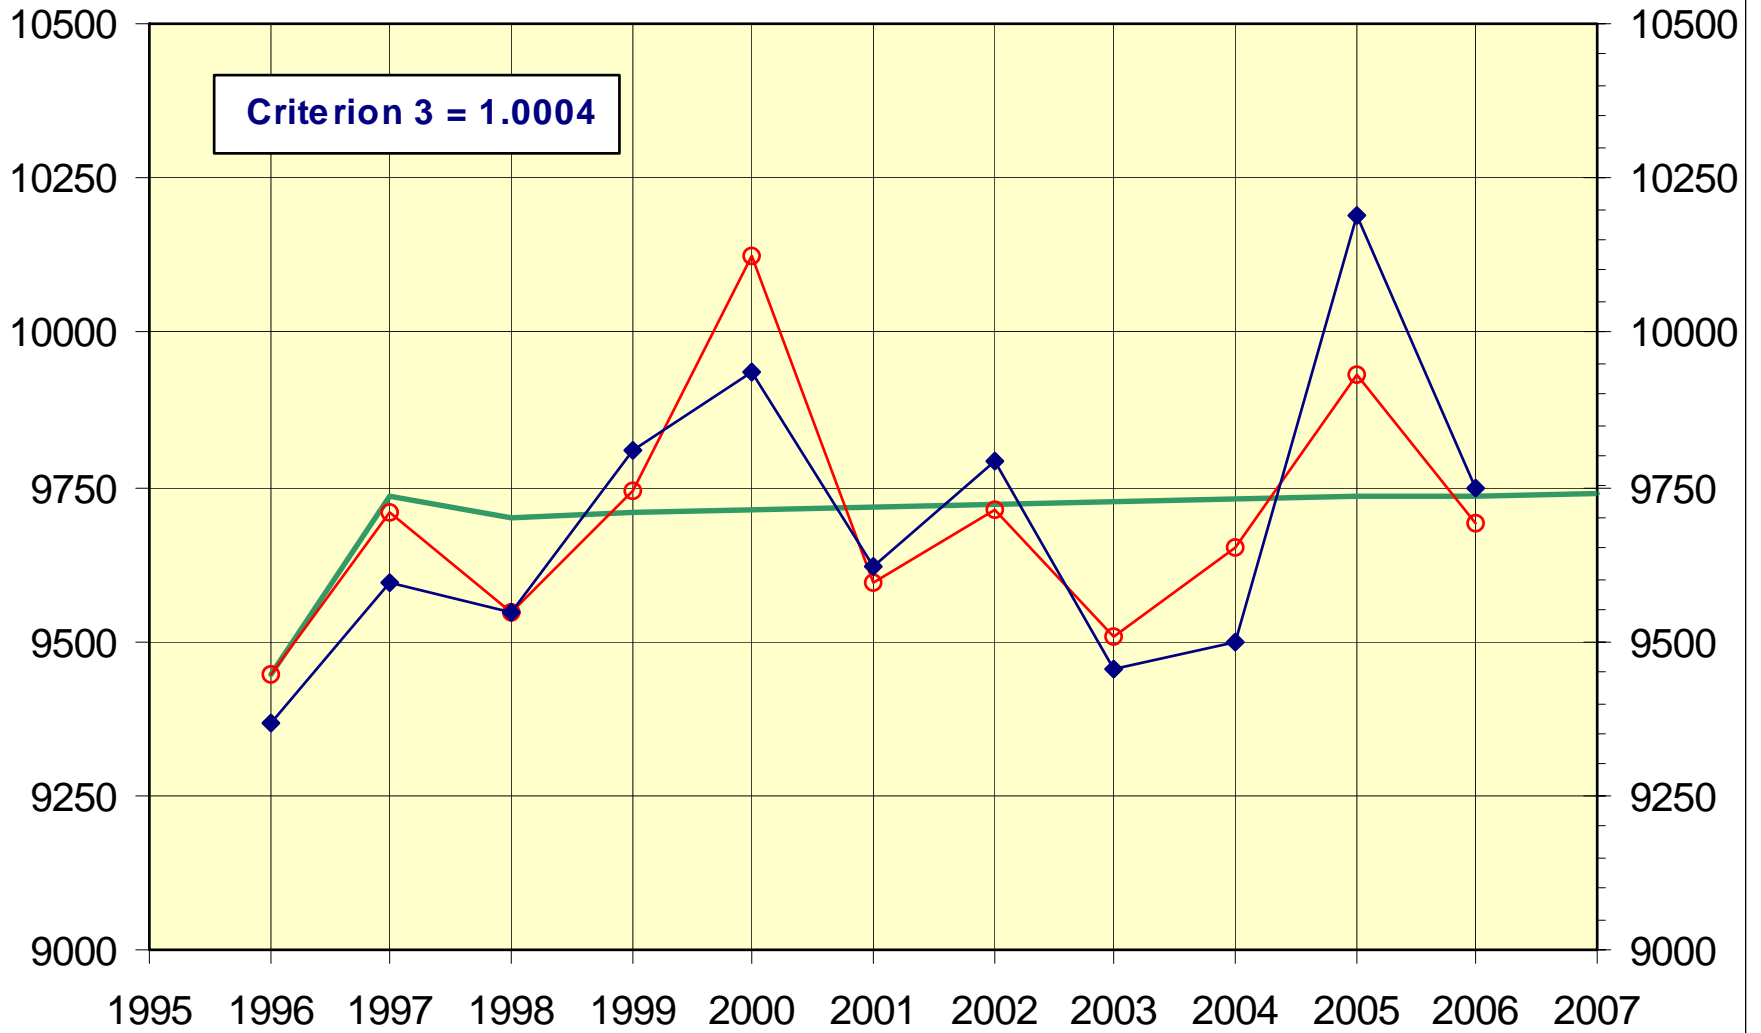


— Normal —○— Weather-Adjusted —◆— Actual GWh

# NYSE&G Weather-Adjusted Summer Energy - GWh

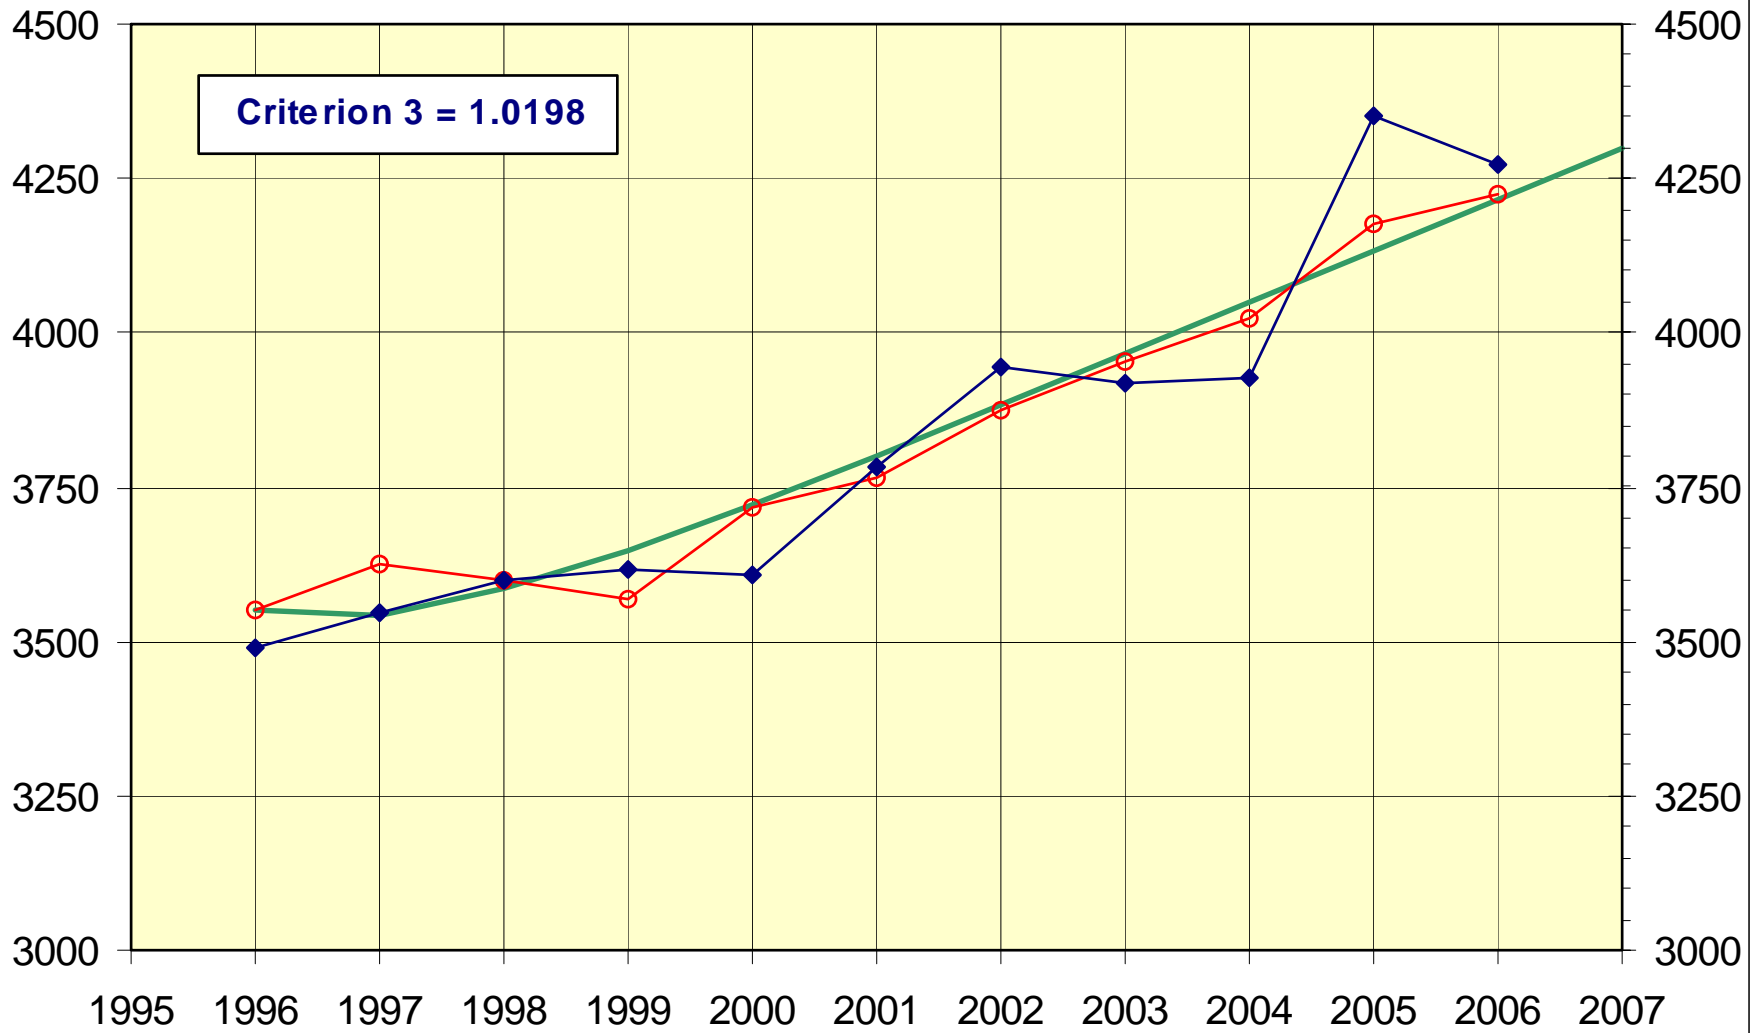


— Normal —○— Weather-Adjusted —◆— Actual GWh

### O&R Weather-Adjusted Summer Energy - GWh

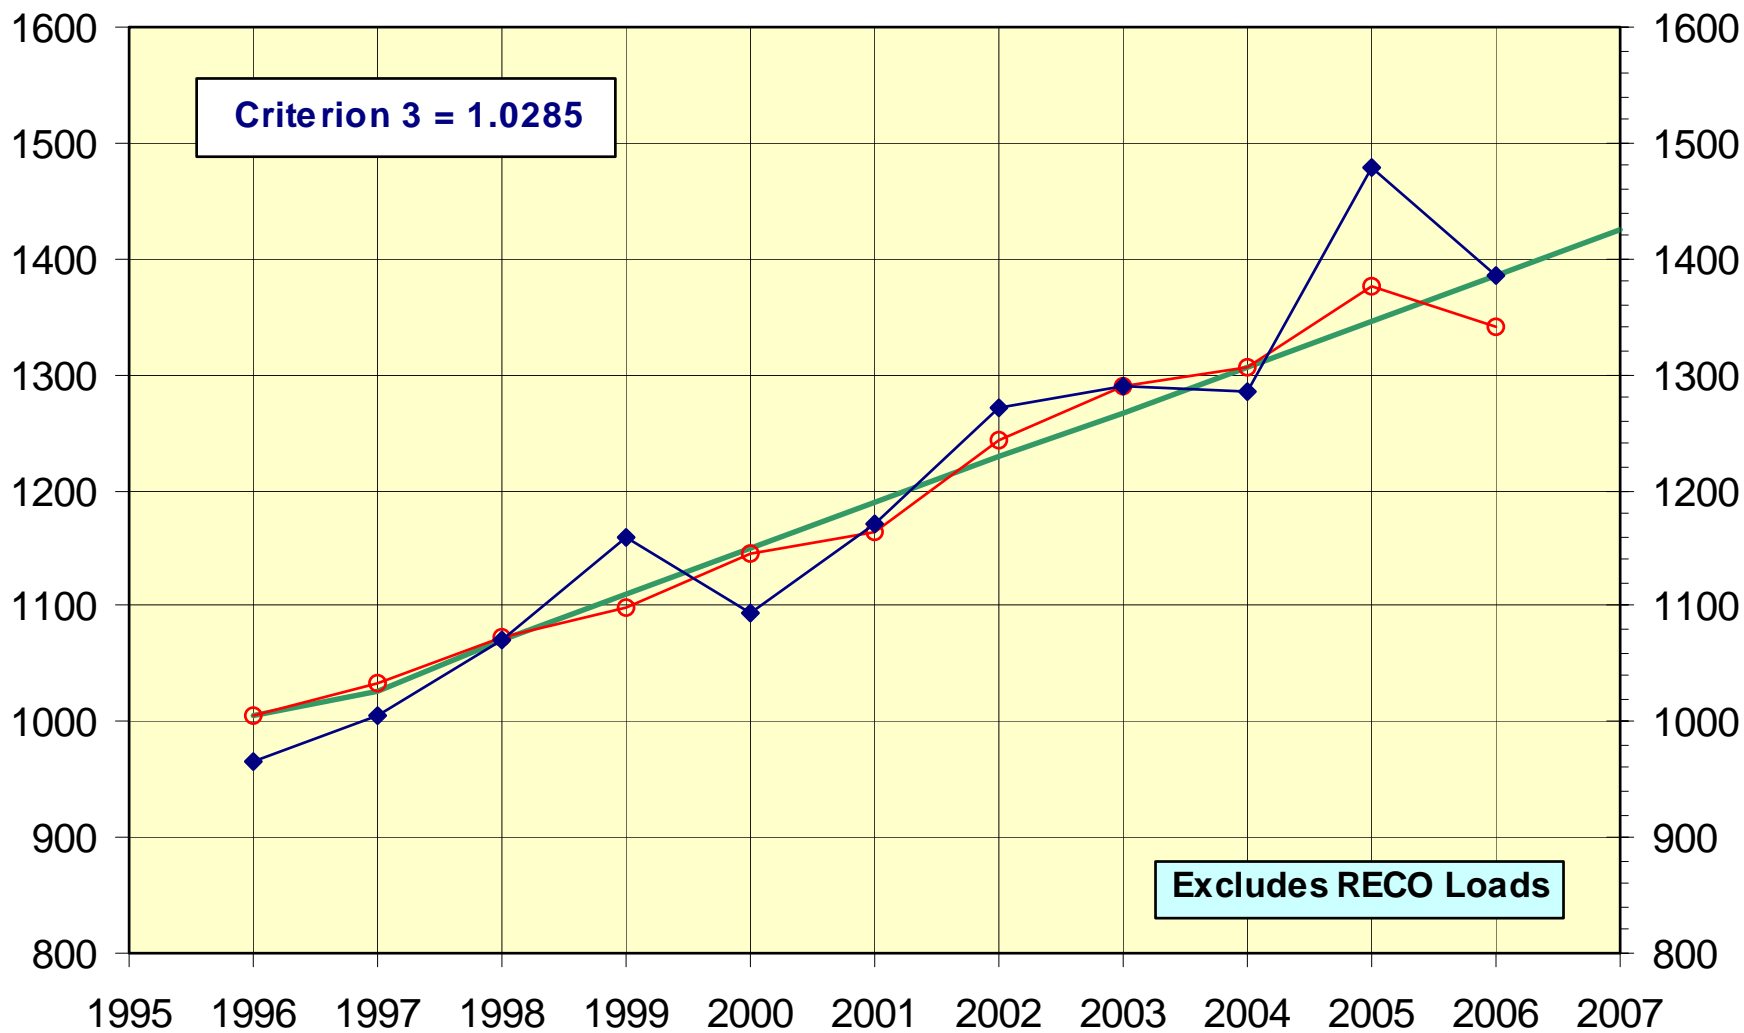

— Normal —○— Weather-Adjusted —◆— Actual GWh

### RG&E Weather-Adjusted Summer Energy - GWh

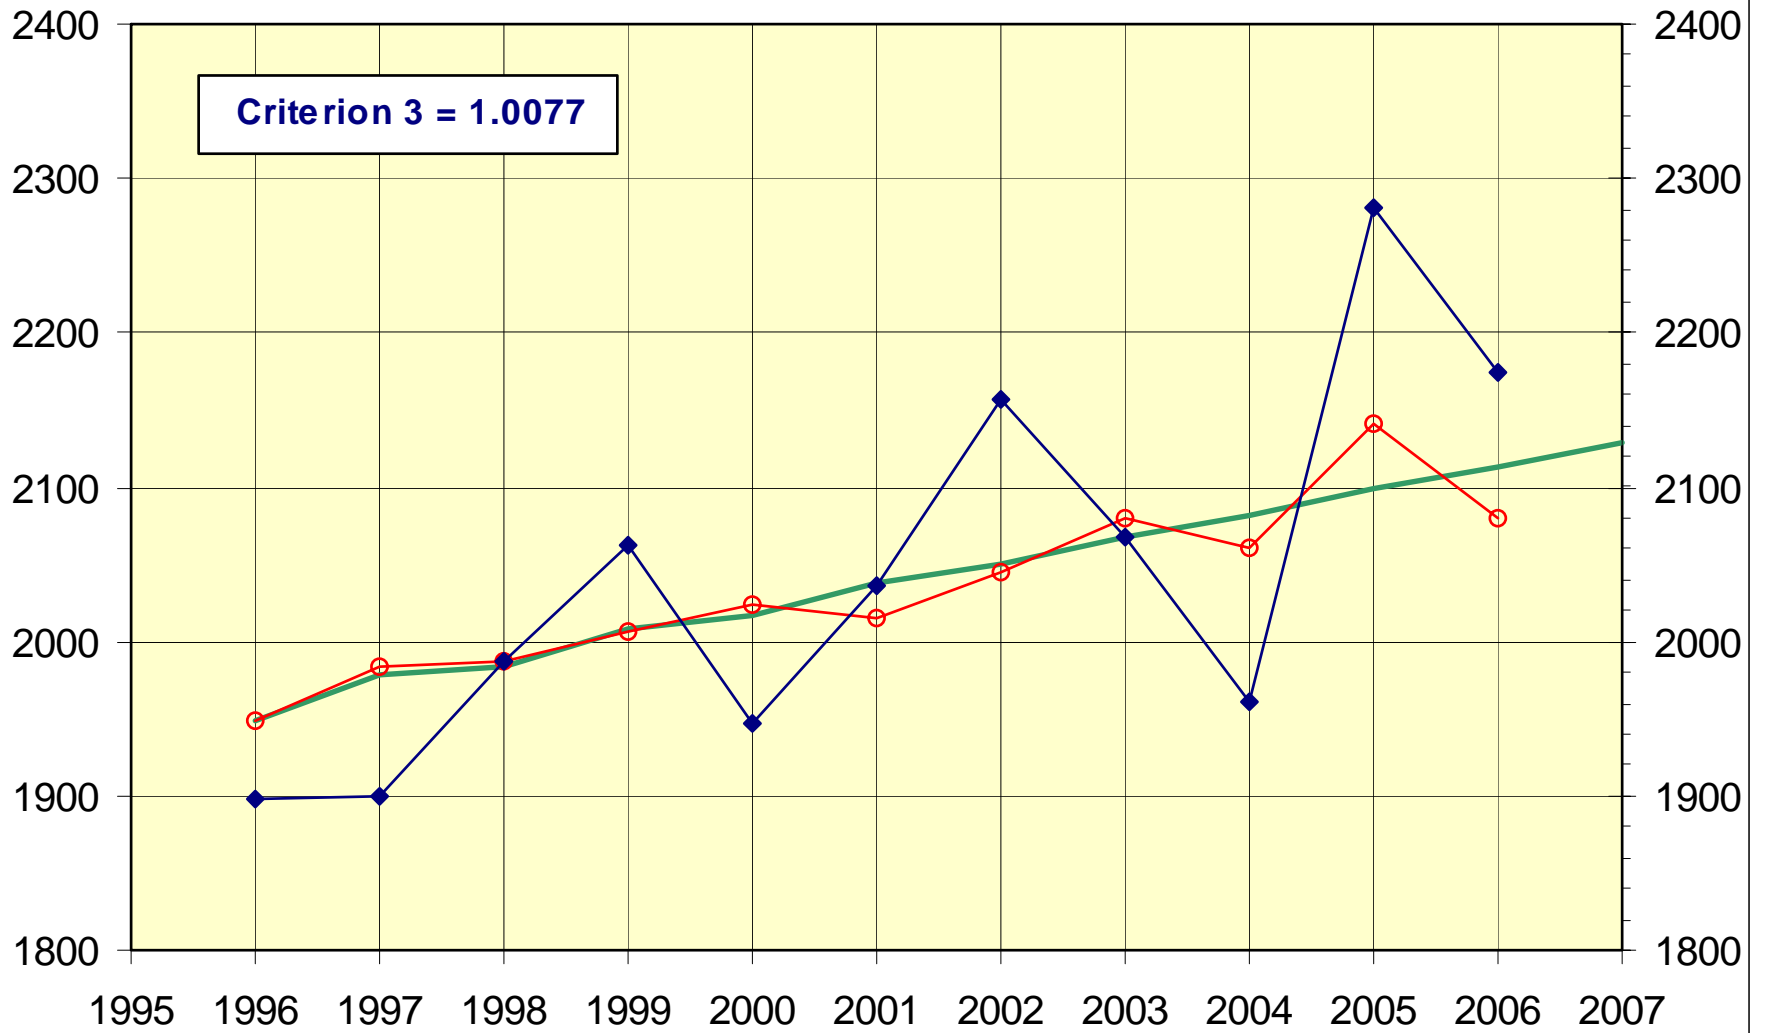

— Normal —○— Weather-Adjusted —◆— Actual GWh