


Topology for 2018 RNA – Study Year 2020

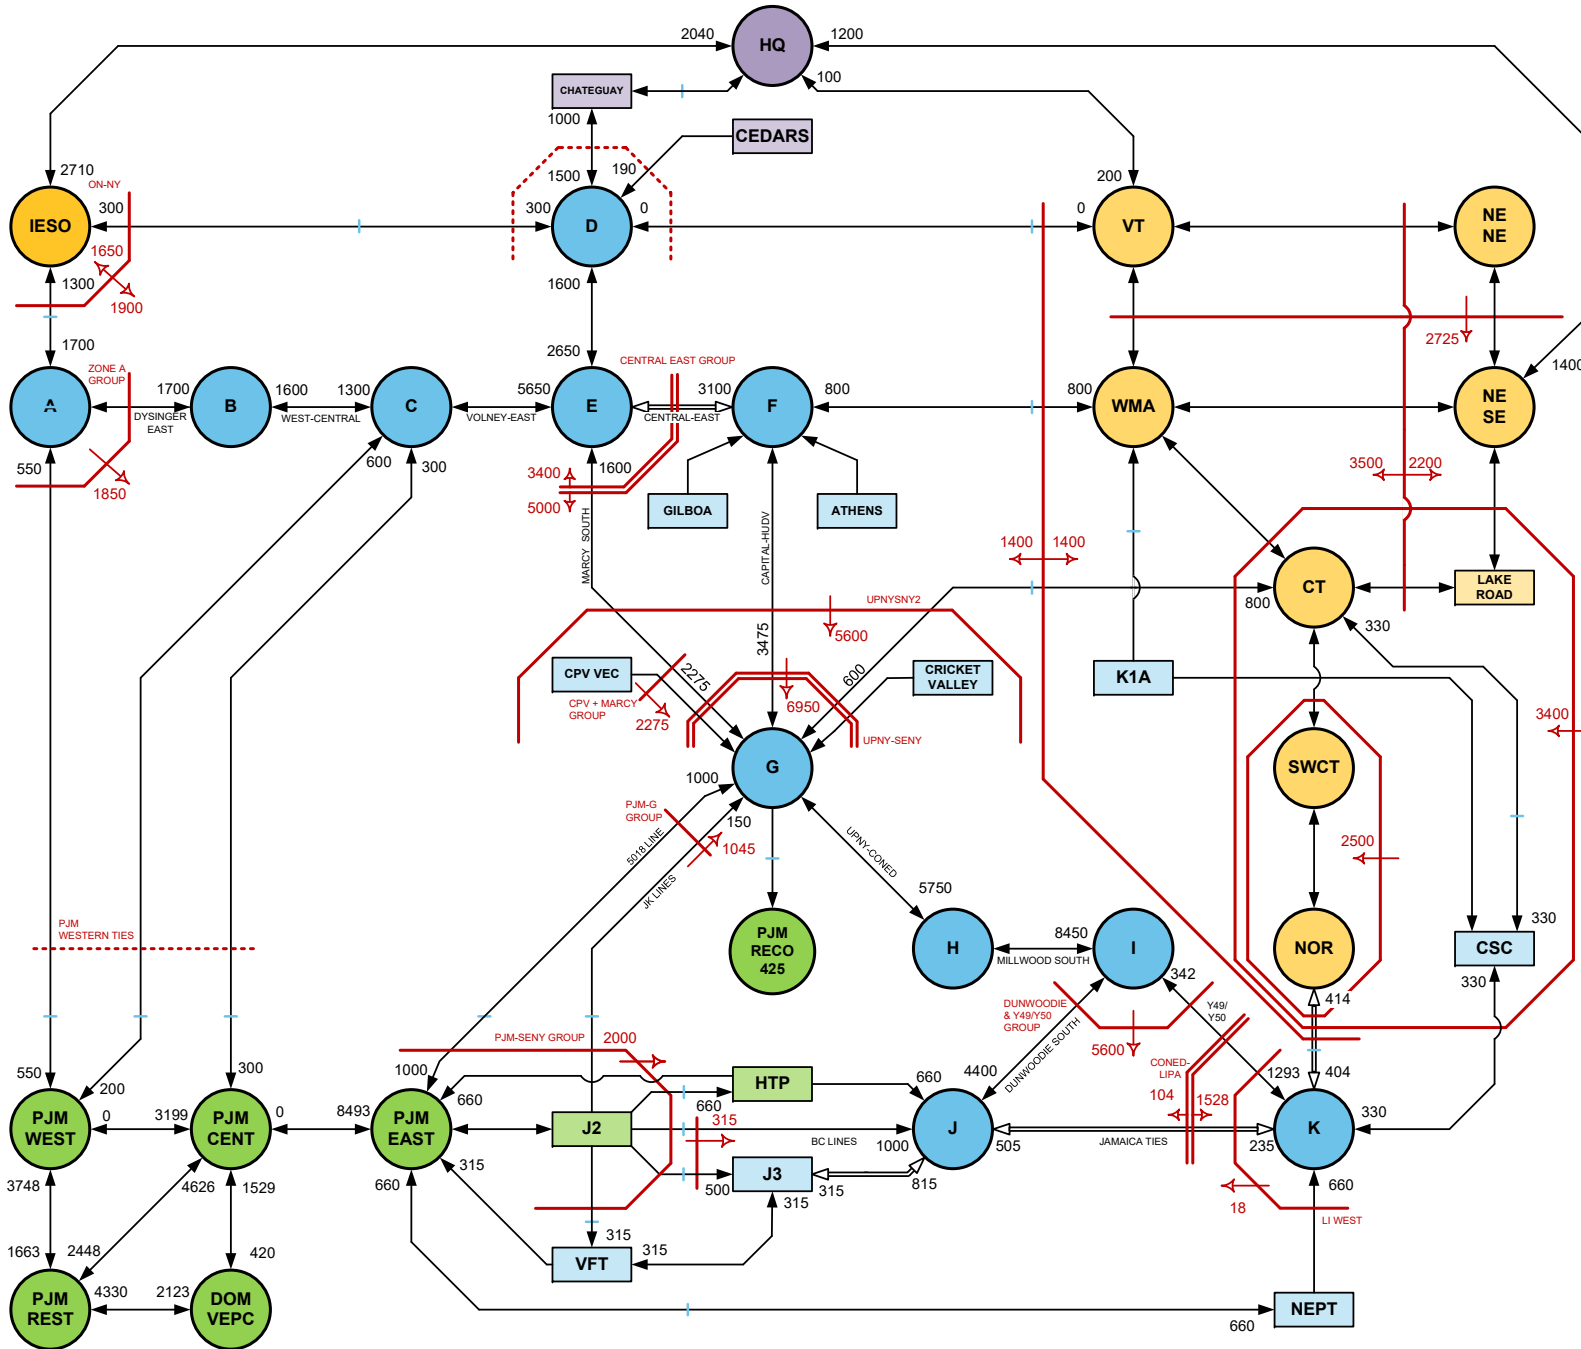


Notes

1. PJM to NY emergency assistance (EA) assumption for calculating the PJM-NY Western ties, PJM-G Group, and ABC Line Group flow distribution limit: 1500MW
2. NYCA EA simultaneous import limit: 3,500 MW
3. External areas representation based upon information received from the NPCC CP-8 WG

Legend

- Interface
 - Unidirectional Interface
 - Interface w/ Dynamic Ratings
 - Interface Group
 - Interface Group w/ Dynamic Ratings
 - Monitoring Interface Group
 - NYCA EA Interface Group Marker
 - "Dummy Bubble"
- NOTE: An interface is considered to not have a MW limitation if no number is specified

Topology for 2018 RNA – Study Years 2022-2028

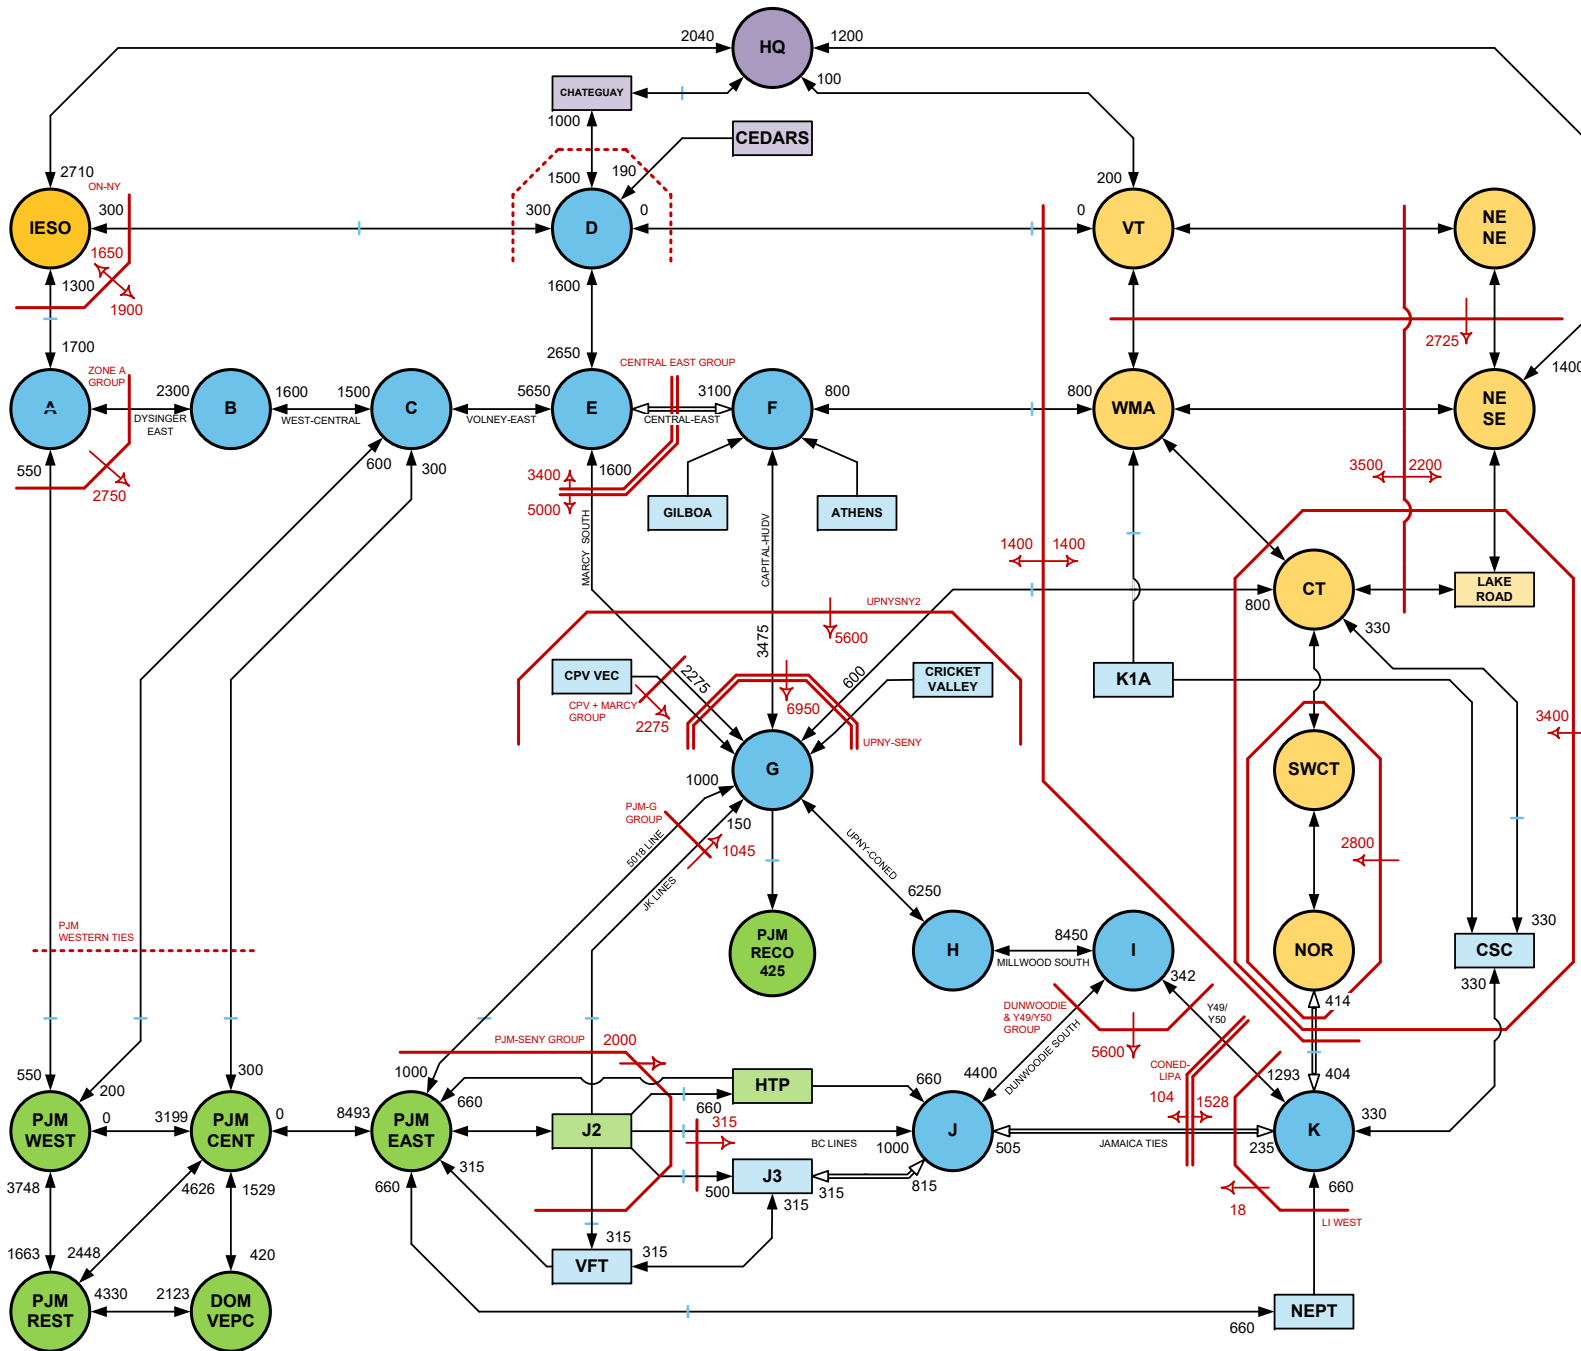

Notes

1. PJM to NY emergency assistance (EA) assumption for calculating the PJM-NY Western ties, PJM-G Group, and ABC Line Group flow distribution limit: 1500MW
2. NYCA EA simultaneous import limit: 3,500 MW
3. External areas representation based upon information received from the NPCC CP-8 WG

Legend

- ↔ Interface
 - Unidirectional Interface
 - ↔ Interface w/ Dynamic Ratings
 - Interface Group
 - Interface Group w/ Dynamic Ratings
 - - - Monitoring Interface Group
 - / - NYCA EA Interface Group Marker
 - xx "Dummy Bubble"
- NOTE: An interface is considered to not have a MW limitation if no number is specified