



**NY Power
Authority**

NYPA Transmission Plan

November 3, 2017 ESPWG-TPAS

Xia Jiang
Sr. System Planning Engineer I
New York Power Authority

NYPA Transmission Plan


Project	Description	In Service Date	NYISO Process Status	Article VII Status	Construction Status	Firm or Non-Firm
PV20 Submarine Cable Replacement Project	Replace 1.7-mile submarine cable between Cumberland Head, NY and Grand Isle, VT	Dec. 2017	Non-material change approved	N/A	Under construction	Firm



NYPA Transmission Plan

Project	Description	In Service Date	NYISO Process Status	Article VII Status	Construction Status	Firm or Non-Firm
Moses-Adirondack Smart Path Reliability Project *	Replace 78 miles of both Moses-Adirondack 1&2, built to 345 kV but operated at 230 kV	June, 2023	Q#566, SIS in progress	Plan to submit in 2018	Not started yet	Firm

Note * The project was previously named: Moses-Adirondack (MA) 1&2 Rebuild Project

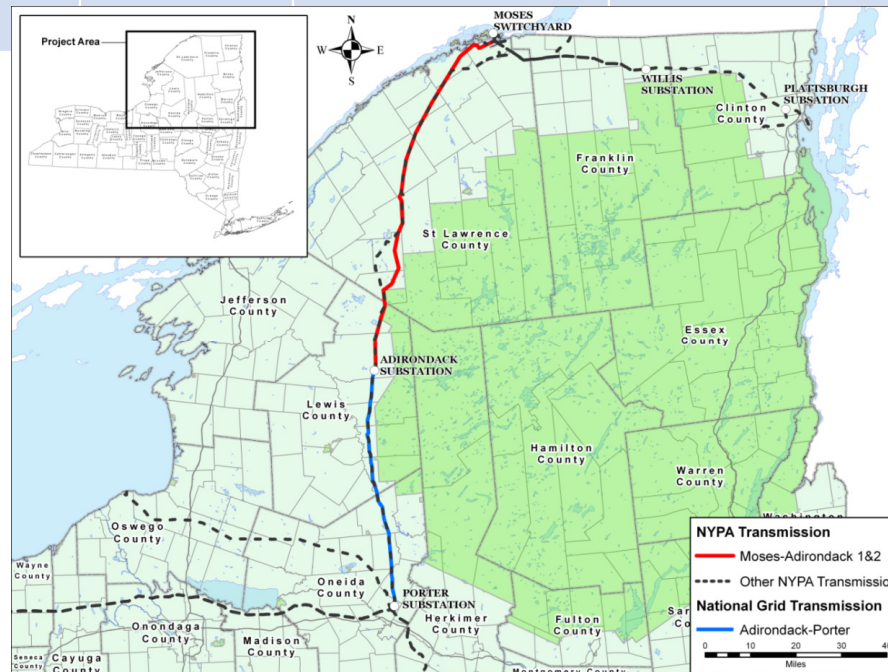

- **NYPA Transmission Plan, and**
- **Design Criteria for Developer Connection to the NYPA Transmission System**

Located at:

<https://www.nypa.gov/power/transmission/technical-information>

Questions?

Thank you!