



2011 Congestion Assessment and Resource Integration Study



Comprehensive System Planning Process

CARIS – Phase 1

Final Report

March 20, 2012

NYISO System Resources and Planning staff can be reached at 518-356-6000 to address any questions regarding this CARIS report or the NYISO's economic planning processes.

Caution and Disclaimer

The contents of these materials are for information purposes and are provided “as is” without representation or warranty of any kind, including without limitation, accuracy, completeness or fitness for any particular purposes. The New York Independent System Operator (NYISO) assumes no responsibility to the reader or any other party for the consequences of any errors or omissions. The NYISO may revise these materials at any time in its sole discretion without notice to the reader.

Table of Contents

Executive Summary	5
1. Introduction	17
2. Background	20
2.1. Congestion Assessment and Resource Integration Study (CARIS) Process	20
2.1.1. Phase 1 - Study Phase	21
2.1.2. Phase 2 – Project Phase	22
3. CARIS Methodology and Metrics	25
3.1. CARIS Methodology	25
3.2. CARIS Metrics	25
3.2.1. Principal Benefit Metric	26
3.2.2. Additional Benefit Metrics	26
4. Baseline System Assumptions	28
4.1. Notable System Assumptions & Modeling Changes	28
4.2. Load and Capacity Forecast	30
4.3. Transmission Model	31
4.3.1. New York Control Area Transfer Limits	32
4.4. Fuel Forecasts	33
4.4.1. CARIS Base Annual Forecast	33
4.4.2. New York Fuel Forecast	33
4.4.3. Seasonality and Volatility	34
4.4.4. External Areas Fuel Forecast	36
4.5. Emission Cost Forecast	36
4.6. Generic Solutions	39
4.6.1. Resource Block Sizes	39
4.6.2. Guidelines and Assumptions for Generic Solutions	40
4.6.3. Generic Solution Pricing Considerations	41
5. 2011 CARIS Phase 1 Results	42
5.1. Congestion Assessment	42
5.1.1. Historic Congestion	42
5.1.2. Projected Future Congestion	45
5.2. Ranking of Congested Elements	46
5.3. Three CARIS Studies	47
5.3.1. Selection of the Three Studies	47
5.3.2. Generic Solutions to Congestion	49
5.4. Benefit/Cost Analysis	54
5.4.1. Cost Analysis	55
5.4.2. Primary Metric Results	57
5.4.3. Benefit/Cost Ratios	58
5.4.4. Additional Metrics Results	59
5.5. Scenario Analysis	62

5.5.1. Scenario Analysis.....	62
6. 2011 CARIS Findings – Study Phase.....	68
7. Next Steps	70
7.1. Additional CARIS Studies.....	70
7.2. Phase 2 – Specific Transmission Project Phase.....	70
7.3. Project Phase Schedule	70
Appendix A – Glossary.....	72
Appendix B - Congestion Assessment and Resource Integration Study Process	
Appendix C - Baseline System Assumptions and Methodology	
Appendix D - Overview of CARIS Modeling	
Appendix E - Detailed Results of 2011 CARIS Phase 1	
Appendix F - Initial CARIS Manual	
Appendix G - 2010 RNA and 2010 CRP Reports	
Appendix H - Generic Solution Results - Additional Details	

List of Tables

Table 1: Major Scenario Assumptions	13
Table 2: Scenarios Impact on Congestion: 2015 + 2020 (\$M nominal).....	13
Table 4-1: Timeline of NYCA Changes.....	30
Table 4-2: CARIS 1 Base Case Load and Resource Table	31
Table 4-3: Transmission System Normal Voltage Transfer Limits for Key Interfaces (in MW)	33
Table 4-4: Transmission Block Sizes.....	39
Table 4-5: Generation Block Sizes	39
Table 4-6: DR (Each 200 MW Block contains Demand Response +EE)	40
Table 4-7: Generic Solution Pricing Considerations	41
Table 5-1: Historic Demand\$ Congestion by Zone 2006-2010 (nominal \$M)	43
Table 5-2: Historic Demand\$ Congestion by Constrained Paths 2006-2010 (nominal \$M)	43
Table 5-3: Historic NYCA System Changes – Mitigated Bids 2006-2010 (nominal \$M)	44
Table 5-4: Projection of Future Demand\$ Congestion 2011-2020 by Zone (nominal \$M)	45
Table 5-5: Projection of Future Demand\$ Congestion 2011-2020 by Constrained Path (nominal \$M)	46
Table 5-6: Ranked Elements Based on the Highest Present Value of Demand\$ Congestion over the Fifteen Years Aggregate	46
Table 5-7: Number of Congested Hours by Constraint.....	47
Table 5-8: Demand\$ Congestion of the Top Three CARIS Studies (nominal \$M)	48
Table 5-9: Demand\$ Congestion Comparison for Central East – New Scotland – Pleasant Valley Study (nominal \$M).....	51
Table 5-10: Central East – New Scotland – Pleasant Valley Study: NYCA-wide Production Cost Savings (Present Value in 2011 \$M).....	51
Table 5-11: Demand\$ Congestion Comparison for New Scotland – Pleasant Valley Study (nominal \$M).....	52
Table 5-12: New Scotland – Pleasant Valley Study: NYCA-wide Production Cost Savings	52
Table 5-13: Demand\$ Congestion Comparison for Leeds-Pleasant Valley (nominal \$M)	53
Table 5-14: Leeds-Pleasant Valley Study: NYCA-wide Production Cost Savings	54
Table 5-15: Generic Solution Costs for Each Study	56
Table 5-16: Production Cost Generic Solutions Savings 2011-2020: Present Value in 2011 (\$M)	58
Table 5-17: Ten-Year Change in NYCA Load Payments, Generator Payments, Net Import Payments, Losses Costs, TCC Payments and ICAP Costs (Present Value \$M)	60
Table 5-18: Ten-Year Change in NYCA Load Payments, Energy Costs, Congestion Costs and Losses Costs (Present Value \$M)	60
Table 5-19: ICAP MW Impact	61
Table 5-20: Ten-Year Change in NYCA CO ₂ , SO ₂ and NO _x Emissions (Dollars in Present Value).....	62
Table 5-21: Scenario Matrix.....	63
Table 5-22: Comparison of Base Case and Scenario Cases, 2015 and 2020 (nominal \$M).....	64
Table 6-1: Base Case Projected Congestion 2011-2020	68
Table 6-2: Production Cost Savings 2011-2020, Present Value in 2011 \$M	68
Table 6-3: Benefit/Cost Ratios	69

List of Figures

Figure 1: Generic Solutions Benefit/Cost Ratios.....	6
Figure 2: Congestion on the Top Three CARIS Studies (Present Value in 2011 \$M).....	7
Figure 3: Projected Congestion on the Top Three CARIS Groupings (Nominal \$M).....	8
Figure 4: NYCA-wide Production Cost Savings (Present Value in 2011 \$M).....	9
Figure 5: Changes in Metrics for Study 1.....	10
Figure 6: Changes in Metrics for Study 2.....	11
Figure 7: Changes in Metrics for Study 3.....	11
Figure 8: Projected Emissions Changes for Three Studies.....	12
Figure 1-1: NYISO Comprehensive System Planning Process.....	18
Figure 2-1: Overall CARIS Diagram.....	21
Figure 4-1: Areas Modeled in CARIS (Excluding WECC, FRCC, SPP, & TRE).....	32
Figure 4-2: Forecasted fuel prices for Zones J & K (nominal \$).....	35
Figure 4-3: Forecasted fuel prices for Zones A-I (nominal \$).....	36
Figure 4-4: Emission Allowance Forecast.....	38
Figure 5-1: Historic Cumulative BPC Savings, 2006-2010 (nominal \$M).....	44
Figure 5-2: Production Costs Savings, 2015 and 2020 (nominal \$M).....	48
Figure 5-3: Base Case Congestion of Top 3 Congested Groupings, 2011-2020 - Present Value (\$M).....	49
Figure 5-4: Total NYCA-wide Production Cost Savings 2011-2020 (Present Value in 2011 \$M).....	57
Figure 5-5: B/C Ratio (High, Mid, and Low Cost Estimate Ranges).....	58
Figure 5-6: Scenario Impact on Central East – Pleasant Valley Congestion.....	65
Figure 5-7: Scenario Impact on New Scotland – Pleasant Valley Congestion.....	65
Figure 5-8: Scenario Impact on Leeds- Pleasant Valley Congestion.....	66

Executive Summary

1. Overview

With the publication of this *2011 Congestion Assessment and Resource Integration Study (CARIS) Phase I Report* the New York Independent System Operator (NYISO) has completed the first phase of its two-phase, economic planning process. This CARIS Phase 1 report provides information to market participants, policy makers, and other interested parties for their consideration in evaluating projects designed to address congestion costs identified in the study. The report presents an assessment of historic (2006-2010) and projected (2011-2020) congestion on the New York State bulk power transmission system and provides an analysis of the potential costs and benefits of relieving that congestion using generic projects as solutions.

The development of the CARIS Phase I report was a complex process that incorporated uncertainties in input assumptions. In addition, modeling changes were made that were intended to improve the 2011 CARIS relative to the 2009 CARIS. An overview of these “Changes Since Last CARIS” appears later in this Executive Summary. A more detailed description of changes and differences appears in Section 4.1 of the main report.

Generic transmission, generation and demand response (DR) projects were applied to relieve congestion for the three top ranked congested elements or group of elements in the New York Control Area (NYCA) without assessing the feasibility of such projects. In order to provide more information for market participants, policy makers, and other interested parties, additional benefit metrics such as emissions costs, load and generator payments, Installed Capacity (ICAP) costs, and the Transmission Congestion Contract (TCC) value are also presented. Although some of the metrics, indicated significant additional benefits, they were not added into the benefits used in the benefit and cost (B/C) ratio.

The primary metric for CARIS is the NYCA-wide production cost savings which is then utilized as the benefit component in the B/C ratio. The costs of the generic solutions were based upon estimates of low, mid and high solution costs. The B/C ratios for the generic solutions are shown in Figure 1. All of the high or mid range cost estimates produced B/C ratios that are significantly less than one and thus reflect the fact that their projected costs outweighed their estimated production cost savings over the ten year study period. Only three of the generic solutions produced B/C ratios greater than one: two of them were transmission and one was DR. The two transmission solutions were the low range cost solutions for Leeds to Pleasant Valley and New Scotland to Pleasant Valley; and the low range cost solution for DR was for the Central East - New Scotland - Pleasant Valley.

The B/C ratios of the transmission solutions vary greatly depending on the characteristics of the existing transmission system and the solution locations on the system as well as the range of the unit cost estimates. For each of the three studies, the B/C ratios for the transmission solution varied more than the generation or DR solutions because the relative range between the high and low unit cost estimates were much greater than the cost ranges associated with

generation and DR. Additionally, across the three studies the production cost savings used in the B/C ratios had more variation for the transmission solutions but stayed relatively constant for the generation and DR solutions. The generic generation solution was the same for all three studies and therefore did not show any differences in the production cost savings among the three groupings. Finally, the majority of the production cost savings for the demand response solutions are due to reducing demand rather than reducing congestion on the transmission system.

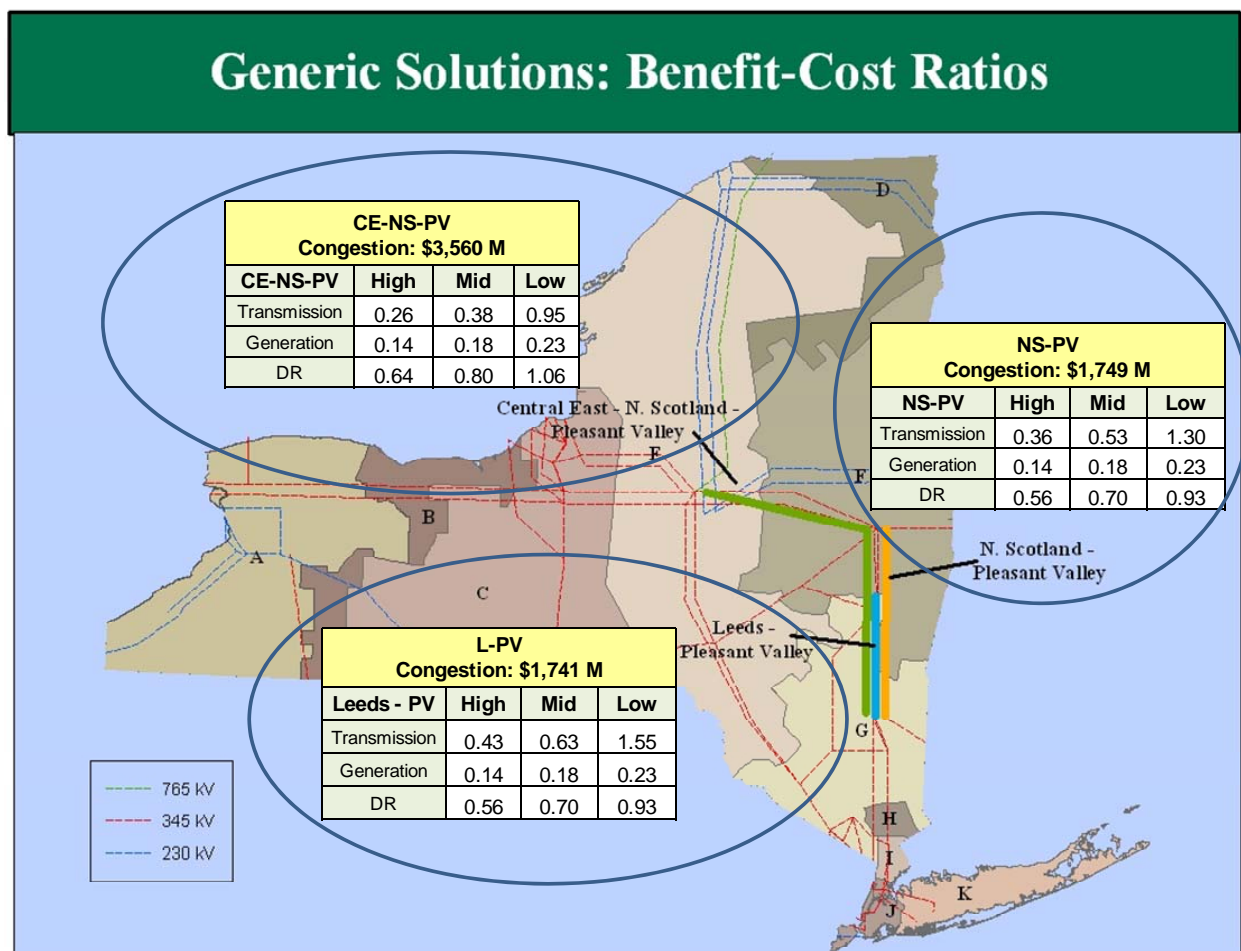


Figure 1: Generic Solutions Benefit/Cost Ratios

2. Summary of Study Process and Results

A. The Three Congestion Studies

Consistent with the CARIS procedures, the NYISO ranked and grouped transmission elements with the largest production cost savings when congestion on that constraint was

relieved. The top three groupings selected for the three 2011 CARIS studies are shown in Figure 2 along with the present value of projected congestion. Specifically, the three studies are: Central East - New Scotland - Pleasant Valley (Study 1), New Scotland - Pleasant Valley (Study 2), and Leeds-Pleasant Valley (Study 3) and the annual congestion is shown in Figure 3.

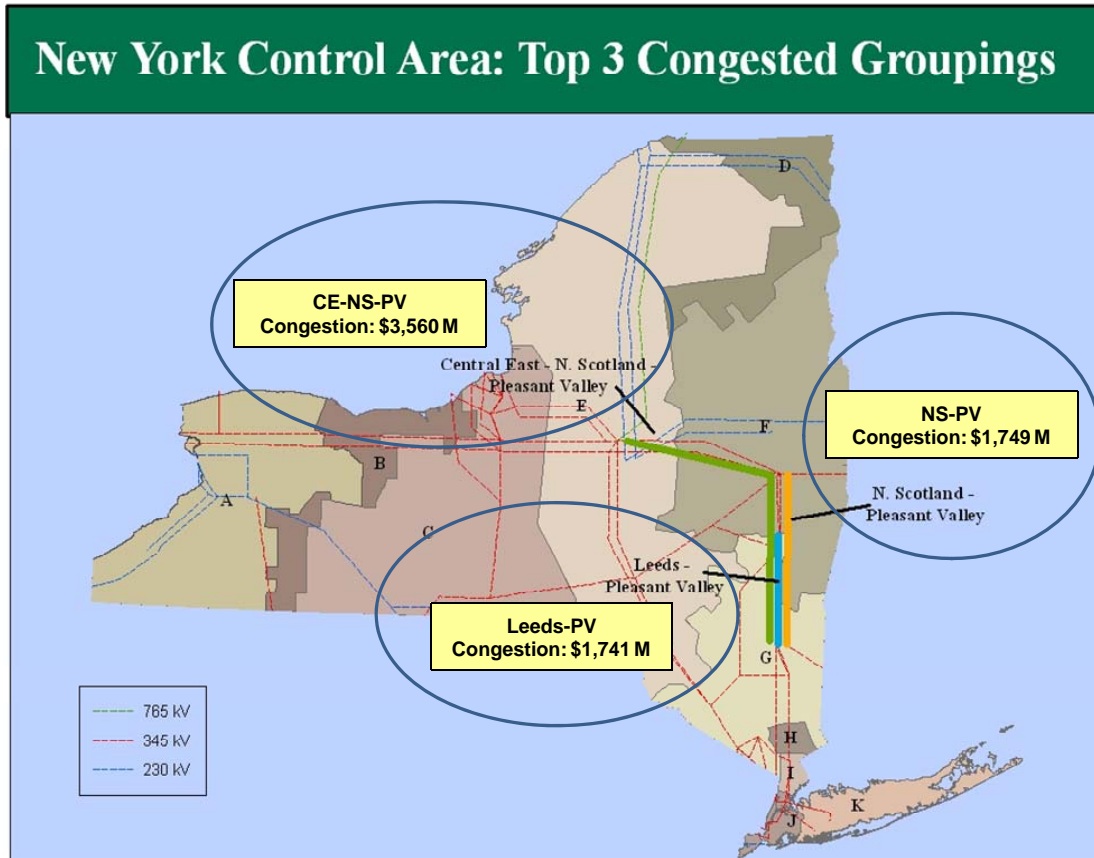


Figure 2: Congestion on the Top Three CARIS Studies (Present Value in 2011 \$M)

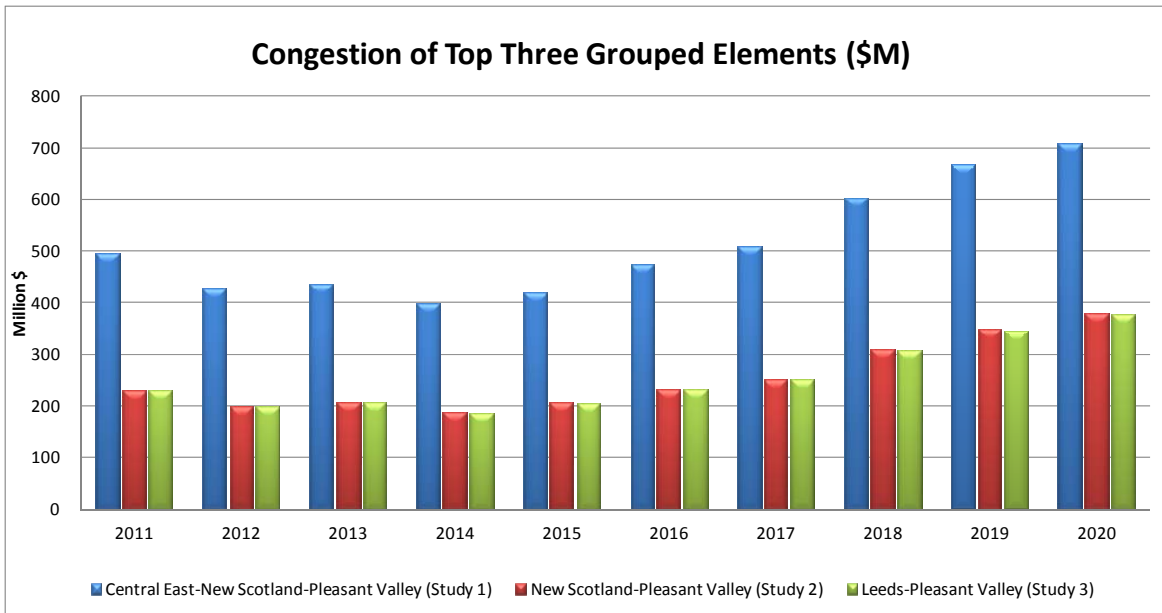


Figure 3: Projected Congestion on the Top Three CARIS Groupings (Nominal \$M)

In each of the three studies, the NYISO calculated the present value of projected congestion savings over ten years to determine the size of generic transmission, generation, and DR resources. Each generic transmission line solution consists of building a new 345 kV transmission line of approximately 1,000 MVA connecting the buses upstream and downstream of the congested element. The study groups are nested with a southern terminus at Pleasant Valley, therefore the generic generation solution for each study consists of building a new 1000 MW combined cycle plant, connected downstream of the congested elements. Each DR generic solution consists of installing 200 MW of energy efficiency and 200 MW of demand response modeled at 100 peak hours. In study 1, the DR is located in zones F & G and in studies 2 and 3 the DR is located in zones G & I, which are largely located downstream of the congested elements. Although demand response at peak hours provides less reduction in energy consumption than an equal amount of energy efficiency, equal amounts of energy efficiency and demand response were modeled in the 2009 CARIS and this approach was used once again in the 2011 CARIS.

Costs for each type of generic solution were presented through the stakeholder process but no determination was made as to the feasibility of any generic solution. Recognizing that the costs, points of interconnection, timing, and characteristics of actual projects may vary significantly, a range of costs (low, mid and high) was developed for each type of resource.

The present value of the estimated carrying costs for each of the generic solutions was compared to the present value of projected production cost savings for a ten-year period, yielding a benefit/cost ratio for each generic solution. The benefit/cost ratios displayed in Figure 1 are based on the cumulative present value in 2011 dollars of the NYCA-wide production cost saving over the ten year period (2011 -2020) as shown in Figure 4. For purposes of a relative order of

magnitude comparison, nominal electric production costs of New York generators over the ten-year study period range between \$3.5 billion and \$5.8 billion annually.

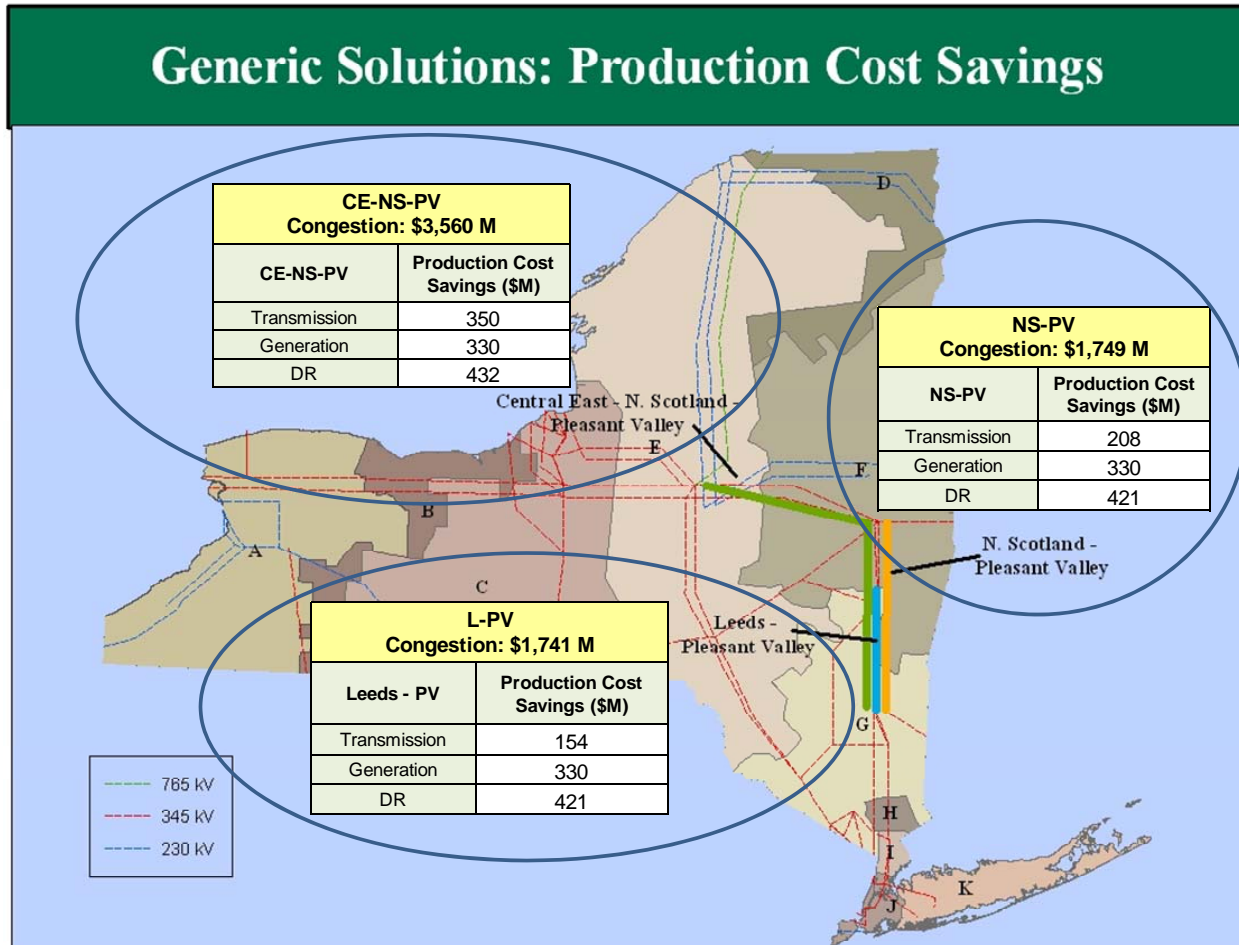


Figure 4: NYCA-wide Production Cost Savings (Present Value in 2011 \$M)

B. Additional Metrics

In addition to the NYCA-wide production cost savings for each generic solution, the NYISO also has provided, for informational purposes, additional metrics results for each of the three studies and each of the generic solutions in terms of changes in: (a) emission quantities and costs, (b) NYCA generator payments, (c) LBMP load payments, (d) installed capacity (ICAP) costs, (e) loss payments for losses on the transmission system, and (f) congestion rents or transmission congestion contracts (TCCs) payments. All but the ICAP metric are results of the production cost simulation program and show either increases or decreases depending primarily on which generic solution is modeled. The ICAP metrics are computed using the latest available information from the installed reserve margin (IRM), locational capacity requirement (LCR), and

ICAP Demand Curves, and consistently show reduced ICAP costs for each study and for each generic solution.

Figures 5 through 7 below present in graphical form the changes in the additional metric quantities (NYCA generator payments, NYCA load payments, TCC payments, NYCA losses costs, and NYCA ICAP costs, as well as congestion costs reported as Demand\$ congestion) for each of the three study cases. These are presented for the total ten year (2011-2020) present value amounts in 2011 \$M present value amounts. The ICAP cost metrics (variants 1 & 2) are indicative measures of the range of potential benefits resulting from the implementation of a CARIS solution.

Negative numbers (shown in brackets) represent reductions in those metric quantities. These quantities are internal NYCA only. Generator payments include changes in external production costs associated with changes in net imports.

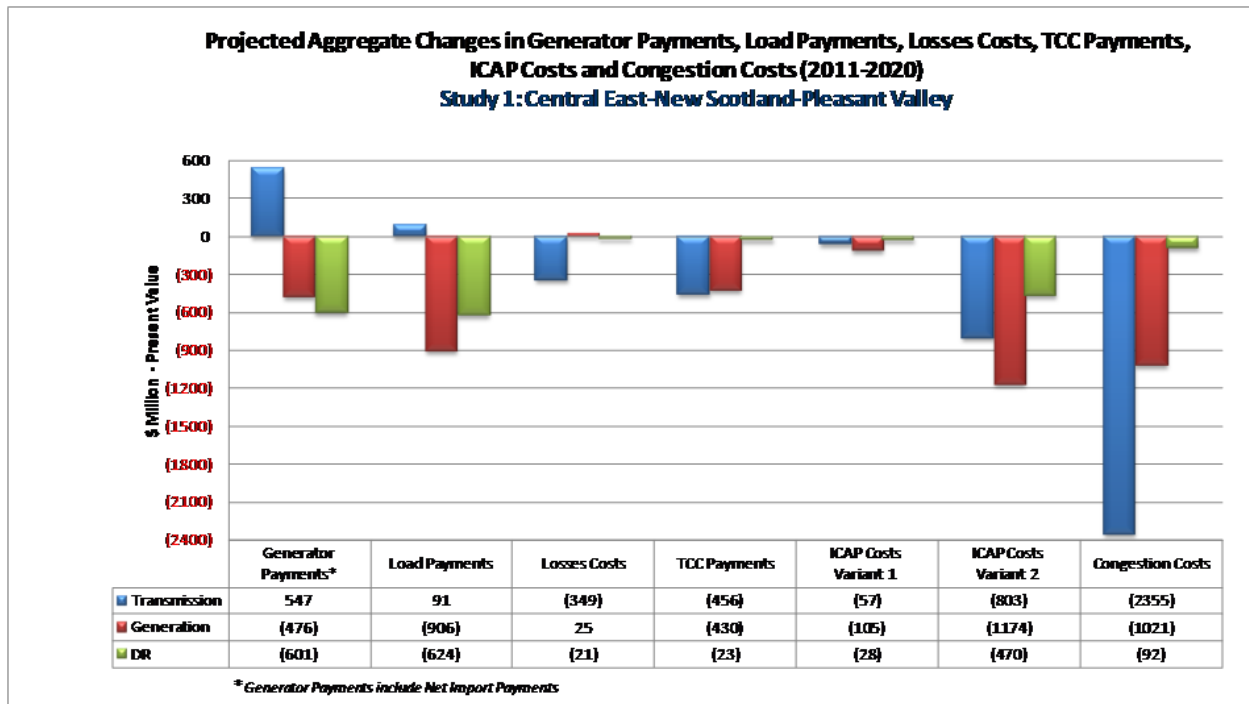


Figure 5: Changes in Metrics for Study 1

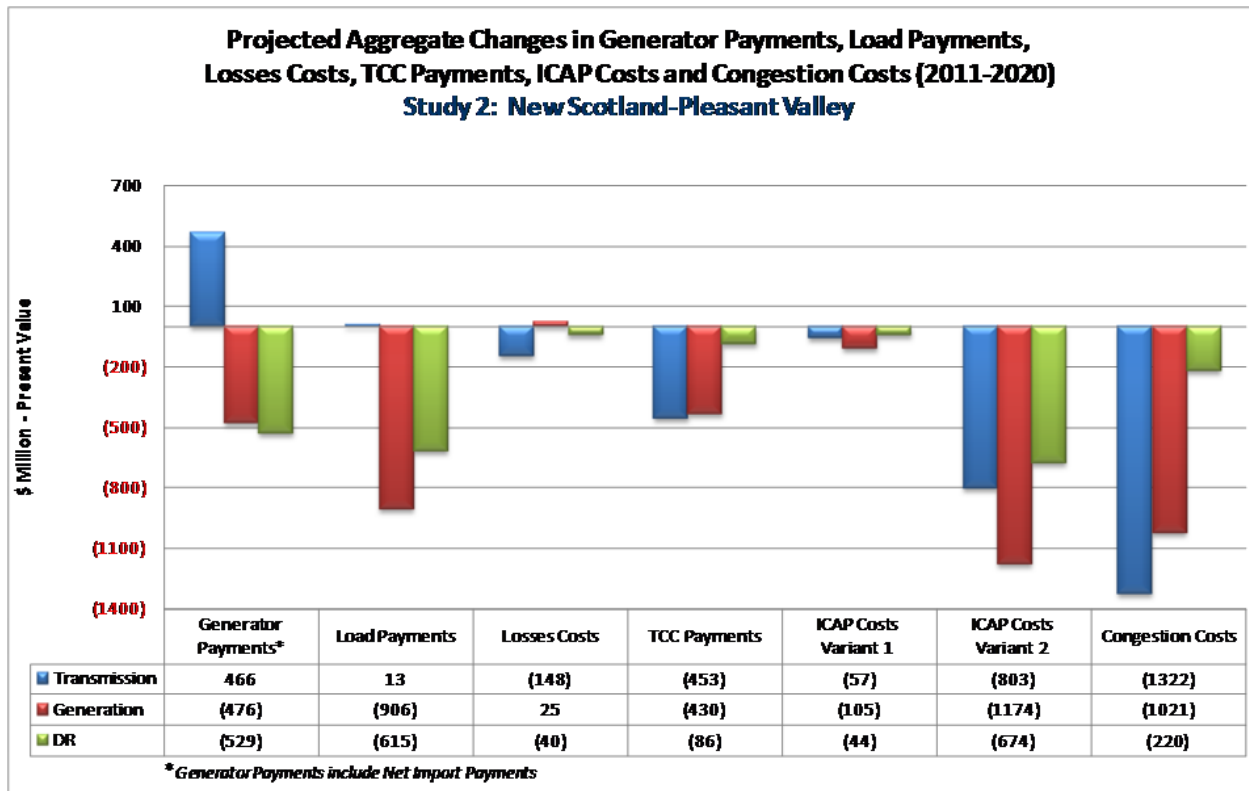


Figure 6: Changes in Metrics for Study 2

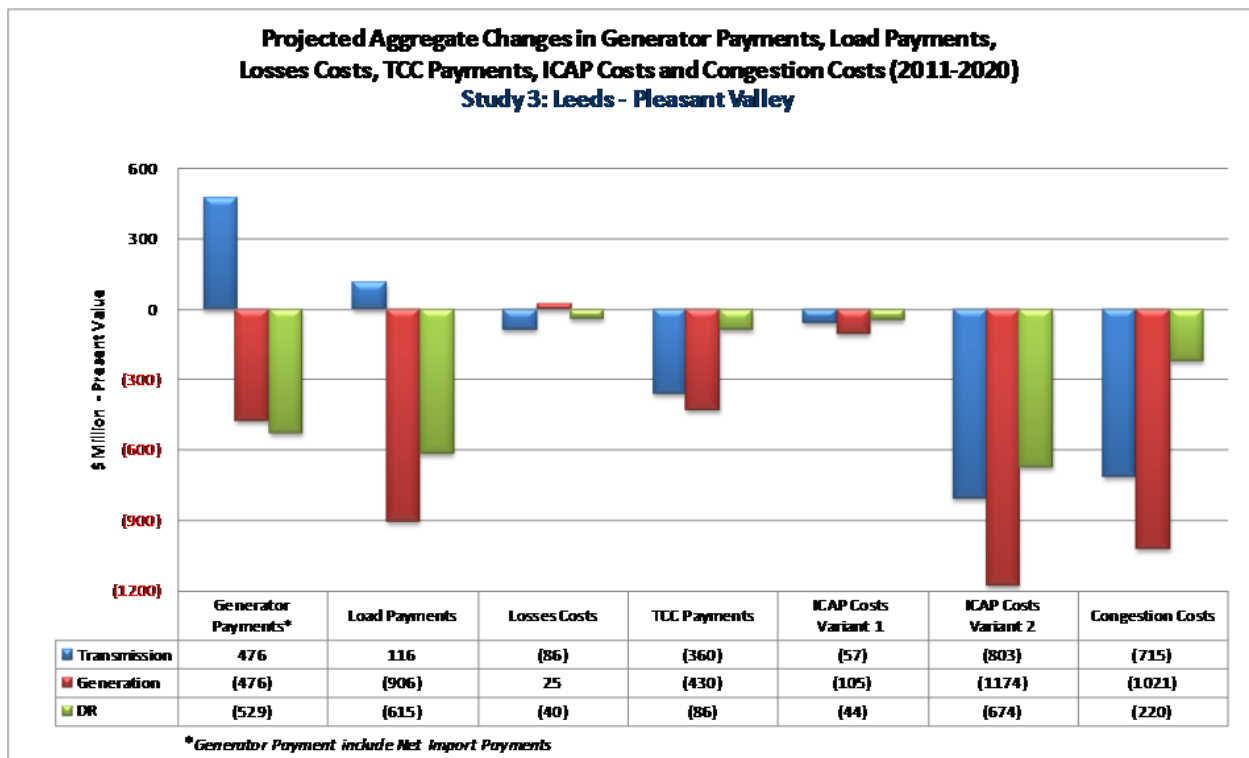


Figure 7: Changes in Metrics for Study 3

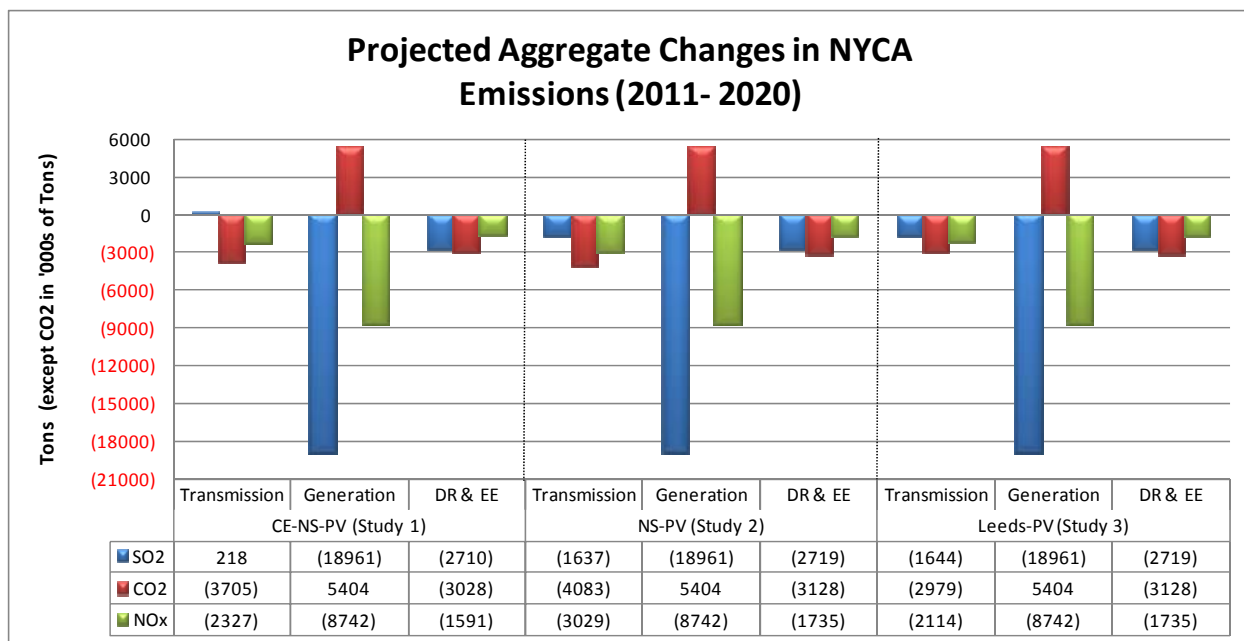


Figure 8: Projected Emissions Changes for Three Studies

C. Scenario Analysis

The NYISO conducted scenario analyses to evaluate the congestion impact of changing variables in the base case assumptions. Scenario analysis provides useful insight on the sensitivity of projected congestion values to differing assumptions included in the base case. Variations in some inputs may provide results that are consistent across NYCA, while other inputs may yield changes that are more localized. The scenarios were selected by the NYISO in collaboration with its stakeholders. They modify the base case to address potential regulatory changes in environmental emission requirements, full achievement of the State Renewable Portfolio Standard¹ and the State Energy Efficiency Portfolio Standard,² variations from the forecasted energy consumption and fuel prices, and the continued utilization of the Athens SPS for the ten-year study period. These scenarios are each addressed individually; no cumulative impacts are determined.

Table 1 lists major assumptions used for each scenario; and Table 2 shows the impact on congestion for each scenario for the combined years 2015 and 2020. Negative values represent a reduction in congestion impact measured by Demand\$ congestion, where Demand\$ congestion is a measure of the congestion component in the LBMP and its impact on NYCA loads, as further defined in Section 3.2 of the report.

¹ NYSPSC CASE 03-E-0188. Order Regarding Retail Renewable Portfolio Standard. September 24, 2004.

² NYSPSC CASE 07-M-0548. Order Establishing Energy Efficiency Portfolio Standard And Approving Programs. June 23, 2008. *id.*, Order Authorizing Efficiency Programs, Revising Incentive Mechanism, and Establishing a Surcharge Schedule, October 25, 2011; see also NYSPSC Case 10-M00457, In the Matter of the Systems Benefits Charge IV, Order Continuing the System Benefits Charge, October 24, 2011 .

Table 1: Major Scenario Assumptions

Scenario	Variables
EPA Projected NOx and SO ₂ Costs	Increases in SO ₂ and Ozone Season NOx costs; decreases in annual NOx cost as projected by EPA
Higher Load Forecast	6% increase
Lower Load Forecast	9% decrease
Full RPS and Full EEPS Goals Achievement	Add renewables from Interconnection Queue to achieve 9870 GWh goal and reduce 2015 load to 32147 MW
Athens SPS Continued In Service*	2011-2020
Higher Natural Gas Prices	One standard deviation
Lower Natural Gas Prices	One standard deviation
Lower CO ₂ Emission Costs	Flat \$/ton

*The CARIS base case assumes, for study purposes, that the Athens SPS (which remained in service throughout 2011 and is currently in service as of February 2012) is not in service throughout the 2011-2020 study period. Taking the Athens SPS system out of service results in a reduction in the transfer capability of the UPNY-SENY interface. This reduction was calculated to be 450 MW in the 2006 Athens SPS System Impact Study.

Table 2: Scenarios Impact on Congestion: 2015 + 2020 (\$M nominal)

CONSTRAINTS	2015 + 2020 Scenarios: Change in Demand Congestion (Nominal \$M)							
	EPA Projected NOx and SO ₂ Costs	Higher Load Forecast	Lower Load Forecast	Full RPS and Full EEPS Goals Achievement	Athens SPS Continued in Service	Higher Natural Gas Prices	Lower Natural Gas Prices	Lower Carbon Emission Costs
LEEDS-PLSNTVLY	12	103	(175)	38	(199)	58	(72)	(81)
CENTRAL EAST	(22)	(5)	155	839	59	120	(223)	(59)
DUNWOODIE_SHORE RD_345	45	8	(4)	8	8	14	(25)	4
GREENWOOD LINES	0	8	(10)	(3)	1	2	(1)	1
WEST CENTRAL-OP	4	(0)	(0)	(4)	2	4	(2)	(9)
GOTHS A - GOWANUSS	2	5	(5)	(2)	(2)	0	(2)	(0)
LEEDS3_NEW SCOTLAND_345	2	(2)	1	1	3	0	(0)	(4)
RAINY8W138_VERNW_138	1	0	0	0	1	2	(3)	2
ASTORIAW138_HG5_138	1	0	(0)	0	(1)	(0)	0	(1)
Study 1: Central East-New Scotland-Pleasant Valley	(8)	96	(19)	877	(136)	178	(296)	(144)
Study 2: New Scotland-Pleasant Valley	14	101	(174)	39	(196)	58	(73)	(85)
Study 3: Leeds-Pleasant Valley	12	103	(175)	38	(199)	58	(72)	(81)

Table 2 above shows the congestion impact from the scenarios for each of the most congested constraints. It also shows the change in congestion resulting from each scenario for each of the three study groups.

3. Other Findings and Observations

- **Potential Impacts** - This report provides an economic analysis of projected congestion on the New York State bulk power transmission system and the potential costs and benefits of relieving that congestion. The study provides information to interested parties to consider developing transmission, generation or DR projects, as appropriate, to relieve congestion, and to propose transmission projects for economic evaluation and potential recovery of costs through the NYISO's Tariff. There are other potential benefits to relieving transmission congestion, such as reduced load payments, increased generator payments, reduced losses, ICAP savings, and reduced emissions that may be of interest to parties in making their investment decisions. For CARIS 1, the load payment metric does not reflect that loads may be partially hedged through bilateral contracts and ownership of TCCs.
- **Demand\$ Congestion** – As with the 2009 CARIS Report, the level of congestion projected in this 2011 CARIS Phase I Report varies from historic levels. Several enhancements were implemented for this 2011 CARIS as compared to the 2009 CARIS model, which reduced the disparity between historic and projected congestion. The disparity continues to occur in large part due to certain assumptions, operational parameters and market participant behavior that cannot be fully captured by the production cost simulation model. These disparities include market bidding behavior by both generators and load, virtual transactions that occur in the NYISO Day-Ahead Market, transmission outages, actual commodity price variations and hourly load variations. Actual congestion realized in the future years will differ from the projected values because actual system operating conditions, economic conditions, fuel prices, environmental compliance costs and market behavior will be different from what has been assumed in the study. The purpose of the production simulation model, however, is to help assess the effectiveness of congestion mitigation solutions.

The CARIS base case model projects the Demand\$ congestion values in New York at \$709 million in 2011 and \$1098 million in 2020. Comparatively, historic Demand\$ congestion values from 2006 to 2010 ranged from a low of \$977 million in 2009 to a high of \$2,613 million in 2008.

- **Changes Since Last CARIS** - These include assumption changes, modeling changes, and changes to the methodology to evaluate the primary benefit metric. Examples of base case assumption changes which tend to decrease congestion include lower load forecasts caused by the economic recession, lower natural gas prices, and new generating units and transmission. Major modeling changes for the 2011 study, some of which could increase congestion, include lower Central East interface limits to represent how the limit is impacted by nearby generation, refinement to the representation of the Ramapo PARS to better model how they are used in system operations, utilization of flat hurdle rates to reflect inter-regional energy market transaction costs, and implementation of a weekly fuel forecast to better track seasonal changes. Additionally a change was made to the NYCA-wide production cost savings calculation, adjusting the methodology for valuing changes in imports/exports.

- **Resource Updates** - The ten year assessment of future congestion and the potential benefits of relieving some of this congestion is based upon the new and existing NYCA resources that have been included in the base case for the 2010 Comprehensive Reliability Plan (CRP), with one exception. Since the publication of the 2010 CRP, the Hudson Transmission Partners started (in mid 2011) the construction of the transmission intertie between Bergen, NJ and W. 49 Street (“HTP transmission line”). This satisfied NYISO’s base case inclusion criterion. Any additional system resources coming into service, or any changes to the existing resources, during the ten year study period will produce different results when modeled in the base case or coupled with the generic solutions than those presented in this report.
- **Scenario Analyses** - Scenario analyses were used to provide projected congestion information associated with variations in load, fuel price, available resources, and other assumptions. The scenario analysis shows the impact on congestion for individual constraints as well as the three study groupings.
- **Specific Solutions Will Produce Different Results** - Projects with characteristics other than the generic projects studied here could also relieve congestion. The generic solutions are representative, and are presented for informational purposes only, but their feasibility was not assessed.
- **Diversity of NYCA Impacts** - This study reports the benefits of relieving congestion both statewide and by zone across New York. All zones do not benefit equally when implementing the generic solutions. For example, load payments decreased in some zones and increased in others.
- **Benefit Lifespan** - The useful life of actual projects may be longer than the ten-year study period evaluated in this report pursuant to the NYISO tariff. Benefits and costs in later years can be considered in CARIS Phase 2.
- **Congestion Pattern Changes** - There have been changes in congestion patterns across the New York bulk transmission system over the past several years. As discussed in the *2010 State of the Markets Report* by Potomac Economics and the 2009 CARIS Report, lower natural gas prices and new transmission and generation in southeast New York have reduced the projected congestion. Due to the economic downturn and other factors since 2009, lower natural gas prices, lower load forecasts, new transmission, and new generation in southeast New York have been incorporated into the 2011 CARIS model. These changes in assumptions tend to reduce congestion in New York. Other factors, such as increased imports, particularly from Canada, and changes in the projected emission costs associated with new environmental regulations, will tend to increase congestion in upstate New York. Differences in projected emissions cost across regions in the model account for some of this increased congestion. The 2011 CARIS results illustrate the combined impact of all these modeling changes.

4. Next Steps

Additional Study Requests

Going forward, any interested party can request, at its own expense, an additional study to assess a specific project and its impact on congestion on the New York bulk power system. The NYISO will conduct the requested studies in the order in which they were accepted and as the NYISO's resource commitments allow.

Specific Project Analysis

Phase 2 of the CARIS process is expected to begin in March 2012, subject to the approval of this 2011 CARIS Phase 1 report by the NYISO Board of Directors. In Phase 2, developers are encouraged to propose projects to alleviate the identified congestion. The NYISO will evaluate proposed specific economic transmission projects upon a developer's request to determine the extent such projects alleviate congestion, and whether the projected economic benefits would make the project eligible for cost recovery under the NYISO's Tariff. While the eligibility criterion is production cost savings, zonal LBMP load savings (net of TCC revenues and bilateral contracts) is the metric used in Phase 2 for the identification of beneficiary savings and the determinant used for cost allocation to beneficiaries for a transmission project. For a transmission project to qualify for cost recovery through the NYISO's Tariff, the project has to have: (a) a capital cost of at least \$25 million, (b) benefits that outweigh costs over the first ten years of operation, and (c) received approval to proceed from 80% or more of the actual votes cast by beneficiaries on a weighted basis. Subsequent to meeting these conditions, the developer will be able to obtain cost recovery of their transmission project through the NYISO's Tariff, subject to the developer's filing with the Federal Energy Regulatory Commission (FERC) for approval of the project costs and rate treatment.

1. Introduction

Pursuant to Attachment Y of its Open Access Transmission Tariff (OATT, or the Tariff), the NYISO performed the first phase of the 2011 Congestion Assessment and Resource Integration Study (CARIS). The study assesses both historic³ and projected congestion on the New York bulk power system and estimates the economic benefits of relieving congestion. Together with the Local Transmission Planning Process (LTPP) and the Comprehensive Reliability Planning Process (CRPP), the CARIS is the final process in the NYISO's biennial Comprehensive System Planning Process (CSPP) (see Figure 1-1). The 2011 CARIS completes the CSPP process that began with LTPP inputs for the 2010 Reliability Needs Assessment.

CARIS consists of two phases: Phase 1, the Study Phase, and Phase 2, the Project Phase. Phase 1 is initiated after the NYISO Board of Directors (Board) approves the Comprehensive Reliability Plan (CRP). In Phase 1, the NYISO, in collaboration with its stakeholders and other interested parties, develops a ten-year projection of congestion and together with historic congestion identifies, ranks, and groups the most congested elements on the New York bulk power system. For the top three congested elements or groupings, studies are performed which include: (a) the development of three types of generic solutions to mitigate the identified congestion; (b) a benefit/cost assessment of each solution based on projected NYCA-wide production cost savings and estimated project costs; and (c) presentation of additional metrics for informational purposes. The three types of generic solutions are transmission, generation and demand response. Scenario analyses are also performed to help identify factors that increase, decrease or produce congestion in the CARIS base case.

This final report presents the 2011 CARIS Phase 1 study results and provides objective information on the nature of congestion in the New York Control Area (NYCA). Developers can use this information to decide whether to proceed with transmission, generation, or demand response projects. Developers of such projects may choose to pursue them on a merchant basis, or to enter into bi-lateral contracts with LSEs or other parties. This report does not make recommendations for specific projects, and does not advocate any specific type of resource addition or other actions.

Developers may propose economic transmission projects for regulated cost recovery under the NYISO's Tariff and proceed through the Project Phase, CARIS Phase 2, which will be conducted by the NYISO upon request and payment by a developer. Developers of all other projects can request that the NYISO conduct an additional CARIS analysis at the developer's cost to be used for the developer's purposes, including for use in an Article VII, Article X or other regulatory proceedings. For a transmission project, the NYISO will determine whether it qualifies for regulated cost recovery under the Tariff. Under CARIS, to be eligible for regulated cost recovery, an economic transmission project must have production cost savings greater than the project cost (expressed as having a benefit to cost ratio (B/C) greater than 1.0), a cost of at least \$25 million, and be approved by at least 80% of the weighted vote cast by New York's Load Serving Entities (LSEs) that serve loads in zones that the NYISO identifies as beneficiaries

³ The NYISO began reporting NYISO historic congestion information in 2003.

of the transmission project. The beneficiaries are those load zones that experience net benefits measured over the first ten years from the proposed project commercial operation date. After the necessary approvals, regulated economic transmission projects are eligible to receive cost recovery from these beneficiaries through the NYISO Tariff provisions once they are placed in service.

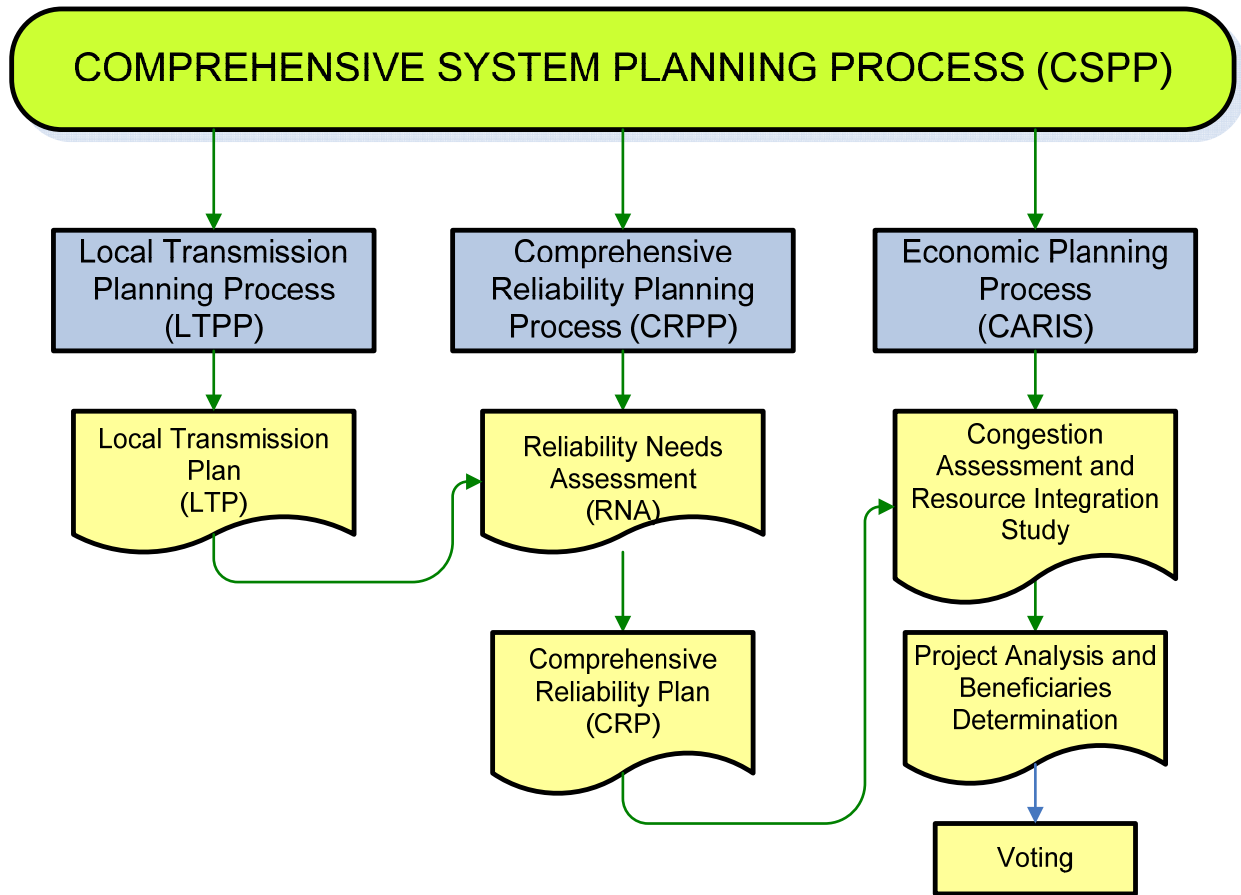


Figure 1-1: NYISO Comprehensive System Planning Process

This 2011 CARIS Phase 1 study includes intended enhancements to the 2009 CARIS Phase 1 study in its assumptions, modeling, and methodology for evaluating benefits which were discussed with ESPWG. Some of these changes reflect actual system changes while others are modeling changes that caused a difference in the study results all else being equal. Examples of base case assumption changes which tend to decrease congestion include lower load forecasts caused by the economic recession, lower natural gas prices, and new generating units and transmission. Notable modeling changes for the 2011 study, some of which might increase

congestion, include lower Central East interface limits to represent how the limit is impacted by nearby generation, and refinement to the representation of the operation of the Ramapo PARS to better model how they are used in system operations. Other changes include the utilization of flat hurdle rates to reflect inter-regional energy market transaction costs which directly affected the import levels from each of the NYCA neighbors, and implementation of a weekly fuel forecast to better track the path of seasonal changes. It is also important to note the decision to utilize the MAPS Production Costing software for the 2011 CARIS instead of using the GridView software for the 2009 CARIS study. The methodology for calculating NYCA-wide production costs was changed in the way that changes in NYCA imports/exports were valued.

The projected congestion in this report will be different than the actual congestion experienced in the future. CARIS simulations are based upon a limited set of long term assumptions for modeling of grid resources throughout the ten-year planning horizon. A range of cost estimates was used to calculate the cost of generic solution projects (transmission, generation, and DR). These costs are intended for illustrative purposes only and are not based on any feasibility analyses. Each of the generic solution costs are utilized in the development of benefit/cost ratios.

The NYISO Staff presented the Phase 1 Study results in a written draft report to the NYISO's Electric System Planning Working Group (ESPWG) and the Transmission Planning Advisory Subcommittee (TPAS) for review. After that review, the draft report was presented to the NYISO's Business Issues Committee (BIC) and the Management Committee (MC) for discussion and action before it was submitted to the Board for approval.

2. Background

2.1. Congestion Assessment and Resource Integration Study (CARIS) Process

The objectives of the CARIS economic planning process are to:

- a. Project congestion on the New York State bulk power transmission facilities over the ten-year CSPP planning horizon;
- b. Identify, through the development of appropriate scenarios, factors that might affect congestion;
- c. Provide information to market participants, stakeholders and other interested parties on solutions to reduce congestion;
- d. Provide an opportunity for developers to propose solutions that may reduce the congestion; and
- e. Provide a process for the evaluation and approval of regulated economic transmission projects for regulated cost recovery under the NYISO Tariff.

These objectives are achieved through the two phases of the CARIS process which are graphically depicted in Figure 2-1 below.

Congestion Assessment and Resource Integration Study (CARIS)

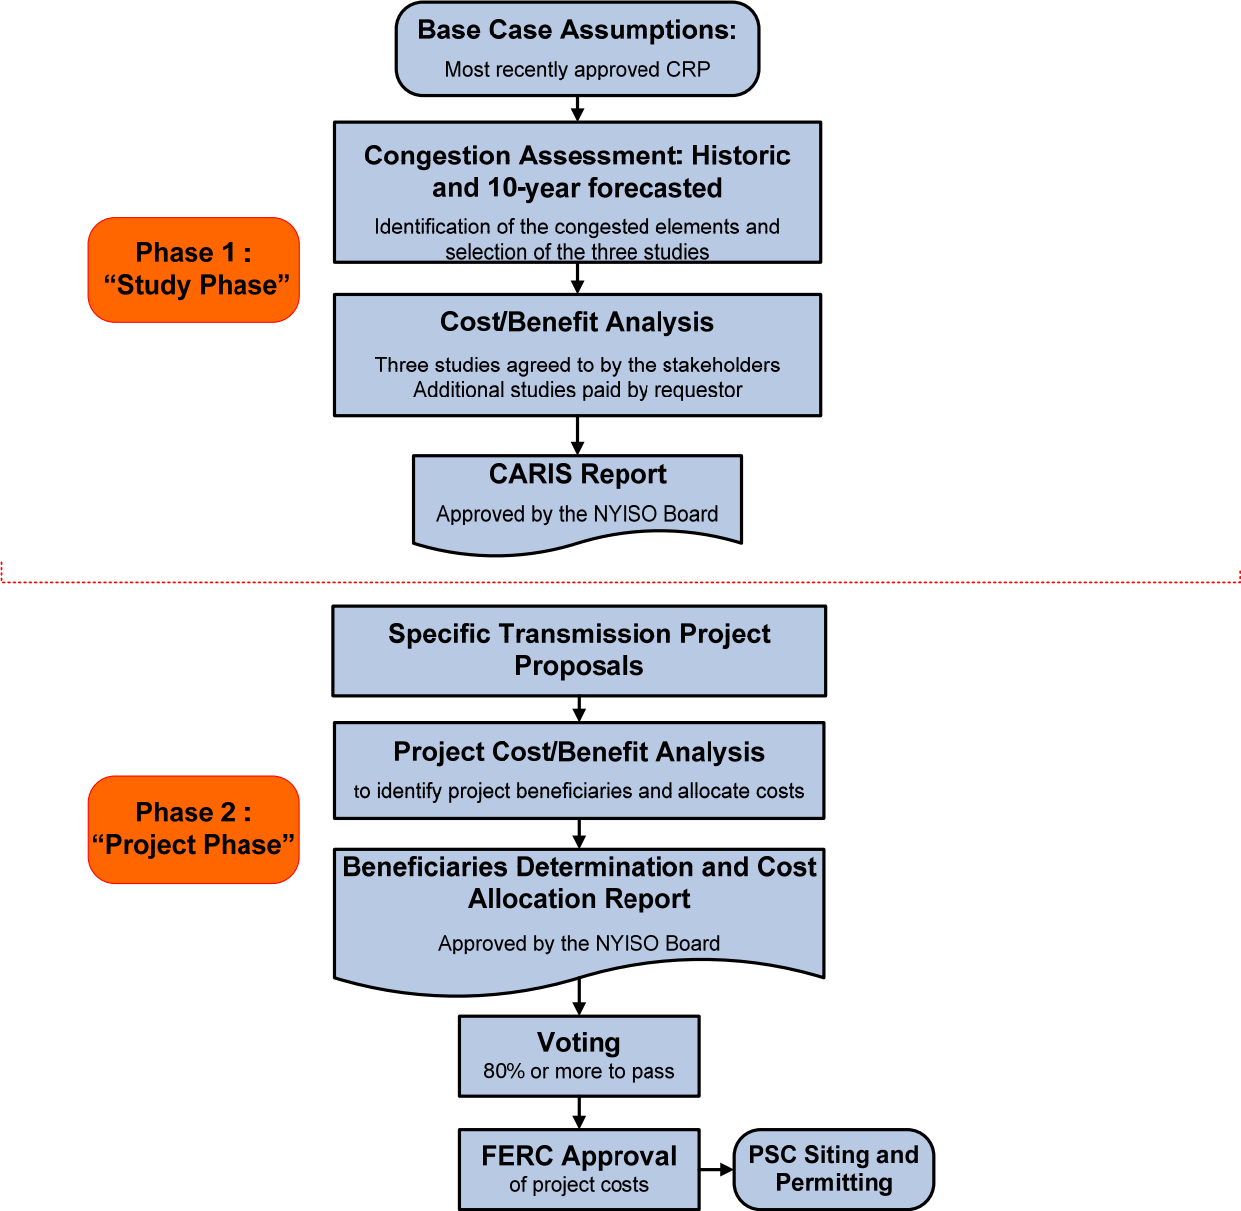


Figure 2-1: Overall CARIS Diagram

2.1.1. Phase 1 - Study Phase

In Phase 1 of the CARIS process, the NYISO, in collaboration with market participants, identifies the most congested elements in the New York bulk power system and conducts three

transmission congestion studies based on those elements. In identifying the most congested elements, the NYISO performs both a five-year historic and a ten-year forward-looking congestion assessment to identify the seven most congested elements and, through a relaxation process, develops potential groupings and rankings based on the highest projected production cost savings resulting from the relaxation. The top three ranked elements or groupings become the subjects of the three CARIS studies. For each of these three studies the NYISO conducts a benefit/cost analysis of generic solutions. All resource types - generation, transmission and DR - are considered on a comparable basis as generic solutions to congestion. The solutions analyzed are not specific projects, but rather represent generic transmission, DR and generation resources placed individually in the congested locations on the system to calculate their effects on relieving each of the three most congested elements and the resulting economic benefits.

The principal metric for measuring the economic benefits of each generic solution is the NYCA-wide production cost savings that would result from each generic solution, expressed as the present value over the ten-year planning horizon. The CARIS report also presents data on additional metrics, including estimates of reductions in losses, changes in Locational Based Marginal Pricing (LBMP) load payments, generator payments, changes in installed capacity costs, changes in emissions costs and changes in payments for Transmission Congestion Contracts (TCCs). The TCC payment metric in Phase 1 is simplified to include congestion rent calculations only, and is different from the TCC revenue metric contained in Phase 2. The Installed Capacity (ICAP) metric calculation was changed after the 2009 CARIS Phase 1. CARIS metrics are described in more detail in Section 3.

The NYISO also conducts scenario analyses to assess the congestion impact of various changes to base case assumptions. Scenario results are presented as the change in Demand\$ congestion on the three study elements or groupings, as well as other constraints throughout NYCA.

2.1.2. Phase 2 – Project Phase

The Phase 2 model will be developed from the CARIS 1 database using an assumption matrix developed after discussion with ESPWG and will reflect all necessary system modeling changes required for a 10 year extension of the model. Updating and extending the CARIS database for Phase 2 of the CARIS is conducted after the approval of the CARIS Phase 1 report by the NYISO Board.

Potential economic transmission projects that have an estimated capital cost in excess of \$25 million may seek regulated cost recovery through the NYISO Tariff. Such developers must submit their projects to the NYISO for a benefit/cost analysis in accordance with the Tariff. The costs for the benefit/cost analysis will be supplied by the developer of the project as required by the Tariff. Projects may be eligible for regulated cost recovery only if the present value of the NYCA-wide production cost savings exceeds the present value of the costs over the first ten years of the project life. In addition, the present value over the first ten years of LBMP load savings, net of TCC revenues and bilateral contract quantities, must be greater than the present

value of the projected project cost revenue requirements for the first ten years of the amortization period.

Beneficiaries will be LSEs in load zones determined to benefit economically from the project, and cost allocation among those load zones will be based upon their relative economic benefit. The beneficiary determination for cost allocation purposes will be based upon each zone's net LBMP load savings. The net LBMP load savings are determined by adjusting the LBMP load savings to account for TCC revenues and bilateral contract quantities; all LSEs in the zones with positive net LBMP load savings are considered to be beneficiaries. The net LBMP load savings produced by a project over the first ten years of commercial operation will be measured and compared on a net present value basis with the project's revenue requirements over the same first ten years of a project's life measured from its expected in-service date. LSE costs within a zone will be allocated according to the ratio of its load to all load in the zone - both expressed in MWh.

In addition to the NYCA-wide production cost savings metric and the net LBMP load savings metric, the NYISO will also provide additional metrics, for information purposes only, to estimate the potential benefits of the proposed project and to allow LSEs to consider other metrics when evaluating or comparing potential projects. These additional metrics will include estimates of reductions in losses, changes in LBMP load payments, changes in generator payments, changes in Installed Capacity (ICAP) costs, changes in emissions costs, and changes in TCC revenues. The TCC revenue metric that will be used in Phase 2 of the CARIS process is different from the TCC payment metric used in Phase 1. In Phase 2, the TCC revenue metric will measure reductions in estimated TCC auction revenues and allocation of congestion rents to the TOs (for more detail on this metric see Section 3.2.2 of this report and the CSPP Manual⁴).

The NYISO will also analyze and present additional information by conducting scenario analyses, at the request of the developer after discussions with ESPWG, regarding future uncertainties such as possible changes in load forecasts, fuel prices and environmental regulations, as well as other qualitative impacts such as improved system operations, other environmental impacts, and integration of renewable or other resources. Although this data may assist and influence how a benefiting LSE votes on a project, it will not be used for purposes of cost allocation.

The NYISO will provide its benefit/cost analysis and beneficiary determination for particular projects to the ESPWG for comment. Following that review, the NYISO benefit/cost analysis and beneficiary determination will be forwarded to the BIC and MC for discussion and action. Thereafter the benefit/cost analysis and beneficiary determination will be forwarded to the NYISO Board of Directors for review and approval.

After the project benefit/cost and beneficiary determinations are approved by the NYISO Board and posted on the NYISO's website, the project will be brought to a special meeting of the beneficiary LSEs for an approval vote, utilizing the approved voting procedure (see Section 1.2.5

⁴ http://www.nyiso.com/public/webdocs/services/planning/initial_caris_manual_bic_approved/CARISmanual.pdf. The planning Manuals are currently under revision and will be released as a CSPP Manual.

of the Initial CARIS Manual, Appendix F). The specific provisions for cost allocation are set forth in the Tariff. In order for a project to be approved for regulated cost recovery, the Tariff states that “eighty (80) percent or more of the actual votes cast on a weighted basis must be cast in favor of implementing the project.” If the project meets the required vote in favor of implementing the project, and the project is implemented, all beneficiaries, including those voting “no,” will pay their proportional share of the cost of the project through the NYISO Tariff. This process will not relieve the developer of the responsibility to file with FERC for approval of the project costs which were presented by the developer to the voting beneficiaries and with the appropriate state authorities to obtain siting and permitting approval for the project.

3. CARIS Methodology and Metrics

3.1. CARIS Methodology

For the purposes of conducting the ten-year forward looking CARIS analysis, the NYISO, in conjunction with ESPWG, developed a production costing model database and utilized GE's Multi-Area Production Simulation (MAPS) software. The details and assumptions in developing this database are summarized in Appendix C.

The Portfolio Ownership and Bid Evaluation (PROBE) production cost simulation tool, developed by PowerGEM LCC, has been used for the last seven years to perform the NYISO historic congestion analysis. PROBE utilizes the actual NYISO Day-Ahead Market (DAM) data to emulate the actual security constrained unit commitment (SCUC) operation. CARIS utilizes the most recent five years of historic data. Unlike MAPS simulation, PROBE simulates virtual bidding and transmission outages and calculates production costs based on generation mitigated bids. While those additional attributes are important in capturing the real congestion costs for the past events, it is nearly impossible to model them with certainty in projecting future transmission congestion. Therefore, these attributes are not accounted for in the ten-year forward looking CARIS analysis. Actual future congestion will vary from projections depending on a number of factors. For more detail see Appendix D.

3.2. CARIS Metrics

The principal benefit metric for CARIS analysis is the NYCA-wide production cost savings that would result from each of the generic solutions. Additional benefit metrics were analyzed as well, and the results are presented in this report and accompanying appendices for informational purposes only. All benefit metrics were determined by measuring the difference between the projected CARIS base case value and a projected solution case value when each generic solution was added. The discount rate of 7.36% used for the present value analysis was the current weighted average cost of capital for the NYTOs, weighted by their annual GWh send-out in 2010.

One of the key metrics in the CARIS analysis is termed Demand Dollar congestion (expressed as Demand\$ congestion in PROBE). Demand\$ congestion represents the congestion component of load payments. For a load zone, the Demand\$ congestion of a constraint is the product of the constraint shadow price, the load zone shift factor (SF) on that constraint, and the zonal load. For NYCA, the Demand\$ congestion is the sum of all of the zonal Demand\$ congestion.

These definitions are consistent with what has been used for the reporting of historic congestion for the past seven years. Demand\$ congestion is used to identify and rank the significant transmission constraints as candidates for grouping and the evaluation of potential generic solutions. It does not equate to payments by load.

3.2.1. Principal Benefit Metric⁵

The principal benefit metric for the CARIS analysis is the present value of the NYCA-wide production cost savings that are projected to result from implementation of each of the generic congestion mitigation solutions. The NYCA-wide production cost savings are calculated as those savings associated with generation resources in the NYCA and the costs of incremental imports/exports priced at external proxy generator buses of the solution case. This was adopted given the acknowledged need to improve the 2009 CARIS methodology⁶ where the NYCA-wide production cost savings were calculated as those savings associated with generation resources in the NYCA and the change in the net imports priced at the respective external proxy generator buses with and without the solution.

Specifically, the NYCA-wide production cost savings are calculated using the following formula:

$$\text{NYCA-wide Production Cost Savings} = \text{NYCA Generator Production Cost Savings} - \sum \sum [(\text{Import/Export Flow})_{\text{Solution}} - (\text{Import/Export Flow})_{\text{Base}}] \times \text{ProxyLMP}_{\text{Solution}}$$

Where $\text{ProxyLMP}_{\text{Solution}}$ is the LMP at one of the external proxy buses; $(\text{Import/Export Flow})_{\text{Solution}} - (\text{Import/Export Flow})_{\text{Base}}$ represents incremental imports/exports with respect to one of the external systems; and the summations are made for each external area and all simulated hours.

3.2.2. Additional Benefit Metrics

The additional benefits, which are provided for information purposes only, include estimates of reduction in loss payments, LBMP load costs, generator payments, ICAP costs, emission costs, and TCC payments. All the quantities, except ICAP, will be the result of the forward looking production cost simulation for the ten-year planning period. The NYISO, in collaboration with the ESPWG, determined the additional informational metrics to be defined for this CARIS cycle given existing resources and available data. The collaborative process determined the methodology and models needed to develop and implement these additional metrics requirements, which are described below and detailed in the Initial CARIS Manual. An example illustrating the relationship among some of these metrics is provided in Appendix E.

⁵ Section 31.3.1.3.4 of the Tariff specifies the principal benefit metric for the CARIS analysis.

⁶ http://www.nyiso.com/public/webdocs/committees/bic_espwg/meeting_materials/2012-01-03/PC_method_comparison_12-28-11.pdf;
http://www.nyiso.com/public/webdocs/committees/bic_espwg/meeting_materials/2011-12-09/ESPWG_12911_final.pdf

Reduction in Losses – This metric calculates the change in marginal losses payments. Losses payments are based upon the loss component of the zonal LBMP load payments.

LBMP Load Costs – This metric measures the change in total load payments. Total load payments include the LBMP payments (energy, congestion and losses) paid by electricity demand (load, exports, and wheeling). Exports will be consistent with the input assumptions for each neighboring control area.

Generator Payments – This metric measures the change in generation payments by measuring only the LBMP payments (energy, congestion, losses). Thus, total generator payments are calculated for this information metric as the sum of the LBMP payments to NYCA generators and payments for net imports. Imports will be consistent with the input assumptions for each neighboring control area.

ICAP Costs –The latest available information from the installed reserve margin (IRM), locational capacity requirement (LCR), and ICAP Demand Curves are used for the calculation. The NYISO first calculates the NYCA MW impact of the generic solution on LOLE. The NYISO then forecasts the installed capacity cost per megawatt-year point on the ICAP demand curves in Rest of State and in each locality for each planning year. There are two variants for calculating this metric, both based on the MW impact. For more detail on this metric see the Section 31.3.1.3.5.6 of the Tariff.

Emission Costs – This metric measures the change in the total cost of emission allowances for CO₂, NO_x, and SO₂, emissions on a zonal basis. Total emission costs are reported separately from the production costs. Emission costs are the product of forecasted total emissions and forecasted allowance prices.

TCC Payments – The TCC payment metric is calculated differently for Phase 1 than it is calculated for Phase 2 of the CARIS process, as described in the NYISO Tariff. In this CARIS Phase 1, the change in the TCC Payment is calculated as the change in load payment minus the sum of the generator payments and the net import payments. This is not a measure of the Transmission Owners' TCC auction revenues.

4. Baseline System Assumptions

The implementation of the CARIS process requires the gathering, assembling, and coordination of a significant amount of data, in addition to that already developed for the reliability planning processes. The 2011 CARIS study process is conducted by updating the base case input assumptions provided in the 2010 CRP and aligns with the ten-year reliability planning horizon for the 2010 CRP.

4.1. Notable System Assumptions & Modeling Changes

The base case has been updated as of July 1, 2011 for this CARIS Phase 1 using the assumptions provided below. These assumptions were discussed with the stakeholders at several meetings of the ESPWG. Appendix C includes a detailed description of the assumptions utilized in the CARIS analysis. The key assumptions are presented below:

1. Power flow models – the 2010 CRP power flow base cases were updated for use in the 2011 CARIS study.
2. The load and capacity forecast was updated using the 2011 Gold Book baseline forecast for energy and peak demand by zone for the ten year study period.
3. The transmission and constraint model utilizes a bulk power system representation for most of the Eastern Interconnection as described below. The model uses both the 2010 RNA/CRP transfer limits and actual operating limits.
4. The production cost model performs a security constrained economic dispatch of generation resources to serve the load. The production cost curves, unit heat rates, fuel forecasts and emission costs forecast were developed by the NYISO from multiple data sets including public domain information, proprietary forecasts and confidential market information. The model includes scheduled generation maintenance periods based on a combination of each unit's planned and forced outage rates. Because of the uncertainty associated with the Cross-State Air Pollution Rule (CSAPR) ruling, this study did not update the emission assumptions in place as of July 1, 2011.
5. In addition to the modeling changes listed below that can have significant impacts on the congestion projections, there are known NYCA events that have impacts on the simulation outcome, as summarized in Table 4-1.

Major Modeling Inputs

Input Parameter

Load Forecast

Natural Gas Price Forecast

Carbon Price Forecast

NOx Price Forecast

SOx Price Forecast

Change from the 2009 CARIS

Lower

Lower

Higher by end of term

Higher

Higher

Modeling Changes

Description

Central East Interface Limit

Change from the 2009 CARIS

The starting limit was 200MW less than what was used in 2009 limit to be more representative of the Central East operating limit that take into account the operation of nearby generation

Ramapo PARs

Changed from being automatically optimized during model simulation in 2009 to more closely representing the actual Day Ahead market operations of Ramapo PARs

Con Ed – PSEG Wheel

In 2009, both the A/B/C and J/K interfaces were set at 600 MW min, 1200 MW max with imbalance monitored. Now changed to set both A/B/C and J/K to deliver 1000 MW with a bandwidth of +/- 100 MW, to more closely represent latest agreement conforming the ConEd/ PSEG wheel protocol

Fuel price forecast

The use of a more refined fuel price forecast (monthly to weekly)

Hurdle rates

Flat dispatch hurdle rates to better reflect inter-regional energy market transaction costs over the 10 years, and

Generator modeling

The use of more representative combined cycle and gas turbine models

Table 4-1: Timeline of NYCA Changes

2011	2012	2013	2014	2015 - 2020
M29 Cable Installed	Bayonne Generator Installed (500 MW)	HTP Installed	Nine Mile Pt2 Uprate (53 MW)	No changes
Athens SPS Removed*	Nine Mile Pt2 Uprate (115 MW)		Munnsville Wind Power Uprate (0.6 MW)	
Steel Winds II Installed (1.5 MW)	Ontario Uprate (5.6 MW)			
Astoria Energy II Installed (576 MW)				
Energy Systems North East Retired(79.4 MW)**				
Project Orange 1&2 Retired (40 MW)**				
Greenidge 4 Protective Layup (106.1 MW)				
Westover 8 Protective Layup (81.2 MW)				

* The CARIS base case assumes, for study purposes, that the Athens SPS (which remained in service throughout 2011 and is currently in service as of February 2012) is not in service throughout the 2011-2020 study period. The Athens SPS system impact study in 2006 indicated a 450 MW increase in the transfer capability of the UPNY-SENY interface with the SPS in service.

** Units retired in 2010

4.2. Load and Capacity Forecast

The load and capacity forecast used in the CARIS base case, provided in Table 4-2, was based on the 2011 Gold Book and accounts for the impact of programs such as the Energy Efficiency Portfolio Standard (EEPS).

Table 4-2: CARIS 1 Base Case Load and Resource Table ⁷

Year	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020
Peak Load (MW)										
NYCA	32,712	33,182	33,433	33,609	33,678	33,749	33,916	34,190	34,533	34,867
Zone J	11,505	11,635	11,720	11,785	11,830	11,880	12,015	12,200	12,405	12,585
Zone K	5,364	5,470	5,520	5,543	5,572	5,633	5,655	5,721	5,775	5,845
Resources (MW)										
Capacity	40,106	40,865	40,860	40,863	40,863	40,863	40,863	40,863	40,863	40,863
NYCA SCR	2,053	2,053	2,053	2,053	2,053	2,053	2,053	2,053	2,053	2,053
Total	42,159	42,918	42,913	42,916	42,916	42,916	42,916	42,916	42,916	42,916
Capacity	9,667	10,167	10,167	10,167	10,167	10,167	10,167	10,167	10,167	10,167
Zone J SCR	476	476	476	476	476	476	476	476	476	476
Total	10,143	10,643	10,643	10,643	10,643	10,643	10,643	10,643	10,643	10,643
Capacity	5,549	5,549	5,549	5,549	5,549	5,549	5,549	5,549	5,549	5,549
Zone K SCR	154	154	154	154	154	154	154	154	154	154
Total	5,703	5,703	5,703	5,703	5,703	5,703	5,703	5,703	5,703	5,703

Source: 2011 Gold Book baseline load forecasts from Section I.

4.3. Transmission Model

The CARIS production cost analysis utilizes a bulk power system representation for the entire Eastern Interconnection, which is defined roughly as the bulk electric network in the United States and Canadian Provinces East of the Rocky Mountains, excluding WECC, FRCC, SPP, and Texas. Figure 4-1 below illustrates the NERC Regions and Balancing Authorities in the CARIS model. The CARIS model includes a full active representation for the NYCA, ISO-NE, IESO, and PJM.

⁷ New York Control Area (NYCA) "Capacity" values include resources internal to New York, additions (South Pier generator addition is not included), re-ratings, retirements, purchases and sales, and UDRs with firm capacity. Zones J and K capacity values do not include UDRs with firm capacity.

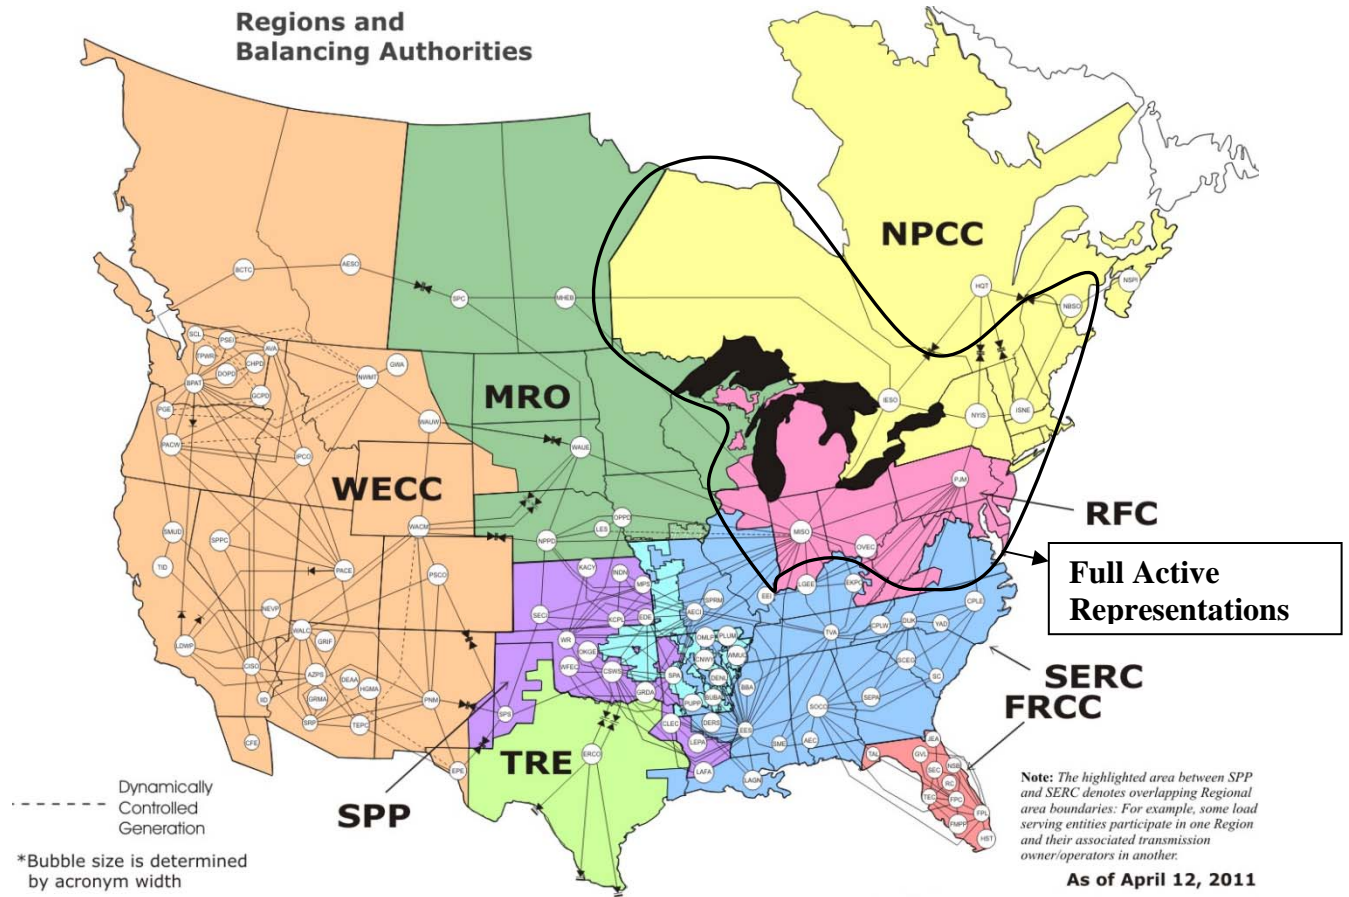


Figure 4-1: Areas Modeled in CARIS (Excluding WECC, FRCC, SPP, & TRE)

Source: NERC

4.3.1. New York Control Area Transfer Limits

Unlike the RNA and CRP, which utilize emergency limits, the CARIS utilizes the actual normal facility ratings for the calculation of thermal transfer limits. For voltage and stability based limits, the normal and emergency limits are assumed to be the same. For New York Control Area Interface Transfer limits, the limits are consistent with the SCUC operating limits and operating nomograms with some exceptions as indicated in Table 4-3 below.

Table 4-3: Transmission System Normal Voltage Transfer Limits for Key Interfaces (in MW)

Interface	2011 CARIS Study
WEST CENTRAL-Open	2150
CENTRAL EAST	2400
ConEd - Long Island	2166
Dunwoodie (l) to NYCity (J)	4350
Dunwoodie (l) to Long Island (k)	1161
Sprainbrook/Dunwoodie South	5365

Note: Central East was modeled with a unit sensitive nomogram reflective of the operating nomogram.

Normal thermal interface transfer limits for the CARIS study are not directly utilized from the thermal transfer analysis performed using the Power Technologies Inc. Managing and Utilizing System Transmission (MUST) software application. Instead, CARIS uses the most limiting monitored line and contingency sets identified from MUST analysis. The resulting monitored lines and contingency sets used in the CARIS do not include lines that have less than a 5% impact on the NYCA cross-state transmission interfaces, or the lines that only impact local 115-138 kV transmission or sub-transmission constraints.

4.4. Fuel Forecasts

4.4.1. CARIS Base Annual Forecast

The fuel price forecasts for CARIS are based on the U.S. Energy Information Administration's (EIA)⁸ current national long-term forecast of delivered fuel prices, which is released each spring as part of the Annual Energy Outlook (AEO). The figures in this forecast are in real dollars (i.e., indexed relative to a base year). Forecasted time-series of the GDP deflator published by EIA, as part of the AEO, were used to inflate the *real* values to *nominal* values. This forecast is updated quarterly based on data published in EIA's periodic Short-Term Energy Outlooks.

4.4.2. New York Fuel Forecast

In developing the New York fuel forecast, adjustments were made to the EIA fuel forecast to reflect bases for fuel prices in New York. Key sources of data for estimating the relative differences or 'basis' for fuel prices in New York are the Monthly Utility and non-Utility Fuel Receipts and Fuel Quality Data reports based on the information collected through Form

⁸ www.eia.doe.gov

EIA-923.⁹ The base annual forecast series from the EIA 2011 annual energy outlook forecast are then subjected to an adjustment to reflect the New York ‘basis’ relative to the national prices as described below.

Natural Gas

Analysis of EIA’s Short-Term Energy Outlooks from the past two years for the national average of delivered price of natural gas for electricity generation suggests that it is, on average, 10% higher than Henry Hub prices. The regional basis is then assessed against 110% of Henry Hub prices. The natural gas price for Downstate (Zones J and K), is the Transco Zone 6 (New York) hub-price¹⁰ and for Upstate (Zones A through I) the proxy-hub is the Tetco-M3. As of September 2011, the forecasted Downstate natural gas price is roughly 17% higher relative to the national average, and the Upstate natural gas price is 10% higher than the national average. Forecasted fuel prices for Upstate and Downstate New York are shown in Figures 4-2 and 4-3.

Fuel Oil

Based on EIA data in Electric Power Monthly, price differentials across states and localities can be explained by a combination of transportation/delivery charges and taxes during the 24 month period ending May 2011. According to Electric Power Monthly, the trend of fuel-oil prices for New York implies that, on average, they are 5% below the national average delivered price. Based on this, the basis for both distillate and residual oils for Downstate are 0.95 (relative to the national average). The Upstate basis is 0.98 to reflect the additional transportation costs. For illustrative purposes, forecasted prices for Distillate Oil (Fuel Oil #2) and for Residual Oil (Fuel Oil #6) are shown in Figures 4-2 and 4-3.

Coal

The data from Electric Power Monthly for the average cost of coal delivered for electricity generation was used to calculate a common basis for all NYCA Zones. Prices in New York are, on average, 40% higher than in the United States as a whole. (The published figures do not make a distinction between the different varieties of coal; *i.e.*, bituminous, sub-bituminous, lignite, etc.), EIA’s 2011 AEO forecast is used for CARIS.

4.4.3. Seasonality and Volatility

All average monthly fuel prices, with the exception of coal and uranium, display somewhat predictable patterns of fluctuations over a given 12-month period. In order to capture such seasonality, NYISO estimated seasonal-factors using standard statistical methods.¹¹ The

⁹ Prior to 2008, this data was submitted via FERC Form 423. 2008 onwards, the same data are collected on Schedule 2 of the new Form EIA-923. See <http://www.eia.doe.gov/cneaf/electricity/page/ferc423.html> . These figures are published in Electric Power Monthly.

¹⁰ The raw hub-price is ‘burdened’ by an appropriate level of local taxes.

¹¹ This is a two-step process: First, deviations around a centered 12-month moving average were calculated over the 2005-2010 period; second, the average values of these deviations were normalized to estimate monthly/seasonal factors.

multiplicative factors were applied to the annual forecasts to yield forecasts of average monthly prices.

The 2011 data used to estimate the seasonal factors are as follows:

- Natural Gas: Raw daily prices from ICE (Intercontinental Exchange) for the trading hubs Transco Zone 6 (New York) - as a proxy for Downstate (Zones J and K) – Tetco-M3 – as a proxy for Upstate (Zones A to I).
- Fuel Oils #2 and #6: The average daily prices from Argus, Bloomberg, and Platts.

The seasonalized time-series represents the forecasted trend of average monthly prices.

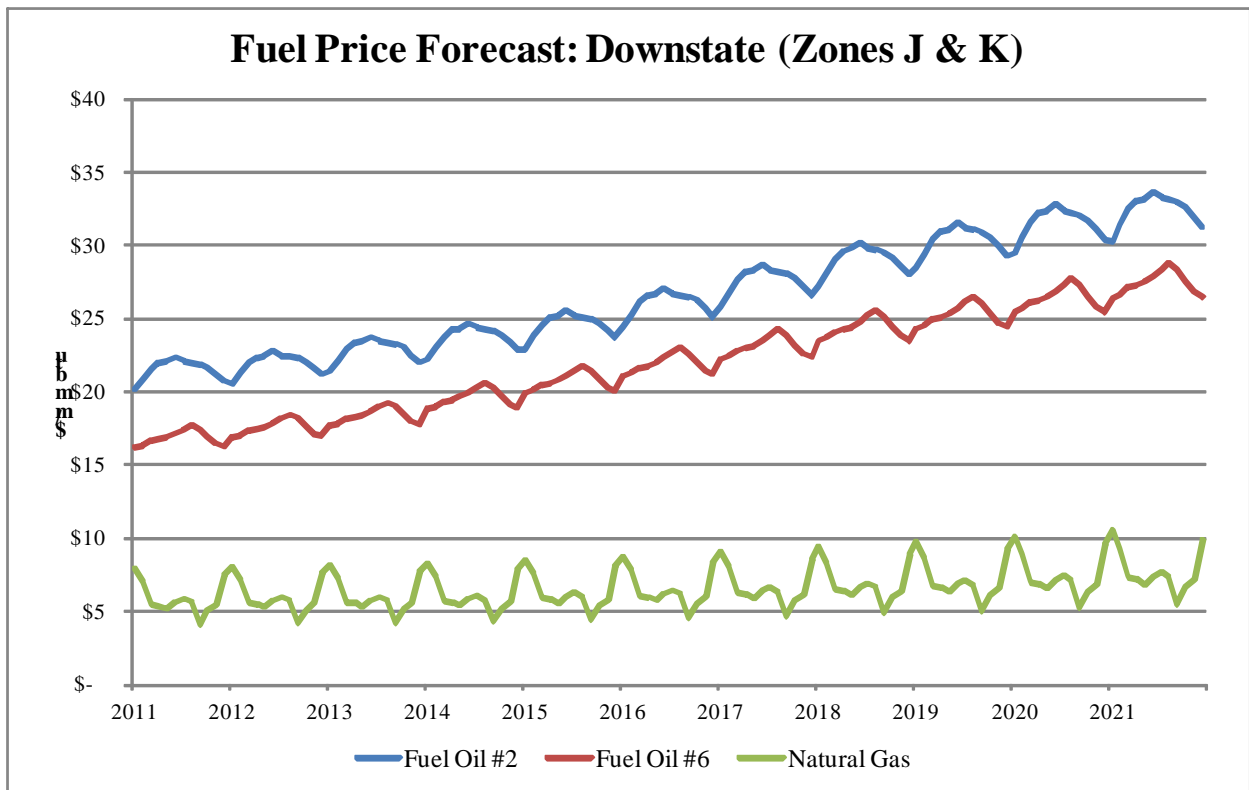


Figure 4-2: Forecasted fuel prices for Zones J & K (nominal \$)

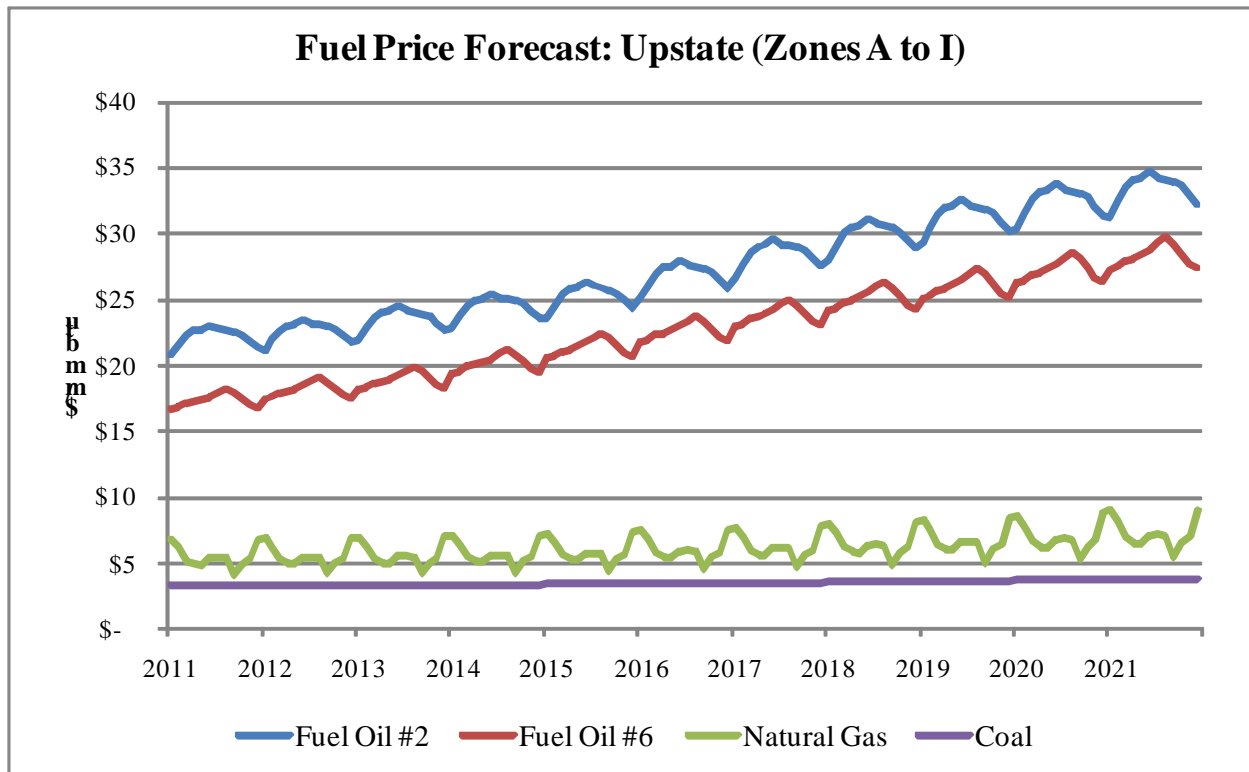


Figure 4-3: Forecasted fuel prices for Zones A-I (nominal \$)

4.4.4. External Areas Fuel Forecast

The fuel forecasts for the three external areas, ISO-NE, PJM, and IESO, were also developed. For each of the fuels, the basis for ISO-NE, PJM-East, and PJM-West were based on the state level data published in Electric Power Monthly. With respect to IESO, the relative prices were based on data from a recent publication.¹²

4.5. Emission Cost Forecast

The costs of emission allowances are an increasing portion of generator production costs. Currently, all NYCA fossil fueled generators greater than 25 MW and most generators in most surrounding states are required to hold allowances in amounts equal to their emissions of SO₂, NO_x, and CO₂. There are exchanges for trading allowances and futures contracts for allowances. The Chicago Climate Futures Exchange (CCFE) offers standardized and cleared futures and options contracts on emission allowances and other environmental products. Until mid 2010, there was a robust market for the exchange of these allowances. When the USEPA proposed the revised Clean Air Interstate Rule (CAIR), called the Clean Air Transport Rule (CATR), the

¹² Ontario Wholesale Electricity Market Price Forecast For the Period May 1, 2008 through October 31, 2009, Presented to Ontario Energy Board, April 11, 2008 by Navigant Consulting Inc., Toronto, Ontario.

proposal called for the end of the use of the CAIR allowances. The effect of this proposal was to place the holders of these allowances in the position of "use them or lose them". Generators who had been banking allowances then sought to reclaim the remaining value by seeking buyers at all time minimum prices. As a consequence, the NYISO concluded that market prices were no longer a reliable benchmark for estimating the cost of future SO₂ and NO_x emissions.

Emission allowance price forecasts for SO₂ and NO_x were developed by estimating the cost of removal from operation of existing emission control equipment for 2011.

In July 2011, the USEPA replaced the Clean Air Transport Rule proposal with the finalized Cross-State Air Pollution Rule (CSAPR) that requires significant additional reductions of SO₂ and NO_x emissions beyond those previously identified. Due to the timing of this rule and the numerous unanswered questions surrounding it, a decision was made with the support of the ESPWG not to incorporate the rule in the 2011 CARIS 1 study. However, the impact of the CSAPR, together with its technical adjustments proposed by EPA in Oct 2011, is analyzed as a scenario in the report.

The CSAPR establishes a new allowance allocation and trading system for units larger than 25 MW of nameplate capacity. To demonstrate compliance with the rule, affected generators will need one allowance for each ton of designated pollutants emitted in a year. In New York, CSAPR will affect 167 units that represent 23,275 MW of capacity. The first emission reductions are expected to start in 2012 with additional reductions required in 2014. These additional emission reductions are anticipated to apply in 2012 and 2013 and will be accompanied by increased costs from fuel switching and more aggressive operation of existing emission control equipment. In 2014, provided that the technical adjustments become final, additional limitations will become effective for NO_x RACT and BART as well as the initiation of the CSAPR Assurance Level provisions. The EPA projects that these limits will increase the projected cost of removal of NO_x.¹³

The RGGI program for capping CO₂ emissions from power plants includes six New England states plus NY, MD, DE, NJ, however NJ was not included in RGGI in the model. Experience to date has shown the program to be oversupplied with CO₂ allowances. The price forecast is near the floor for 2011. The program is currently being evaluated with a possible goal of reducing the cap and thereby increasing the prices. The working assumption for this study was an initiation of a federal CO₂ program in 2016. It was assumed by the NYISO and discussed with ESPWG that for the purposes of this study that by 2016 the RGGI program would be redesigned to increase

¹³ The D.C. Circuit Court of Appeals granted a stay of the CSAPR pending the court's review of the various petitions challenging the rule's validity. The court ordered parties to submit a briefing plan in January that would allow these cases to be heard in April 2012. The court also made clear that it expects the EPA to continue to administer its Clean Air Interstate Rule pending the court's resolution of these petitions. (See *EME Homer City Generation L.P. v. U.S. EPA*, D.C. Cir. No. 11-1302 (Dec. 30, 2011))

CO2 allowance prices to match the federal program when it becomes effective. Since federal carbon legislation has been stalled, and the RGGI program has not yet reduced the annual cap on carbon emissions, the actual carbon allowance price and associated allowance futures are significantly lower than the assumption used in this 2011 CARIS Phase 1. No CO2 emissions adder was modeled for Ontario, assuming that IESO (Ontario) would not be affected by either a tightened RGGI program or a federal CO2 program. This resulted in some imports from Ontario becoming more economic in the model as US CO2 allowance costs were increased.

Emission costs, which are driven by the fuel burned, the efficiency of the unit and the emission control technology employed, are calculated as the product of emission rate and emission allowance costs. Annual emission rates were used in the simulations. The annual emission rates in terms of Ton/mmBTU are available from the EPA’s Clean Air Markets Division. Since the emission rate determined above is an average emission rate, the same rate was used across the operating range.

Figure 4-4 shows the emission allowance forecast by year in \$/Ton.

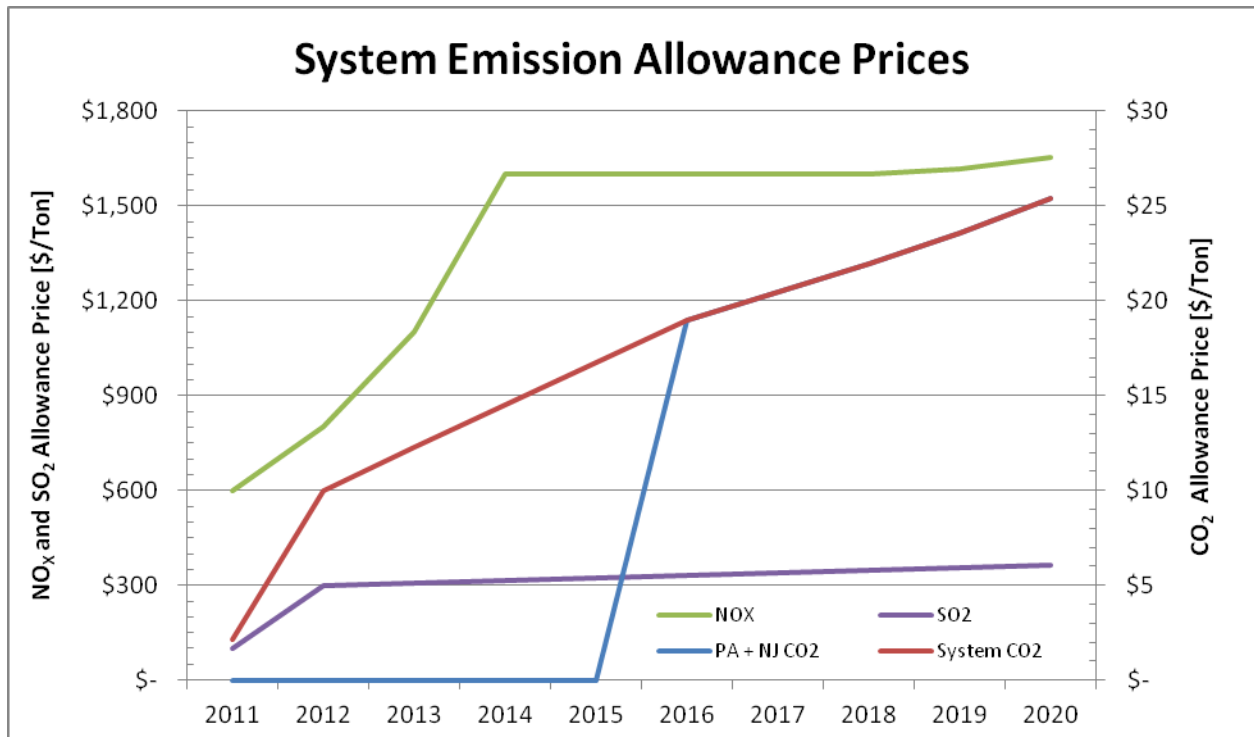


Figure 4-4: Emission Allowance Forecast

With respect to the carbon emission futures under the Regional Greenhouse Gas Initiative (RGGI), the data from the CCFE was available only through 2012. The implied trend was extrapolated to cover the 2013-2020 study period.

4.6. Generic Solutions

Generic solutions are evaluated by NYISO for each of the three CARIS studies utilizing each resource type (generation, transmission, and demand response (DR)) as required in Section 31.3.1.3 of the Tariff. The development of the generic solution representative costs was based on available public information with stakeholder input. This methodology utilized typical MW block size generic solutions, a standard set of assumptions without determining actual project feasibility, and order of magnitude costs for each resource type.

The cost estimates for generic solutions only are intended to set forth an order of magnitude of the potential projects' costs for Benefit/Cost ratio analysis. These estimates should not be assumed as reflective or predictive of actual projects or imply that facilities can necessarily be built for these estimated costs or in the locations assumed.

4.6.1. Resource Block Sizes

Typical resource block sizes are developed for each resource type based on the following guidelines:

- Block size would be reflective of a typical size built for the specific resource type and geographic location;
- Block size is to be small enough to be additive with reasonable step changes; and
- Blocks sizes are in comparable proportions between the resource types.

The block sizes selected for each resource type are presented in Table 4-4 through Table 4-6.

Table 4-4: Transmission Block Sizes

Location	Line System Voltage (kV)	Block Capacity (MVA)
Zone A-J	345	1000
Zone K	138	500

Notes: Block size for Zone J was selected to be 600 MVA. 138 kV was selected for Zone K due to the limited number of 345 kV substations located within this Zone. The block capacity was selected so as to be reflective of the typical line size for this voltage class and location.

Table 4-5: Generation Block Sizes

Plant Location	Plant Block Size Capacity (MW)
Zone A-K	500

Table 4-6: DR (Each 200 MW Block contains Demand Response +EE)

Location	Demand Response Quantity (MW)	Portfolio Type
Zone A-K	100	Energy Efficiency
Zone A-K	100	Demand Response

4.6.2. Guidelines and Assumptions for Generic Solutions

Developing cost estimates for these resource types was dependent on many different parameters and assumptions and without consideration of project feasibility or project-specific costs. A detailed list of assumptions utilized for each resource is included in the Generic Solution Cost Matrix, in Appendix C.

The following guidelines and assumptions were used to select the generic solution:

Transmission Resource

- The generic transmission solution consists of a new transmission line interconnected to the system upstream and downstream of the grouped congested elements being studied.
- The generic transmission line terminates at the nearest existing substations of the grouped congested elements.
- If there is more than one substation located near the grouped congested elements which meets the required criteria, then the two substations that have the shortest distance between the two are selected. Space availability at substations was not evaluated in this process.

Generation Resource

- The generic generation solution consisted of the construction of a new combined cycle generating plant connecting downstream from the grouped congested elements being studied.
- The generic generation solution terminates at the nearest existing substation of the grouped congested elements.
- If there is more than one substation located near the grouped congested elements which meets the required criteria, the substation that has the highest relative shift factor was selected. Space availability at substations was not evaluated in this process.

Demand Response (DR)

- The generic DR solution was modeled as a reduction in load consisting of energy efficiency and demand response within the zone where the most downstream grouped congested element is terminated.
- The demand response was assumed to be on-peak, concentrated in the top 60-100 highest load hours.
- The DR installed in a zone was limited to less than 10% of the peak zonal load. If the modeled DR exceeds 10% of the peak zonal load, it is prorated based on peak load between the selected zone and the next downstream zone.
- The DR solution was not optimized to give the highest production cost savings per unit of cost, although energy efficiency yields significantly larger production cost savings than demand response

4.6.3 Generic Solution Pricing Considerations

Three sets of cost estimates which were designed to be reflective of the differences in labor, land and permitting costs among Upstate, Downstate and Long Island follow below. The considerations used for estimating costs for the three resource types and for each geographical area are listed in Table 4-7.

Table 4-7: Generic Solution Pricing Considerations

Transmission	Generation	DR
Transmission Line Cost per Mile	Plant Costs	Energy Efficiency Programs
Substation Terminal Costs	Generator Lead Cost per Mile	Demand Response Programs
System Upgrade Facilities	Substation Terminal Costs	
	System Upgrade Facilities	
	Gas Line Cost per Mile	
	Gas Regulator Station	

Low, mid, and high cost estimates for each element were discussed with stakeholders. This establishes a range of cost estimates to address the variability of generic projects. The resulting order of magnitude unit pricing levels are included in the Generic Solution Cost Matrix in Appendix C.

5. 2011 CARIS Phase 1 Results

This section presents summary level results of six steps of the 2011 CARIS Phase 1. These six steps include: (1) congestion assessment; (2) ranking of congested elements; (3) selection of three studies; (4) generic solution applications; (5) benefit/cost analysis; and (6) scenario analysis. Study results are described in more detail in Appendix E.

5.1. Congestion Assessment

The CARIS process begins with the development of a ten-year projection of future Demand\$ congestion costs. This projection is combined with the past five years of historic congestion to identify and rank significant and recurring congestion. The results of the historical and future perspective are presented in the following two sections.

In order to assess and identify the most congested elements, both positive and negative congestion on constrained elements are taken into consideration. Whether congestion is positive or negative depends on the choice of the reference point. All metrics are referenced to the Marcy 345 kV bus near Utica, NY. In the absence of losses, any location with LBMP greater than the Marcy LBMP has positive congestion, and any location with LBMP lower than the Marcy LBMP has negative congestion. The negative congestion typically happens due to transmission constraints that prevent lower cost resources from being delivered towards the Marcy bus.

5.1.1. Historic Congestion

Historic congestion assessment has been conducted at the NYISO for the last seven years with metrics and procedures developed with the ESPWG and approved by the NYISO Operating Committee. Four congestion metrics were developed to assess historic congestion: Bid-Production Cost (BPC) as the primary metric, Load Payments metric, Generator Payments metric, and Congestion Payment metric. The results of the historic congestion analysis are posted on the NYISO website quarterly. For more information or source of historical results below see:

http://www.nyiso.com/public/markets_operations/services/planning/documents/index.jsp

Historic congestion costs by zone, expressed as Demand\$, are presented in Table 5-1, indicating that the highest congestion is in New York City and Long Island.

Table 5-1: Historic Demand\$ Congestion by Zone 2006-2010 (nominal \$M)

Zone	2006	2007	2008	2009	2010
West	1	(14)	(25)	(14)	(1)
Genesee	2	(14)	(9)	4	6
Central	4	9	18	8	11
North	(0)	(0)	(2)	(3)	(1)
Mohawk Valley	2	5	10	4	5
Capital	27	74	143	53	62
Hudson Valley	54	87	176	57	73
Millwood	27	31	78	16	23
Dunwoodie	44	56	124	41	49
NY City	673	700	1403	503	560
Long Island	708	518	624	274	350
NYCA Total	1,542	1,508	2,613	977	1,141

Reported values do not deduct TCCs
 NYCA totals represent the sum of absolute values
 Athens SPS in service 2008 – 2010 (and 2011)
 DAM data include Virtual Bidding & Transmission planned outages

Table 5-2 below lists historic congestion costs, expressed as Demand\$, for top NYCA constraints* from 2006 to 2010. The top congested paths are shown below.

Table 5-2: Historic Demand\$ Congestion by Constrained Paths 2006-2010 (nominal \$M)

Constrained Path *	2006	2007	2008	2009	2010	Total
CENTRAL EAST	195	572	1,199	435	491	2,892
LEEDS_PLSNTVLY_345	452	435	667	149	232	1,935
DUNWOODIE_SHORRD_345	492	260	187	118	155	1,212
GREENWOOD LINES	119	90	113	87	132	541
WEST CENTRAL-OP	2	51	55	1	0	109
ASTORIAW138_HG5_138	1	2	1	0	0	5
GOTHLS S_ GOWANUS_ 345	0	0	0	0	0	1

* Ranking is based on absolute values.

Table 5-3 summarizes the annual historic congestion results posted by the NYISO. NYISO reports the summaries of the calculated changes in the four historic congestion metrics: Bid Production Cost (BPC), Generator Payments, Congestion Payments, and Load Payments. The changes in these four historic congestion metrics were calculated using PROBE as the constrained system values minus the unconstrained system values. Positive numbers imply savings while negative numbers imply increases in payments when all constraints are relieved. Unhedged Congestion is calculated as the total congestion represented by Demand\$ congestion minus the TCC hedge payments (TCC auction proceeds). Total payments made by load adjusted for the TCC hedges, TCC shortfalls, and Rate Schedule 1 imbalances comprise the statewide

Unhedged Load Payments. These adjusted statewide Unhedged Load Payments equal the total Generator Payments.

Table 5-3: Historic NYCA System Changes – Mitigated Bids 2006-2010 (nominal \$M)

Year	Change in BPC	Change in Generator Payments	Change in Unhedged Congestion Payments	Change in TCC Payments
2006	118	59	921	634
2007	130	(107)	806	670
2008	243	(417)	1,525	1,143
2009	82	(102)	477	480
2010	94	(116)	640	515

Figure 5-1 below illustrates a cumulative effect of bid production costs savings over the past five years as a result of relieving all NYCA constraints.

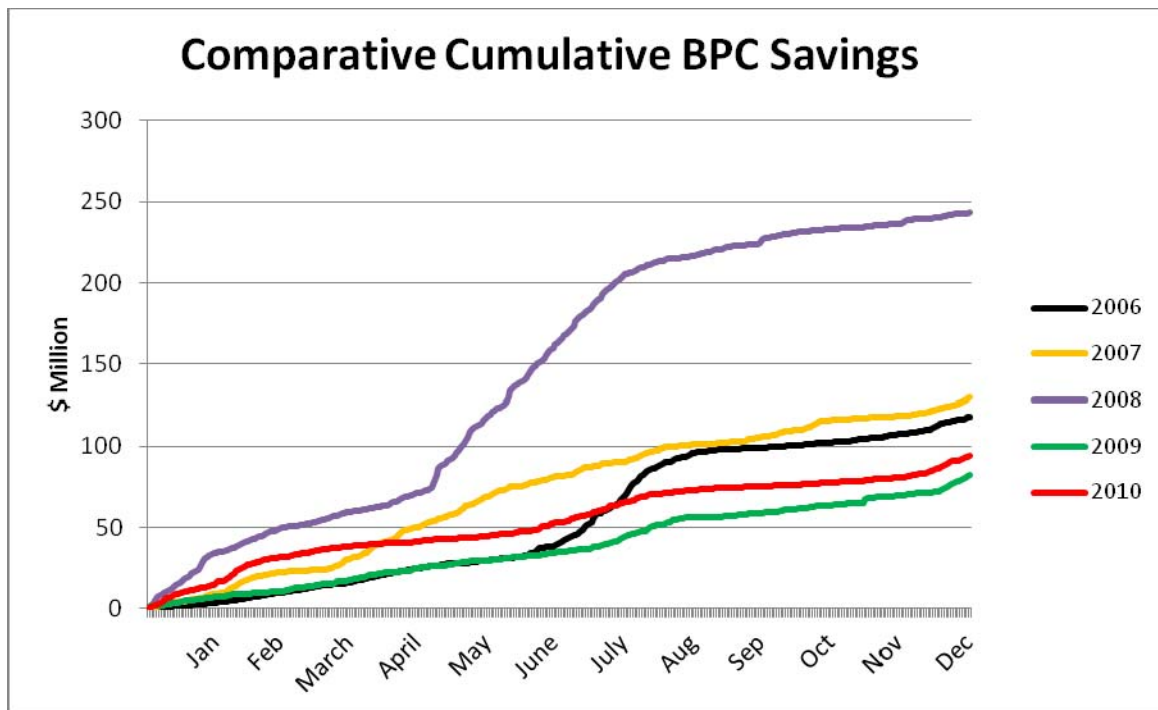


Figure 5-1: Historic Cumulative BPC Savings, 2006-2010 (nominal \$M)

5.1.2. Projected Future Congestion

Future congestion for the 10 year study period was determined from a MAPS simulation using a ten year base case developed with the ESPWG. As reported in Section 3.2, congestion is reported as Demand\$ congestion. MAPS simulations are highly dependent upon many long-term assumptions, each of which affects the study results. The MAPS model utilizes input assumptions listed in Appendix C.

When comparing historic congestion costs to projected congestion costs, it is important to note that there are significant differences in assumptions used by PROBE and MAPS. MAPS, unlike PROBE, did not simulate the following: (a) virtual bidding; (b) transmission outages; (c) fixed load and price-capped load; (d) generation and demand bid price; (e) Bid Production Cost Guarantee payments (BPCG); and (f) co-optimization with ancillary services.

Discussion

Table 5-4 presents the projected congestion from 2011 through 2020 by zone. The relative costs of congestion shown in this table indicate that the majority of the projected congestion is in the Downstate zones – NY City and Long Island. Year to year changes in congestion reflect changes in the model, which are discussed in Section 4.1.

Table 5-4: Projection of Future Demand\$ Congestion 2011-2020 by Zone (nominal \$M)

Zone	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020
West	1	0	1	1	1	2	2	3	3	5
Genesee	1	0	0	0	0	0	1	1	2	2
Central	5	4	4	4	4	5	5	6	6	6
North	5	7	7	7	8	8	8	9	10	10
Mohawk Valley	3	2	2	2	2	3	3	3	3	4
Capital	46	40	41	37	38	43	46	52	56	57
Hudson Valley	56	50	51	47	50	55	59	69	76	80
Millwood	19	17	18	16	17	19	21	24	27	28
Dunwoodie	37	33	34	31	33	37	39	46	51	55
NY City	343	307	319	301	317	347	373	442	492	530
Long Island	192	185	193	190	202	222	240	273	297	320
NYCA Total	709	646	670	636	672	740	796	929	1023	1098

Note: Reported costs have not been reduced to reflect TCC hedges and represent absolute values. Athens SPS was not modeled during years 2011-2020, although it was still in service as of January 2012. Taking the Athens SPS system out of service results in a reduction in the transfer capability of the UPNY-SENY interface. This reduction was calculated to be 450 MW in the 2006 Athens SPS System Impact Study.

Based on the positive Demand\$ congestion costs, the future top congested paths are shown in Table 5-5 below.

Table 5-5: Projection of Future Demand\$ Congestion 2011-2020 by Constrained Path (nominal \$M)

Nominal Value (\$M) *	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	Total
CENTRAL EAST	268	226	229	209	212	243	257	295	318	329	2,584
LEEDS_PLSNTVLY 345	228	199	206	187	205	231	250	307	346	377	2,535
DUNWOODIE_SHORRD_345	41	46	49	54	57	60	65	69	73	80	595
GREENWOOD LINES	10	10	11	12	12	12	13	15	17	19	131
GOTHLS S_GOWANUSS_345	5	4	4	4	5	5	5	6	7	8	52

* The absolute value of congestion is reported.

5.2. Ranking of Congested Elements

The identified congested elements from the ten-year projection of congestion are lined up with the past five years of identified historic congested elements to develop fifteen years of Demand\$ congestion statistics for each initially identified top constraint. The fifteen years of statistics are analyzed to determine recurring congestion or the mitigation of congestion from future system changes incorporated into the base CARIS system that may lead to exclusions. Ranking of the identified constraints is initially based on the highest present value of congestion over the fifteen-year period with five years historic and ten years projected.

Table 5-6 lists the ranked elements based on the highest present value of congestion over the fifteen years of the study, including both positive and negative congestion. Central East and Leeds - Pleasant Valley continue to be the paths with the greatest congestion. The level of congestion over the Dunwoodie-Shore Road path diminishes in the future with the recent addition of the Caithness plant. The top seven elements are evaluated in the next step for selection of the three studies.

Table 5-6: Ranked Elements Based on the Highest Present Value of Demand\$ Congestion over the Fifteen Years Aggregate

Constraints *	Present Value of Congestion (in 2011 \$M)		
	Historic	Future	Aggregate
CENTRAL EAST	\$3,426	\$1,810	\$5,237
LEEDS-PLEASANT VALLEY	\$2,383	\$1,741	\$4,124
DUNWOODIE-SHOR RD	\$1,526	\$409	\$1,935
GREENWOOD LINES	\$648	\$90	\$737
WEST CENTRAL-OP	\$135	\$28	\$163
GOTHLS-GOWANUSS	\$1	\$36	\$37
ASTORIAW138-HG5	\$6	\$4	\$10

*The absolute value of congestion is reported.

The frequency of actual and projected congestion is shown in Table 5-7 below. The table presents the actual number of congested hours by constraint, from 2007 through 2010, and projected hours of congestion, from 2011 through 2020. The change in the number of projected hours of congestion, by constraint after each generic solution is applied, is shown in Appendix E.

Table 5-7: Number of Congested Hours by Constraint

# of DAM Congested Hours	Actual				CARIS Base Case Projected									
	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020
DUNWOODIE-SHORE RD	5,603	4,469	5,240	4,292	7,820	8,247	8,390	8,423	8,421	8,402	8,403	8,402	8,385	8,374
GOTHS - GOWANUS 345	931	329	121	460	2,801	3,084	3,126	2,991	3,015	3,074	3,037	3,235	3,264	3,153
GREENWOOD LINES	4,593	4,741	4,330	4,317	4,382	4,394	4,277	4,164	4,116	3,613	3,561	3,769	3,778	3,974
CENTRAL EAST	3,195	5,182	4,788	2,964	1,889	1,836	1,945	1,793	1,754	1,685	1,748	1,893	1,878	1,908
LEEDS PLSNTVLY	1,572	1,083	725	673	1,830	1,710	1,770	1,811	1,843	1,866	1,881	2,048	2,131	2,261
ASTORIAW138_HG5_138	-	-	-	-	1,361	1,894	1,961	1,951	2,004	2,478	2,502	2,489	2,519	2,238
WEST CENTRAL	1,943	2,120	296	1	118	436	588	439	471	642	710	831	893	918

5.3. Three CARIS Studies

5.3.1. Selection of the Three Studies

Selection of the three CARIS studies is a two-step process in which the top seven ranked constraints are identified and utilized for further assessment in order to identify potential for grouping of constraints. Resultant grouping of elements for each of the top seven ranked constraints is utilized to determine the three studies.

In Step 1, both historic (5 years) and projected (10 years) congested elements for the fifteen- year period are ranked in ascending order based on the calculated present value of Demand\$ congestion. In Step 2, the top congested elements from Step 1 are relieved independently to determine if any needs to be grouped with other elements that show significant congestion when a primary element is relieved. See Appendix E for more detailed discussion.

For this study, Astoria West-Hellgate was eliminated from consideration before applying the first step because projected congestion was de minimis. In the first step, the remaining six congested elements with the highest present value ranking were utilized for further assessment. In the second step, the assessment was accomplished in multiple iterations to include additional elements that appear as limiting when each of the top six congested elements are relaxed by removing their limits. The assessed element groupings are then ranked based upon the highest change in production cost as shown in Figure 5-2.

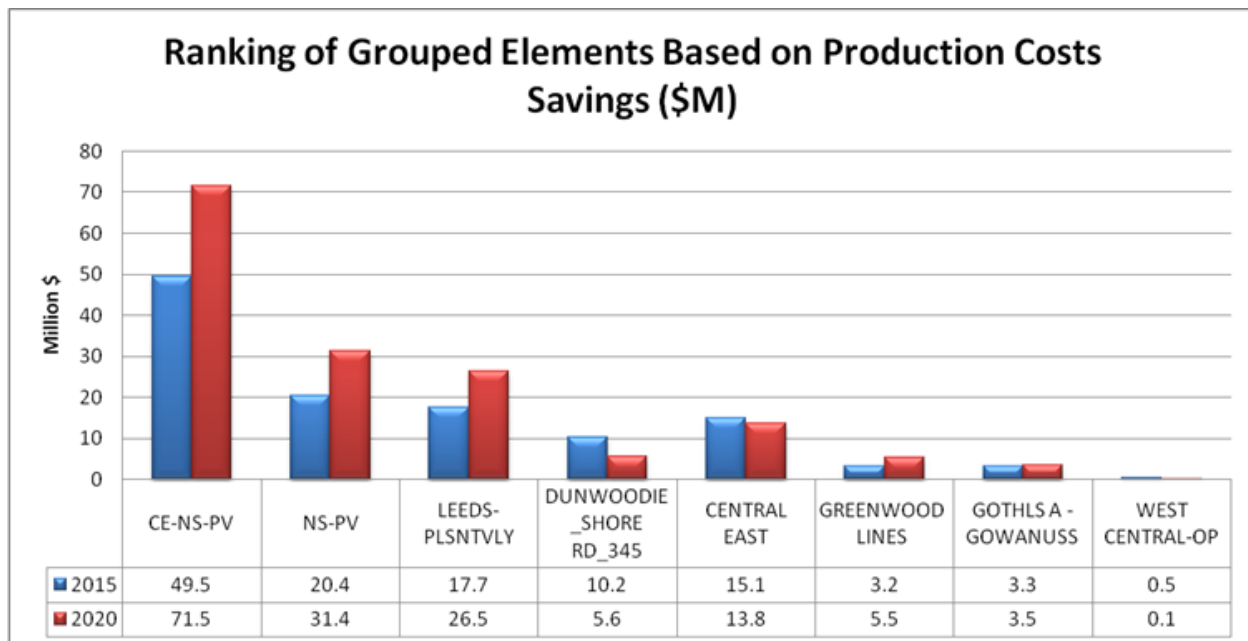


Figure 5-2: Production Costs Savings, 2015 and 2020 (nominal \$M)

The three ranked groupings with the largest change in production cost are selected as the three CARIS studies: Central East-New Scotland-Pleasant Valley (CE-NS-PV), New Scotland – Pleasant Valley (NS-PV) and Leeds-Pleasant Valley (L-PV). Table 5-8 has the base case congestion associated with each of the three studies. A detailed discussion on the ranking process is presented in Appendix E.

Table 5-8: Demand\$ Congestion of the Top Three CARIS Studies (nominal \$M)

Study	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020
Central East-New Scotland-Pleasant Valley (Study 1)	495	425	436	398	419	474	507	603	667	708
New Scotland-Pleasant Valley (Study 2)	228	200	207	189	207	231	250	308	349	379
Leeds-Pleasant Valley (Study 3)	228	199	206	187	205	231	250	307	346	377

The location of the top three congested groupings, which define the three studies, along with their present value of congestion (in 2011 dollars) is presented in Figure 5-3.

New York Control Area: Top 3 Congested Groupings

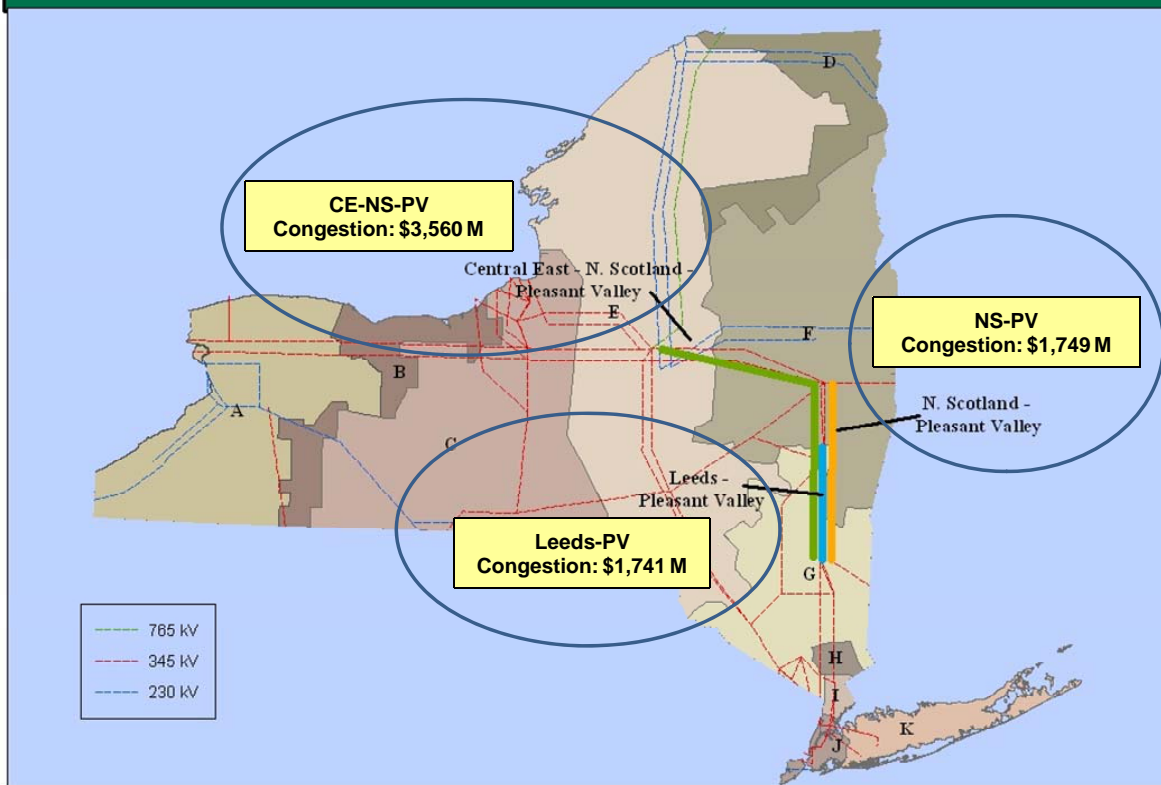


Figure 5-3: Base Case Congestion of Top 3 Congested Groupings, 2011-2020 - Present Value (\$M)

5.3.2. Generic Solutions to Congestion

The congestion of each of the three groupings being studied is mitigated by individually applying one of the generic resource types; transmission, generation and DR. The resource type is applied based on the rating and size of the blocks determined in the Generic Solutions Cost Matrix included in Appendix C and is consistent with the methodology explained in Section 4 of this report. Resource blocks were applied to relieve a majority of the congestion. Additional resource blocks were not added if diminishing returns would occur.

In regard to the generic solutions, it is important to note the following:

- Other solutions may exist which will alleviate the congestion on the studied elements.
- No attempt has been made to determine the optimum solution for alleviating the congestion.
- No engineering, physical feasibility study, routing study or siting study has been completed for the generic solutions. Therefore, it is unknown if the generic solutions can be physically constructed as studied.
- Generic solutions are not assessed for impacts on system reliability or feasibility.

- Actual projects will incur different costs.
- The generic solutions differ in the degree to which they relieve the identified congestion.
- For each of the base case and solution cases, HQ imports are held constant.

The discount rate of 7.36% used for the present values analysis is the weighted average of the after-tax Weighted Average Cost of Capital (WACC) for the NYTOs. The weighted average is based on the utilities' annual GWh sendout of energy for 2010.

Transmission has the greatest impact on reducing Demand\$ congestion (55% to 100%) because adding a transmission solution addresses the underlying system constraint that was driving the congestion. The generation solution reduced Demand\$ congestion by 48% to 77%. A large portion of the production cost savings resulting from generation can be attributed to the efficiency advantage of the generic generation solution when compared to the system wide heat rate. The demand response solution reduced Demand\$ congestion by 2% to 10%, yet shows the largest production cost savings because it directly reduces the energy production requirements

The results of the three generic solutions are provided below with more detail in Appendix E. The following generic solutions were applied for each study:

Study 1: Central East – New Scotland – Pleasant Valley

The following generic solutions were applied for Central East – New Scotland -Pleasant Valley Study:

- Transmission: A new 345 kV line from Edic to New Scotland to Pleasant Valley, 155 Miles. The new line increases the Central East voltage transfer limit by approximately 600 MW and the UPNY-SENY thermal capability by up to 1200 MW.
- Generation: A new 1,000 MW Plant at Pleasant Valley
- Demand Response & Energy Efficiency (DR/EE): 100 MW Demand Response and 100 MW Energy Efficiency for a total of 200MW in Zone F and 200MW in Zone G (200 MW is less than 10% of peak load in each of Zones F & G)

Table 5-9 shows the Demand\$ congestion of Central East – New Scotland – Pleasant Valley for 2015 and 2020 before and after each of the generic solutions is applied. The base Case congestion numbers, \$419M for 2015 and \$708M for 2020, are taken directly from Table 5-8 representing the level of congestion of the Study 1 before the solutions.

Table 5-9: Demand\$ Congestion Comparison for Central East – New Scotland – Pleasant Valley Study (nominal \$M)

Resource Type	2015			2020		
	Base Case	Solution	% Change	Base Case	Solution	% Change
Transmission	419	190	-55%	708	305	-57%
Generation - 1000 MW	419	96	-77%	708	195	-72%
Demand Response - 400 MW	419	405	-3%	708	696	-2%

Table 5-10 shows the production cost savings expressed as the present value in 2011 \$ from 2011 to 2020 for the Central East – New Scotland – Pleasant Valley study after generic solutions were applied.

Table 5-10: Central East – New Scotland – Pleasant Valley Study: NYCA-wide Production Cost Savings (Present Value in 2011 \$M)

Resource Type	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020
Transmission	46	39	36	33	33	32	32	31	34	34
Generation - 1000 MW	26	32	29	30	31	37	36	35	36	37
Demand Response	49	48	45	45	44	43	42	39	39	38

The Central East – New Scotland – Pleasant Valley 345 kV transmission solution is projected to relieve the congestion across existing Central East – New Scotland – Leeds-Pleasant Valley transmission lines by 55% in 2015 and 57% in 2020 respectively, as shown in Table 5-9. In Table 5-10, the annual production cost savings are relatively flat in present value, but increase in nominal value from 2014 to 2020 as fuel prices increase. Total ten year NYCA-wide production cost savings is \$350 million (present value) as the result of better utilization of economic generation in the state and economic imports from neighboring regions made available by the large scale transmission upgrades represented by this generic transmission solution.

The generation solution is projected to reduce congestion by 77 % in 2015 and 72% in 2020. The ten-year production cost savings of \$330 million (present value) are due to the uncongested location and the assumed better heat rate of the generic generating unit compared to the average system heat rate. Efficient generator solutions reduce imports from neighbors and enable a more efficient and lower cost NYCA generation market. Savings accrue in lower production cost as well as reduced congestion.

The Zones F and G DR/EE solution is projected to reduce congestion by 3% in 2015 and 2% in 2020, while the ten-year total production cost saving is \$432 million (present value). The relative large value of production cost saving is largely attributable to the reduction in energy use of the DR/EE solution itself. DR solutions show greater reductions in production cost than the generation and transmission solutions.

Study 2: New Scotland – Pleasant Valley

The following generic solutions were applied for New Scotland – Pleasant Valley study:

- Transmission: A new 345 kV line from New Scotland to Pleasant Valley, 65 Miles. The new line increases the UPNY-SENY transfer capability by up to 1200 MW and the Central East voltage limit by 100 MW.
- Generation: A new 1,000 MW Plant at Pleasant Valley
- Demand Response & Energy Efficiency (DR/EE): 100 MW Demand Response and 100 MW Energy Efficiency for a total of 200MW in Zone G and 200MW in Zone I (200 MW is less than 10% of peak load in each of Zones G & I)

Table 5-11 shows the Demand\$ congestion of New Scotland – Pleasant Valley for 2015 and 2020 before and after each of the generic solutions is applied.

Table 5-11: Demand\$ Congestion Comparison for New Scotland – Pleasant Valley Study (nominal \$M)

Resource Type	2015			2020		
	Base Case	Solution	% Change	Base Case	Solution	% Change
Transmission	207	14	-93%	379	44	-88%
Generation - 1000 MW	207	96	-54%	379	195	-49%
Demand Response - 400 MW	207	187	-10%	379	345	-9%

Table 5-12 shows the NYCA-wide production cost savings expressed as the present value in 2011 \$ from 2011 to 2020 for the New Scotland – Pleasant Valley study after generic solutions were applied.

Table 5-12: New Scotland – Pleasant Valley Study: NYCA-wide Production Cost Savings
(Present Value in 2011 \$M)

Resource Type	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020
Transmission	27	23	21	20	20	19	19	18	20	21
Generation - 1000 MW	26	32	29	30	31	37	36	35	36	37
DR	47	48	44	44	43	42	41	38	38	37

The addition of the New Scotland – Pleasant Valley line is projected to relieve the New Scotland – Pleasant Valley congestion by 93% in 2015 and 88% in 2020. The total ten-year production cost savings of \$208 million (present value) are again due to increased use of lower cost generation in upstate and increased levels of imports compared to the base case. The Central East congestion increased in this solution.

The generation solution is projected to reduce congestion by 54 % in 2015 and 49% in 2020. The ten-year production cost savings of \$330 million (present value) are derived from the heat rate efficiency advantage of the new generic unit compared to the average system heat rate. Imports are significantly reduced in this solution. Efficient generator solutions reduce imports from neighbors and enable a more efficient and lower cost NYCA generation market. Savings accrue in lower production cost as well as reduced congestion.

The Zones G and I DR/EE solution is projected to reduce congestion by 9 – 10%. The ten-year production cost savings of \$421 million (present value) are largely related to the reduction in energy use. DR solutions show greater reductions in production cost than the generation and transmission solutions.

Study 3: Leeds – Pleasant Valley

The following generic solutions were applied for the Leeds-Pleasant Valley study, and the results are shown in Table 5-11:

- Transmission: A new 345 kV line from Leeds to Pleasant Valley; 39 Miles. The new line increases the UPNY-SENY thermal capability by up to 1000 MW and Central East voltage limit by 50 MW.
- Generation: Install a new 1000 MW Plant at Pleasant Valley.
- Demand Response & Energy Efficiency (DR/EE): 100 MW demand response and 100 MW Energy Efficiency for a total of 200 MW in Zone G and 200MW in Zone I (200 MW is less than 10% of peak load in each of Zones G & I).

Table 5-13 shows the Demand\$ congestion of Leeds-Pleasant Valley for 2015 and 2020 before and after each of the generic solutions is applied. Transmission has the greatest impact in reducing congestion and eliminated the entire congestion for the Leeds-Pleasant Valley path.

Table 5-13: Demand\$ Congestion Comparison for Leeds-Pleasant Valley (nominal \$M)

Resource Type	2015			2020		
	Base Case	Solution	% Change	Base Case	Solution	% Change
Transmission	205	0	-100%	377	0	-100%
Generation - 1000 MW	205	96	-53%	377	195	-48%
Demand Response - 400 MW	205	187	-9%	377	345	-8%

Table 5-14 shows the NYCA-wide production cost savings expressed as the present value in 2011 \$ from 2011 to 2020 for the Leeds-Pleasant Valley study after the generic solutions were applied.

Table 5-14: Leeds-Pleasant Valley Study: NYCA-wide Production Cost Savings
(Present Value in 2011\$M)

Resource Type	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020
Transmission	21	16	15	15	15	14	15	13	15	15
Generation - 1000 MW	26	32	29	30	31	37	36	35	36	37
Demand Response	47	48	44	44	43	42	41	38	38	37

The addition of the Leeds to Pleasant Valley 345 kV transmission line results in a projected total ten-year production cost savings of \$154 million (present value). Elimination of the Leeds-Pleasant Valley congestion allows the downstate load better access to upstate generation and economic imports from neighbors. It is also noted that relieving the congestion on the Leeds- Pleasant Valley lines increases the congestion on the other two study groups.

The generation solution is projected to reduce congestion across NYCA for the planning horizon. The ten-year production cost savings of \$330 million (present value) are due to the uncongested location and the assumed better heat rate of the generic generating unit compared to the average system heat rate. Efficient generator solutions reduce imports from neighbors and enable a more efficient and lower cost NYCA generation market. Savings accrue in lower production cost as well as reduced congestion.

The Zones G and I DR/EE solution is projected to reduce congestion by 8 – 9%. The ten-year production cost savings of \$421 million (present value) are largely related to the reduction in energy use. DR solutions show greater reductions in production cost than the generation and transmission solutions.

The NYCA-wide production cost savings of the three generic solutions for the three studies are summarized and shown in Figure 5-4.

5.4. Benefit/Cost Analysis

The NYISO conducted the benefit/cost analysis for each of the three: Central East – New Scotland – Pleasant Valley, New Scotland – Pleasant Valley, and Leeds – Pleasant Valley. The CARIS benefit/cost analysis assumes a levelized generic carrying charge rate of 16% for transmission and generation solutions. Therefore, for a given generic solution pertaining to a constrained element, the carrying charge rate, in conjunction with an appropriate discount rate (see description in Section 5.3.2 above) yields a capital recovery factor, which, in turn, is used to calculate the benefit/cost ratio.

$$\text{Benefit/Cost ratio} = \frac{\text{Present Value of Production Cost Savings}}{\text{Overnight Costs} \times \text{Capital Recovery Factor}}$$

The 16% carrying charge rate used in these CARIS benefit/cost calculations reflects generic figures for a return on investment, federal and state income taxes, property taxes, insurance, fixed O&M, and depreciation (assuming a straight-line 30-year method). The calculation of the appropriate capital recovery factor, and, hence, the B/C ratio, is based on the first ten years of the 30-year period,¹⁴ using a discount rate of 7.36% , and the 16% carrying charge rate, yielding a Capital Recovery Factor equal to 1.145.

5.4.1. Cost Analysis

Table 5-15 includes the total cost estimate for each generic solution based on the unit pricing included in Appendix C. The detailed cost breakdown for each solution is included in Appendix E. These are simplified estimates of overnight installation costs and do not include any of the many complicating factors that could be faced by individual projects. On-going fixed operation and maintenance costs and other fixed costs of operating the facility are captured in the capital recovery factor.

¹⁴ The carrying charge rate of 16% was based on a 30-year period because the Tariff provisions governing Phase 2 of CARIS refer to calculating costs over 30 years for information purposes. See OATT Attachment Y, Section 31.4.3.3.4.

Table 5-15: Generic Solution Costs for Each Study

Generic Solution Cost Summary (\$M)			
	Study 1:	Study 2:	Study 3:
Studies	Central East-New Scotland-Pleasant Valley	New Scotland- Pleasant Valley	Leeds - Pleasant Valley
Transmission			
Substation Terminals	Edic to New Scotland to Pleasant Valley	New Scotland to Pleasant Valley	Leeds to Pleasant Valley
Miles (# of terminals)	155 (3)	65 (2)	39 (2)
High	\$1,168	\$502	\$312
Mid	\$799	\$343	\$213
Low	\$322	\$139	\$87
Generation			
Substation Terminal	Pleasant Valley	Pleasant Valley	Pleasant Valley
# of 500 MW Blocks	2	2	2
High	\$1,988	\$1,988	\$1,988
Mid	\$1,622	\$1,622	\$1,622
Low	\$1,256	\$1,256	\$1,256
DR			
Zone	F & G	G&I	G&I
# of 200 MW Blocks	2	2	2
High	\$672	\$754	\$754
Mid	\$540	\$605	\$605
Low	\$406	\$454	\$454

5.4.2. Primary Metric Results

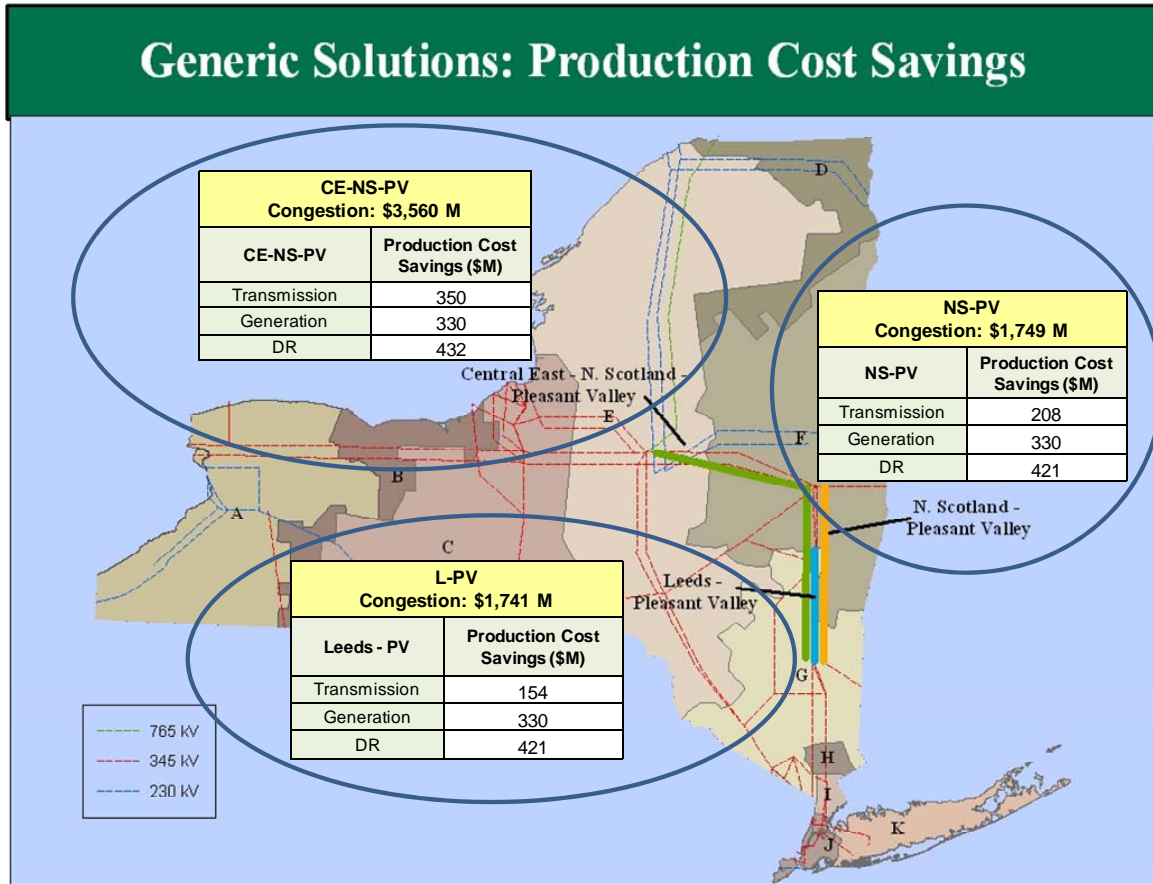


Figure 5-4: Total NYCA-wide Production Cost Savings 2011-2020 (Present Value in 2011 \$M)

The primary benefit metric for the three CARIS studies is the reduction in NYCA-wide production costs. Table 5-16 shows the production cost savings used to calculate the benefit/cost ratios for the generic solutions. In each of the three studies the DR solution produced the highest production cost savings because it directly reduces the energy production requirements. The next highest production cost savings resulted from generation followed by transmission. In the Central East to New Scotland to Pleasant Valley study the transmission solution produced higher production cost savings than generation.

Table 5-16: Production Cost Generic Solutions Savings 2011-2020: Present Value in 2011 (\$M)

	Central East to New Scotland to Pleasant Valley	New Scotland to Pleasant Valley	Leeds to Pleasant Valley
Transmission	350	208	154
Generation	330	330	330
DR/EE	432	421	421

5.4.3. Benefit/Cost Ratios

Figure 5-5 shows the benefit/cost ratios for each study and each generic solution.

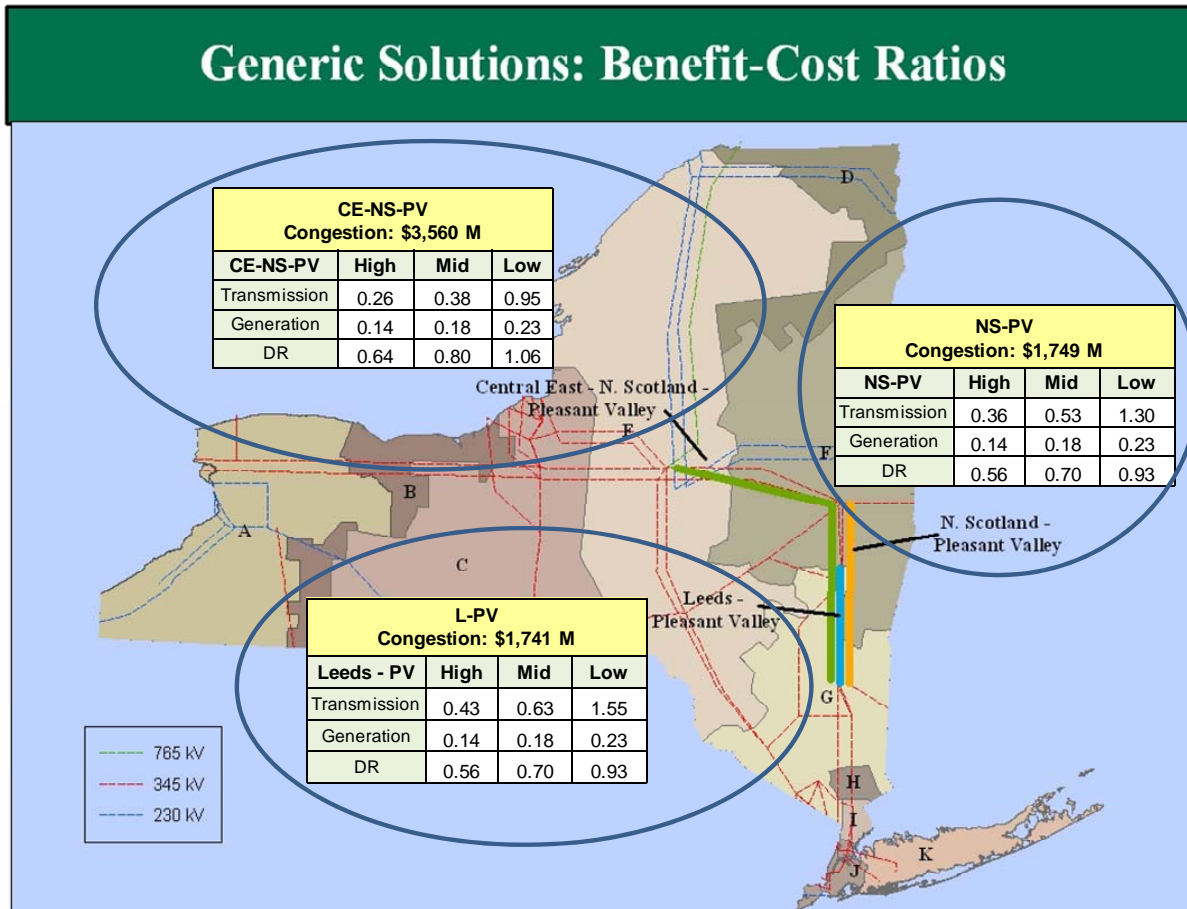


Figure 5-5: B/C Ratio (High, Mid, and Low Cost Estimate Ranges)

5.4.4. Additional Metrics Results

Additional metrics, which are provided for information purposes in Phase 1, are presented in Table 5-17, Table 5-18, and Table 5-19 to show the ten-year total change in: (a) generator payments; (b) LBMP load payments; (c) TCC payments (congestion rents); (d) losses; (e) emission costs/tons; and (f) ICAP MW and cost impact, after the generic solutions are applied. The values represent the generic solution case values less the base case values for all the metrics except for the ICAP metric. Details on the calculations are in Appendix E.

While all but the ICAP metric are from the production cost simulation program, the ICAP metrics are computed using the latest available information from the installed reserve margin (IRM), locational capacity requirement (LCR), and ICAP Demand Curves.¹⁵ For Variant 1, the ISO measured the cost impact of a solution by multiplying the forecast cost per megawatt-year of Installed Capacity (without the solution in place) by the sum of the megawatt impact. For Variant 2, the cost impact of a solution is calculated by forecasting the difference in cost per megawatt-year of Installed Capacity with and without the solution in place and multiplying that difference by fifty percent (50%) of the assumed amount of NYCA Installed Capacity available. Details on the ICAP metric calculations and 10 years of results are provided in Appendix E

¹⁵ http://www.nyiso.com/public/webdocs/products/icap/auctions/Summer-2011/documents/Demand_Curve_Summer_2011_October_FINAL.pdf

Table 5-17: Ten-Year Change in NYCA Load Payments, Generator Payments, Net Import Payments, Losses Costs, TCC Payments and ICAP Costs (Present Value \$M)

Study	Generic Solutions	Load Payments	Generator Payments	Net Import Payments*	Generator Payment + Net Import Payments	Losses Costs	TCC Payments**	ICAP Costs Variant 1	ICAP Costs Variant 2
Transmission									
Study 1: CE-NS-PV	Edic-New Scotland-Pleasant Valley	91	357	190	547	(349)	(456)	(57)	(803)
Study 2: NS-PV	New Scotland-Pleasant Valley	13	204	262	466	(148)	(453)	(57)	(803)
Study 3: Leeds-PV	Leeds – Pleasant Valley	116	288	188	476	(86)	(360)	(57)	(803)
Generation									
Study 1: CE-NS-PV	Pleasant Valley	(906)	523	(999)	(476)	25	(430)	(105)	(1174)
Study 2: NS-PV	Pleasant Valley	(906)	523	(999)	(476)	25	(430)	(105)	(1174)
Study 3: Leeds-PV	Pleasant Valley	(906)	523	(999)	(476)	25	(430)	(105)	(1174)
DR									
Study 1: CE-NS-PV	Zone F&G	(624)	(400)	(201)	(601)	(21)	(23)	(28)	(470)
Study 2: NS-PV	Zone G & I	(615)	(358)	(171)	(529)	(40)	(86)	(44)	(674)
Study 3: Leeds-PV	Zone G & I	(615)	(358)	(171)	(529)	(40)	(86)	(44)	(674)

Note: A negative number implies a reduction in payments/costs

* Net Import Payments are not CARIS additional metrics

** TCC Payments are calculated as Load Payments minus (Generator Payments + Net Import Payments)

Table 5-18: Ten-Year Change in NYCA Load Payments, Energy Costs, Congestion Costs and Losses Costs (Present Value \$M)

Study	Generic Solutions	Load Payments	Energy Costs*	Congestion Costs**	Losses Costs
Transmission					
Study 1: CE-NS-PV	Edic-New Scotland-Pleasant Valley	91	2795	(2355)	(349)
Study 2: NS-PV	New Scotland-Pleasant Valley	13	1483	(1322)	(148)
Study 3: Leeds-PV	Leeds – Pleasant Valley	116	917	(715)	(86)
Generation					
Study 1: CE-NS-PV	Pleasant Valley	(906)	90	(1021)	25
Study 2: NS-PV	Pleasant Valley	(906)	90	(1021)	25
Study 3: Leeds-PV	Pleasant Valley	(906)	90	(1021)	25
DR					
Study 1: CE-NS-PV	Zone F & G	(624)	(512)	(92)	(21)
Study 2: NS-PV	Zone G & I	(615)	(355)	(220)	(40)
Study 3: Leeds-PV	Zone G & I	(615)	(355)	(220)	(40)

Note: A negative number implies a reduction in payments

* Energy Costs are not CARIS additional metrics

** Congestion Costs represent Demand\$ congestion

Table 5-19: ICAP MW Impact

CARIS Solutions		Year 2020 MW Impact (MW)			
		ROS	NYC	LI	Total
Study #1 Central East-New Scotland-Pleasant Valley	Transmission	443	161	96	700
	Generation	824	299	177	1300
	DR/EE (F & G)	222	80	48	350
Study #2 New Scotland-Pleasant Valley	Transmission	443	161	96	700
	Generation	824	299	177	1300
	DR/EE (G & I)	348	126	75	550
Study #3 Leeds-Pleasant Valley	Transmission	443	161	96	700
	Generation	824	299	177	1300
	DR/EE (G & I)	348	126	75	550

The ten-year changes in total emissions resulting from the application of generic solutions are reported in Table 5-20 below. The base case ten-year emission totals for NYCA are: CO₂ = 401,534 tons, SO₂ = 289,765 tons and NO_x = 237,134 tons. The study results reveal that most of the generic solutions impact emissions by less than 2%, with the exception of generation solutions impacting SO₂ and NO_x emissions up to 7% and 4% respectively. The current installed capacity in NYCA as reported in the 2011 Gold Book is 37,707 MW. The generic generation solution of 1,000 MW represents the equivalent of 2.7 % increase in installed capacity. The generic demand response solution of 200 MW of DR and 200 MW of EE could be considered as an additional resource which would be equivalent to 1.1% of installed capacity. The capability of the generic transmission solution is 1,000 MVA, which would be utilized to shift dispatch patterns of several hundred MW of capacity, or something on the order of 1% of installed capacity. The three generic solutions can be considered to change the fleet emission characteristics on the order of 1-3%. The comparison of the relative emission changes among solution types and across locations provides insight about the relative air related impacts if the emissions assumptions come to fruition. The emissions results include only emissions from NYCA units. The external emissions impacts associated with changes in NYCA imports are not reported. Both transmission and demand response solutions show improvements by reducing the emissions of all three pollutants up to 1.3%. Generation solutions produce a net reduction in the emissions of SO₂ and NO_x, due to the relative low emission rates of a new unit compared to the average emission rates of the existing fleet. The Pleasant Valley location offers the greatest emission reductions in SO₂ (7%) and NO_x (4%). Generic generation solutions lead to a slight increase in CO₂ emissions when a 1,000 MW generation solution is applied.

Table 5-20: Ten-Year Change in NYCA CO₂, SO₂ and NO_x Emissions (Dollars in Present Value)

Study	Solution	SO ₂			CO ₂			NO _x		
		Tons	% Chang	Cost (\$M)	'000s Tons	% Chang	Cost (\$M)	Tons	% Chang	Cost (\$M)
Transmission										
Study 1: CE-NS-PV	Edic-New Scotland-Pleasant Valley	218	0.08%	0.03	(3705)	-0.92%	(37.8)	(2327)	-0.98%	(2.1)
Study 2: NS-PV	New Scotland-Pleasant Valley	(1637)	-0.56%	(0.4)	(4083)	-1.02%	(44.4)	(3029)	-1.28%	(2.8)
Study 3: Leeds-PV	Leeds – Pleasant Valley	(1644)	-0.57%	(0.4)	(2979)	-0.74%	(32.6)	(2114)	-0.89%	(1.9)
Generation										
Study 1: CE-NS-PV	Pleasant Valley	(18961)	-6.54%	(3.9)	5404	1.35%	62.7	(8742)	-3.69%	(8.0)
Study 2: NS-PV	Pleasant Valley	(18961)	-6.54%	(3.9)	5404	1.35%	62.7	(8742)	-3.69%	(8.0)
Study 3: Leeds-PV	Pleasant Valley	(18961)	-6.54%	(3.9)	5404	1.35%	62.7	(8742)	-3.69%	(8.0)
Demand Response										
Study 1: CE-NS-PV	Zone F & G	(2710)	-0.94%	(0.6)	(3028)	-0.75%	(32.7)	(1591)	-0.67%	(1.5)
Study 2: NS-PV	Zone G & I	(2719)	-0.94%	(0.6)	(3128)	-0.78%	(33.8)	(1735)	-0.73%	(1.6)
Study 3: Leeds-PV	Zone G & I	(2719)	-0.94%	(0.6)	(3128)	-0.78%	(33.8)	(1735)	-0.73%	(1.6)

5.5. Scenario Analysis

Scenario analysis is performed to explore the impact on congestion associated with variables to the base case. Since this is an economic study and not a reliability analysis, these scenarios focus upon factors that impact the magnitude of congestion across constrained elements.

A forecast of congestion is impacted by many variables for which the future values are uncertain. Scenario analyses are methods of identifying the relative impact of pertinent variables on the magnitude of congestion costs. The CARIS scenarios were presented to ESPWG and modified based upon the input received and the availability of NYISO resources. The focus of these analyses was to examine the impact of the full amount of the resources added through the State Renewable Portfolio Standard (RPS) combined with the full achievement of the State Energy Efficiency Portfolio Standard (EEPS), fuel price and load forecast uncertainties, costs of emissions, and maintaining the Athens SPS in service. The objective of the scenario analysis is to determine the change in the costs of congestion that is caused by variables that differ from their base case values. The simulations were conducted for the mid-period year (2015) and the horizon year (2020).

5.5.1. Scenario Analysis

Table 5-21 summarizes the scenarios studied in CARIS Phase 1. The scenarios consider the effects of changes to the base case model. These changes are described as “Variables” in the table below.

Table 5-21: Scenario Matrix

Scenario	Variables
EPA Projected NOx and SO2 Costs	Increases in SO2 and Ozone Season NOx costs; decreases in annual NOx cost as projected by EPA
Higher Load Forecast	6% increase
Lower Load Forecast	9% decrease
Full RPS and Full EEPS Goals Achievement	Add renewables from Interconnection Queue to achieve 9870 GWh goal and reduce 2015 load to 32147 MW
Athens SPS Continued In Service	2011-2020
Higher Natural Gas Prices	One standard deviation
Lower Natural Gas Prices	One standard deviation
Lower CO2 Emission Costs	Flat \$5/ton ceiling

Table 5-22 presents the impact of eight scenarios selected for study. Those impacts are expressed as congestion costs for the scenarios and the base case. All numbers are shown as absolute values.

2015 Scenarios: Base Case Demand\$ Congestion (Nominal \$M)*										
CONSTRAINTS	TYPE	BASE CASE	EPA Projected NOx and SO2 Costs	Higher Load Forecast	Lower Load Forecast	Full RPS and Full EEPS goals Achievement	Athens SPS Continued in Service	Higher Natural Gas Prices	Lower Natural Gas Prices	Lower Carbon Emission Costs
LEEDS-PLSNTVLY	Contingency	205	177	244	138	221	130	228	173	170
CENTRAL EAST	Interface	212	253	219	268	563	232	272	110	171
DUNWOODIE_SHORE RD_345	Contingency	57	75	61	56	61	61	64	46	58
GREENWOOD LINES	Contingency	12	11	15	8	11	12	13	12	12
WEST CENTRAL-OP	Interface	2	3	2	2	1	3	4	2	0
GOTHLA A - GOWANUSS	Contingency	5	6	6	3	4	4	5	4	4
LEEDS3_NEW SCOTLAND_345	Contingency	2	0	0	3	2	2	2	1	0
RAINY8W138_VERNW_138	Contingency	2	3	2	2	2	2	3	1	3
ASTORIAW138_HG5_138	Contingency	0	0	0	0	1	0	0	0	0
Study 1: Central East-New Scotland-Pleasant Valley		419	430	463	409	787	364	502	284	341
Study 2: New Scotland-Pleasant Valley		207	177	244	141	223	132	229	174	170
Study 3: Leeds-Pleasant Valley		205	177	244	138	221	130	228	173	170

*Absolute values

2020 Scenarios: Demand\$ Congestion (Nominal \$M)*										
CONSTRAINTS	TYPE	BASE CASE	EPA Projected NOx and SO2 Costs	Higher Load Forecast	Lower Load Forecast	Full RPS and Full EEPS Goals Achievement	Athens SPS Continued in Service	Higher Natural Gas Prices	Lower Natural Gas Prices	Lower Carbon Emission Costs
LEEDS-PLSNTVLY	Contingency	377	417	440	269	399	253	412	337	330
CENTRAL EAST	Interface	329	266	317	428	817	369	389	207	312
DUNWOODIE_SHORE RD_345	Contingency	80	107	85	76	84	85	87	66	83
GREENWOOD LINES	Contingency	19	20	24	13	17	19	20	18	20
WEST CENTRAL-OP	Interface	9	12	8	9	6	10	11	7	2
GOTHLA A - GOWANUSS	Contingency	8	9	11	5	7	7	8	7	8
LEEDS3_NEW SCOTLAND_345	Contingency	2	6	2	2	3	5	2	3	0
RAINY8W138_VERNW_138	Contingency	2	2	2	2	2	2	3	1	3
ASTORIAW138_HG5_138	Contingency	1	2	1	1	1	0	1	1	0
Study 1: Central East-New Scotland-Pleasant Valley		708	689	760	699	1,218	627	804	547	642
Study 2: New Scotland-Pleasant Valley		379	423	443	271	401	258	415	339	331
Study 3: Leeds-Pleasant Valley		377	417	440	269	399	253	412	337	330

*Absolute values

Table 5-22: Comparison of Base Case and Scenario Cases, 2015 and 2020 (nominal \$M)

Figures 5-6 through 5-8 show the congestion impact results of eight scenarios performed for the years 2015 and 2020. While the table above shows the congestion impact from the scenarios for each of the most congested constraints, the figures below separately show how each of the three transmission groupings chosen for study are affected by each of the scenarios.

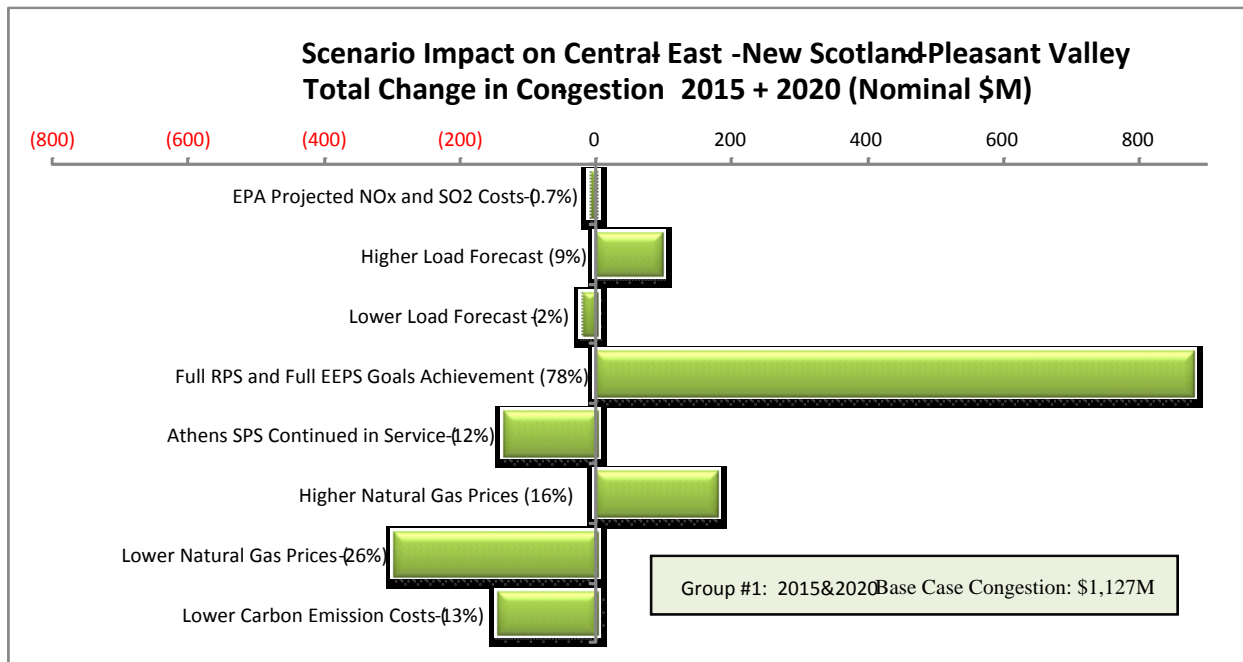


Figure 5-6: Scenario Impact on Central East – Pleasant Valley Congestion

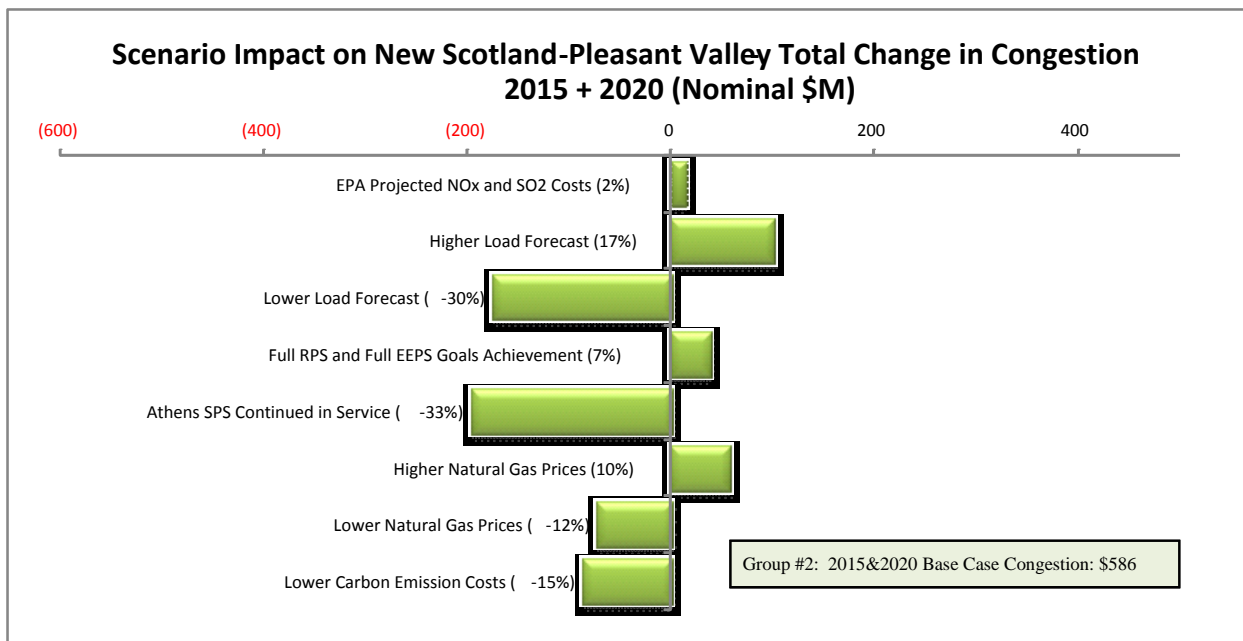


Figure 5-7: Scenario Impact on New Scotland – Pleasant Valley Congestion

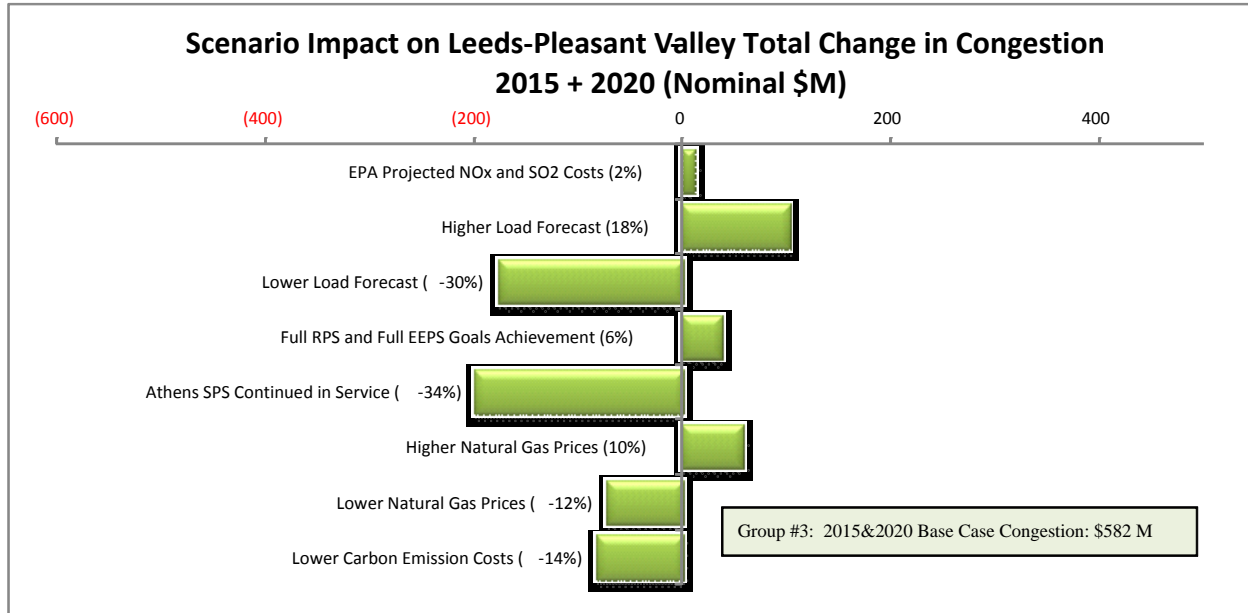


Figure 5-8: Scenario Impact on Leeds- Pleasant Valley Congestion

Scenario 1: EPA Projected NO_x and SO₂ Costs

Emissions of SO₂ and NO_x have costs that are determined by various cap and trade programs currently in effect in New York and in most of the surrounding regions. Forecasts used in the base case for these allowance costs were developed using various private and public data such as some proprietary forecasts, EPA’s allowance price, and market prices from the Chicago Climate Futures Exchange. To examine factors that might produce or increase congestion, the forecast costs of NO_x and SO₂ emissions were modeled based on EPA projections for 2015 and 2020, resulting from the Cross-State Air Pollution Rule.

Scenario 2: Higher Load Forecast

This scenario examined the impact of the higher load forecast on the cost of congestion. The high load forecast is obtained from the 2011 Gold Book, and is 6% higher than the 2011 Gold Book Baseline load forecast used in the 2011 CARIS base case. The high load forecast is 35,738 MW and 36,988 MW respectively in 2015 and 2020. All other assumptions were kept the same as in the base case.

Scenario 3: Lower Load Forecast

This scenario examined the impact of the lower load forecast on the cost of congestion. The low load forecast is derived from the 2011 Gold Book, and is 9% lower than the 2011 Gold Book Baseline load forecast used in the 2011 CARIS base case. The low load forecast is 30,734

MW and 31,819 MW respectively in 2015 and 2020. All other assumptions were the same as in the base case.

Scenario 4: Full RPS and EEPS Goals Achievement

This scenario adds renewable generation projects from the NYISO Interconnection queue to achieve the renewable goal of 9,870 GWh by 2015, and models load reductions which achieve the goal of 15% load reduction resulting in a peak load projection of 32,147 MW in 2015.

Scenario 5: Athens SPS Continued In Service

This scenario assumed that the Athens SPS is in service throughout the study period from 2011 -2020. The 2011 base case assumed that Athens SPS was not in service. The Athens SPS system impact study in 2006 indicated a 450 MW increase in the transfer capability of the UPNY-SENY interface with the SPS in service.

Scenario 6: Higher Natural Gas Prices

This scenario examines congestion costs when natural gas prices are projected to be higher than the base case levels by one standard deviation. The standard deviation figures represent, for a given fuel, the typical volatility of daily prices around the monthly average based on an assessment of a 5-year history. The volatility of natural gas prices varies across the year such that it is most volatile in winter months and relatively stable during late spring. Consequently, as compared to the base case, the high price case uses January prices around 22% higher for Downstate and 12% higher for Upstate, while remaining about the same in May-June in both cases.

Scenario 7: Lower Natural Gas Prices

This scenario examines congestion costs when natural gas prices are projected to be lower than the base case levels by one standard deviation. The standard deviation figures represent, for a given fuel, the typical volatility of daily prices around the monthly average based on an assessment of a 5-year history. The volatility of natural gas prices varies across the year such that it is most volatile in winter months and relatively stable during late spring. Consequently, as compared to the base case, the low price case uses January prices around 22% lower for Downstate and 12% lower for Upstate, while remaining about the same in May-June in both cases.

Scenario 8: Lower CO₂ Emission Costs

To simulate the potential impact of carbon emission costs lower than those modeled in the base case, this scenario assumed the price of CO₂ allowances to not exceed \$5/ton throughout the 2011-2020 study period.

6. 2011 CARIS Findings – Study Phase

The CARIS identified three study areas by considering monitored elements that have historically displayed high levels of congestion after adjusting for the effects of volatile fuel price changes and also considering the installation of new resources and transmission system improvements contained in the 2010 CRP. In order to estimate the economic impact of alleviating the identified congestion, the three generic solutions were applied to each of the three study areas and production costs savings were calculated based on the three different ranges of generic costs.

Table 6-1 shows the projected congestion for each of the three transmission groupings: Central East-New Scotland-Pleasant Valley, New Scotland-Pleasant Valley, and Leeds-Pleasant Valley.

Table 6-1: Base Case Projected Congestion 2011-2020

Study	Ten-Year Congestion (\$M)	
	Nominal	Present Value (2011 \$)
Study 1: Central East-New Scotland-Pleasant Valley	5,133	3,560
Study 2: New Scotland-Pleasant Valley	2,548	1,749
Study 3: Leeds-Pleasant Valley	2,535	1,741

The application of the generic solutions to the three study areas all result in production cost savings expressed in 2011 present values, as shown in Table 6-2.

Table 6-2: Production Cost Savings 2011-2020, Present Value in 2011 \$M

Study	Ten-Year Production Cost Savings (2011 \$M)		
	Transmission Solution	Generation Solution	DR Solution
Study 1: Central East-New Scotland-Pleasant Valley	350	330	432
Study 2: New Scotland to Pleasant Valley	208	330	421
Study 3: Leeds - Pleasant Valley	154	330	421

In Phase 1, CARIS compares the present value of the production cost savings benefit over the ten-year study period to the present value of fixed costs based on a 16% carrying cost charge, for transmission and generation solutions, to determine a benefit/cost ratio, as presented in Table 6-3. A 16% carrying cost charge does not apply to demand response solutions. See Section 5.5 for a detailed explanation.

Table 6-3: Benefit/Cost Ratios

Study	Cost Ranges	Benefit/Cost Ratios		
		Transmission Solution	Generation Solution	Demand Response Solution
Study 1: Central East-New Scotland-Pleasant Valley	High	0.26	0.14	0.64
	Mid	0.38	0.18	0.80
	Low	0.95	0.23	1.06
Study 2: New Scotland to Pleasant Valley	High	0.36	0.14	0.56
	Mid	0.53	0.18	0.70
	Low	1.30	0.23	0.93
Study 3: Leeds to Pleasant Valley	High	0.43	0.14	0.56
	Mid	0.63	0.18	0.70
	Low	1.55	0.23	0.93

In conclusion, this CARIS Phase 1 study provides: (a) projections of congestion in the NYCA system; (b) present value of ten-year production cost savings ranging from \$150M to \$430M resulting from the application of various generic transmission, generation and demand response solutions; and (c) the Benefit/Cost ratios as high as 1.55 and as low as 0.14 depending on the high-medium-low generic project cost estimates.

Additionally, the scenario analyses provide information on new or increased projected congestion costs resulting from changes in variables selected for scenario analyses (see Table 5-22 in Section 5).

7. Next Steps

In addition to the CARIS Phase 1 Study, any interested party can request additional studies or use the CARIS Phase 1 results for guidance in submitting a request for a Phase 2 study.

7.1. Additional CARIS Studies

In addition to the three CARIS studies, any interested party may request an additional study of congestion on the NYCA bulk power system. Those studies can analyze the benefits of alleviating congestion with all types of resources, including transmission, generation and demand response, and compare benefits to costs.

7.2. Phase 2 – Specific Transmission Project Phase

The NYISO staff will commence Phase 2 – the Project Phase – of the CARIS process following the approval of the Phase 1 report by the NYISO Board. The model for Phase 2 studies would include known changes to the system configuration that meet base case inclusion rules and would be updated with any new load forecasts, fuel costs, and emission costs projections upon review and discussion by stakeholders. Phase 2 will provide a benefit/cost assessment for each specific transmission project that is submitted by developers who seek regulated cost recovery under the NYISO's Tariff.

Transmission projects seeking regulated cost recovery will be further assessed by NYISO staff to determine whether they qualify for cost allocation and cost recovery under the NYISO Tariff¹⁶. To qualify, the total capital cost of the project must exceed \$25 million, the benefits as measured by the NYCA-wide production cost savings must exceed the project cost measured over the first ten years from the proposed commercial operation date, and a super-majority ($\geq 80\%$) of the weighted votes cast by the beneficiaries must be in favor of the project. Additional details on the Phase 2 process can be found in Appendix F.

7.3. Project Phase Schedule

The NYISO staff will perform benefit/cost analysis for submitted economic transmission project proposals for and, if a developer seeks cost recovery, will determine beneficiaries and conduct cost allocation calculations. The results of the Phase 2 analyses will provide a basis for beneficiary voting on each proposed transmission project.

¹⁶ Market-based responses to congestion identified in Phase 1 of the CARIS are not eligible for regulated cost recovery, and therefore are not obligated to follow the requirements of Phase 2. Cost recovery of market-based projects shall be the responsibility of the developer.

The next CARIS cycle will begin in 2013, upon the completion of the next CRPP cycle (approval of the 2012 CRP).

Appendix A – Glossary

TERM	DEFINITION
Ancillary Services	Services necessary to support the transmission of Energy from Generators to Loads, while maintaining reliable operation of the NYS Power System in accordance with Good Utility Practice and Reliability Rules. Ancillary Services include Scheduling, System Control and Dispatch Service; Reactive Supply and Voltage Support Service (or Voltage Support Service); Regulation Service; Energy Imbalance Service; Operating Reserve Service (including Spinning Reserve, 10-Minute Non-Synchronized Reserves and 30-Minute Reserves); and Black Start Capability. [FROM SERVICES TARIFF]
Bid Production Cost	Total cost of the Generators required to meet Load and reliability Constraints based upon Bids corresponding to the usual measures of Generator production cost (e.g., running cost, Minimum Generation Bid, and Start Up Bid). [FROM SERVICES TARIFF]
Bulk Power Transmission Facility (BPTF)	Transmission facilities that are system elements of the bulk power system which is the interconnected electrical system within northeastern North America comprised of system elements on which faults or disturbances can have a significant adverse impact outside of the local area.
Business Issues Committee (BIC)	A NYISO committee that is charged with, among other things, the responsibility to establish procedures related to the efficient and non-discriminatory operation of the electricity markets centrally coordinated by the NYISO, including procedures related to bidding, Settlements and the calculation of market prices.
Capacity	The capability to generate or transmit electrical power, or the ability to reduce demand at the direction of the NYISO.
Chicago Climate Futures Exchange (CCFE)	A derivatives exchange that offers standardized and cleared futures and options contracts on emission allowances and other environmental products.
Clean Air Markets Division (CAMD)	A division of the U.S. Environmental Protection Agency responsible for various market-based regulatory programs that are designed to improve air quality by reducing outdoor concentrations of fine particles, sulfur dioxide, nitrogen oxides, and mercury.
Comprehensive Reliability Plan (CRP)	A biennial study undertaken by the NYISO that evaluates projects offered to meet New York’s future electric power needs, as identified in the Reliability Needs Assessment (RNA). The CRP may trigger electric utilities to pursue regulated solutions to meet Reliability Needs if market-based solutions will not be available by that point. It is the second step in the Comprehensive Reliability Planning Process (CRPP)
Comprehensive Reliability Planning Process (CRPP)	The biennial process that evaluates resource adequacy and transmission system security of the state’s bulk electricity grid over a ten-year period and evaluates solutions to meet those needs. The CRPP consists of two studies: the RNA, which identifies potential problems, and the CRP, which evaluates specific solutions to those problems.

Comprehensive System Planning Process (CSPP)	A transmission system planning process that is comprised of three components: (1) Local transmission planning; (2) Compilation of local plans into the Comprehensive Reliability Planning Process (CRPP), which includes developing a Comprehensive Reliability Plan (CRP); (3) Channeling the CRP data into the Congestion Assessment and Resource Integration Study (CARIS)
Congestion	Congestion on the transmission system results from physical limits on how much power transmission equipment can carry without exceeding thermal, voltage and/or stability limits determined to maintain system reliability. If a lower cost generator cannot transmit its available power to a customer because of a physical transmission constraint, the cost of dispatching a more expensive generator is the congestion cost.
Congestion Rent	The opportunity costs of transmission Constraints on the NYS Bulk Power Transmission System. Congestion Rents are collected by the NYISO from Loads through its facilitation of LBMP Market Transactions and the collection of Transmission Usage Charges from Bilateral Transactions.
Contingencies	Electrical system events (including disturbances and equipment failures) that are likely to happen.
Day Ahead Market (DAM)	A NYISO-administered wholesale electricity market in which capacity, electricity, and/or Ancillary Services are auctioned and scheduled one day prior to use. The DAM sets prices as of 11 a.m. the day before the day these products are bought and sold, based on generation and energy transaction bids offered in advance to the NYISO. More than 90% of energy transactions occur in the DAM.
DC tie-lines	A high voltage transmission line that uses direct current for the bulk transmission of electrical power between two control areas.
Demand Response	A mechanism used to encourage consumers to reduce their electricity use during a specified period, thereby reducing the peak demand for electricity.
Eastern Interconnection Planning Collaborative (EIPC)	A group of planning authorities convened to establish processes for aggregating the modeling and regional transmission plans of the entire Eastern Interconnection and for performing inter-regional analyses to identify potential opportunities for efficiencies between regions in serving the needs of electrical customers.
Economic Dispatch of Generation	The operation of generation facilities to produce energy at the lowest cost to reliably serve consumers.
Electric System Planning Working Group (ESPWG)	A NYISO governance working group for Market Participants designated to fulfill the planning functions assigned to it. The ESPWG is a working group that provides a forum for stakeholders and Market Participants to provide input into the NYISO's Comprehensive Reliability Planning Process (CRPP), the NYISO's response to FERC reliability-related Orders and other directives, other system planning activities, policies regarding cost allocation and recovery for reliability projects, and related matters.
Energy Efficiency Portfolio Standard (EEPS)	A statewide program ordered by the NYSPSC in response to the Governor's call to reduce New Yorkers' electricity usage by 15% of forecast levels by the year 2015, with comparable results in natural gas conservation. Also known as 15x15.

Exports	A Bilateral Transaction or purchases from the LBMP Market where the Energy is delivered to a NYCA Interconnection with another Control Area. [FROM SERVICES TARIFF]
External Areas	Neighboring Control Areas including HQ, ISO-NE, PJM, IESO
Federal Energy Regulatory Commission (FERC)	The federal energy regulatory agency within the US Department of Energy that approves the NYISO's tariffs and regulates its operation of the bulk electricity grid, wholesale power markets, and planning and interconnection processes.
FERC Form 715	An annual transmission planning and evaluation report required by the FERC - filed by the NYISO on behalf of the transmitting utilities in New York State.
FERC Order No. 890	Adopted by FERC in February 2007, Order 890 is a change to FERC's 1996 open access regulations (established in Orders 888 and 889). Order 890 is intended to provide for more effective competition, transparency and planning in wholesale electricity markets and transmission grid operations, as well as to strengthen the Open Access Transmission Tariff (OATT) with regard to non-discriminatory transmission service. Order 890 requires Transmission Providers - including the NYISO - have a formal planning process that provides for a coordinated transmission planning process, including reliability and economic planning studies.
Grandfathered Rights	The transmission rights associated with: (1) Modified Wheeling Agreements; (2) Transmission Facility Agreements with transmission wheeling provisions; and (3) Third Party Transmission Wheeling Agreements (TWA) where the party entitled to exercise the transmission rights associated with such Agreements has chosen, as provided in the Tariff, to retain those rights rather than to convert those rights to TCCs. [FROM SERVICES TARIFF]
Grandfathered TCCs	The TCCs associated with: (1) Modified Wheeling Agreements; (2) Transmission Facility Agreements with transmission wheeling provisions; and (3) Third Party TWAs where the party entitled to exercise the transmission rights associated with such Agreements has chosen, as provided by the Tariff, to convert those rights to TCCs. [FROM SERVICES TARIFF]
Heat Rate	A measurement used to calculate how efficiently a generator uses heat energy. It is expressed as the number of BTUs of heat required to produce a kilowatt-hour of energy. Operators of generating facilities can make reasonably accurate estimates of the amount of heat energy a given quantity of any type of fuel, so when this is compared to the actual energy produced by the generator, the resulting figure tells how efficiently the generator converts that fuel into electrical energy.
High Voltage Direct Current (HVDC)	A transmission line that uses direct current for the bulk transmission of electrical power, in contrast with the more common alternating current systems. For long-distance distribution, HVDC systems are less expensive and suffer lower electrical losses.
Investment Hurdle Rate	The minimum acceptable rate of return.
Imports	A Bilateral Transaction or sale to the LBMP Market where Energy is delivered to a NYCA Interconnection from another Control Area.

Independent Market Monitoring Unit	Consulting firm retained by the NYISO Board pursuant to Article 4 of the NYISO's Market Monitoring Plan.
Independent System Operator (ISO)	An organization, formed at the direction or recommendation of the Federal Energy Regulatory Commission (FERC), which coordinates, controls and monitors the operation of the electrical power system, usually within a single US State, but sometimes encompassing multiple states.
Installed Capacity (ICAP)	A generator or load facility that complies with the requirements in the Reliability Rules and is capable of supplying and/or reducing the demand for energy in the NYCA for the purpose of ensuring that sufficient energy and capacity are available to meet the Reliability Rules.
Installed Reserve Margin (IRM)	The amount of installed electric generation capacity above 100% of the forecasted peak electric consumption that is required to meet New York State Reliability Council (NYSRC) resource adequacy criteria. Most planners consider a 15-20% reserve margin essential for good reliability.
Load	A term that refers to either a consumer of Energy or the amount of demand (MW) or Energy (MWh) consumed by certain consumers. [FROM SERVICES TARIFF]
Locational Capacity Requirement (LCR)	Locational Capacity Requirement specifies the minimum amount of installed capacity that must be procured from resources situated specifically within a locality (Zone K and Zone J). It considers resources within the locality as well as the transmission import capability to the locality in order to meet the resource adequacy reliability criteria of the New York State Reliability Council (NYSRC) and the Northeast Power Coordinating Council (NPCC).
Load Serving Entity (LSE)	Any entity, including a municipal electric system and an electric cooperative, authorized or required by law, regulatory authorization or requirement, agreement, or contractual obligation to supply Energy, Capacity and/or Ancillary Services to retail customers located within the NYCA, including an entity that takes service directly from the NYISO to supply its own Load in the NYCA. [FROM SERVICES TARIFF]
Load Zones	The eleven regions in the NYCA connected to each other by identified transmission interfaces. Designated as Load Zones A-K.
Local Transmission Planning Process (LTPP)	The first step in the Comprehensive System Planning Process (CSPP), under which stakeholders in New York's electricity markets participate in local transmission planning.
Locational Based Marginal Pricing (LBMP)	The price of Energy at each location in the NYS Transmission System.
Market Analysis and Portfolio Simulation (MAPS) Software	An analytic tool for market simulation and asset performance evaluations.
Multi-Area Reliability Simulation (MARS) Software	An analytic tool for market simulation to assess the reliability of a generation system comprised of any number of interconnected areas.

Market Based Solution	Investor-proposed projects that are driven by market needs to meet future reliability requirements of the bulk electricity grid as outlined in the RNA. Those solutions can include generation, transmission and Demand Response Programs.
Market Participant	An entity, excluding the NYISO, that produces, transmits sells, and/or purchases for resale capacity, energy and ancillary services in the wholesale market. Market Participants include: customers under the NYISO tariffs, power exchanges, TOs, primary holders, load serving entities, generating companies and other suppliers, and entities buying or selling transmission congestion contracts.
New York Control Area (NYCA)	The area under the electrical control of the NYISO. It includes the entire state of New York, and is divided into 11 zones.
New York Independent System Operator (NYISO)	Formed in 1997 and commencing operations in 1999, the NYISO is a not-for-profit organization that manages New York's bulk electricity grid - a 11,009-mile network of high voltage lines that carry electricity throughout the state. The NYISO also oversees the state's wholesale electricity markets. The organization is governed by an independent Board of Directors and a governance structure made up of committees with Market Participants and stakeholders as members.
New York State Reliability Council (NYSRC)	A not-for-profit entity whose mission is to promote and preserve the reliability of electric service on the New York State Power System by developing, maintaining, and, from time-to-time, updating the Reliability Rules which shall be complied with by the New York Independent System Operator (NYISO) and all entities engaging in electric transmission, ancillary services, energy and power transactions on the New York State Power System.
Nomogram	Nomograms are used to model relationships between system elements. These can include; voltage or stability related to load level or generator status; two interfaces related to each other; generating units whose output is related to each other; and operating procedures.
Northeast Coordinated System Planning Protocol (NCSPP)	ISO New England, PJM and the NYISO work together under the Northeast Coordinated System Planning Protocol (NCSPP), to analyze cross-border issues and produce a regional electric reliability plan for the northeastern United States.
Operating Reserves	Capacity that is available to supply Energy or reduce demand and that meets the requirements of the NYISO. [SERVICES TARIFF TERM]
Overnight Costs	Direct permitting, engineering and construction costs with no allowances for financing costs.
Phase Angle Regulator (PAR)	Device that controls the flow of electric power in order to increase the efficiency of the transmission system.
Proxy Generator Bus	A proxy bus located outside the NYCA that is selected by the NYISO to represent a typical bus in an adjacent Control Area and for which LBMP prices are calculated. The NYISO may establish more than one Proxy Generator Bus at a particular Interface with a neighboring Control Area to enable the NYISO to distinguish the bidding, treatment and pricing of products and services at the Interface.
Regional Greenhouse Gas Initiative (RGGI)	A cooperative effort by ten Northeast and Mid-Atlantic states to limit greenhouse gas emissions using a market-based cap-and-trade approach.

Regulated Backstop Solution	Proposals required of certain TOs to meet Reliability Needs as outlined in the RNA. Those solutions can include generation, transmission or Demand Response. Non-Transmission Owner developers may also submit regulated solutions. The NYISO may call for a Gap solution if neither market-based nor regulated backstop solutions meet Reliability Needs in a timely manner. To the extent possible, the Gap solution should be temporary and strive to ensure that market-based solutions will not be economically harmed. The NYISO is responsible for evaluating all solutions to determine if they will meet identified Reliability Needs in a timely manner.
Regulation Service	An Ancillary Service. See glossary definition for Ancillary Services.
Reliability Need	A condition identified by the NYISO in the RNA as a violation or potential violation of Reliability Criteria. (OATT TERM)
Reliability Needs Assessment (RNA)	A biennial report that evaluates resource adequacy and transmission system security over a ten-year planning horizon, and identifies future needs of the New York electric grid. It is the first step in the NYISO's CRPP.
Security Constrained Unit Commitment (SCUC)	A process developed by the NYISO, which uses a computer algorithm to dispatch sufficient resources, at the lowest possible Bid Production Cost, to maintain safe and reliable operation of the NYS Power System.
Special Case Resource (SCR)	A NYISO demand response Demand Response program designed to reduce power usage by businesses and large power users qualified to participate in the NYISO's ICAP market. Companies that sign up to serve as SCRs are paid in advance for agreeing to reduce power consumption upon NYISO request.
Stakeholders	A person or group that has an investment or interest in the functionality of New York's transmission grid and markets.
Thermal transfer limit	The maximum amount of heat a transmission line can withstand. The maximum reliable capacity of each line, due to system stability considerations, may be less than the physical or thermal limit of the line.
Transfer Capability	The amount of electricity that can flow on a transmission line at any given instant, respecting facility rating and reliability rules.
Transmission Congestion Contract (TCC)	The right to collect, or obligation to pay, Congestion Rents in the Day Ahead Market for Energy associated with a single MW of transmission between a specified Point Of Injection and Point Of Withdrawal. TCCs are financial instruments that enable Energy buyers and sellers to hedge fluctuations in the price of transmission. (SERVICES TARIFF TERM)
Transmission Constraint	Limitations on the ability of a transmission facility to transfer electricity during normal or emergency system conditions.
Transmission District	The geographic area served by the Investor Owned Transmission Owners and LIPA, as well as the customers directly interconnected with the transmission facilities of the Power Authority of the State of New York. (SERVICES TARIFF TERM)
Transmission Interface	A defined set of transmission facilities that separate Load Zones and that separate the NYCA from adjacent Control Areas. (SERVICES TARIFF TERM)

Transmission Owner (TO)	A public utility or authority that provides Transmission Service under the Tariff
Transmission Planning Advisory Subcommittee (TPAS)	A group of Market Participants that advises the NYISO Operating Committee and provides support to the NYISO Staff in regard to transmission planning matters including transmission system reliability, expansion, and interconnection.
Unhedged Congestion	Congestion payment (congestion component times load affected) minus the TCC hedge. [Add definition]