

Impacts and Trends of COVID-19 on NYISO Load

Analysis through 7/31/2021


Chuck Alonge & Maxim Schuler
Demand Forecasting & Analysis

Load Forecasting Task Force

August 24, 2021; Teleconference

Impacts on Daily Energy by Month

Weather Normalized and Backcast Monthly Energy Use - % Versus Expected/Actual (Areas)

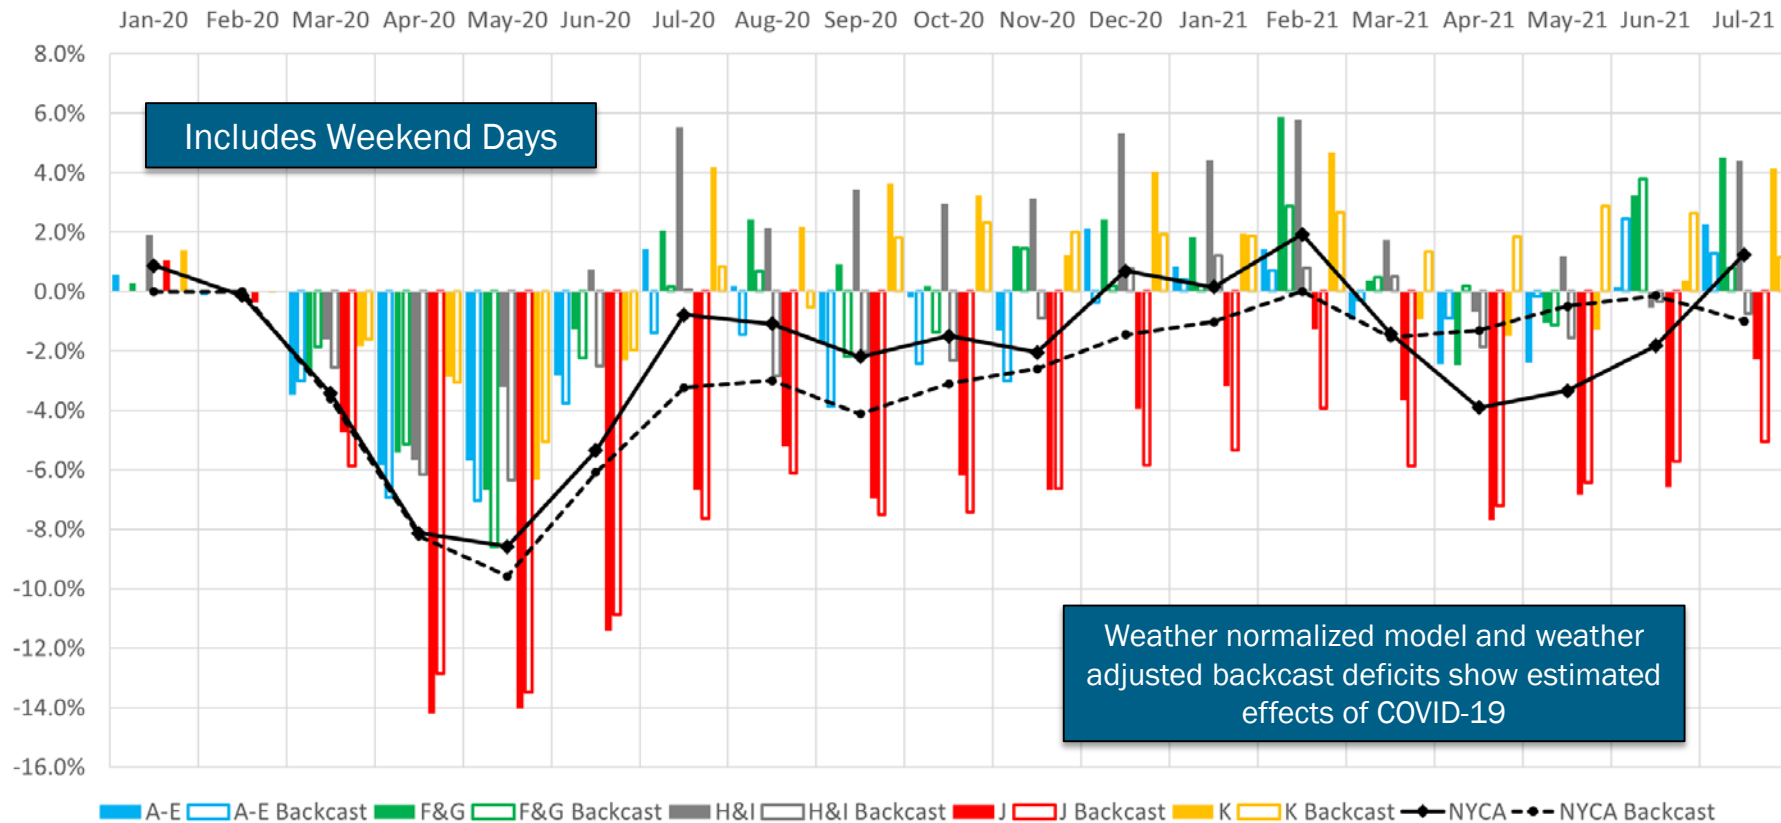

Model Explanation - Impacts on Daily Energy by Month

Actual Difference

- Equals: Actual Load – Expected Load
- Expected Load is the pre-COVID baseline annual load forecast, shared out on a daily basis using the 10-year history of daily weather-normalized energy
- This difference reflects the total change in load relative to expected levels, including weather, economic, virus, and any other impacts

Weather Normalized Difference


- Equals: Weather Normalized Load – Expected Load
- Weather Normalized Load is calculated via Zonal models regressing daily energy against daily weather variables and binaries. These models estimate what the load would have been on a given date under normal weather conditions
- These models are fit through the most recent 12 months of data and have recent weather response signals.
- Expected Load is equivalent to that defined in the Actual Difference calculation
- This difference reflects non-weather driven changes in load levels, including economic, virus, and other impacts. The comparison is weather neutral as normal weather is used on both sides of the comparison

Weather Adjusted Backcast Difference

- Equals: Actual Load - Backcast Load
- Backcast Load is the load generated by the Zonal hourly day-ahead models using actual weather, where the model estimation period ends in February 2020. Thus, these backcasts estimate what the load would have been on a given day under pre-COVID conditions
- These models were fit through February 2020, so they do not contain the most recent weather response signals
- This difference reflects non-weather driven changes in load levels, including economic, virus, and other impacts. The comparison is weather neutral as actual weather is used on both sides of the comparison


Regional Impacts on Peak Demand

2020-2021 Backcast Peaks - % Versus Actual (Areas)

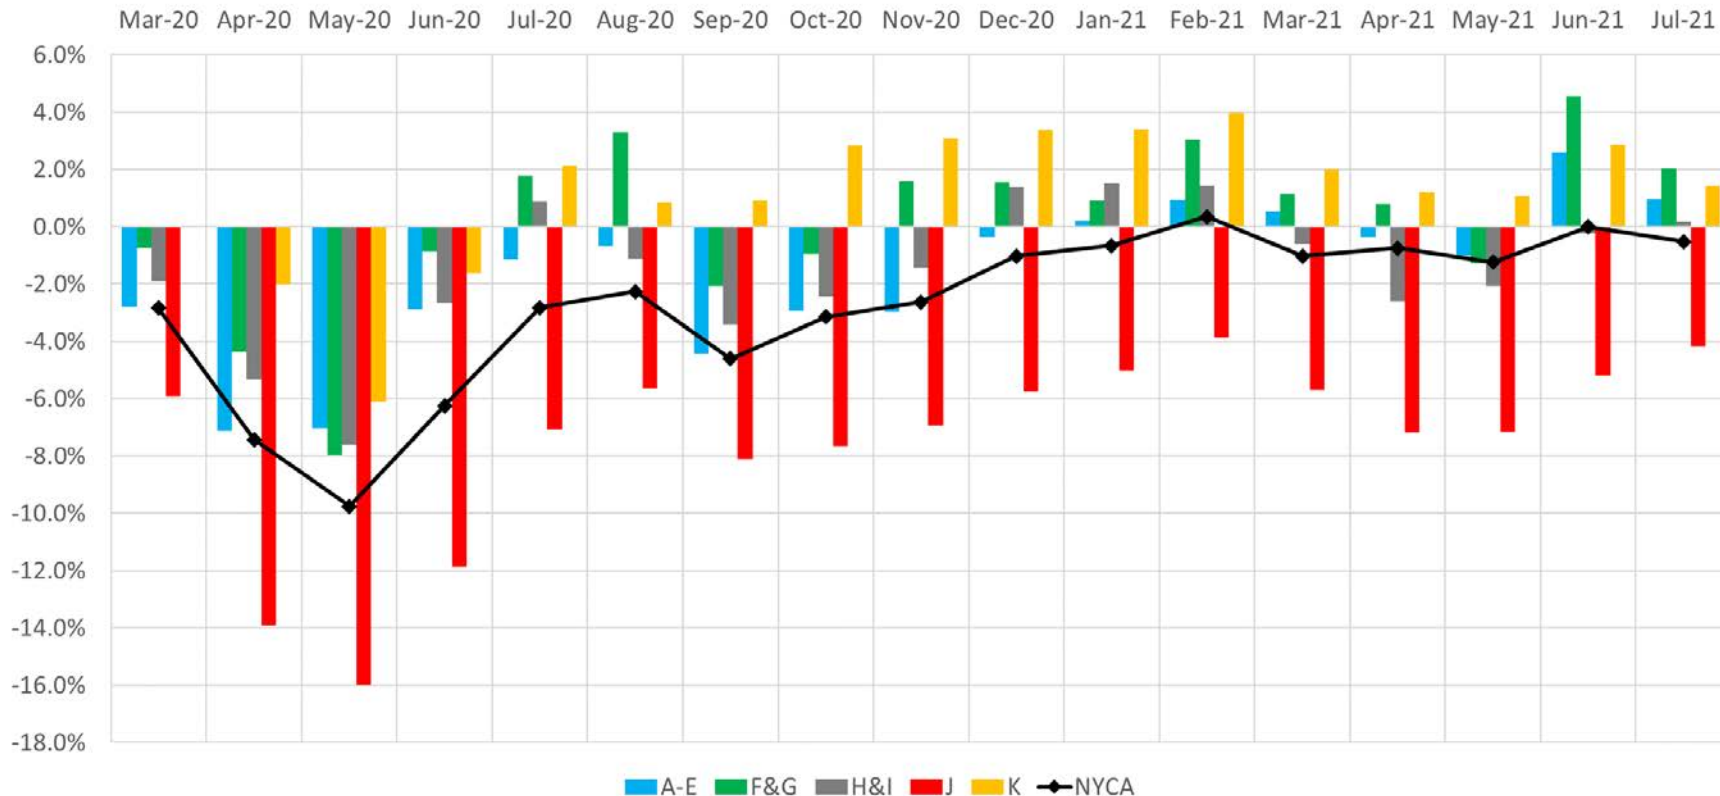


Impacts on Hourly Load Patterns by Month


NYCA Load Profile - Weekday Diurnal Load Changes

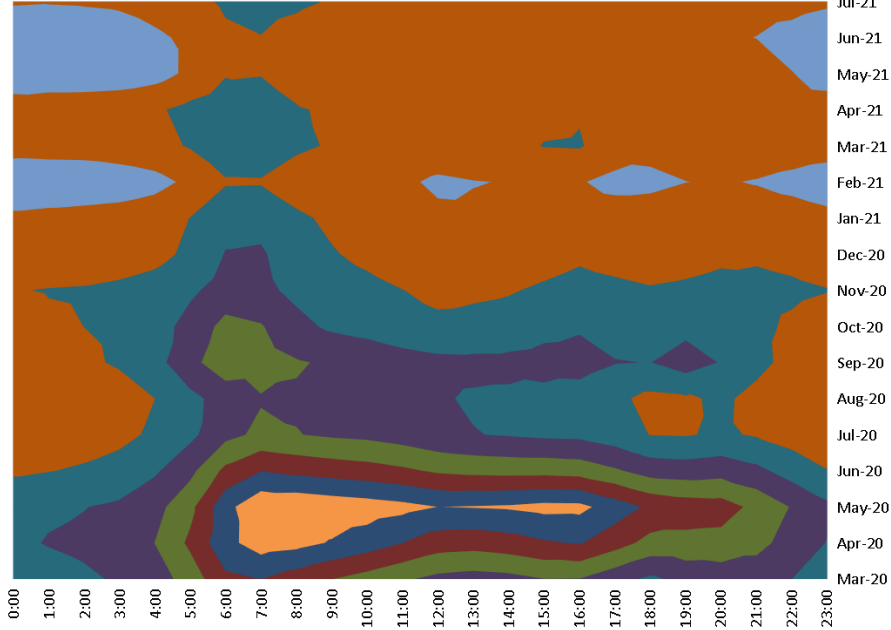

Zone J (NYC) Load Profile - Weekday Diurnal Load Changes

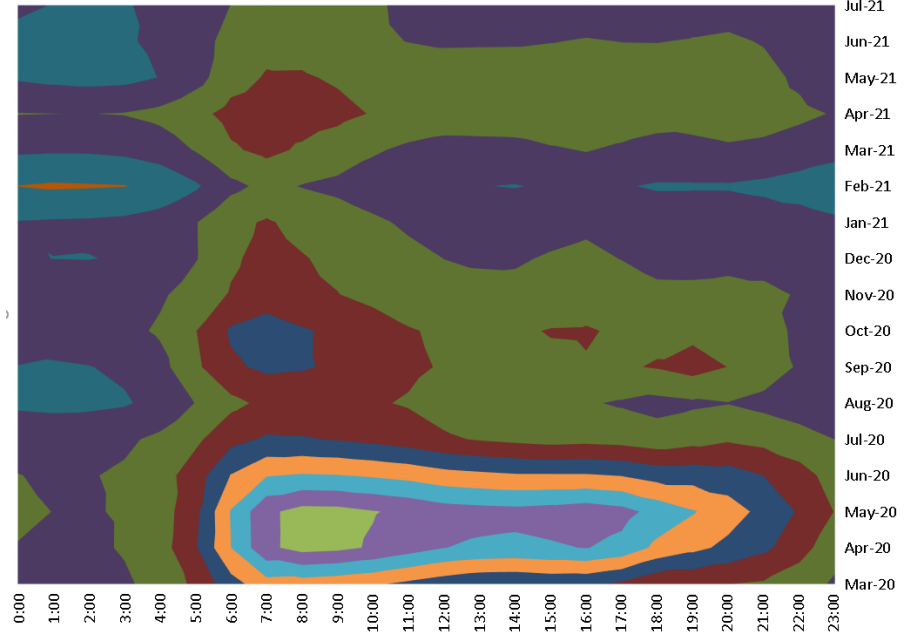


% Difference from Expected

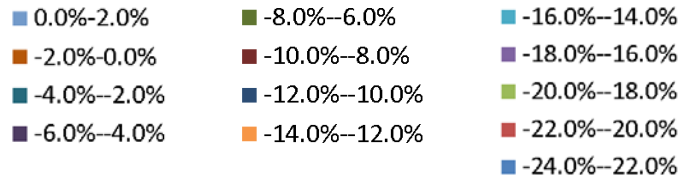


Impacts on Hourly Load Patterns by Week (2021)

NYCA Load Profile - Weekday Diurnal Load Changes

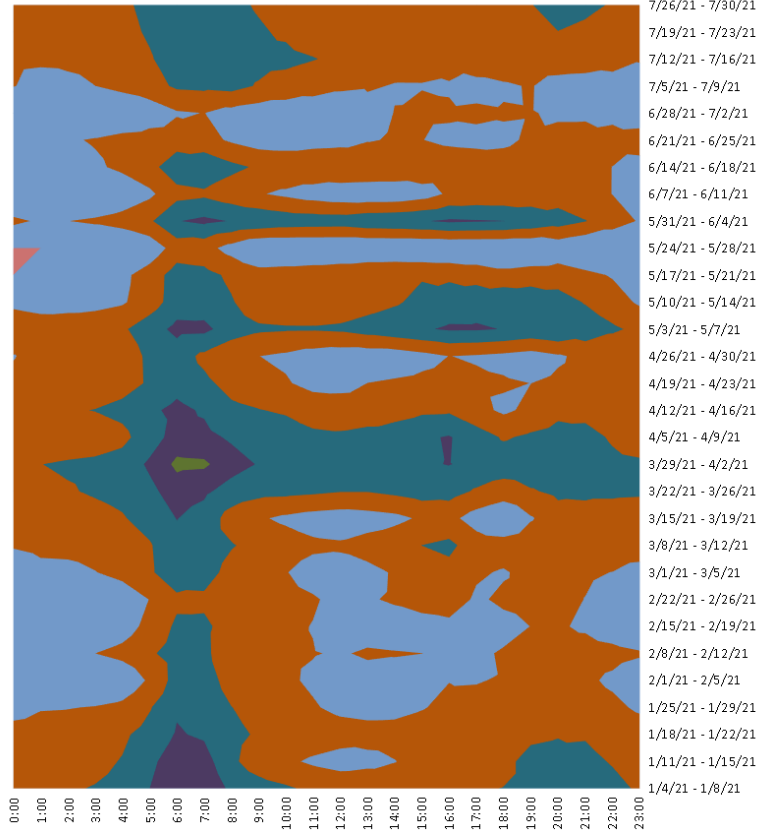


- 0.0%-2.0%
- 2.0%-0.0%
- 4.0%--2.0%
- 6.0%--4.0%
- 8.0%--6.0%
- 10.0%--8.0%
- 12.0%--10.0%
- 14.0%--12.0%
- 16.0%--14.0%
- 18.0%--16.0%
- 20.0%--18.0%
- 22.0%--20.0%
- 24.0%--22.0%

Zone J (NYC) Load Profile - Weekday Diurnal Load Changes

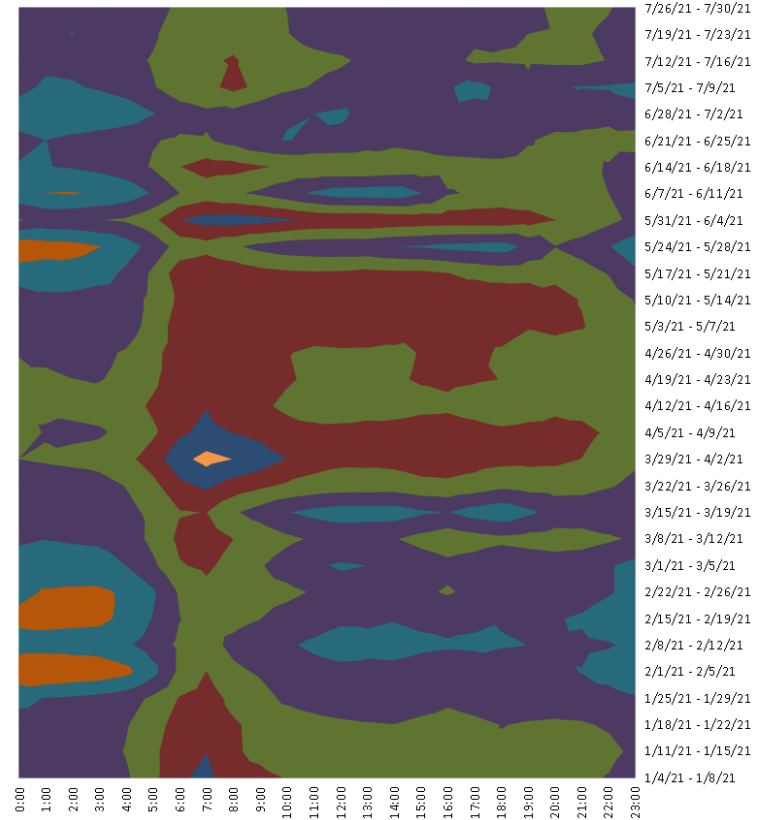


Impacts on Hourly Load Patterns by Week (2020)

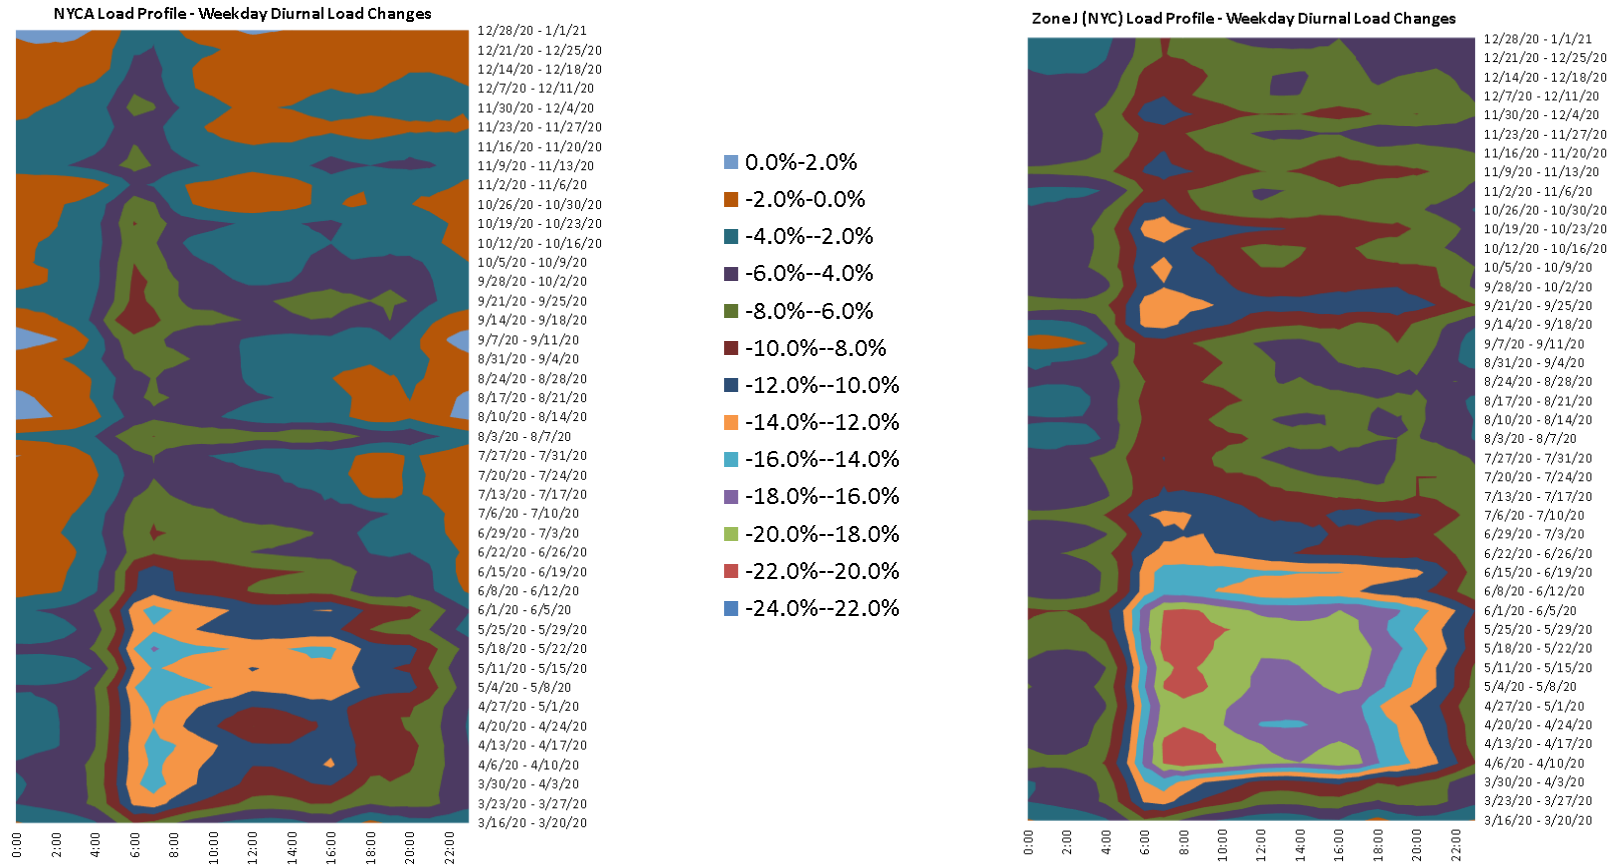

Impacts on Hourly Load Patterns (Area)

Average Hourly Deviation from Expected by Area, 6/1 through 7/30 (Weekdays)

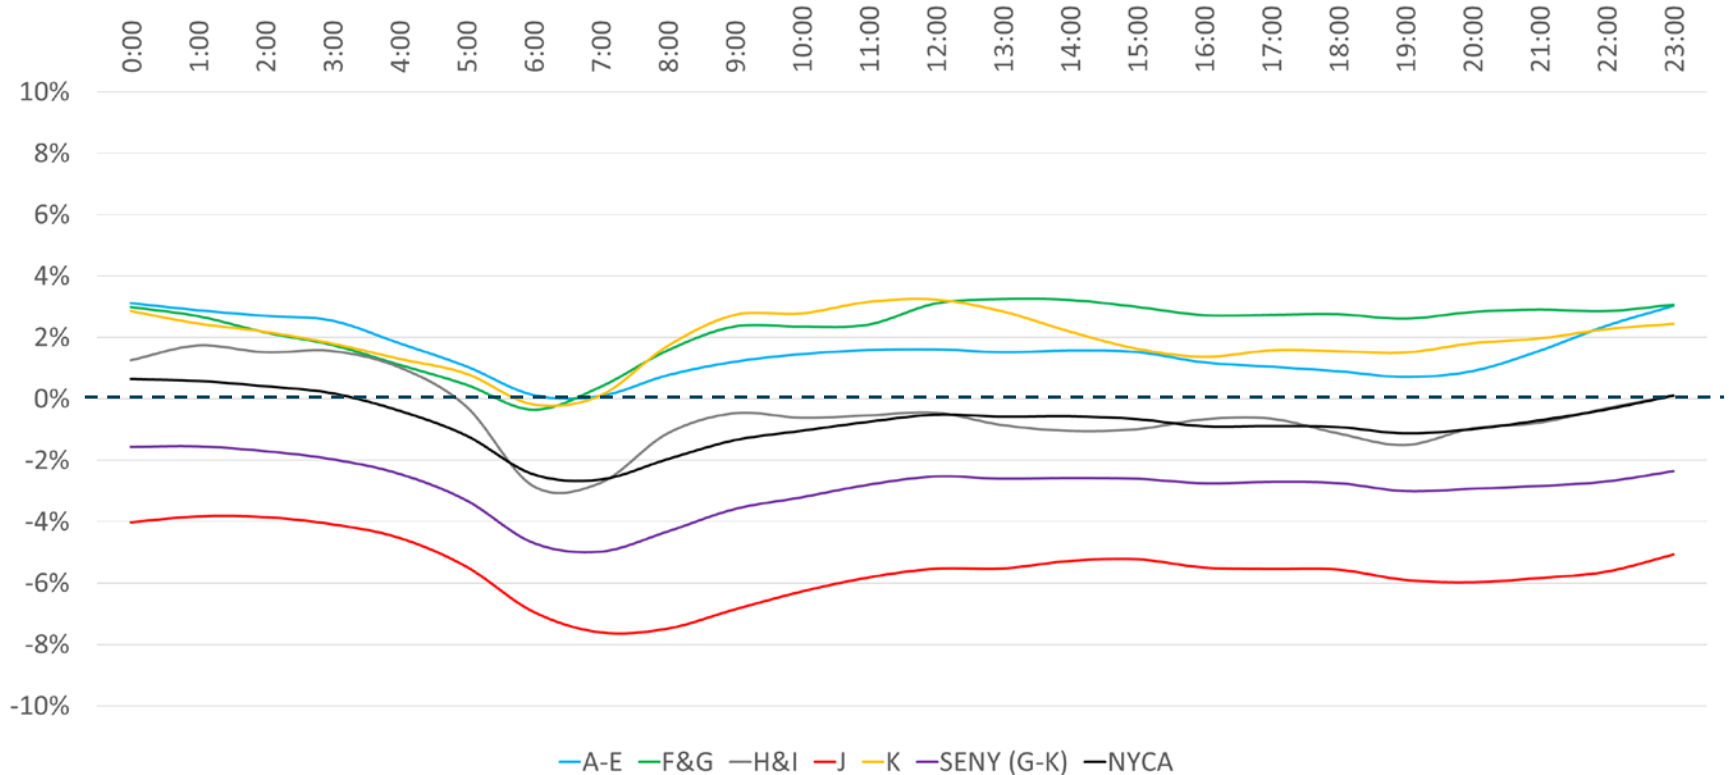

Questions/Discussion

Impacts on Hourly Load Patterns (Area)

Hour	A-E	F&G	H&I	J	K	SENY (G-K)	NYCA
0:00	3%	3%	1%	-4%	3%	-2%	1%
1:00	3%	3%	2%	-4%	2%	-2%	1%
2:00	3%	2%	2%	-4%	2%	-2%	0%
3:00	3%	2%	2%	-4%	2%	-2%	0%
4:00	2%	1%	1%	-5%	1%	-2%	0%
5:00	1%	0%	0%	-5%	1%	-3%	-1%
6:00	0%	0%	-3%	-7%	0%	-5%	-2%
7:00	0%	0%	-3%	-8%	0%	-5%	-3%
8:00	1%	2%	-1%	-7%	2%	-4%	-2%
9:00	1%	2%	0%	-7%	3%	-4%	-1%
10:00	1%	2%	-1%	-6%	3%	-3%	-1%
11:00	2%	2%	-1%	-6%	3%	-3%	-1%
12:00	2%	3%	0%	-6%	3%	-3%	-1%
13:00	2%	3%	-1%	-6%	3%	-3%	-1%
14:00	2%	3%	-1%	-5%	2%	-3%	-1%
15:00	2%	3%	-1%	-5%	2%	-3%	-1%
16:00	1%	3%	-1%	-6%	1%	-3%	-1%
17:00	1%	3%	-1%	-6%	2%	-3%	-1%
18:00	1%	3%	-1%	-6%	2%	-3%	-1%
19:00	1%	3%	-2%	-6%	2%	-3%	-1%
20:00	1%	3%	-1%	-6%	2%	-3%	-1%
21:00	2%	3%	-1%	-6%	2%	-3%	-1%
22:00	2%	3%	0%	-6%	2%	-3%	0%
23:00	3%	3%	0%	-5%	2%	-2%	0%

Average Hourly
Load Deficit
By Area
6/1 - 7/30
(Weekdays)

Impacts on Hourly Load Patterns (Zone)

Hour	A	B	C	D	E	F	G	H	I	J	K
0:00	4%	5%	0%	1%	7%	5%	0%	0%	2%	-4%	3%
1:00	4%	5%	1%	-2%	7%	5%	0%	0%	3%	-4%	2%
2:00	4%	5%	0%	-3%	7%	4%	0%	-1%	2%	-4%	2%
3:00	5%	4%	0%	-3%	6%	4%	-1%	-1%	3%	-4%	2%
4:00	4%	3%	0%	-3%	5%	3%	-1%	-1%	2%	-5%	1%
5:00	3%	2%	-1%	-3%	4%	2%	-2%	-3%	1%	-5%	1%
6:00	2%	1%	-2%	-3%	3%	1%	-2%	-5%	-2%	-7%	0%
7:00	2%	1%	-2%	-4%	4%	2%	-2%	-4%	-2%	-8%	0%
8:00	2%	1%	-2%	-2%	7%	3%	-1%	-2%	-1%	-7%	2%
9:00	2%	1%	-2%	-1%	8%	4%	0%	0%	-1%	-7%	3%
10:00	2%	2%	-2%	1%	9%	5%	0%	0%	-1%	-6%	3%
11:00	3%	2%	-2%	1%	9%	5%	0%	0%	-1%	-6%	3%
12:00	3%	2%	-2%	0%	9%	6%	0%	0%	-1%	-6%	3%
13:00	3%	2%	-2%	-1%	8%	6%	0%	-1%	-1%	-6%	3%
14:00	3%	3%	-2%	-2%	8%	6%	0%	-1%	-1%	-5%	2%
15:00	3%	3%	-2%	-3%	8%	5%	1%	0%	-1%	-5%	2%
16:00	2%	3%	-2%	-4%	7%	5%	1%	-1%	-1%	-6%	1%
17:00	2%	3%	-1%	-5%	6%	5%	1%	-1%	-1%	-6%	2%
18:00	2%	3%	-1%	-4%	5%	5%	1%	-2%	-1%	-6%	2%
19:00	1%	3%	-1%	-6%	5%	5%	0%	-2%	-1%	-6%	2%
20:00	1%	3%	-1%	-5%	5%	5%	1%	-3%	0%	-6%	2%
21:00	1%	3%	0%	-2%	6%	5%	0%	-3%	0%	-6%	2%
22:00	3%	4%	0%	2%	6%	5%	0%	-3%	1%	-6%	2%
23:00	3%	5%	0%	5%	6%	6%	0%	-2%	1%	-5%	2%

Average Hourly Load Deficit by Zone, 6/1 - 7/30 (Weekdays)

Our mission, in collaboration with our stakeholders, is to serve the public interest and provide benefit to consumers by:

- Maintaining and enhancing regional reliability
- Operating open, fair and competitive wholesale electricity markets
- Planning the power system for the future
- Providing factual information to policymakers, stakeholders and investors in the power system

