



Monthly Report

January 2012

Rick Gonzales
Rana Mukerji
Robert Fernandez

TABLE OF CONTENTS

- Operations Performance Metrics Report
- Market Operation's Report
- Daily Loads
- Project Status Report
- Regulatory Filings

Operations Performance Metrics Monthly Report



January 2012 Report

**Operations & Reliability Department
New York Independent System Operator**

Prepared by NYISO Operations Analysis and Services, based on settlements initial invoice data collected on or before February 8, 2012.


Table of Contents

- ◆ **Highlights**
 - Operations Performance
- ◆ **Reliability Performance Metrics**
 - Alert State Declarations
 - Major Emergency State Declarations
 - IROL Exceedance Times
 - Balancing Area Control Performance
 - Reserve Activations
 - Disturbance Recovery Times
 - Load Forecasting Performance
 - Wind Forecasting Performance
 - Lake Erie Circulation and ISO Schedules
- ◆ **Market Performance Metrics**
 - RTM Congestion Residuals Monthly Trend
 - RTM Congestion Residuals Daily Costs
 - RTM Congestion Residuals Event Summary
 - RTM Congestion Residuals Cost Categories
 - DAM Congestion Residuals Monthly Trend
 - DAM Congestion Residuals Daily Costs
 - DAM Congestion Residuals Cost Categories
 - NYCA Unit Uplift Components Monthly Trend
 - NYCA Unit Uplift Components Daily Costs
 - Local Reliability Costs Monthly Trend & Commitment Hours
 - ICAP Spot Market Clearing Price
 - UCAP Awards


January 2012 Operations Performance Highlights

- Peak load of 23,901 MW occurred on 1/3/2012 HB 17
- All-time winter capability period peak load of 25,541 MW occurred on 12/20/2004 HB 17
- 0 hours of Thunder Storm Alerts were declared.
- **Average Lake Erie Loop Flows are near zero**
 - 24 hours of NERC TLR level 3 curtailments

Reliability Performance Metrics

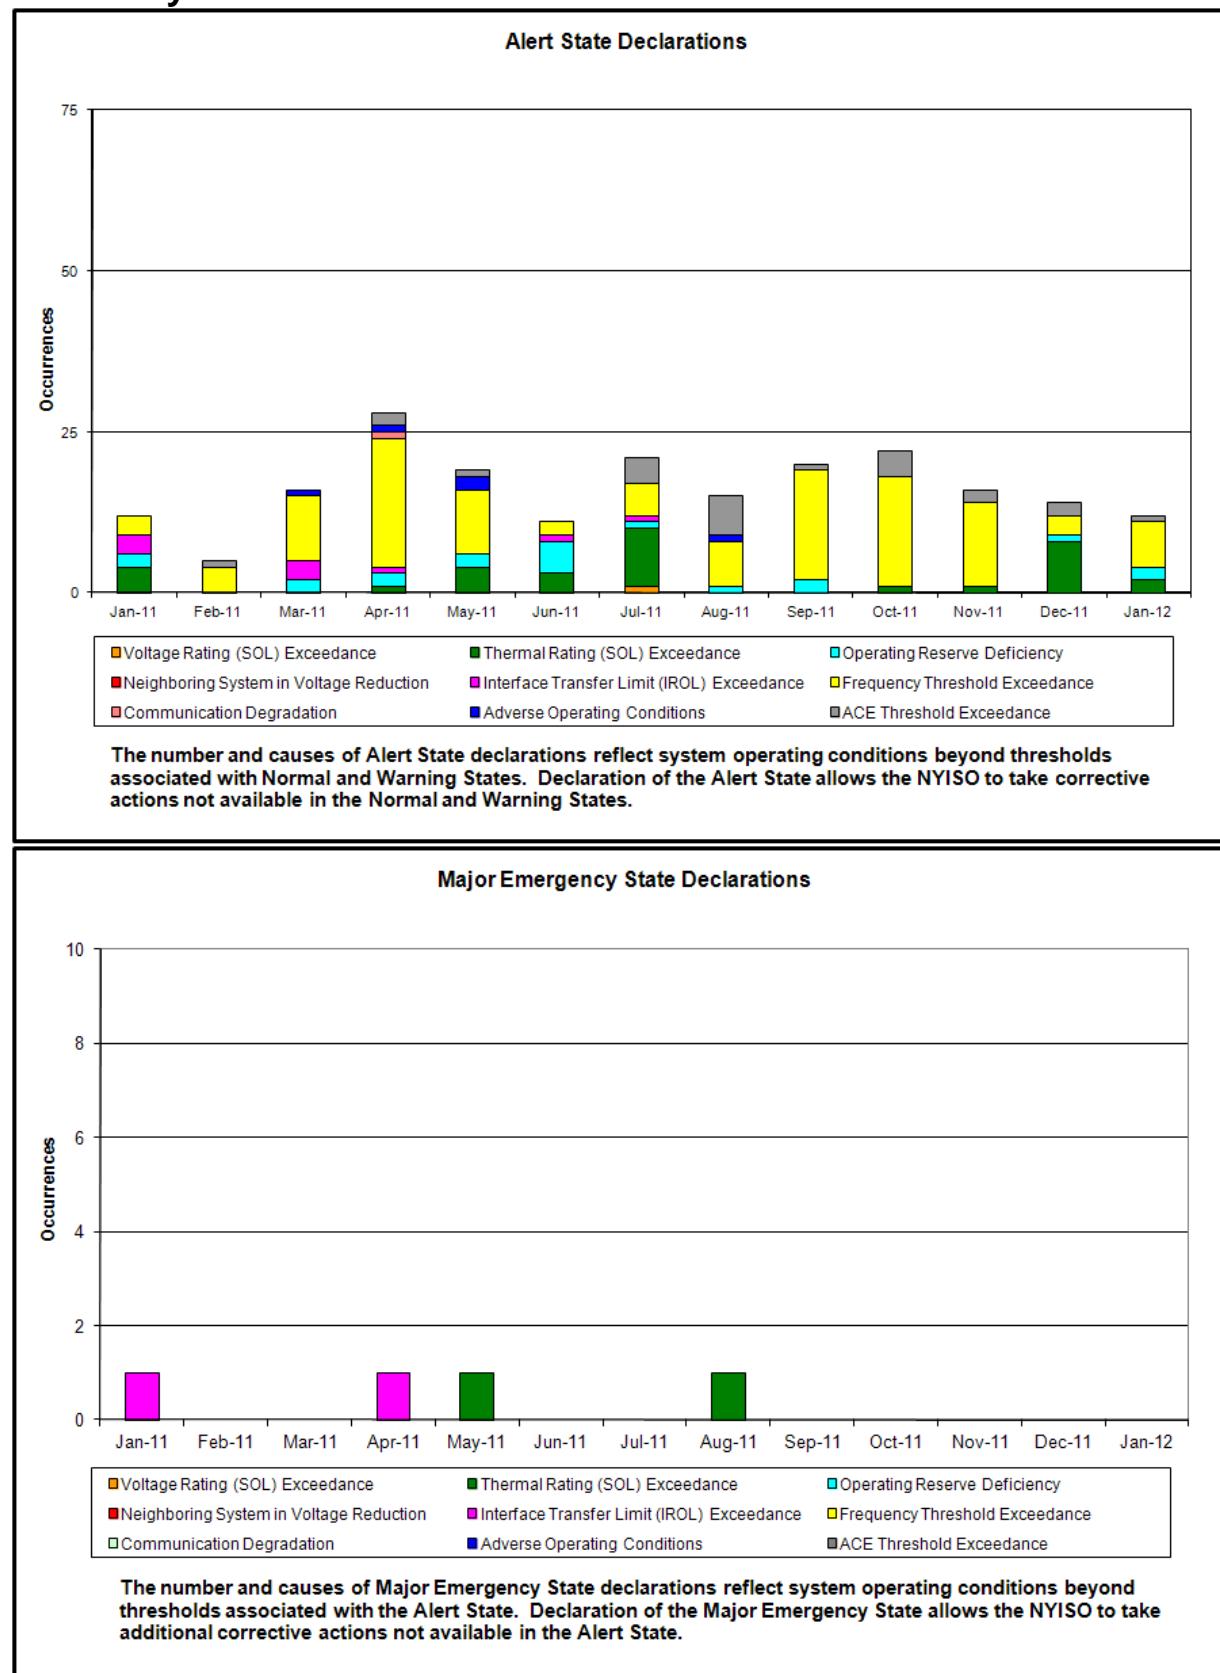


NERC IROL Time Over Limit

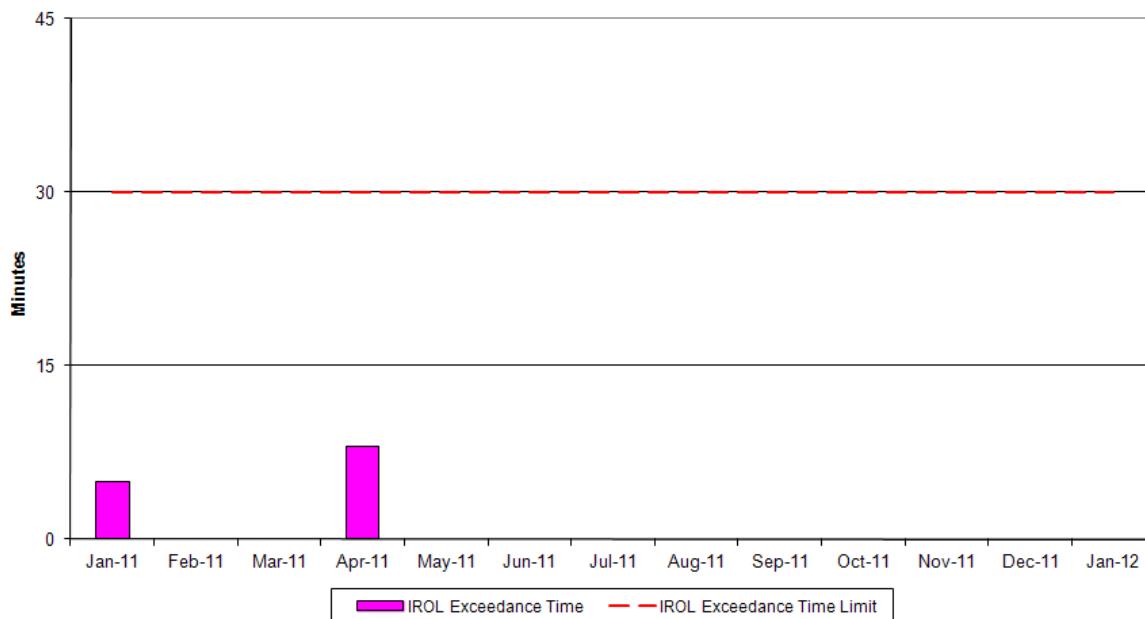


For IROL exceedances leading to Major Emergency State declarations, the maximum IROL exceedence time is identified. IROL exceedances of less than thirty minutes are considered NERC compliant.

NERC Control Performance Standards

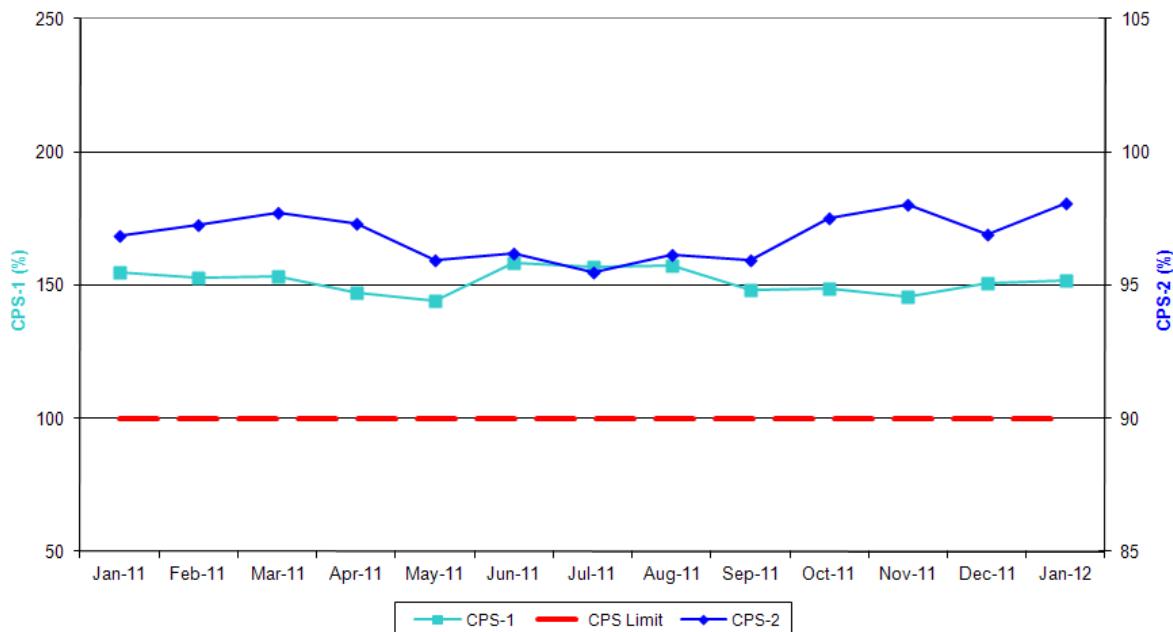


The values of NERC Control Performance Standards (CPS-1 and CPS-2) are indicators of the NYISO Area resource and demand balancing. Values exceeding the identified thresholds are NERC compliant.

Reserve Activations


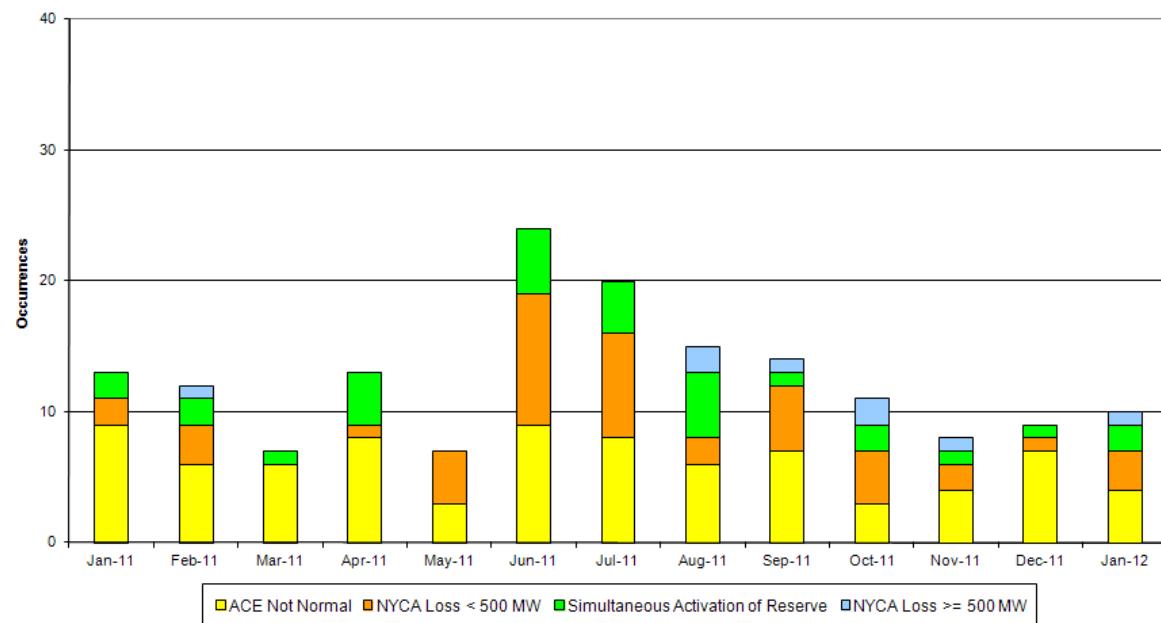




NYISO Reserve Activations are indicators of the need to respond to unexpected operational conditions within the NYISO Area or to assist a neighboring Area (Shared Activation of Reserves) by activating an immediate resource and demand balancing operation.


DCS Event Time to ACE Recovery


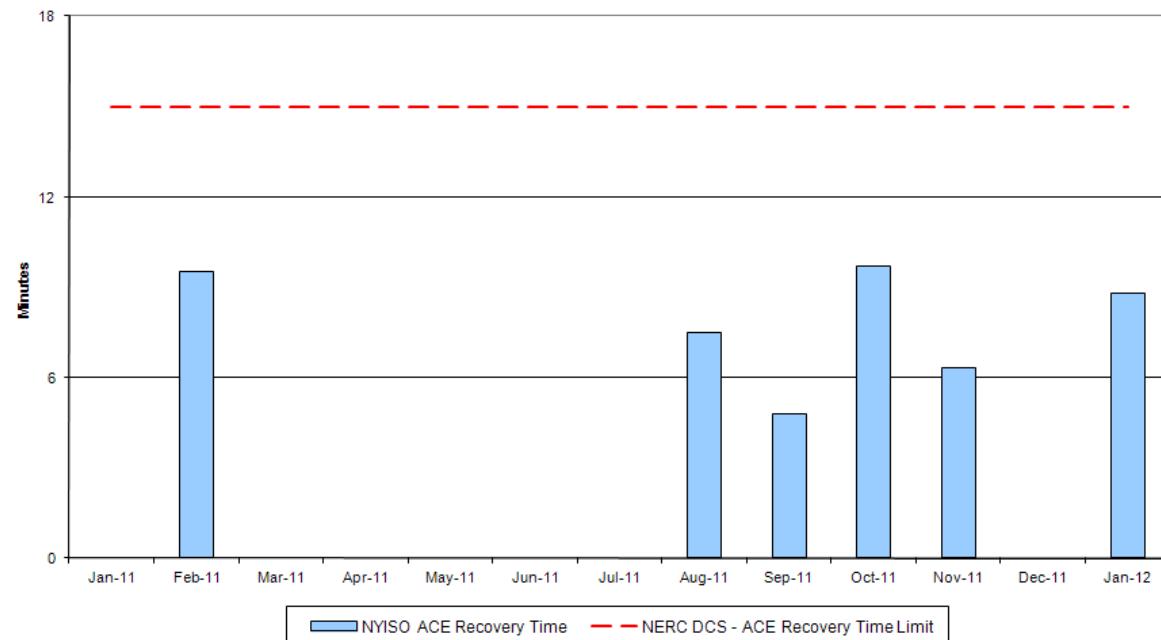


For NYISO initiated Reportable Disturbances, the maximum ACE recovery time is identified. Recovery times of less than 15 minutes are considered NERC compliant.

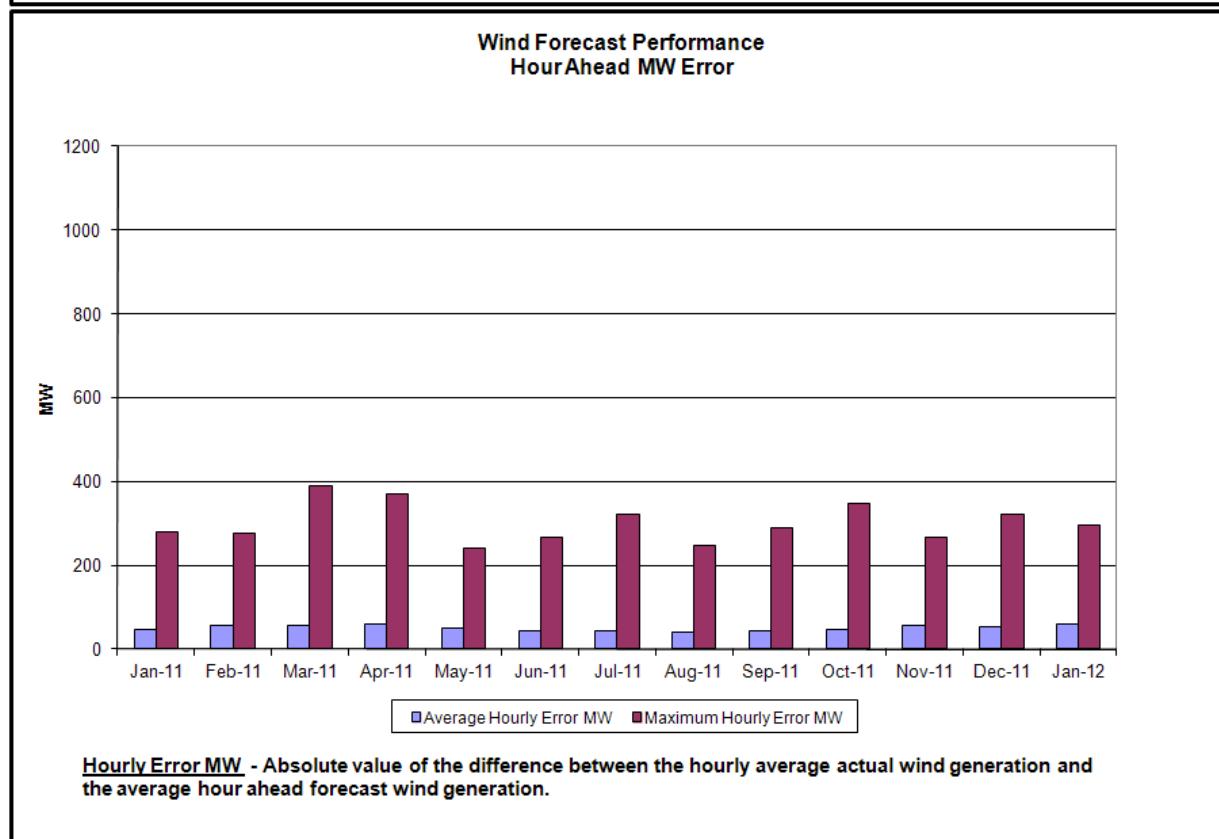
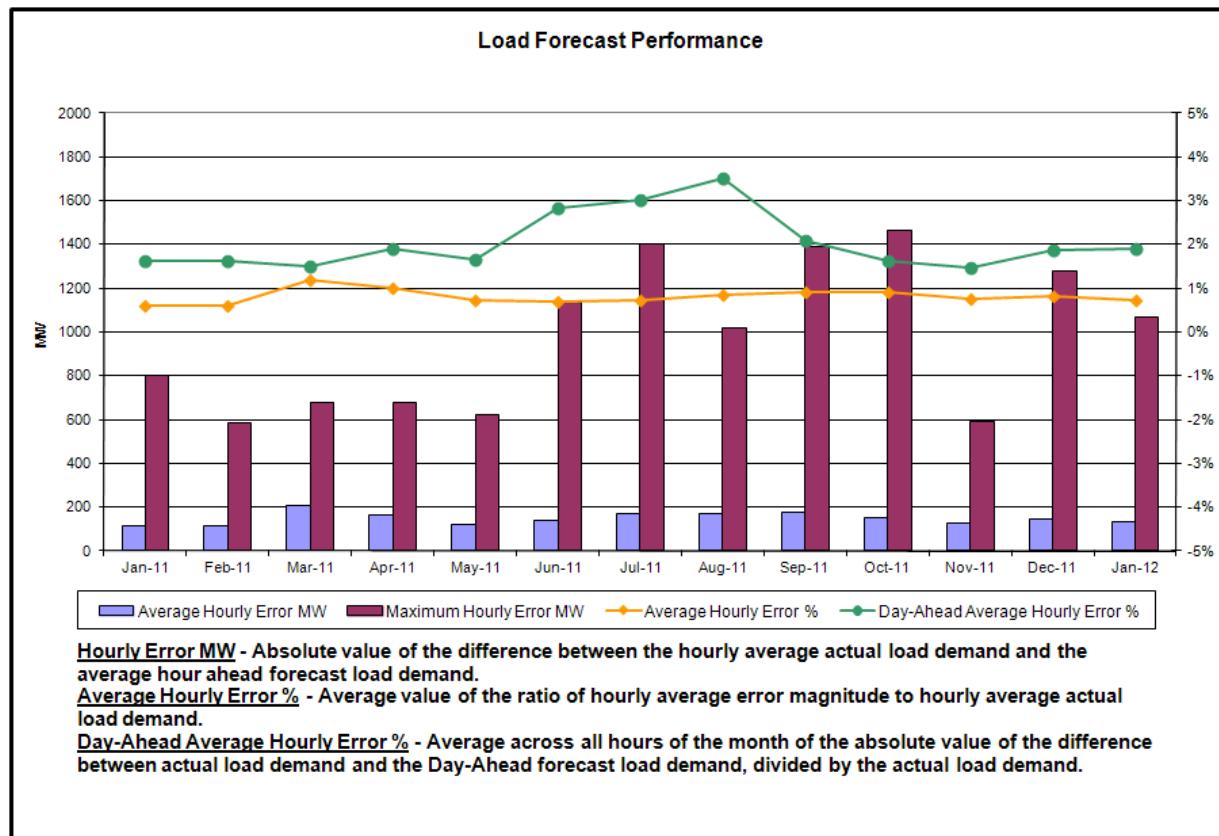


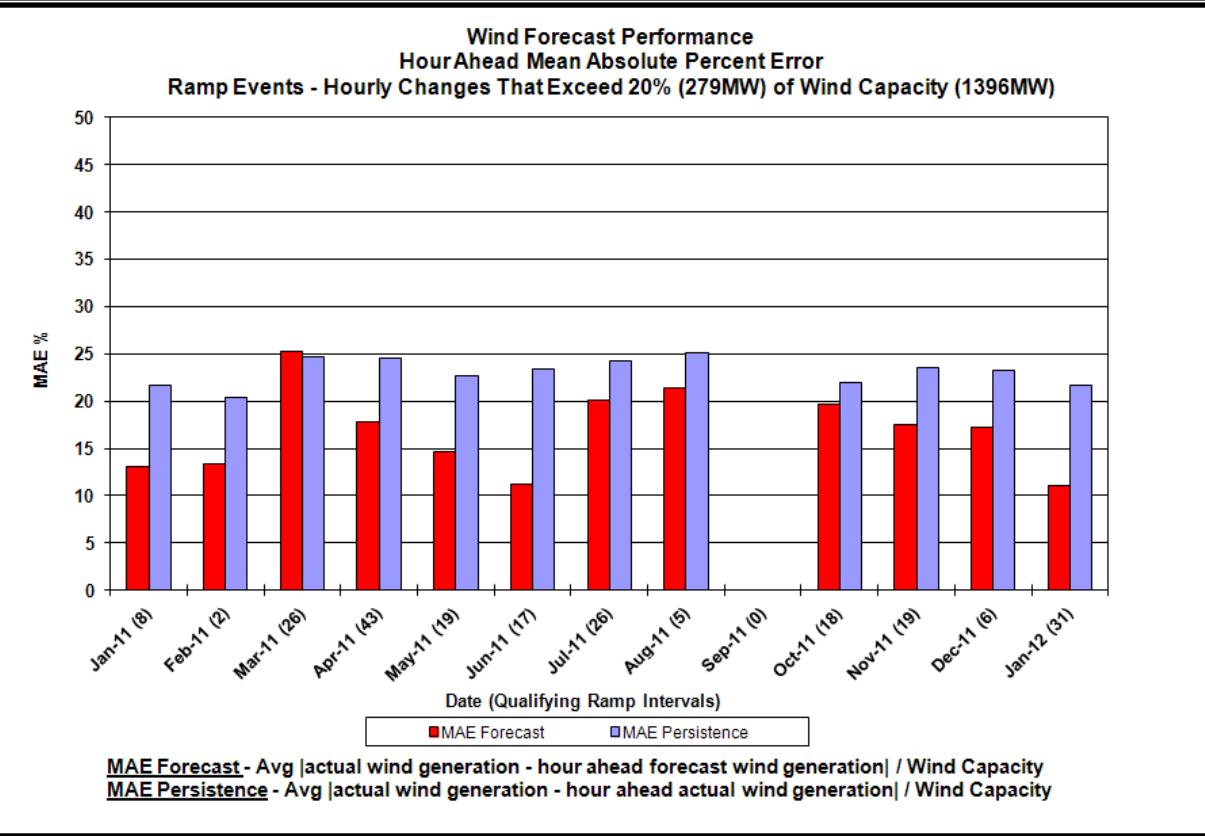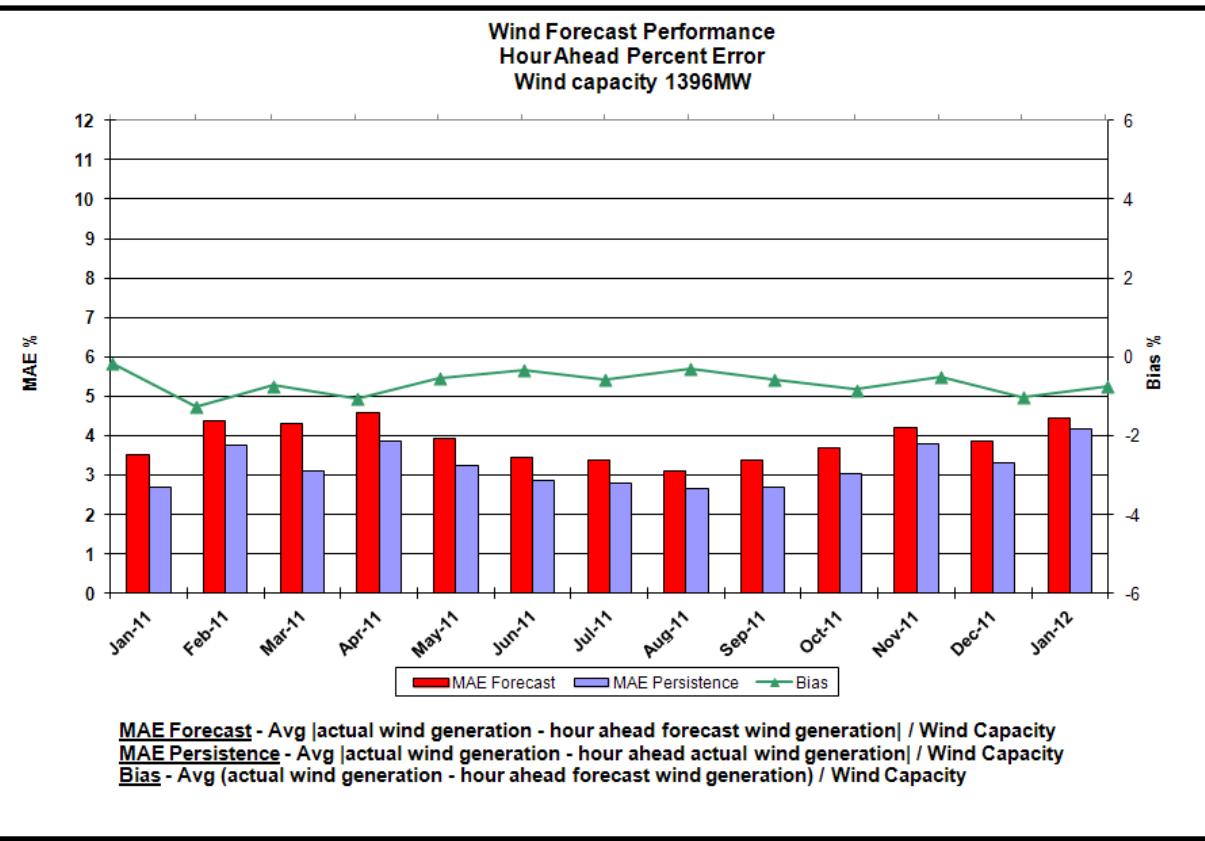

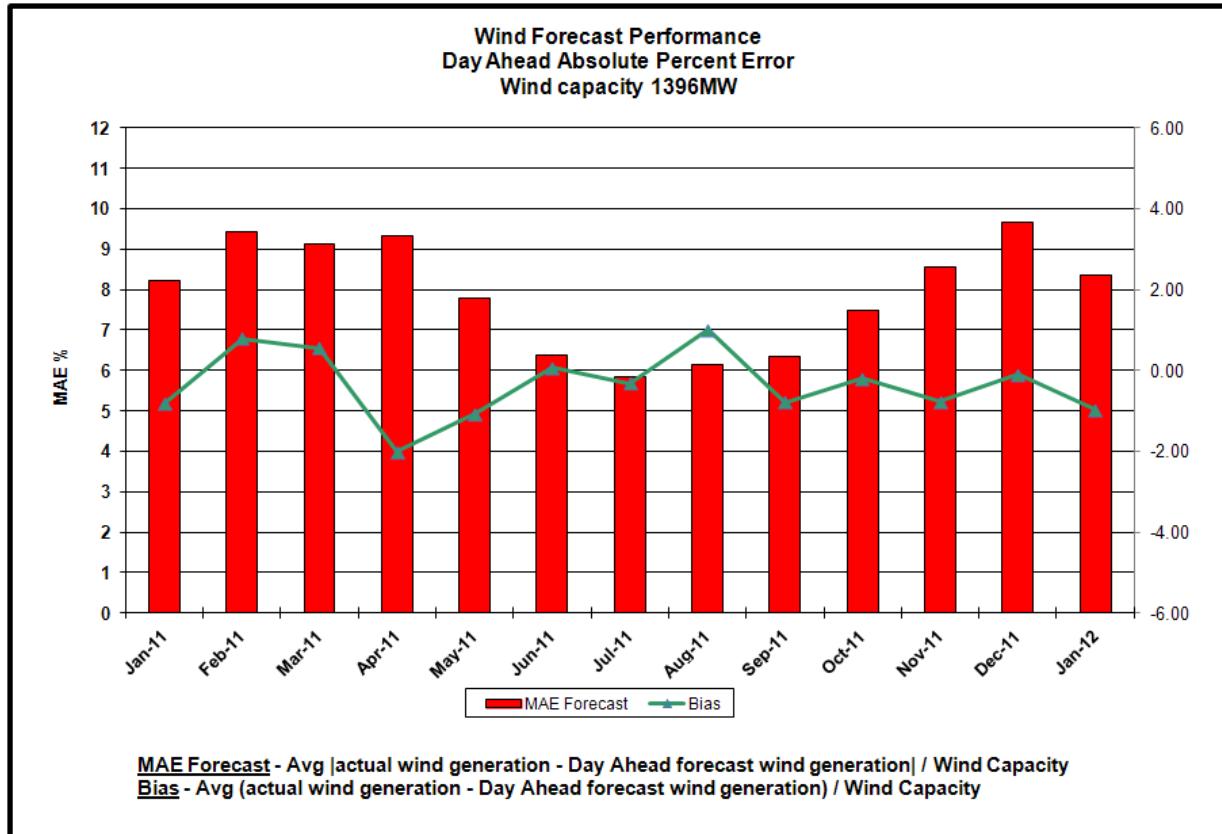

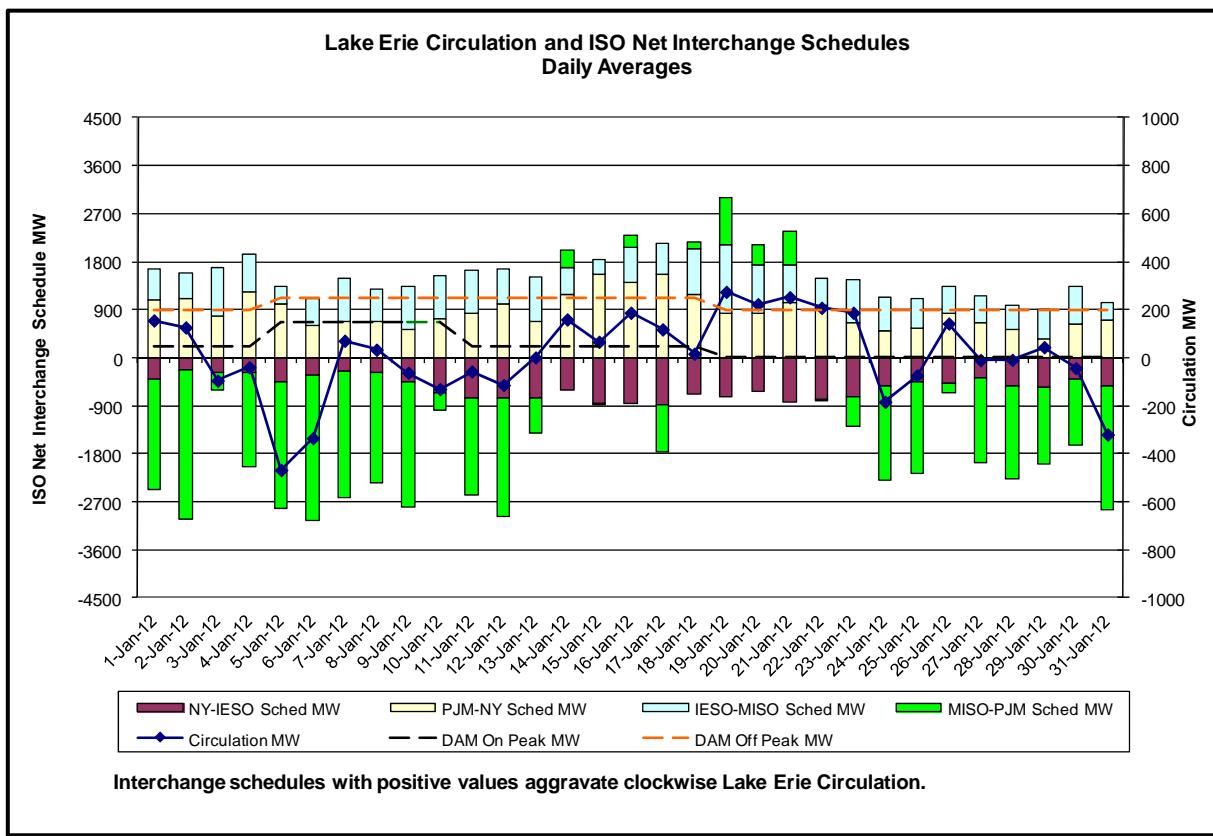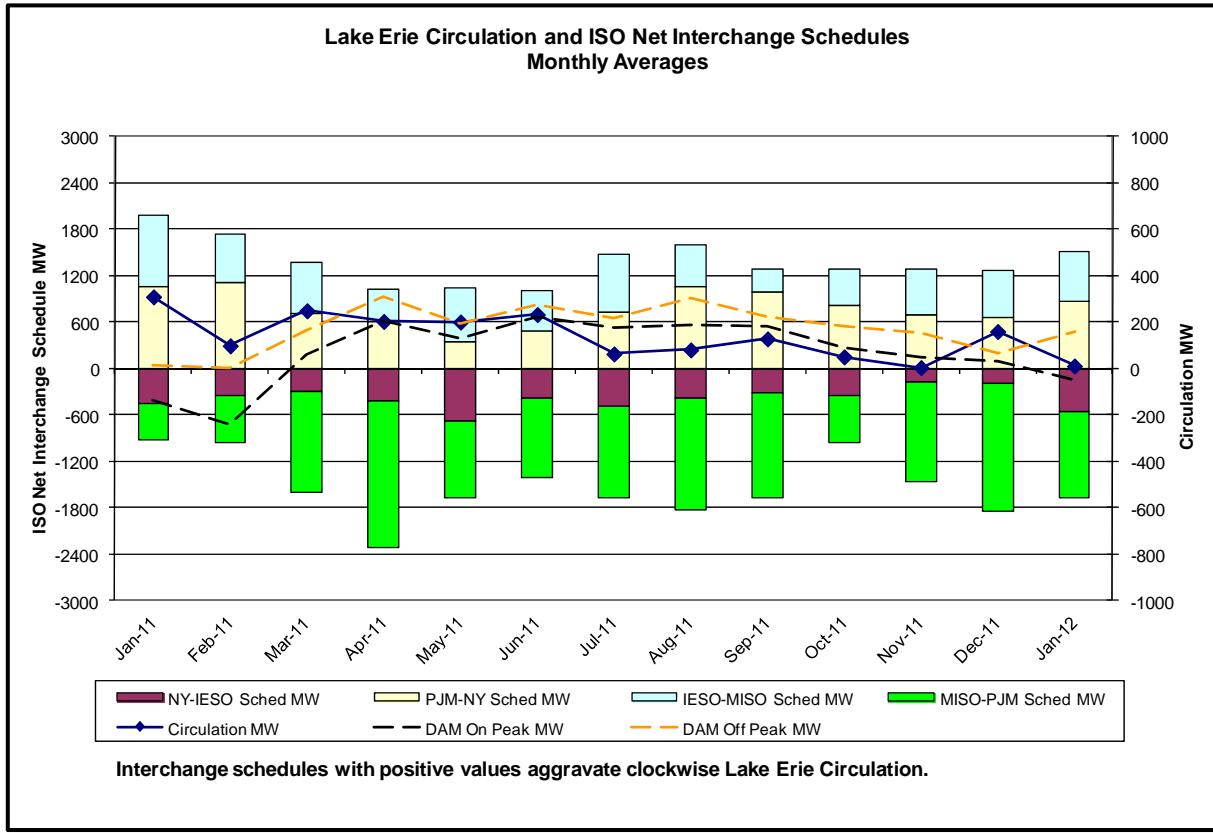

Market Performance Metrics

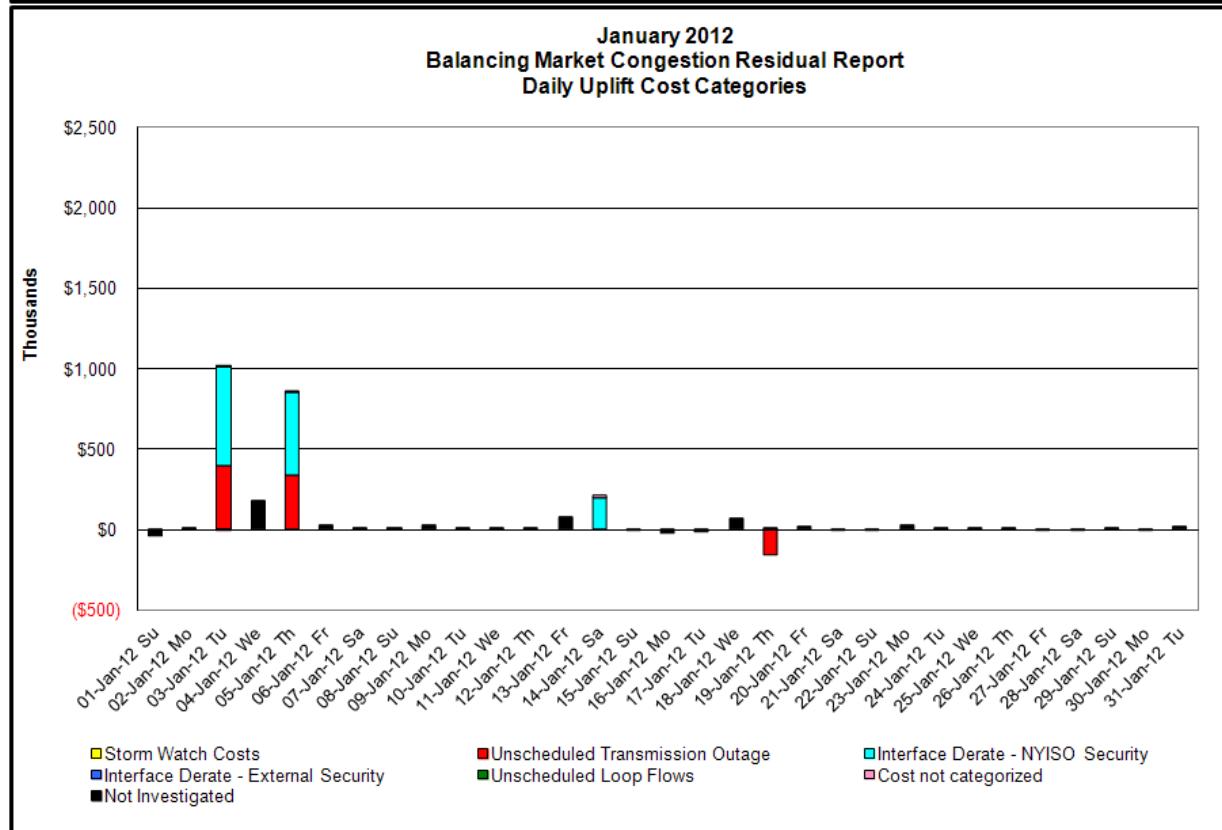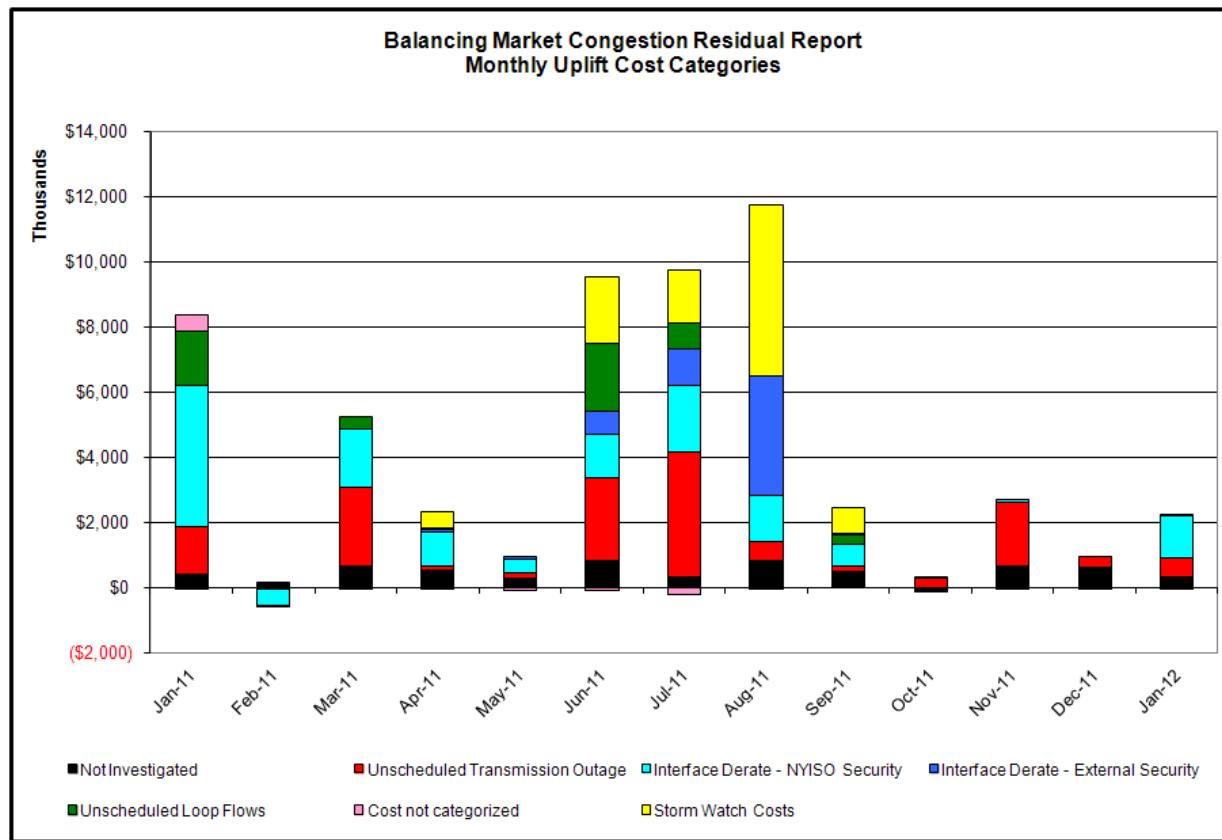

Day's investigated in January: 3,5,14,19			
Event	Date (yyyy)	Hours	Description
1/3/2012		15-16	Forced outage Farragut-Hudson 345kV (#B3402)
1/3/2012		2,6,7,22,23	NYCA DNI Ramp Limit
1/3/2012		13,14	Derate Astoria West/Queensbridge/Vermont
1/3/2012		20	Derate Fox Hills-Willow Brook 138kV (#29212) for I/o Fox Hills-Willow Brook 138kV (#29211)
1/3/2012		11-15,20,21	Derate GowanusS-Greenwood 138kV (#42232)
1/3/2012		11-16,18-21	Derate Scriba-Volney 345kV (#21) for I/o Clay-Independence 345kV (#26)
1/3/2012		18,22	PJM_AC DNI Ramp Limit
1/3/2012		6	IESO_AC DNI Ramp Limit
1/5/2012		8-16,22	Forced outage of Farragut PAR (#TR11) tap changer
1/5/2012		8,22	Derate GowanusS-Greenwood 138kV (#42232)
1/5/2012		16-20	Derate Greenwood/Staten Island
1/5/2012		8,20,21	Derate Vernon-Kent Ave. 138kV (#31232) for I/o SCB:Goethals (1N)
1/5/2012		8,11,12,14-16,20-22	Derate Vernon-Kent Ave. 138kV (#31232) for I/o TWR:Goethals
1/5/2012		8-21	Derate Scriba-Volney 345kV (#21) for I/o Clay-Independence 345kV (#26)
1/14/2012		17-21	Derate Greenwood/Staten Island
1/14/2012		21	Derate GowanusS-Greenwood 138kV (#42232)
1/14/2012		0	NYCA DNI Ramp Limit
1/19/2012		6-19	Forced outage of Neptune


Real-Time Balancing Market Congestion Residual (Uplift Cost) Categories

<u>Category</u>	<u>Cost Assignment</u>	<u>Events Types</u>	<u>Event Examples</u>
Storm Watch	Zone J	Thunderstorm Alert (TSA)	TSA Activations
Unscheduled Transmission Outage	Market-wide	Reduction in DAM to RTM transfers related to unscheduled transmission outage	Forced Line Outage, Unit AVR Outages
Interface Derate - NYISO Security	Market-wide	Reduction in DAM to RTM transfers not related to transmission outage	Interface Derates due to RTM voltages
Interface Derate - External Security	Market-wide	Reduction in DAM to RTM transfers related to External Control Area Security Events	TLR Events, External Transaction Curtailments
Unscheduled Loop Flows	Market-wide	Changes in DAM to RTM unscheduled loop flows impacting NYISO Interface transmission constraints	DAM to RTM Clockwise Lake Erie Loop Flows greater than 125 MW


Monthly Balancing Market Congestion Report Assumptions/Notes

- 1) Storm Watch Costs are identified as daily total uplift costs
- 2) At a minimum those days with \$ 100 K/HR, shortfall of \$ 200 K/Day or more, or surplus of \$ 100 K/Day or more are investigated
- 3) Uplift costs associated with multiple event types are apportioned equally by hour
- 4) Investigations began with Dec 2008. Prior months are reported as Not Investigated.

**DAM Congestion Residual Report
Monthly Cost Categories**

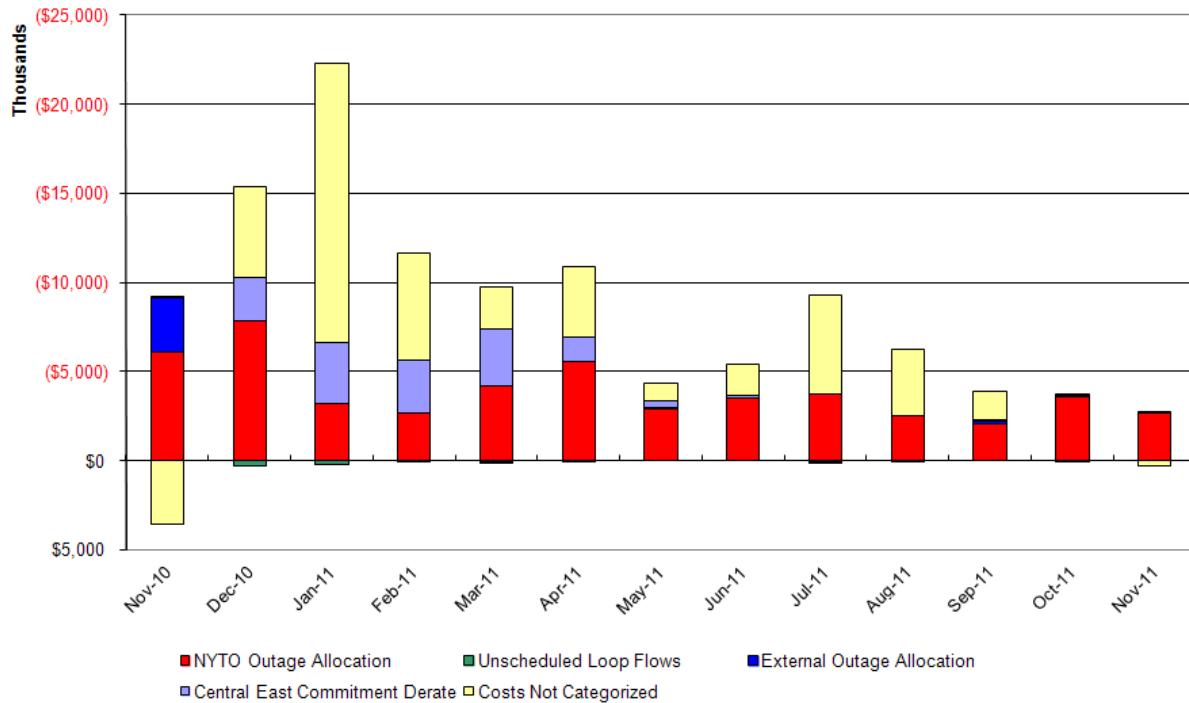


**November 2011
DAM Congestion Residual Report
Daily Cost Categories**

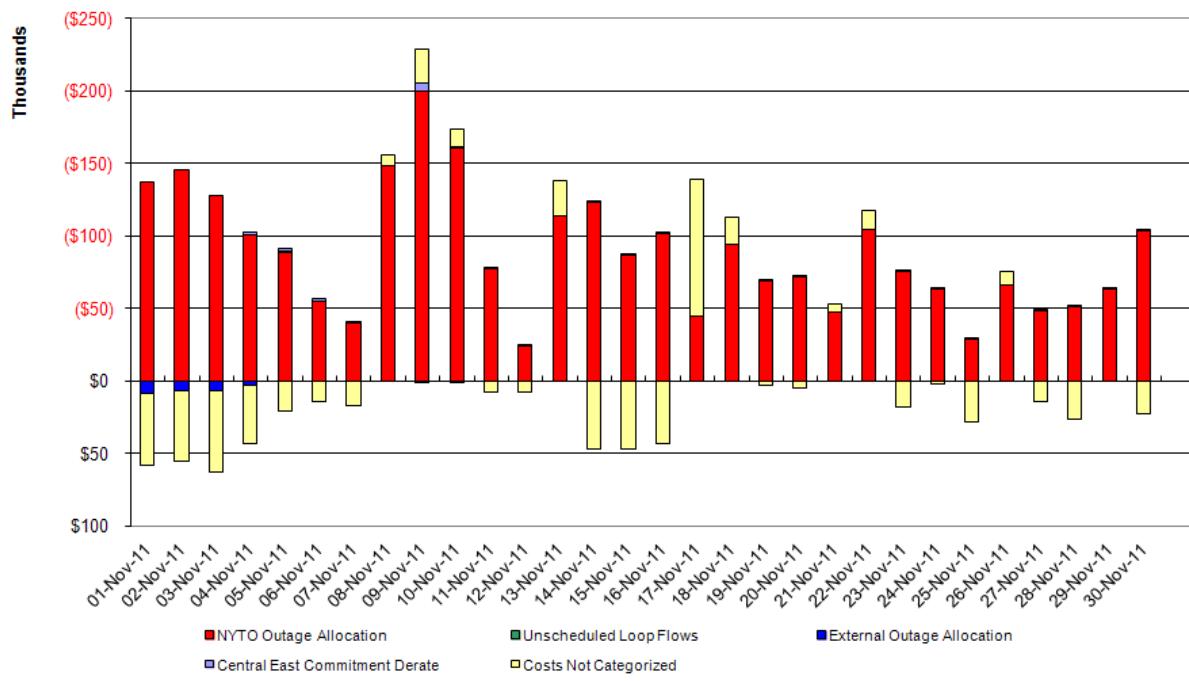


Day-Ahead Market Congestion Residual Categories

<u>Category</u>	<u>Cost Assignment</u>	<u>Events Types</u>	<u>Event Examples</u>
NYTO Outage Allocation	Responsible TO	Direct allocation to NYTO's responsible for transmission equipment status change.	DAM scheduled outage for equipment modeled in-service for the TCC Auction.
Unscheduled Loop Flows	All TO by Monthly Allocation Factor	Residual impact of Lake Erie circulation, MW difference between the DAM and TCC Auction.	Lake Erie Loop Flow Assumptions
External Outage Allocation	All TO by Monthly Allocation Factor	Direct allocation to transmission equipment status change caused by change in status of external equipment.	Tie line required out-of-service by TO of neighboring control area.
Central East Commitment Derate	All TO by Monthly Allocation Factor	Reductions in the DAM Central East_VC limit as compared to the TCC Auction limit, which are not associated with transmission line outages.	

Monthly NYCA Unit Uplift Components

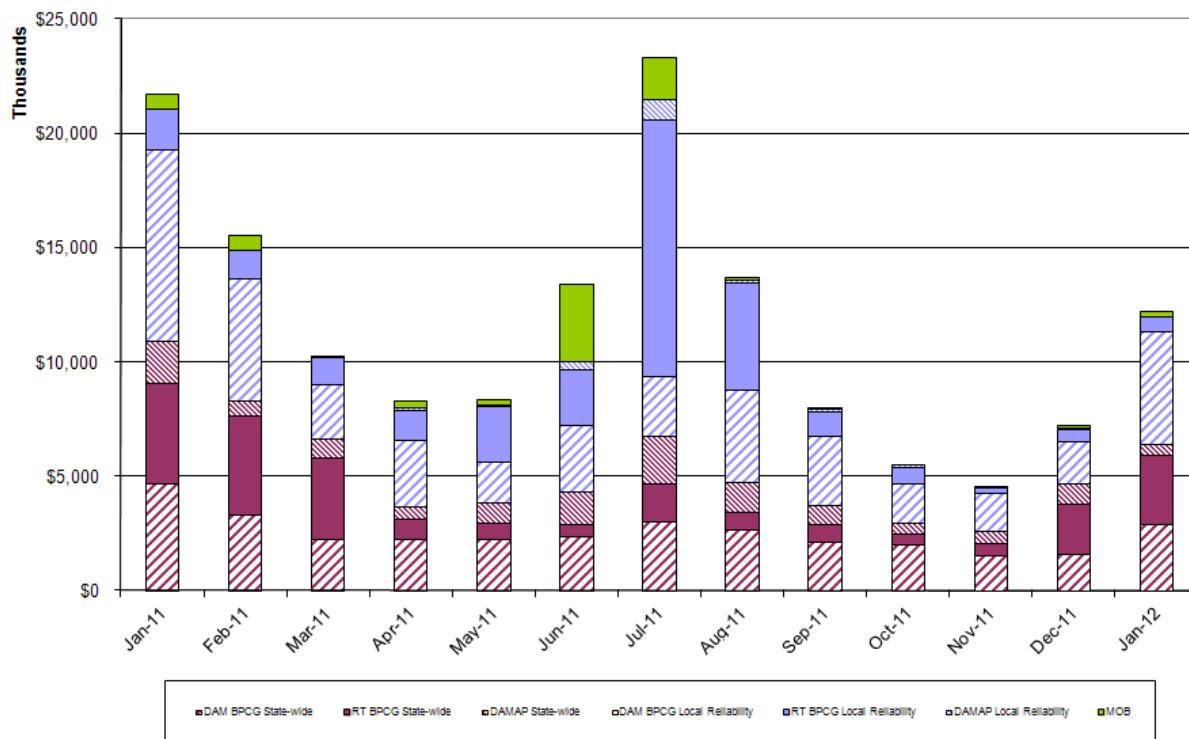


January 2012 Daily Power Supplier Uplift Components

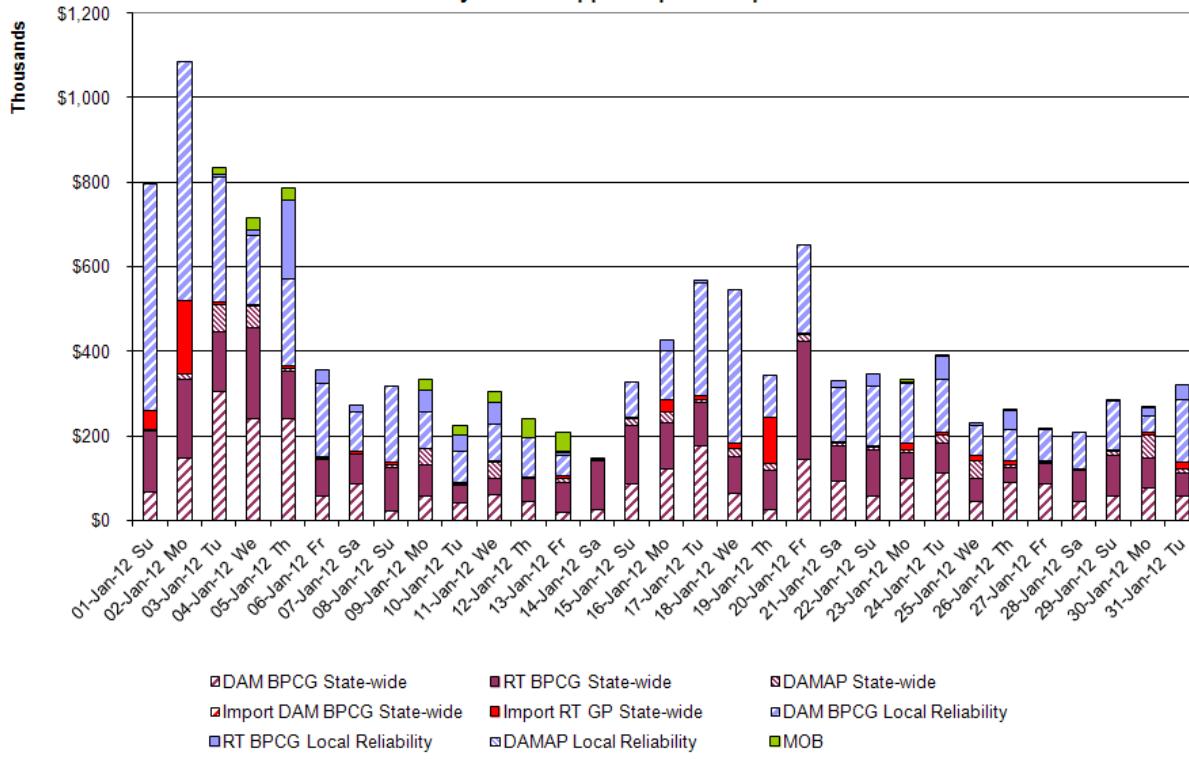


Local Reliability Cost



Monthly RT BPCG, DAM BPCG, DAMAP & Minimum Oil Burn Costs

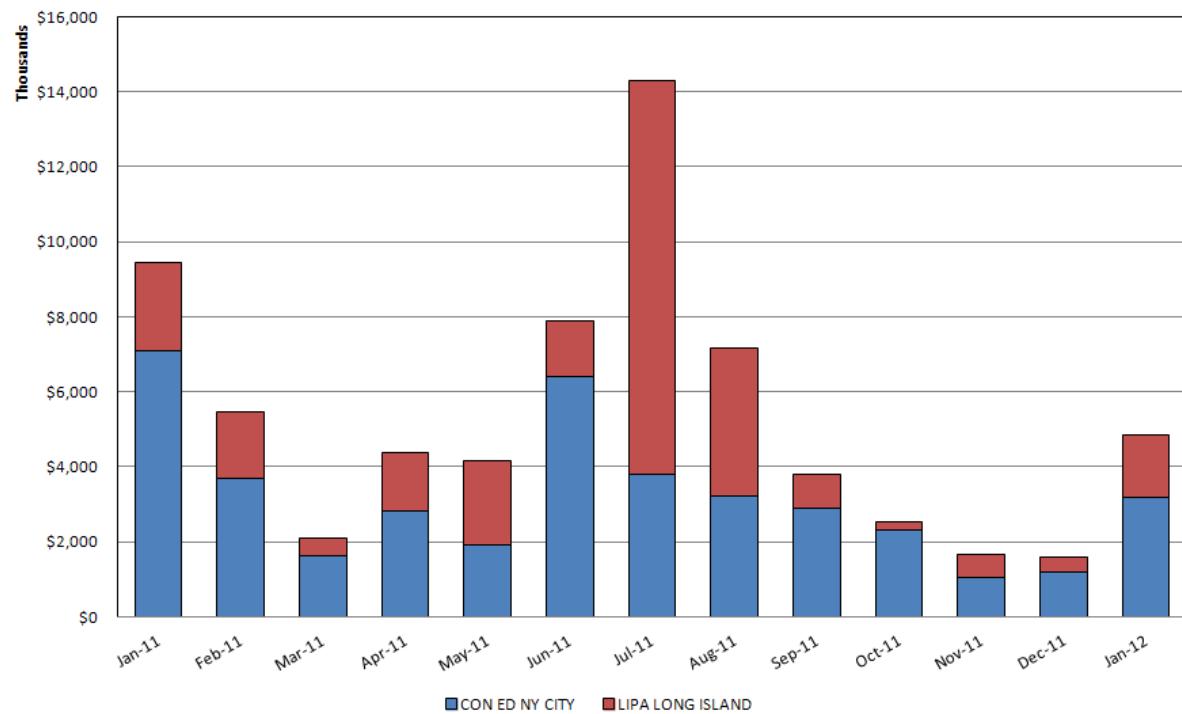


January 2012 Local Reliability Commitment Hours

Monthly DARU & SRE Hours

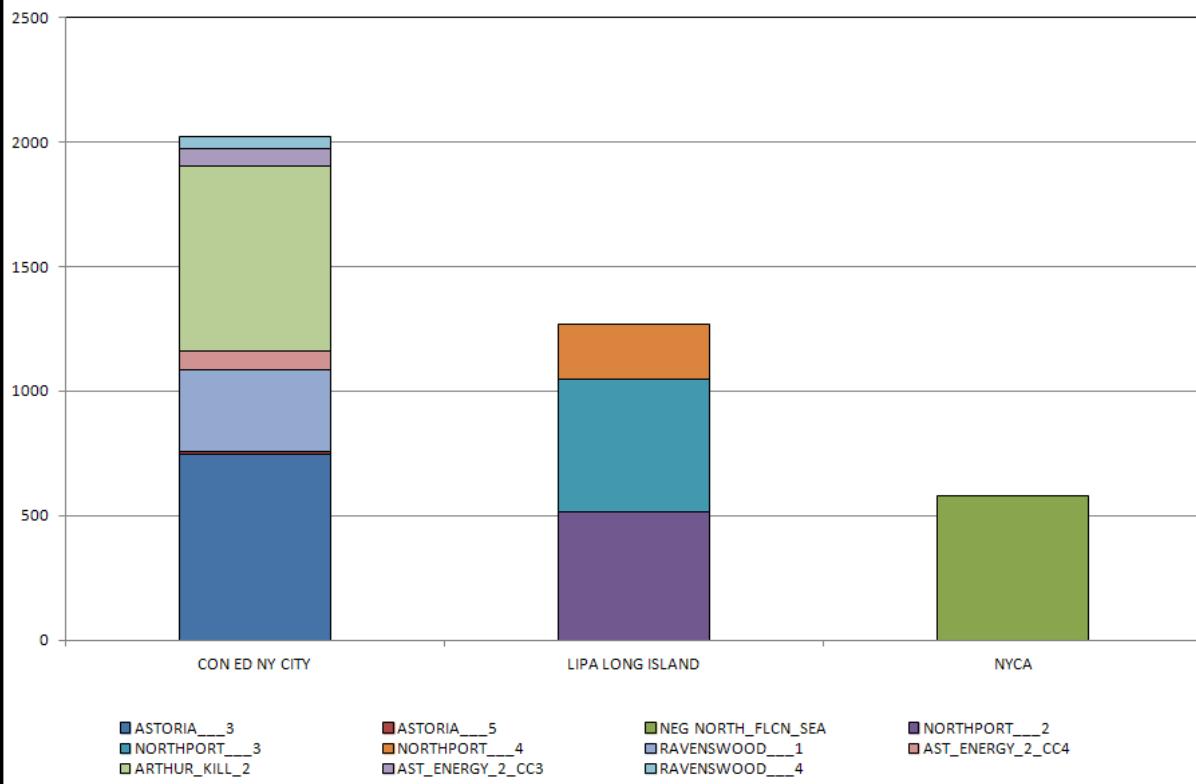


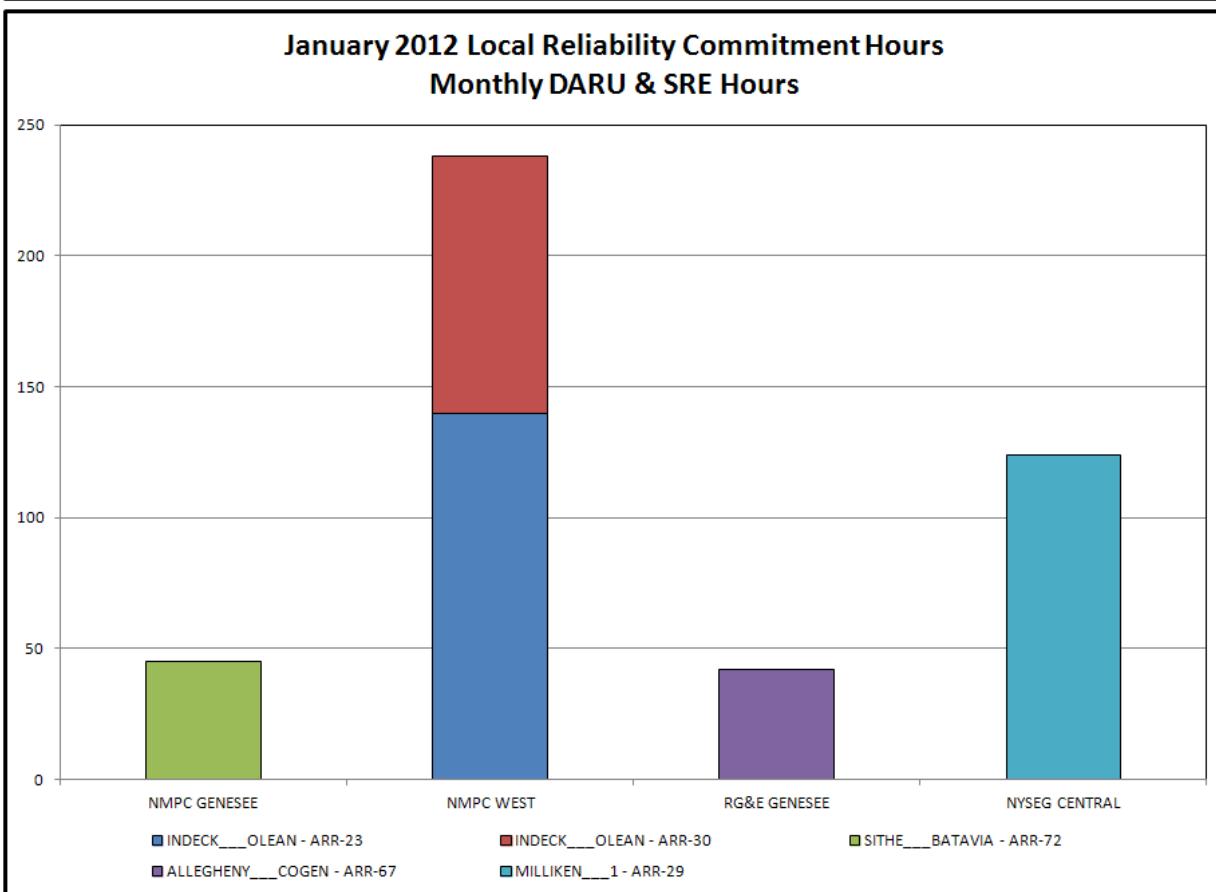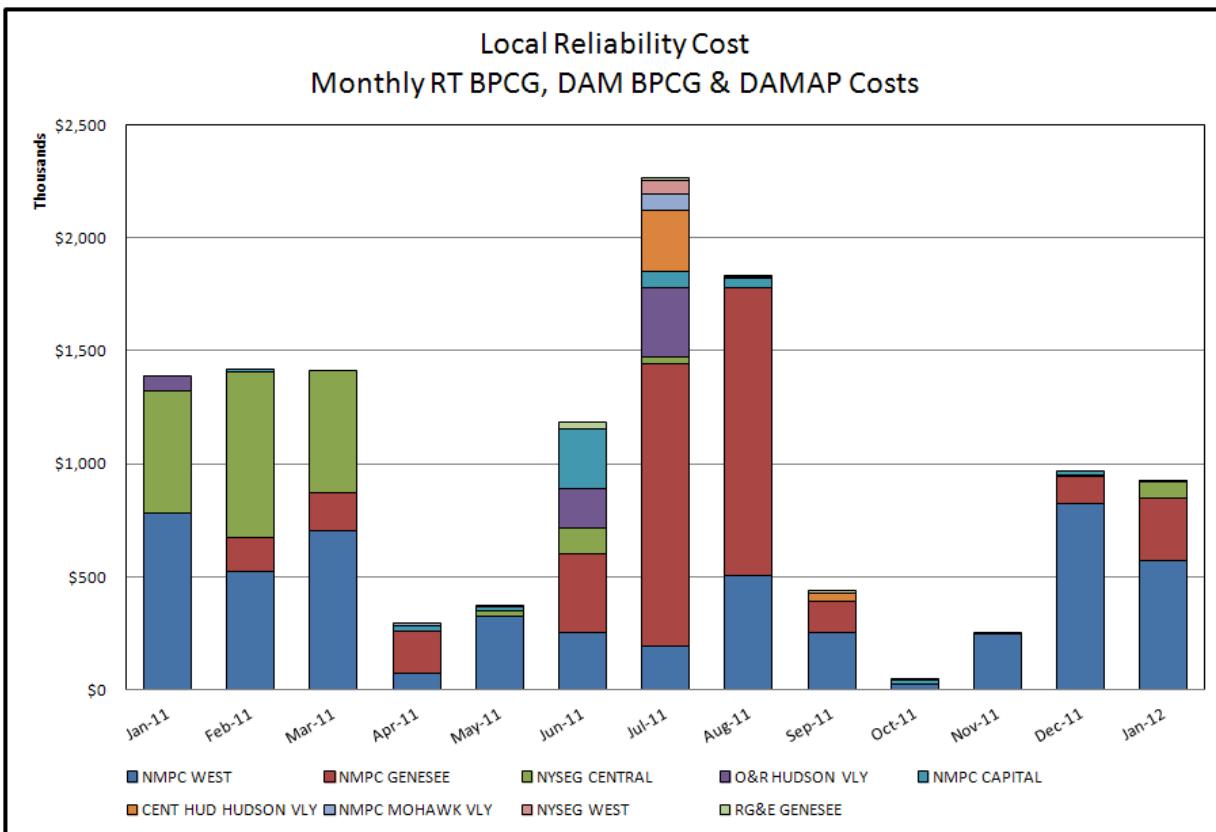

ICAP Spot Market Clearing Price

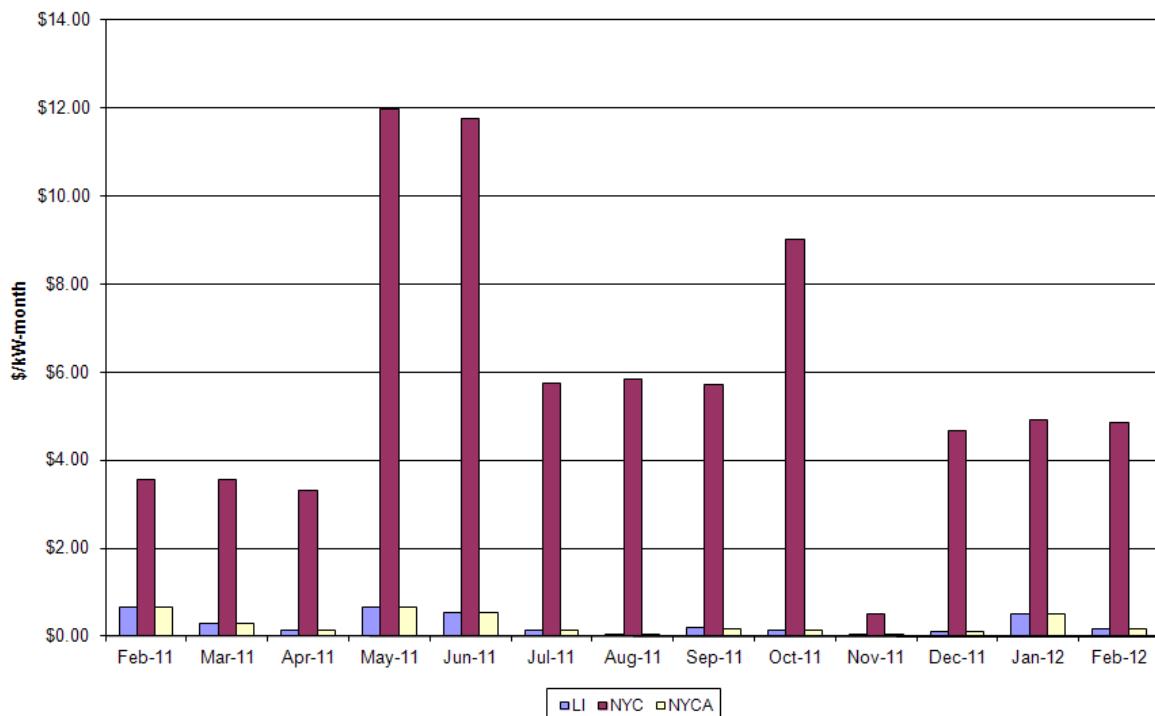

UCAP Sales

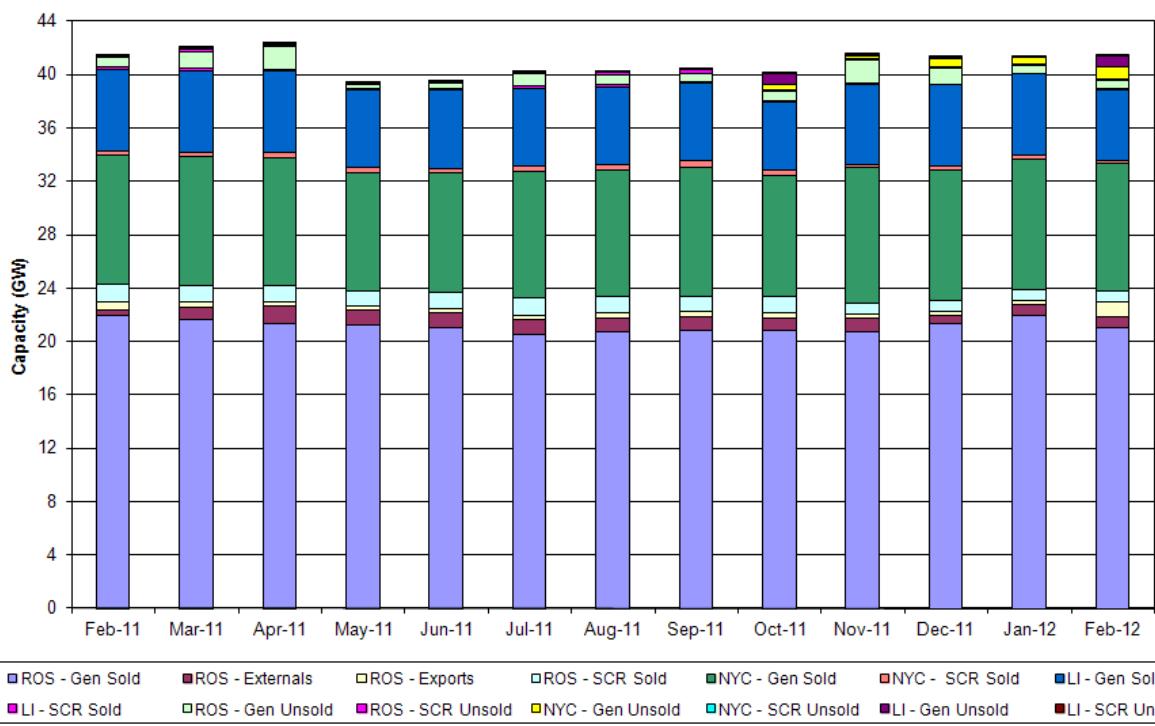

Market Performance Highlights for January 2012


- **LBMP for January is \$44.00/MWh, up from \$39.73/MWh in December 2011.**
 - Day Ahead and Real Time Load Weighted LBMPs are up compared to December 2011.
- **Average monthly year-to-date cost of \$46.67/MWh, a decrease from the previous 2011 average of \$56.55/MWh.**
- **Average daily sendout is 443GWh/day in January; up from 430GWh/day in December 2011 and lower than 457GWh/day in January 2011.**
- **Natural gas and distillate prices are up compared to the previous month.**
 - Natural Gas is \$5.09/MMBtu, up from \$3.98/MMBtu in December.
 - Kerosene is \$23.46/MMBtu, up from \$22.21/MMBtu in December.
 - No. 2 Fuel Oil is \$21.62/MMBtu, up from \$20.60/MMBtu in December.
 - No. 6 Fuel Oil is \$18.61/MMBtu, up from \$17.80/MMBtu in December.
- **Uplift per MWh is higher compared to the previous month.**
 - Uplift (not including NYISO cost of operations) is \$0.36/MWh, higher than \$0.12/MWh in December and lower than \$1.26 in January 2011.
 - The TSA Share is \$0.00/MWh
 - The Local Reliability Share is \$0.15/MWh
 - The Other Share is \$0.21/MWh
 - Total uplift (Schedule 1 components including NYISO Cost of Operations) is higher compared to December.

Daily NYISO Average Cost/MWh (Energy & Ancillary Services)*

2011 Annual Average \$56.55/MWh

January 2011YTD Average \$78.50/MWh

January 2012YTD Average \$46.67/MWh

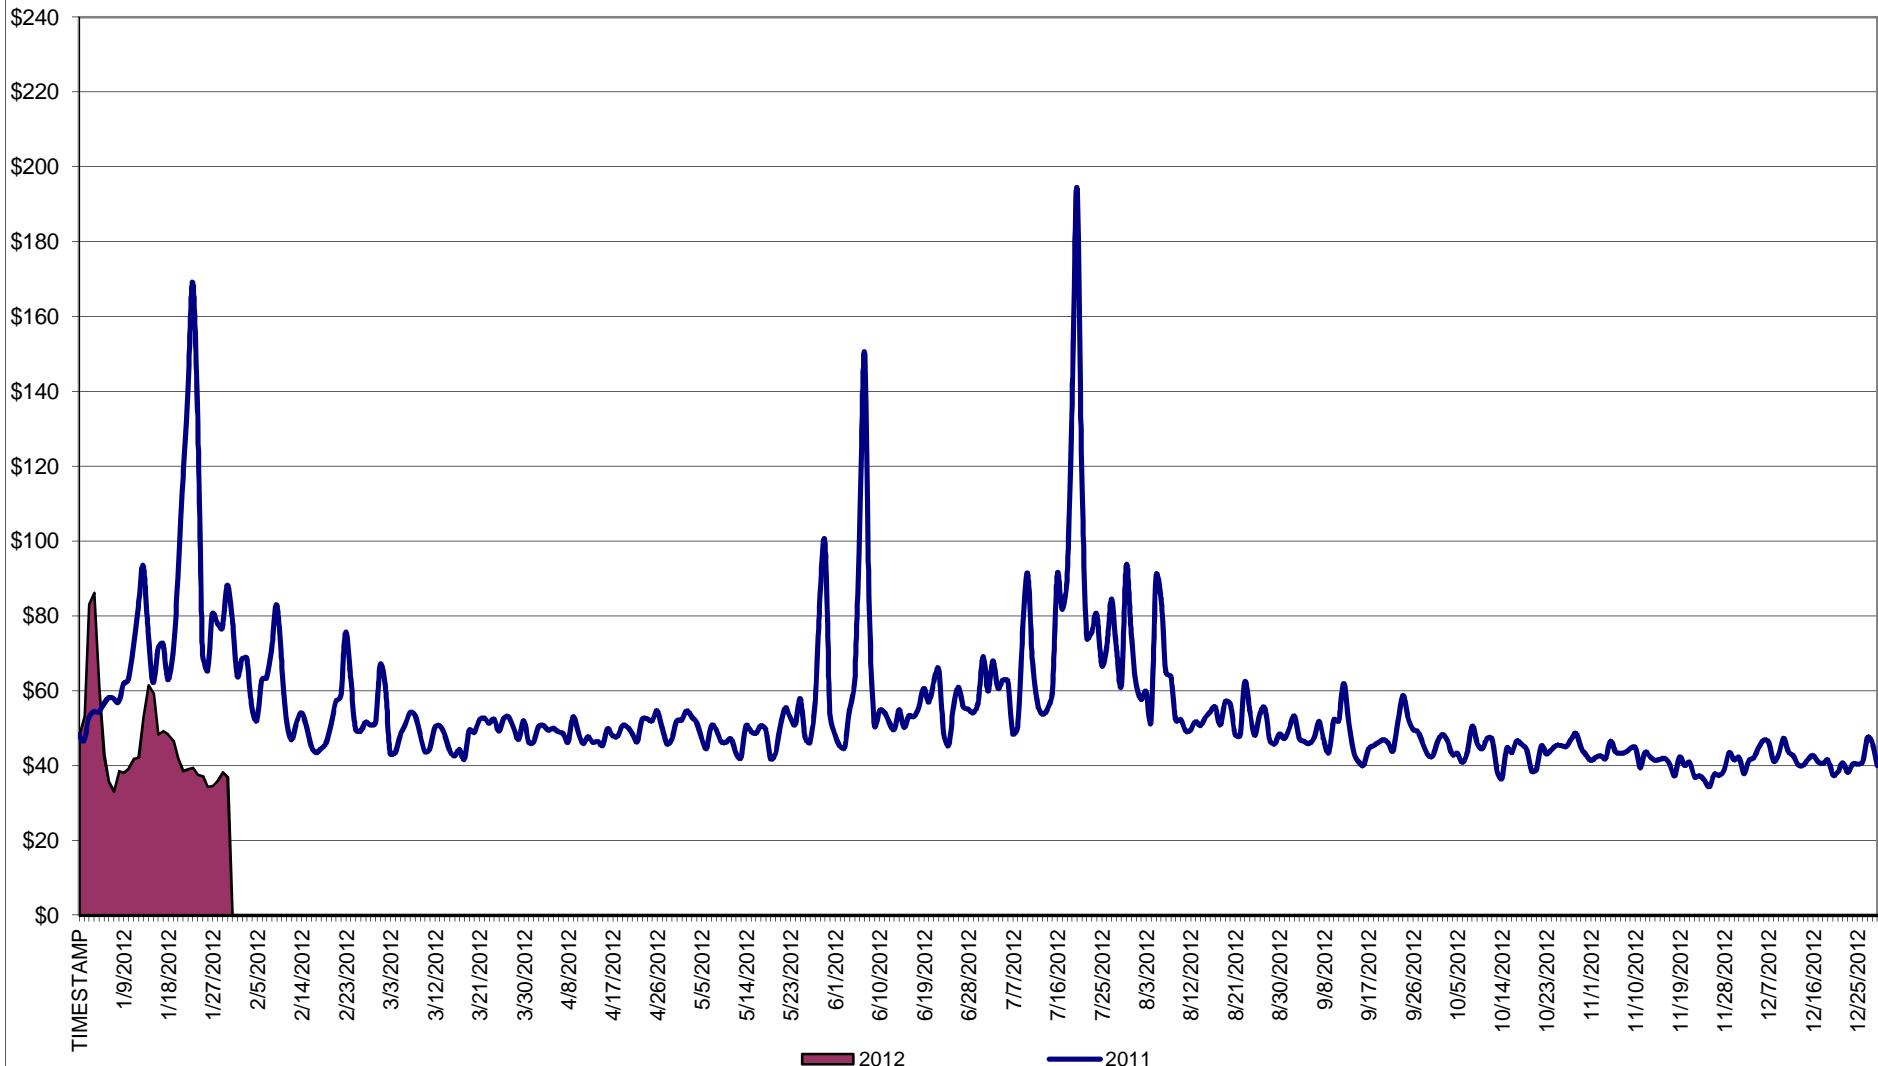

* Excludes ICAP payments.

Market Mitigation and Analysis

Prepared: 2/6/2012 9:20 AM

Data reflects true-ups thru January 2012.


A

NYISO Average Cost/MWh (Energy and Ancillary Services)*
from the LBMP Customer point of view

2012		<u>January</u>	<u>February</u>	<u>March</u>	<u>April</u>	<u>May</u>	<u>June</u>	<u>July</u>	<u>August</u>	<u>September</u>	<u>October</u>	<u>November</u>	<u>December</u>
	LBMP	44.00											
	NTAC	0.85											
	Reserve	0.35											
	Regulation	0.10											
	NYISO Cost of Operations	0.64											
	Uplift	0.36											
	Uplift: TSA Share	-											
	Uplift: Local Reliability Share	0.15											
	Uplift: Other Share	0.21											
	Voltage Support and Black Start	0.37											
	Avg Monthly Cost	46.67											
	Avg YTD Cost	46.67											
2011		<u>January</u>	<u>February</u>	<u>March</u>	<u>April</u>	<u>May</u>	<u>June</u>	<u>July</u>	<u>August</u>	<u>September</u>	<u>October</u>	<u>November</u>	<u>December</u>
	LBMP	74.91	55.60	46.98	46.44	48.49	60.33	75.76	56.04	46.86	42.48	38.97	39.73
	NTAC	0.62	0.75	0.86	0.81	1.13	1.22	0.66	0.60	0.43	0.56	0.62	0.69
	Reserve	0.44	0.50	0.41	0.43	0.48	0.28	0.28	0.13	0.25	0.41	0.26	0.28
	Regualtion	0.20	0.18	0.15	0.12	0.10	0.15	0.12	0.09	0.08	0.09	0.08	0.09
	NYISO Cost of Operations	0.70	0.70	0.70	0.70	0.70	0.70	0.70	0.70	0.70	0.70	0.70	0.70
	Uplift	1.26	0.58	0.45	0.25	(0.02)	0.94	1.01	0.89	0.03	(0.27)	0.05	0.12
	Uplift: TSA Share	-	-	-	0.01	-	0.30	0.08	0.28	0.00	-	-	-
	Uplift: Local Reliability Share	0.61	0.32	0.13	0.10	(0.01)	0.36	0.54	0.32	0.01	(0.15)	0.01	0.02
	Uplift: Other Share	0.65	0.26	0.32	0.14	(0.01)	0.28	0.39	0.29	0.02	(0.12)	0.04	0.10
	Voltage Support and Black Start	0.37	0.37	0.37	0.37	0.37	0.37	0.37	0.37	0.37	0.37	0.37	0.37
	Avg Monthly Cost	78.50	58.69	49.92	49.12	51.24	64.19	79.30	59.13	48.71	44.36	41.05	41.98
	Avg YTD Cost	78.50	68.82	62.36	59.15	57.53	58.81	62.86	62.29	60.78	59.29	57.86	56.55

* Excludes ICAP payments.

NYISO Dollar Flows - Uplift- OATT Schedule 1 components - Data through January 31, 2012

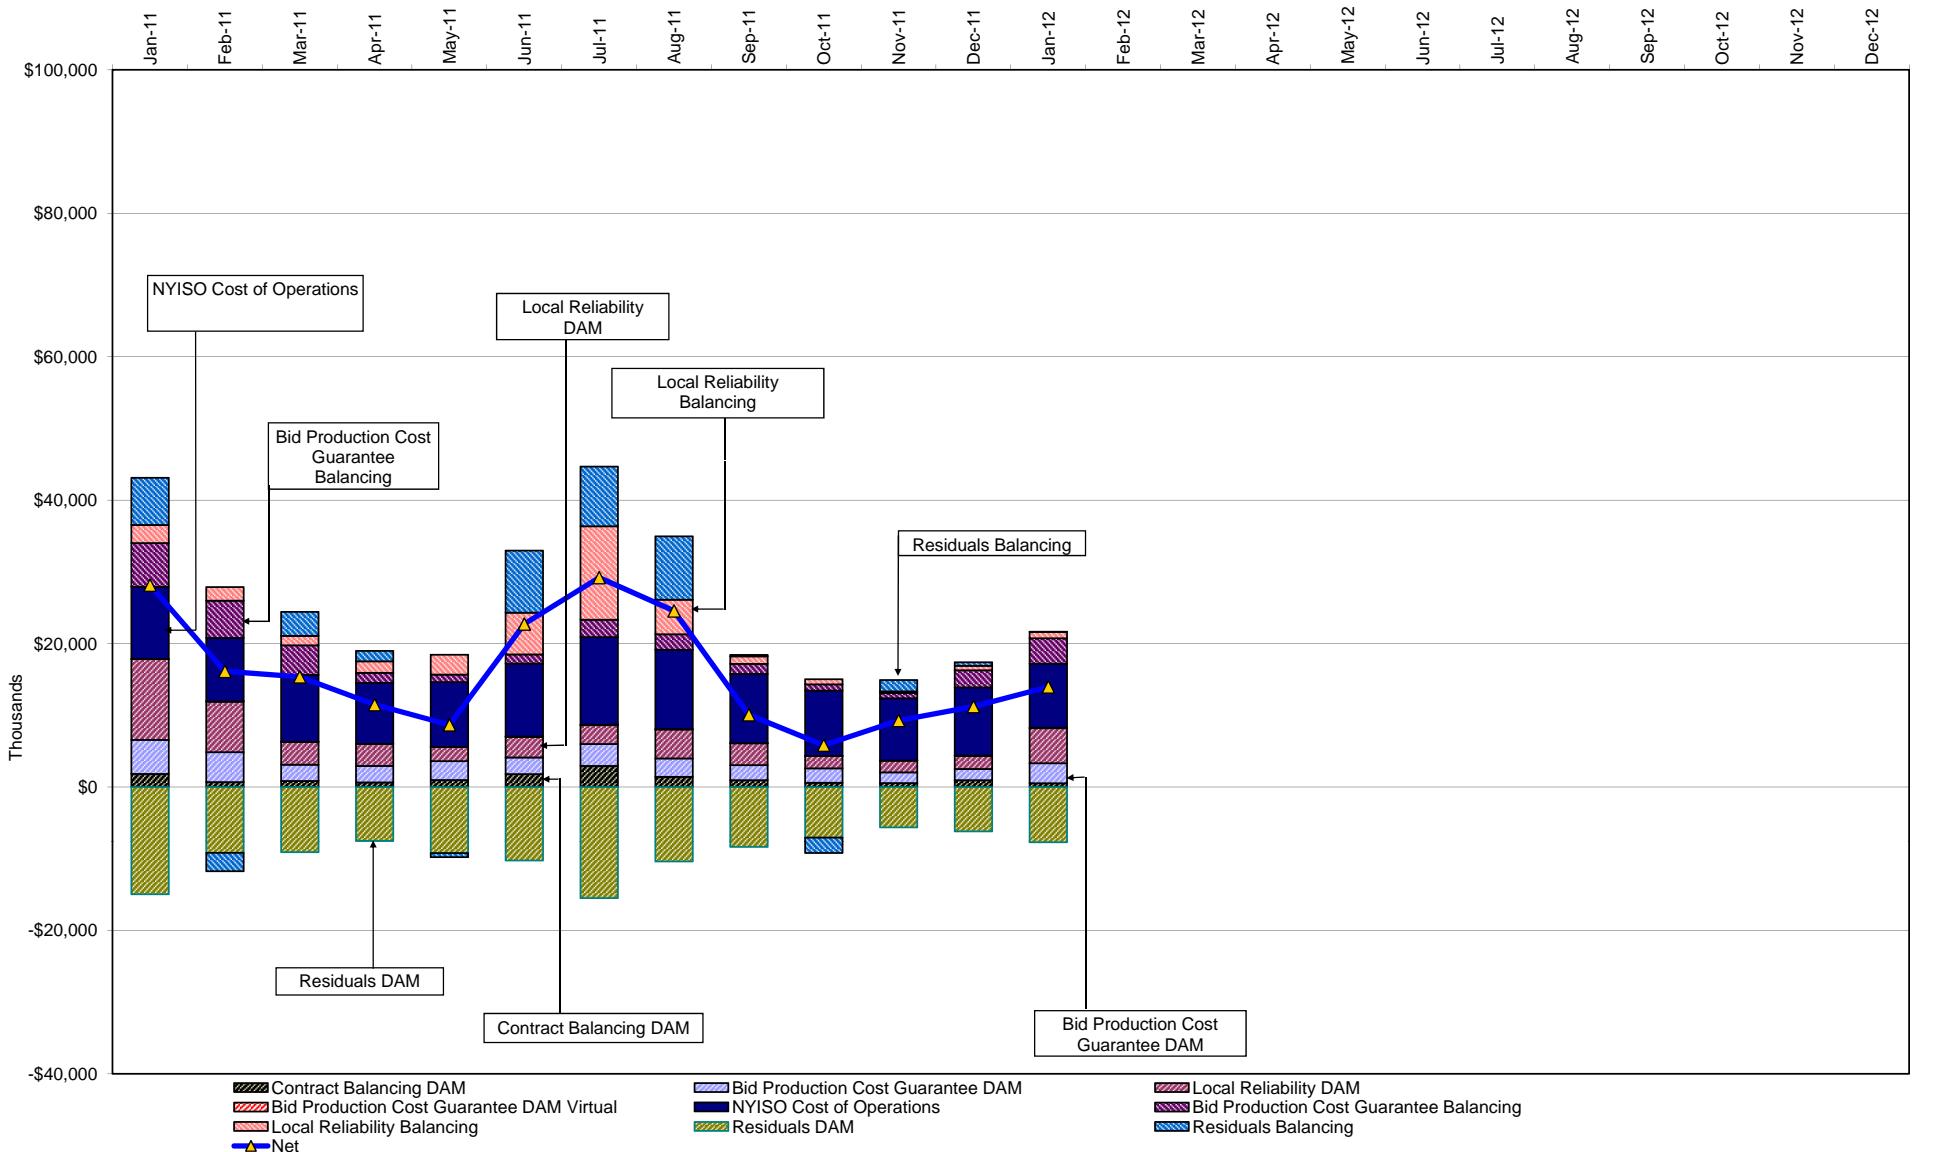

DAM Contract Balancing amounts are for payments made to generating units to make them whole for being dispatched below their Day-Ahead schedule, as a result of out-of-merit dispatches.

DAM Bid Production Cost Guarantees for Virtual Transactions are included in the chart and are shown from the inception of Virtual Transactions. These values are small and cannot be identified on the chart.

DAM residuals consist of both energy and loss revenue collections and payments. By design, there is a net over collection of revenues due to the difference between the marginal losses paid to generation and the average losses charged to loads.

NYISO Markets Transactions

2012	January	February	March	April	May	June	July	August	September	October	November	December
Day Ahead Market MWh	14,877,279											
DAM LSE Internal LBMP Energy Sales	58%											
DAM External TC LBMP Energy Sales	1%											
DAM Bilateral - Internal Bilaterals	38%											
DAM Bilateral - Import/Non-LBMP Market Bilaterals	0%											
DAM Bilateral - Export/Non-LBMP Market Bilaterals	1%											
DAM Bilateral - Wheel Through Bilaterals	1%											
Balancing Energy Market MWh	-878,258											
Balancing Energy LSE Internal LBMP Energy Sales	-110%											
Balancing Energy External TC LBMP Energy Sales	9%											
Balancing Energy Bilateral - Internal Bilaterals	1%											
Balancing Energy Bilateral - Import/Non-LBMP Market Bilaterals	0%											
Balancing Energy Bilateral - Export/Non-LBMP Market Bilaterals	4%											
Balancing Energy Bilateral - Wheel Through Bilaterals	-3%											
Transactions Summary												
LBMP	57%											
Internal Bilaterals	41%											
Import Bilaterals	0%											
Export Bilaterals	2%											
Wheels Through	1%											
Market Share of Total Load												
Day Ahead Market	106.3%											
Balancing Energy +	-6.3%											
Total MWH	13,999,021											
Average Daily Energy Sendout/Month GWh	443											
2011	January	February	March	April	May	June	July	August	September	October	November	December
Day Ahead Market MWh	14,146,283	12,514,435	13,164,026	12,191,562	12,809,240	14,520,490	17,296,367	15,872,137	14,052,940	13,263,167	12,710,654	14,300,553
DAM LSE Internal LBMP Energy Sales	49%	54%	53%	55%	55%	57%	60%	62%	59%	54%	55%	59%
DAM External TC LBMP Energy Sales	1%	1%	2%	2%	1%	1%	2%	1%	1%	4%	2%	1%
DAM Bilateral - Internal Bilaterals	42%	43%	43%	41%	41%	39%	36%	35%	39%	41%	41%	37%
DAM Bilateral - Import/Non-LBMP Market Bilaterals	5%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
DAM Bilateral - Export/Non-LBMP Market Bilaterals	1%	1%	2%	2%	2%	1%	1%	1%	1%	2%	2%	1%
DAM Bilateral - Wheel Through Bilaterals	1%	1%	1%	0%	1%	1%	1%	1%	1%	0%	0%	1%
Balancing Energy Market MWh	311,996	210,141	250,346	35,939	192,443	44,238	221,521	-31,814	-204,604	-204,312	-281,379	-688,007
Balancing Energy LSE Internal LBMP Energy Sales	28%	24%	39%	-226%	40%	-141%	29%	-372%	-147%	-181%	-129%	-115%
Balancing Energy External TC LBMP Energy Sales	48%	50%	50%	197%	39%	271%	77%	328%	53%	59%	21%	13%
Balancing Energy Bilateral - Internal Bilaterals	15%	7%	8%	47%	14%	37%	0%	-1%	5%	11%	0%	0%
Balancing Energy Bilateral - Import/Non-LBMP Market Bilaterals	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Balancing Energy Bilateral - Export/Non-LBMP Market Bilaterals	6%	14%	13%	83%	10%	32%	6%	39%	8%	10%	10%	4%
Balancing Energy Bilateral - Wheel Through Bilaterals	3%	5%	-10%	-1%	-2%	-100%	-12%	-94%	-18%	1%	-2%	-2%
Transactions Summary												
LBMP	51%	55%	55%	57%	57%	59%	63%	63%	59%	56%	56%	58%
Internal Bilaterals	42%	42%	42%	41%	41%	39%	36%	36%	39%	42%	42%	39%
Import Bilaterals	5%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Export Bilaterals	2%	2%	2%	2%	2%	1%	1%	1%	1%	2%	2%	2%
Wheels Through	1%	1%	1%	0%	1%	1%	1%	1%	0%	0%	0%	1%
Market Share of Total Load												
Day Ahead Market	97.8%	98.3%	98.1%	99.7%	98.5%	99.7%	98.7%	100.2%	101.5%	101.6%	102.3%	105.1%
Balancing Energy +	2.2%	1.7%	1.9%	0.3%	1.5%	0.3%	1.3%	-0.2%	-1.5%	-1.6%	-2.3%	-5.1%
Total MWH	14,458,279	12,724,575	13,414,372	12,227,501	13,001,683	14,564,728	17,517,888	15,840,323	13,848,336	13,058,855	12,429,275	13,612,546
Average Daily Energy Sendout/Month GWh	457	447	422	398	411	479	555	505	456	403	408	430

* Balancing Energy: Load(MW) purchased at Real Time LBMP.

* The signs for the detail section intuitively reflect the direction of power flow eliminating the use of double negatives when Balancing Energy is negative.

Notes: Percent totals may not equal 100% due to rounding.

Virtual Transactions are not reflected in this chart.

NYISO Markets 2012 Energy Statistics

	<u>January</u>	<u>February</u>	<u>March</u>	<u>April</u>	<u>May</u>	<u>June</u>	<u>July</u>	<u>August</u>	<u>September</u>	<u>October</u>	<u>November</u>	<u>December</u>
<u>DAY AHEAD LBMP</u>												
Price *		\$40.91										
Standard Deviation		\$15.62										
Load Weighted Price **		\$42.20										
<u>RTC LBMP</u>												
Price *		\$37.93										
Standard Deviation		\$23.43										
Load Weighted Price **		\$39.19										
<u>REAL TIME LBMP</u>												
Price *		\$37.35										
Standard Deviation		\$23.75										
Load Weighted Price **		\$38.88										
Average Daily Energy Sendout/Month GWh	443											


NYISO Markets 2011 Energy Statistics

	<u>January</u>	<u>February</u>	<u>March</u>	<u>April</u>	<u>May</u>	<u>June</u>	<u>July</u>	<u>August</u>	<u>September</u>	<u>October</u>	<u>November</u>	<u>December</u>
<u>DAY AHEAD LBMP</u>												
Price *	\$69.03	\$52.87	\$45.20	\$44.80	\$45.20	\$52.26	\$64.60	\$49.59	\$43.28	\$40.38	\$37.12	\$37.31
Standard Deviation	\$30.78	\$14.77	\$9.06	\$8.22	\$11.77	\$26.24	\$34.99	\$16.62	\$10.26	\$9.30	\$7.64	\$9.13
Load Weighted Price **	\$71.22	\$54.24	\$46.13	\$45.77	\$46.83	\$55.58	\$69.28	\$51.90	\$44.76	\$41.70	\$38.02	\$38.27
<u>RTC LBMP</u>												
Price *	\$64.48	\$50.15	\$45.13	\$44.32	\$43.69	\$50.47	\$63.42	\$48.47	\$46.02	\$38.44	\$37.43	\$34.00
Standard Deviation	\$39.41	\$18.83	\$18.96	\$15.44	\$25.19	\$46.41	\$82.29	\$59.95	\$25.18	\$15.45	\$17.55	\$15.60
Load Weighted Price **	\$66.15	\$51.15	\$45.98	\$45.25	\$45.41	\$53.91	\$68.58	\$51.12	\$47.80	\$39.30	\$38.43	\$34.97
<u>REAL TIME LBMP</u>												
Price *	\$67.92	\$50.26	\$44.22	\$45.20	\$44.26	\$48.68	\$62.96	\$49.39	\$45.92	\$36.91	\$37.67	\$33.50
Standard Deviation	\$58.47	\$22.39	\$17.41	\$19.98	\$26.27	\$44.88	\$64.83	\$62.04	\$26.88	\$13.65	\$19.42	\$14.12
Load Weighted Price **	\$70.32	\$51.61	\$45.24	\$46.28	\$46.66	\$53.42	\$69.66	\$54.28	\$48.40	\$37.88	\$38.84	\$34.57
Average Daily Energy Sendout/Month GWh	457	447	422	398	411	479	555	505	456	402	408	430

* Average zonal load weighted prices.

** Average zonal load weighted prices, load weighted in each hour.

NYISO Monthly Average Internal LBMPs 2011- 2012

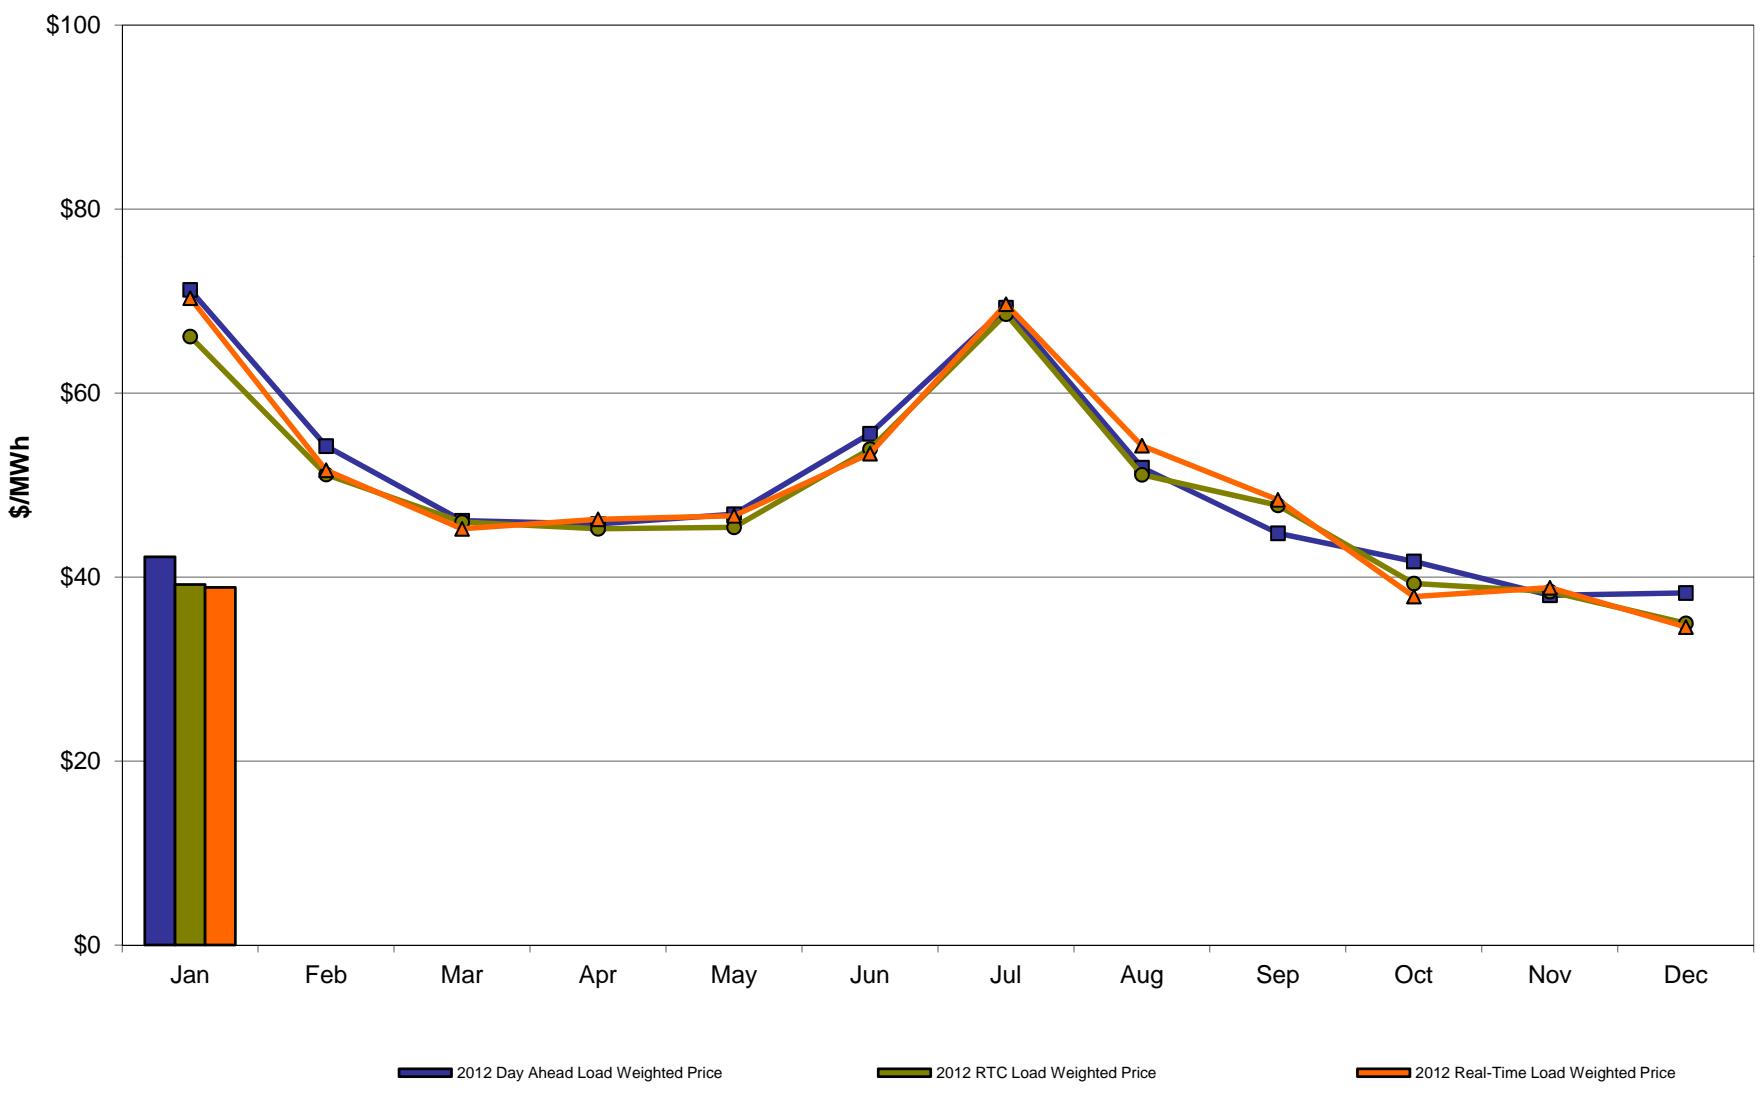


January 2012 Zonal LBMP Statistics for NYISO (\$/MWh)


	WEST <u>Zone A</u>	GENESEE <u>Zone B</u>	NORTH <u>Zone D</u>	CENTRAL <u>Zone C</u>	MOHAWK VALLEY <u>Zone E</u>	CAPITAL <u>Zone F</u>	HUDSON VALLEY <u>Zone G</u>	MILLWOOD <u>Zone H</u>	DUNWOODIE <u>Zone I</u>	NEW YORK CITY <u>Zone J</u>	LONG ISLAND <u>Zone K</u>
DAY AHEAD LBMP											
Unweighted Price *	32.54	33.54	34.18	34.93	36.27	40.17	40.60	40.72	40.70	45.22	48.54
Standard Deviation	8.12	8.99	10.00	10.09	10.90	16.06	14.87	14.96	14.94	18.86	27.93
RTC LBMP											
Unweighted Price *	31.34	32.53	32.77	33.80	34.98	37.45	37.95	37.99	37.97	40.73	44.48
Standard Deviation	17.29	18.21	18.32	19.29	20.01	25.72	24.26	24.39	24.31	27.67	33.07
REAL TIME LBMP											
Unweighted Price *	30.42	31.56	31.78	32.75	33.86	35.86	36.42	36.45	36.47	40.80	45.43
Standard Deviation	16.09	16.99	17.31	17.79	18.44	19.81	19.86	20.05	19.81	43.53	35.10
	ONTARIO IESO	HYDRO QUEBEC (Wheel)	HYDRO QUEBEC (Import/Export)	PJM	NEW ENGLAND	CROSS SOUND CABLE Controllable	NORTHPORT- NORWALK Controllable	NEPTUNE Controllable	LINDEN VFT Controllable	Dennison Controllable	
DAY AHEAD LBMP											
Unweighted Price *	31.55	33.91	32.90	36.76	40.19	46.81	44.00	46.16	36.91	33.80	
Standard Deviation	7.54	9.85	9.68	11.20	15.32	26.67	19.09	26.44	6.98	9.79	
RTC LBMP											
Unweighted Price *	28.85	30.77	30.57	33.81	35.63	39.71	39.11	39.47	37.93	30.90	
Standard Deviation	8.91	10.40	10.35	11.15	12.62	22.41	22.12	22.29	18.32	10.10	
REAL TIME LBMP											
Unweighted Price *	29.65	31.27	31.10	33.91	36.18	41.15	38.70	40.82	39.88	31.66	
Standard Deviation	15.08	16.92	16.90	17.51	18.90	30.90	29.27	30.72	43.86	16.63	

* Straight LBMP averages


West Zone A
Monthly Average LBMP Prices 2011 - 2012

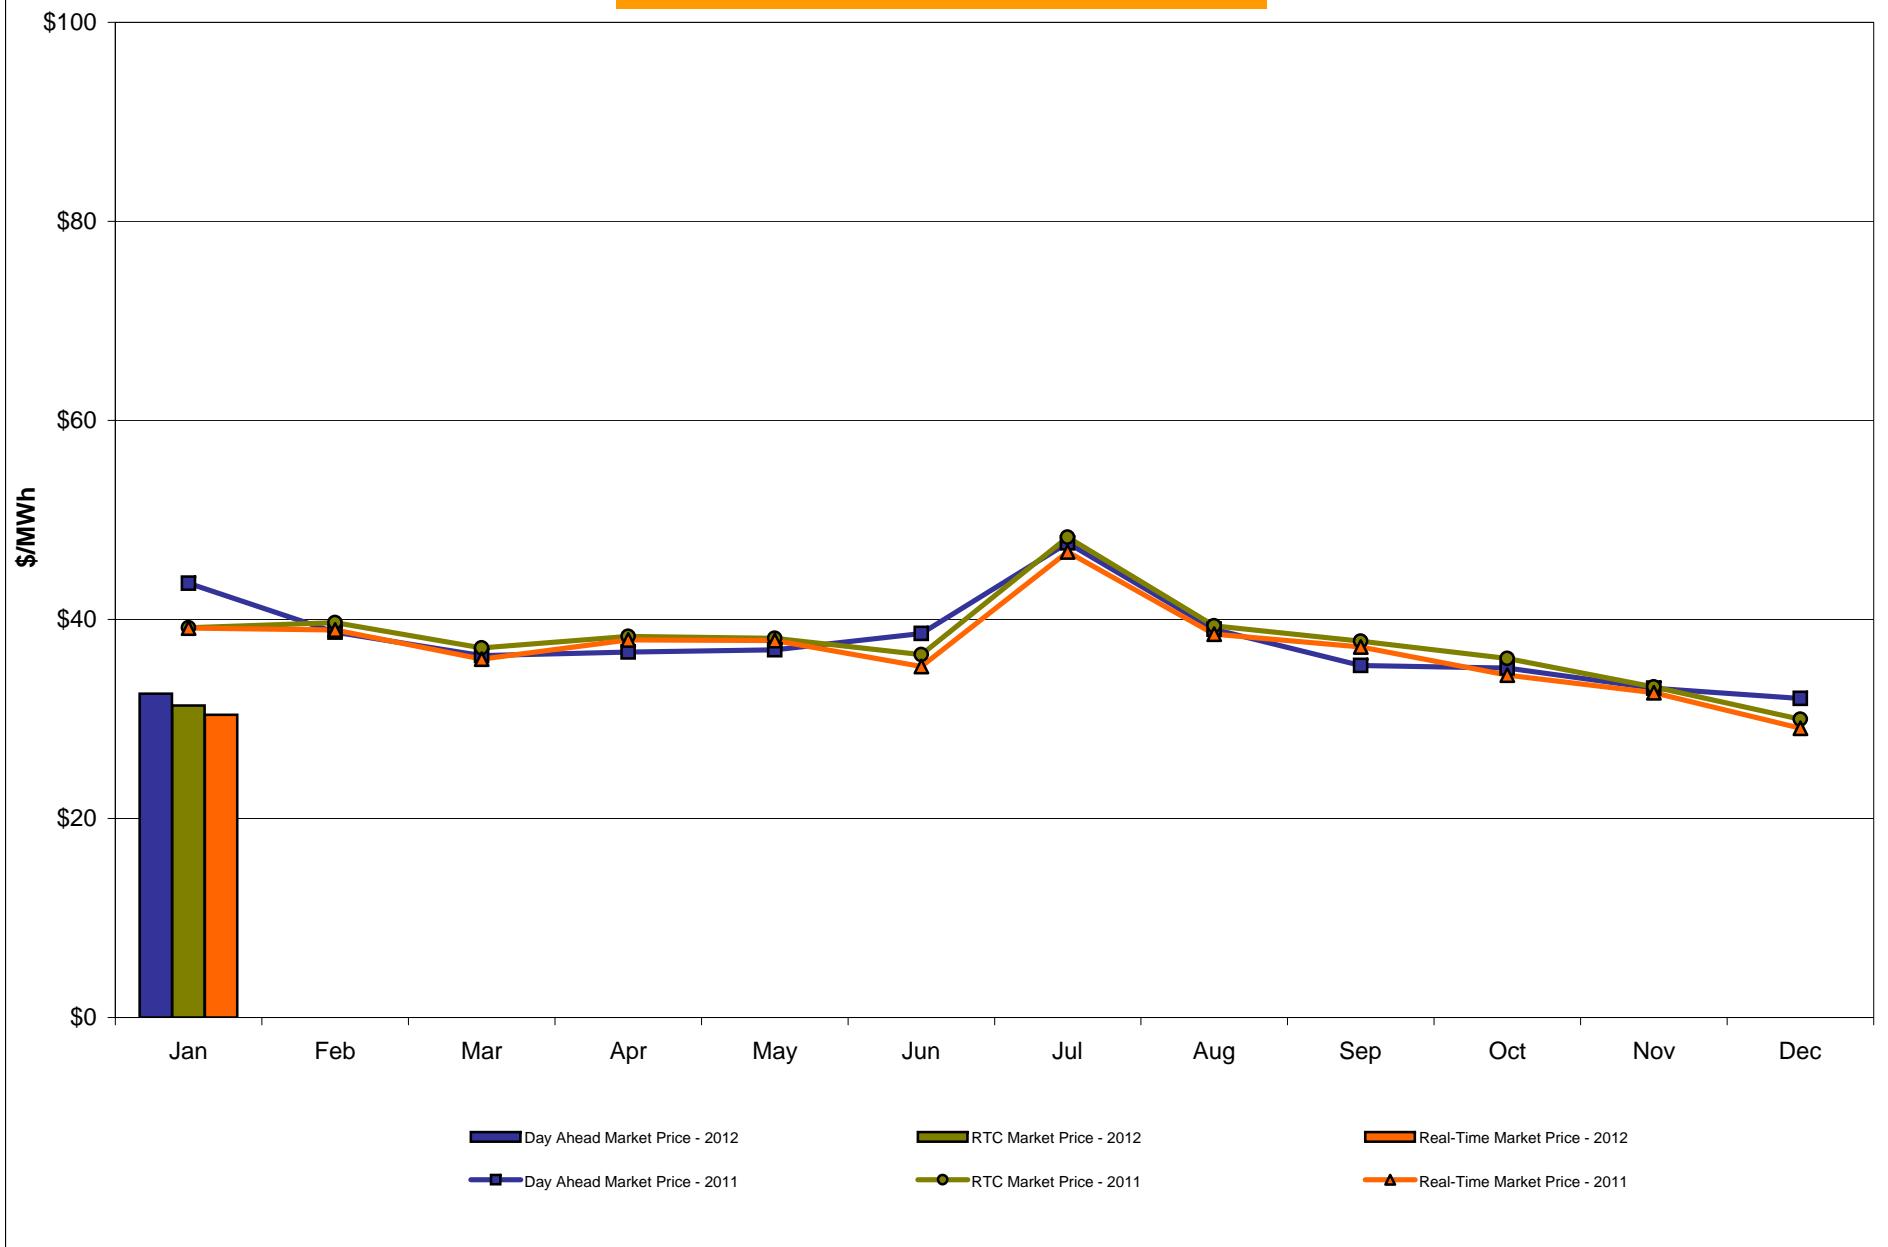


Capital Zone F
Monthly Average LBMP Prices 2011 - 2012

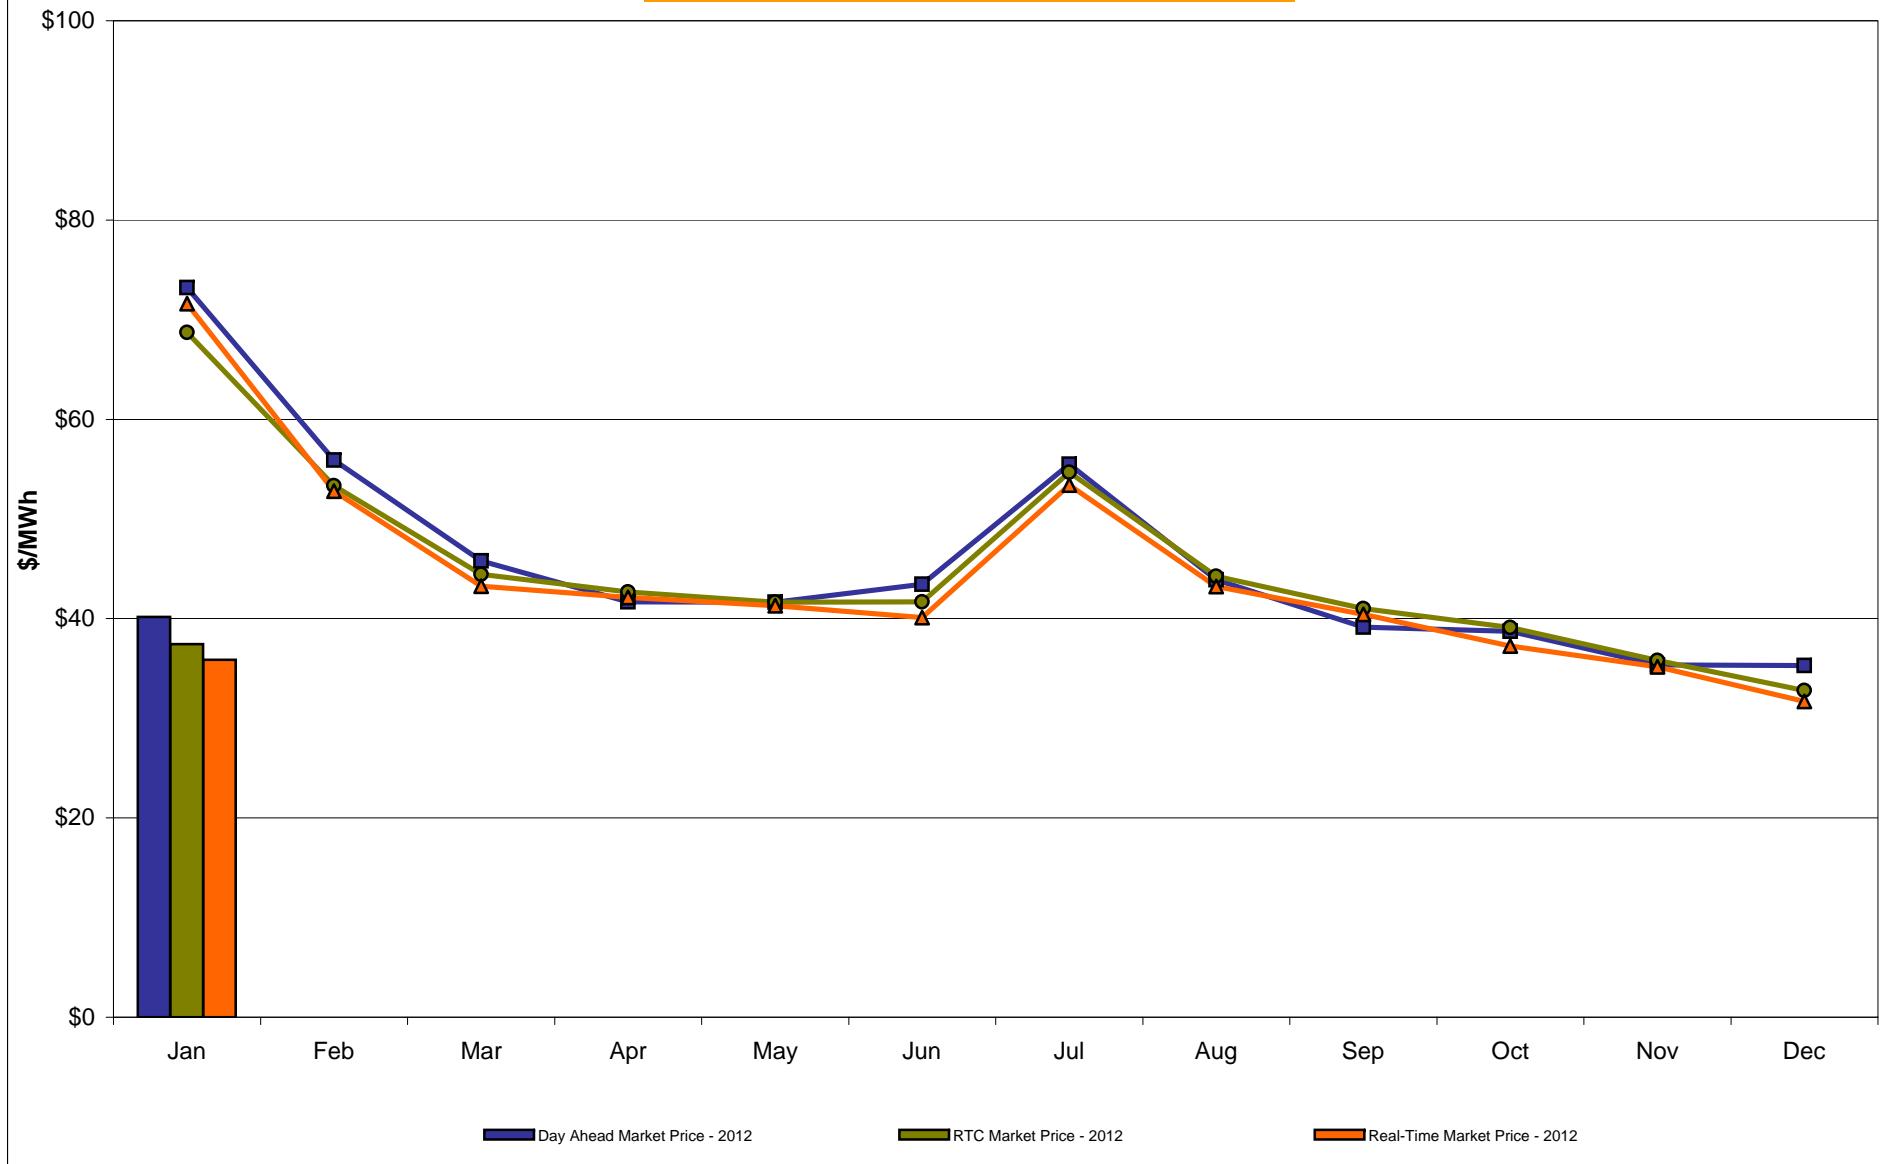


Hudson Valley Zone G
Monthly Average LBMP Prices 2011 - 2012

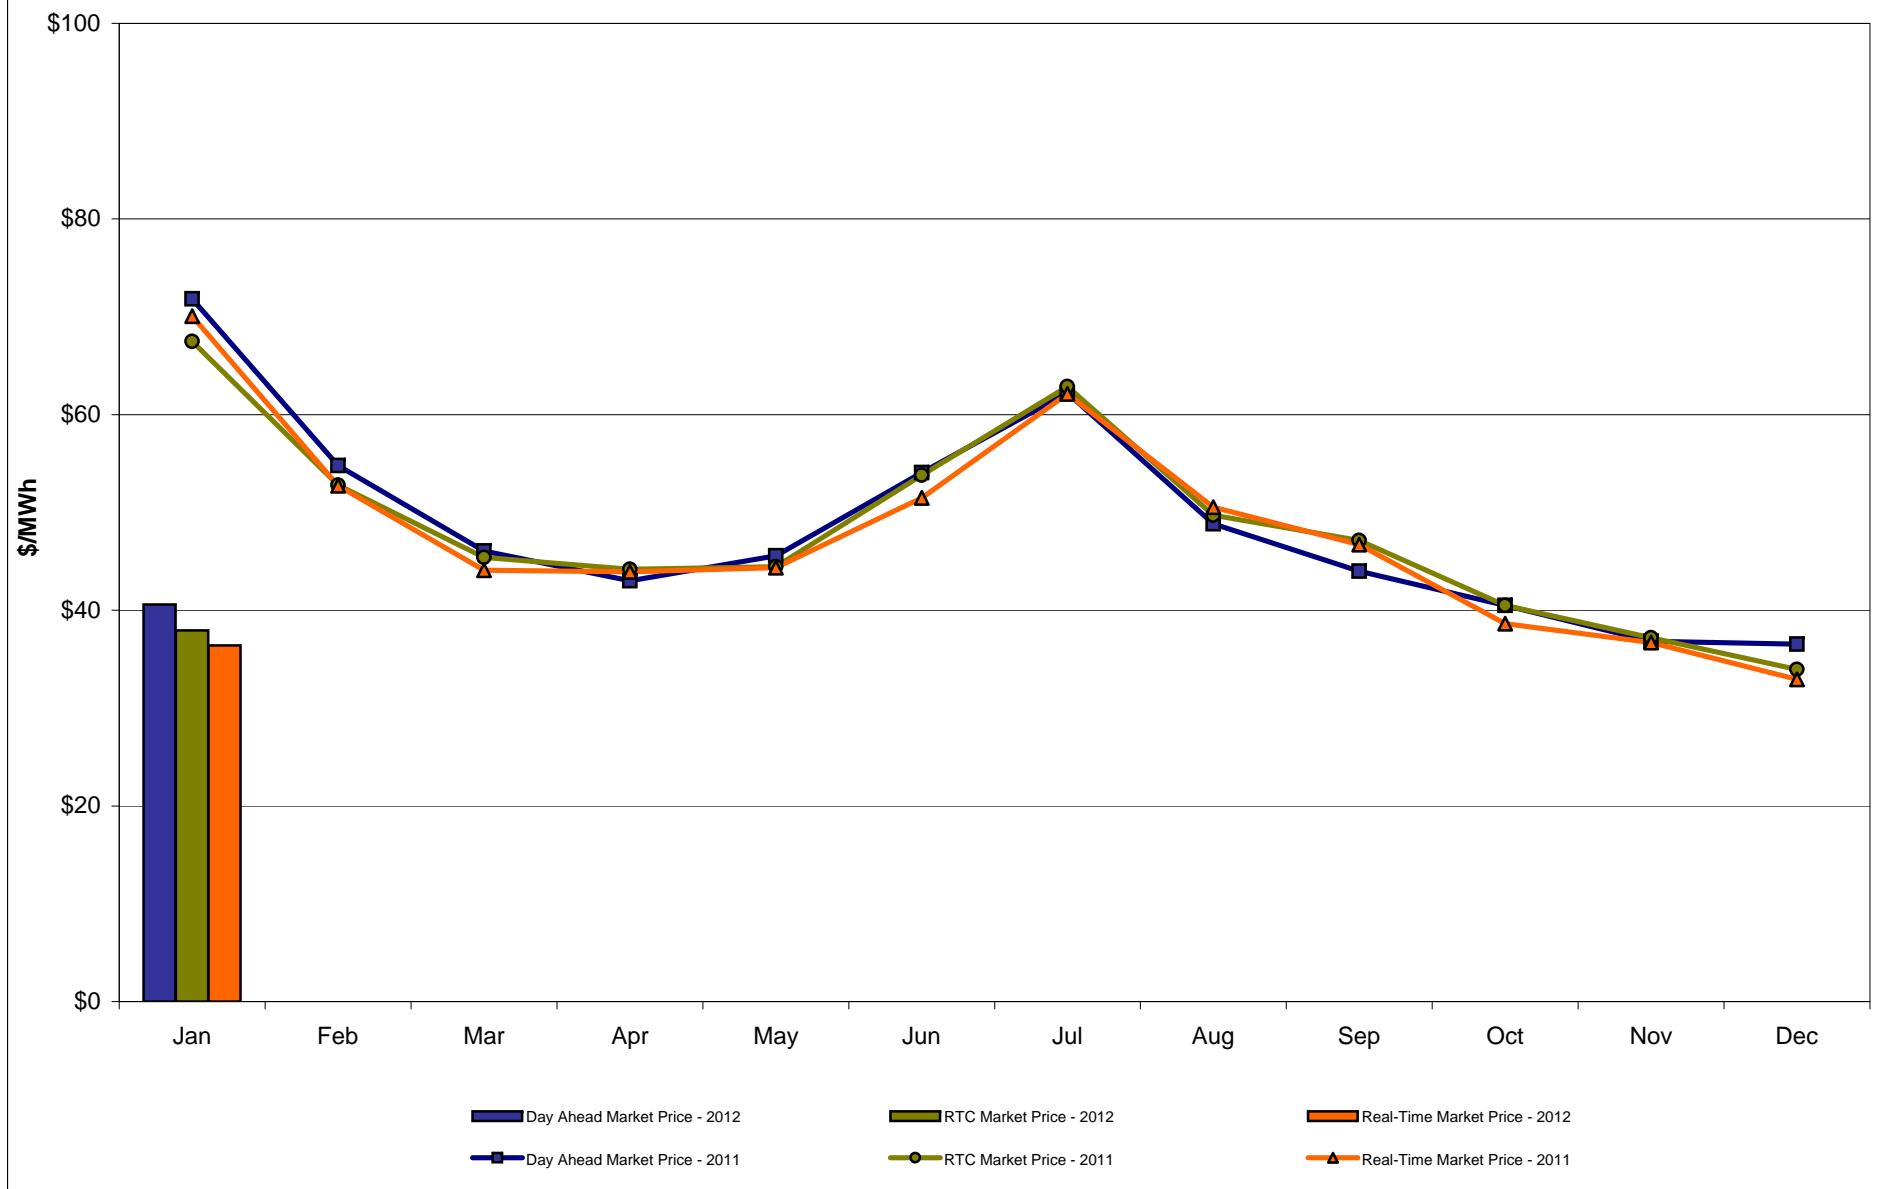


NYC Zone J
Monthly Average LBMP Prices 2011 - 2012

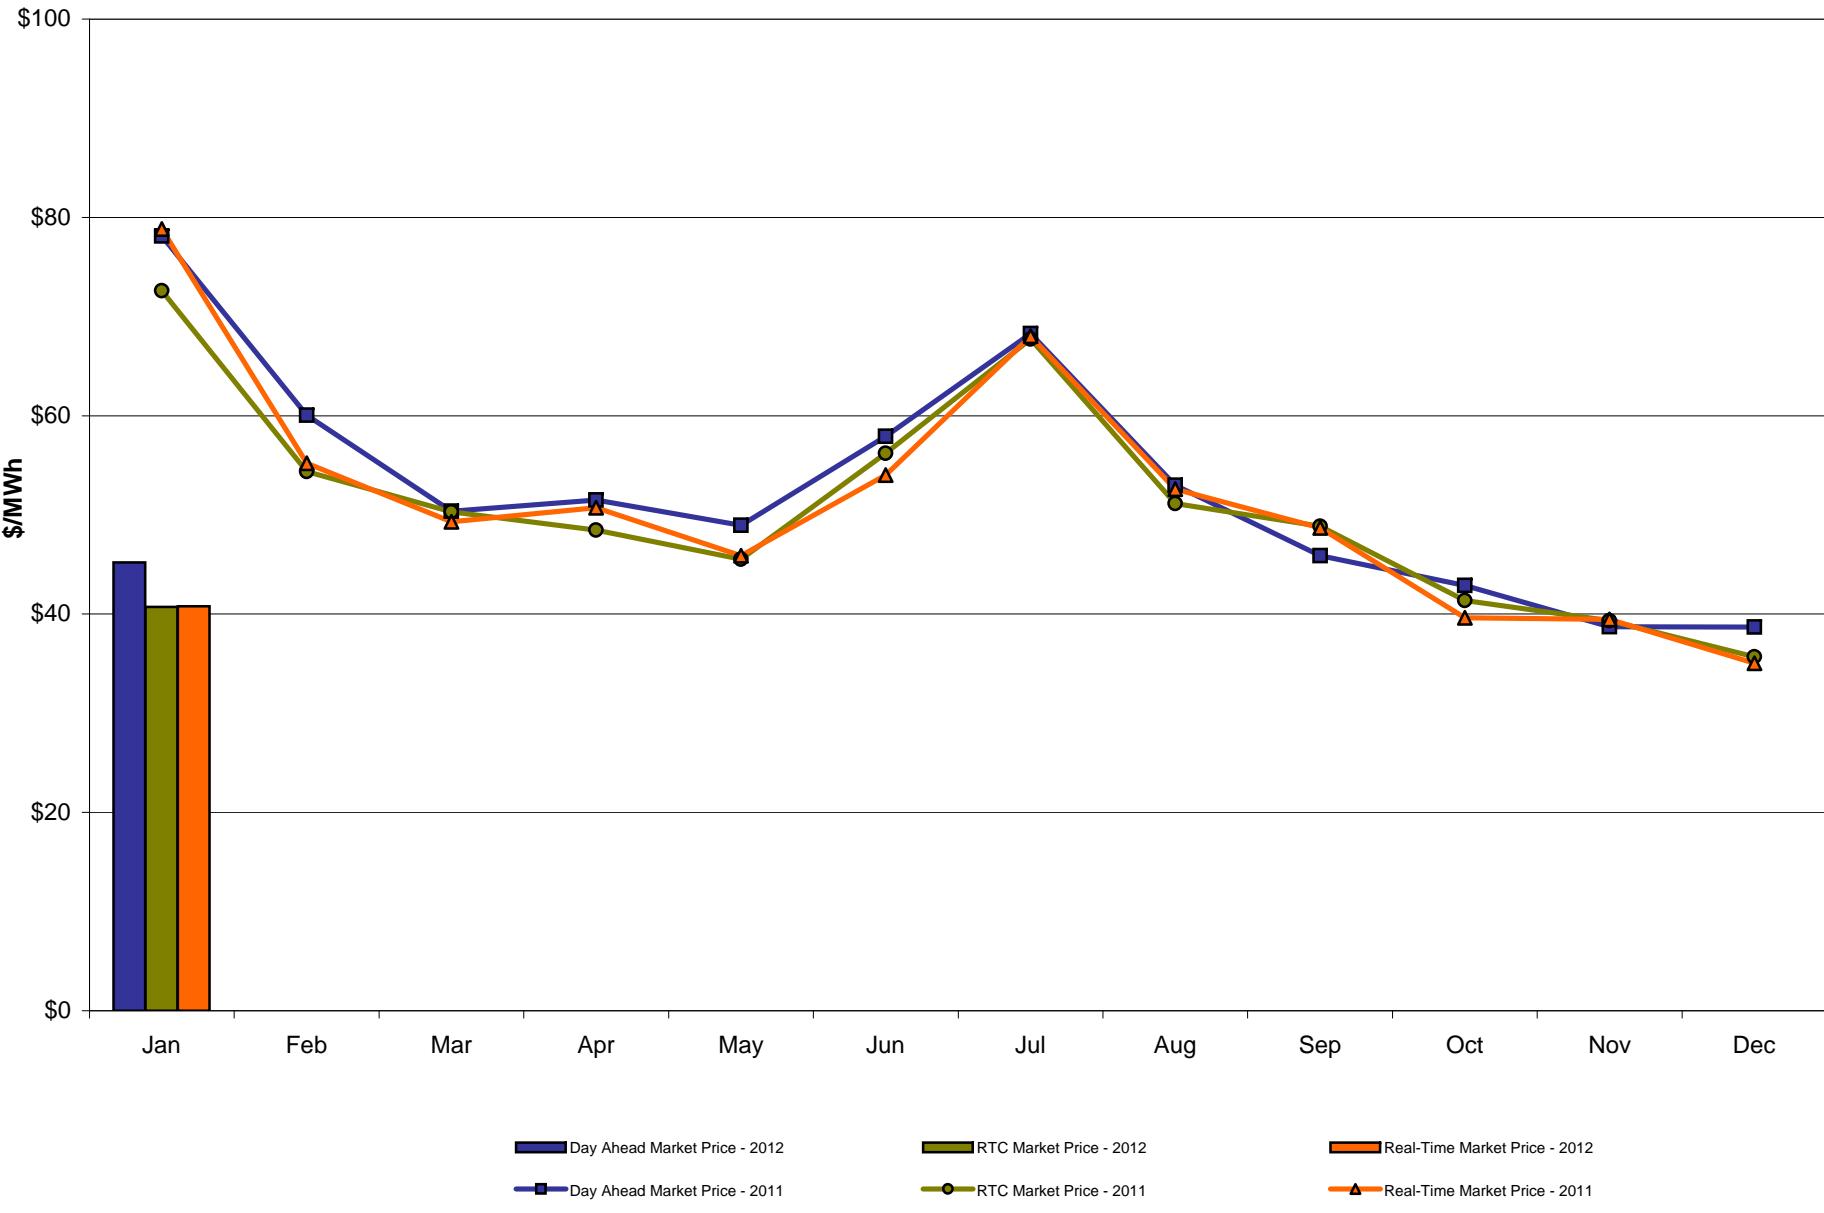


Long Island Zone K
Monthly Average LBMP Prices 2011 - 2012

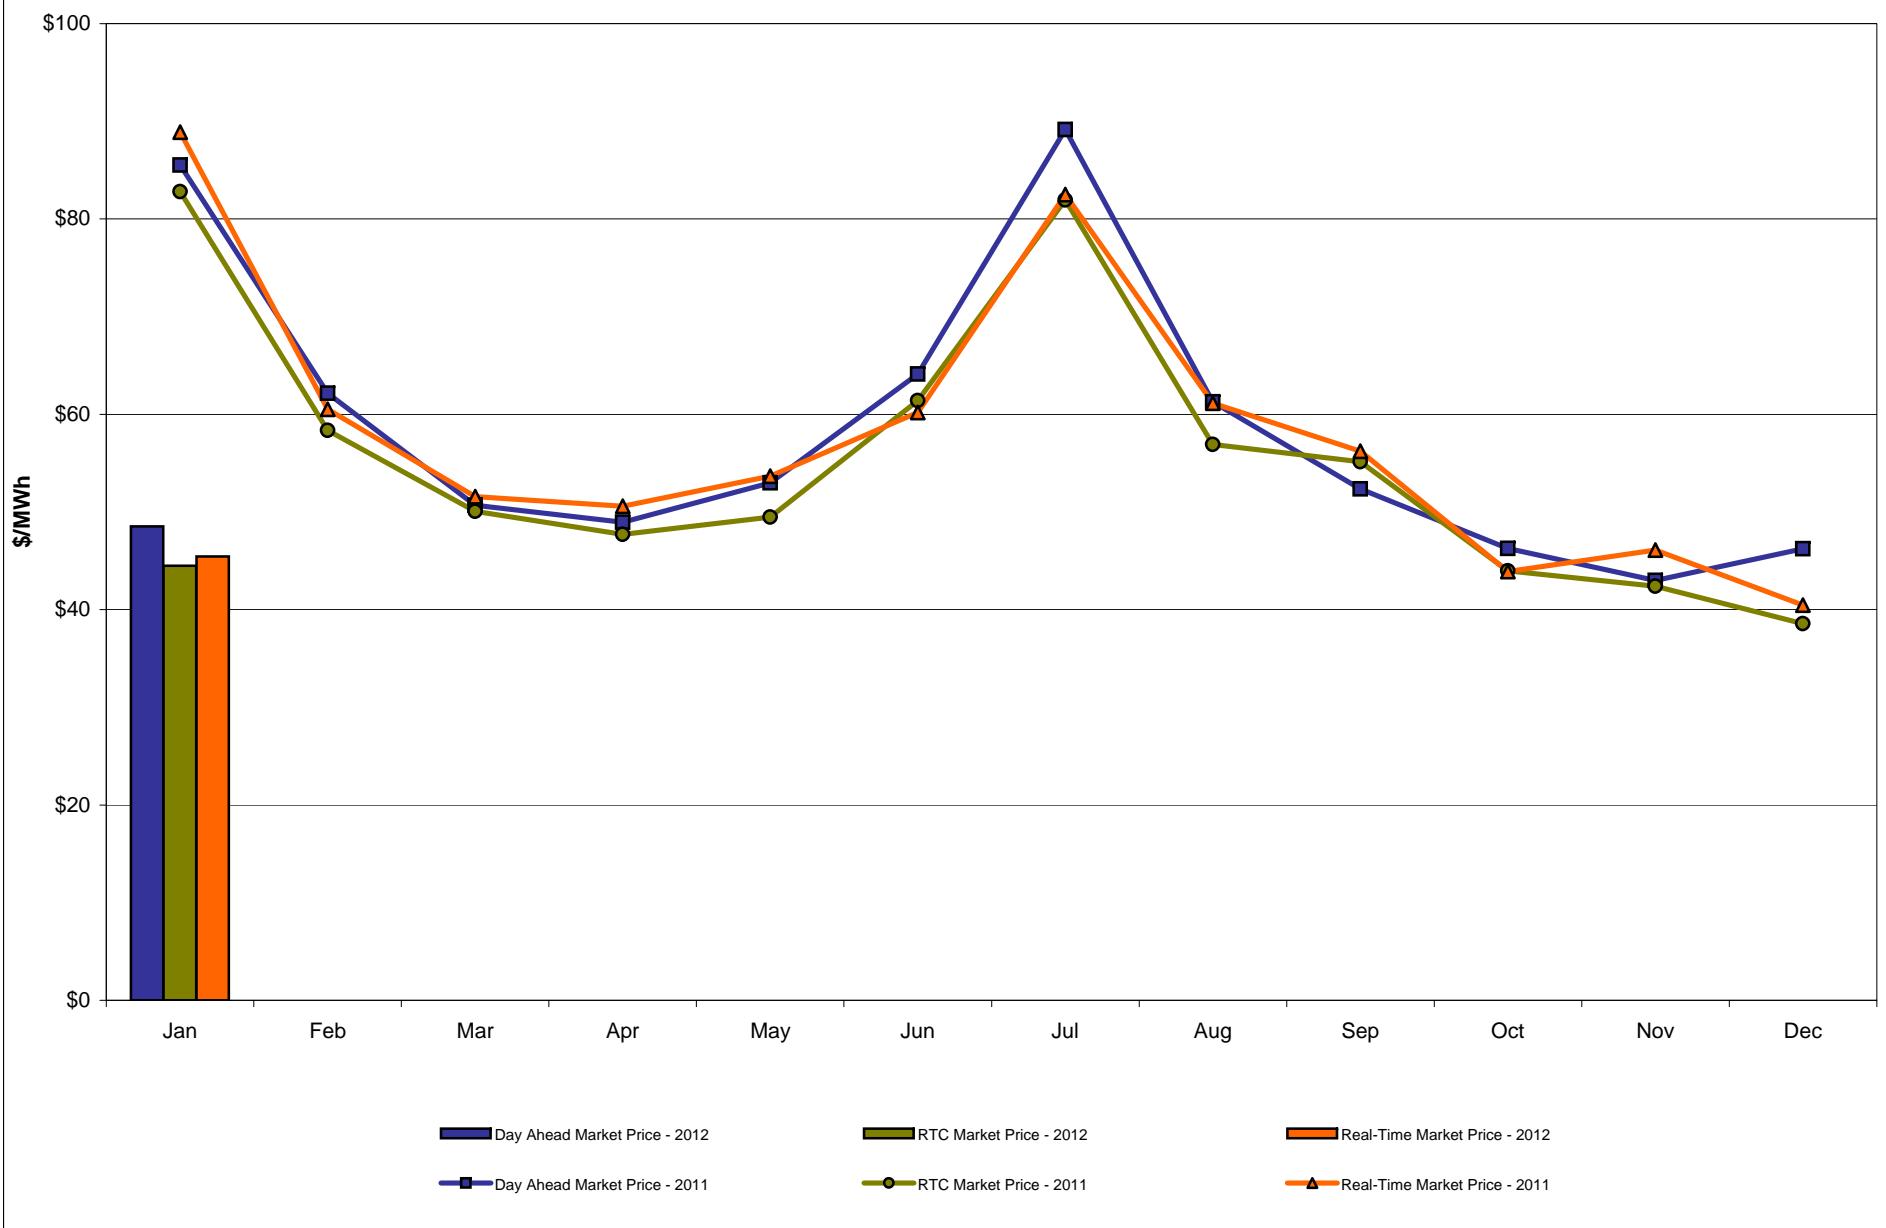



**DAM Zonal Unweighted Monthly Average LBMP Components
thru January 31, 2012**

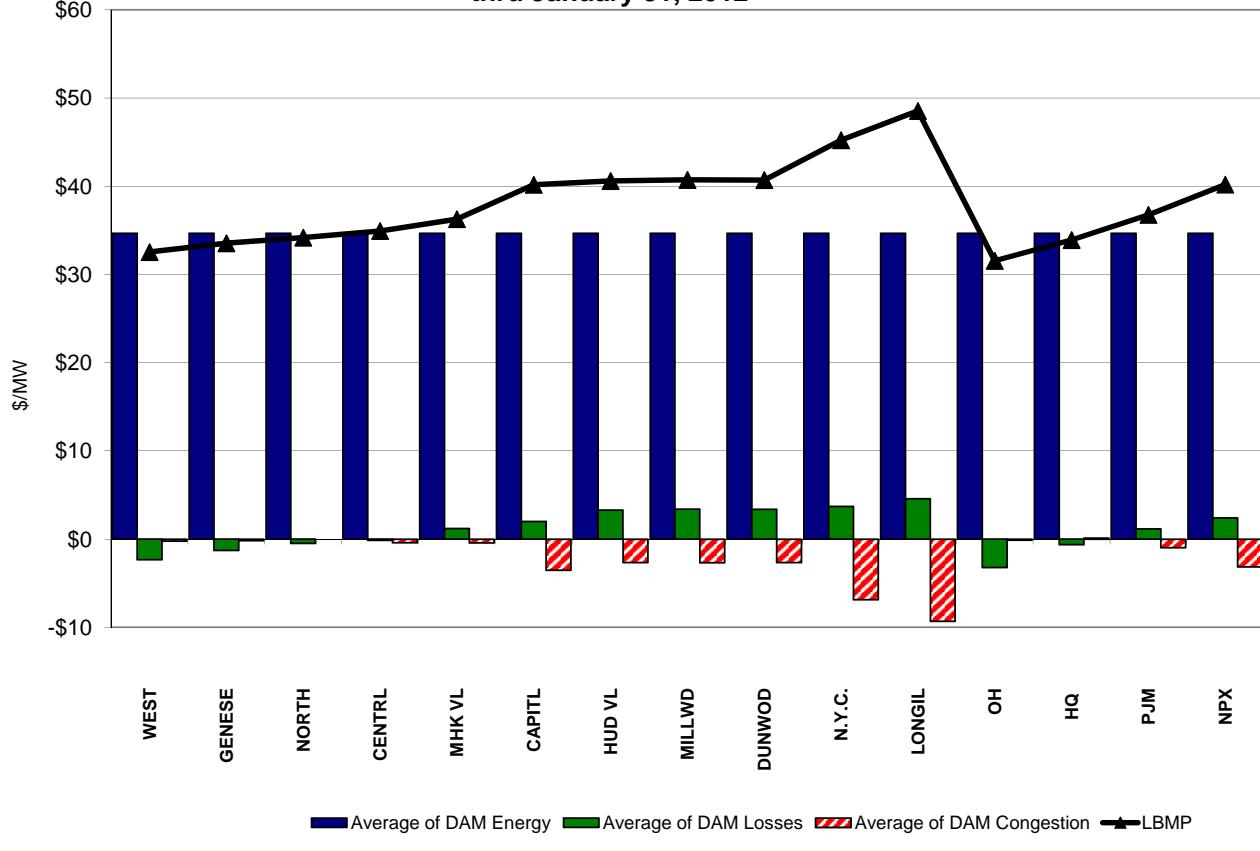

**RT Zonal Unweighted Monthly Average LBMP Components
thru January 31, 2012**

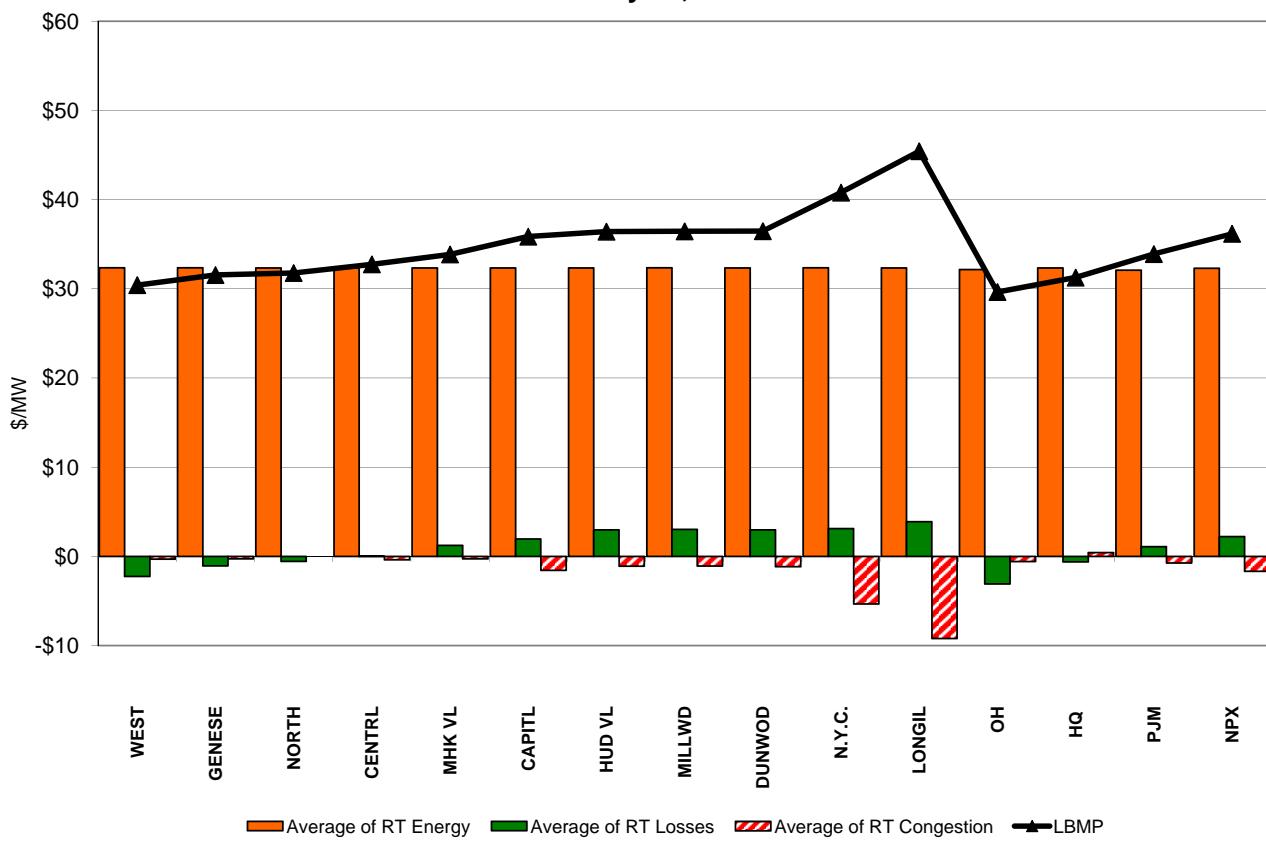


External Comparison ISO-New England

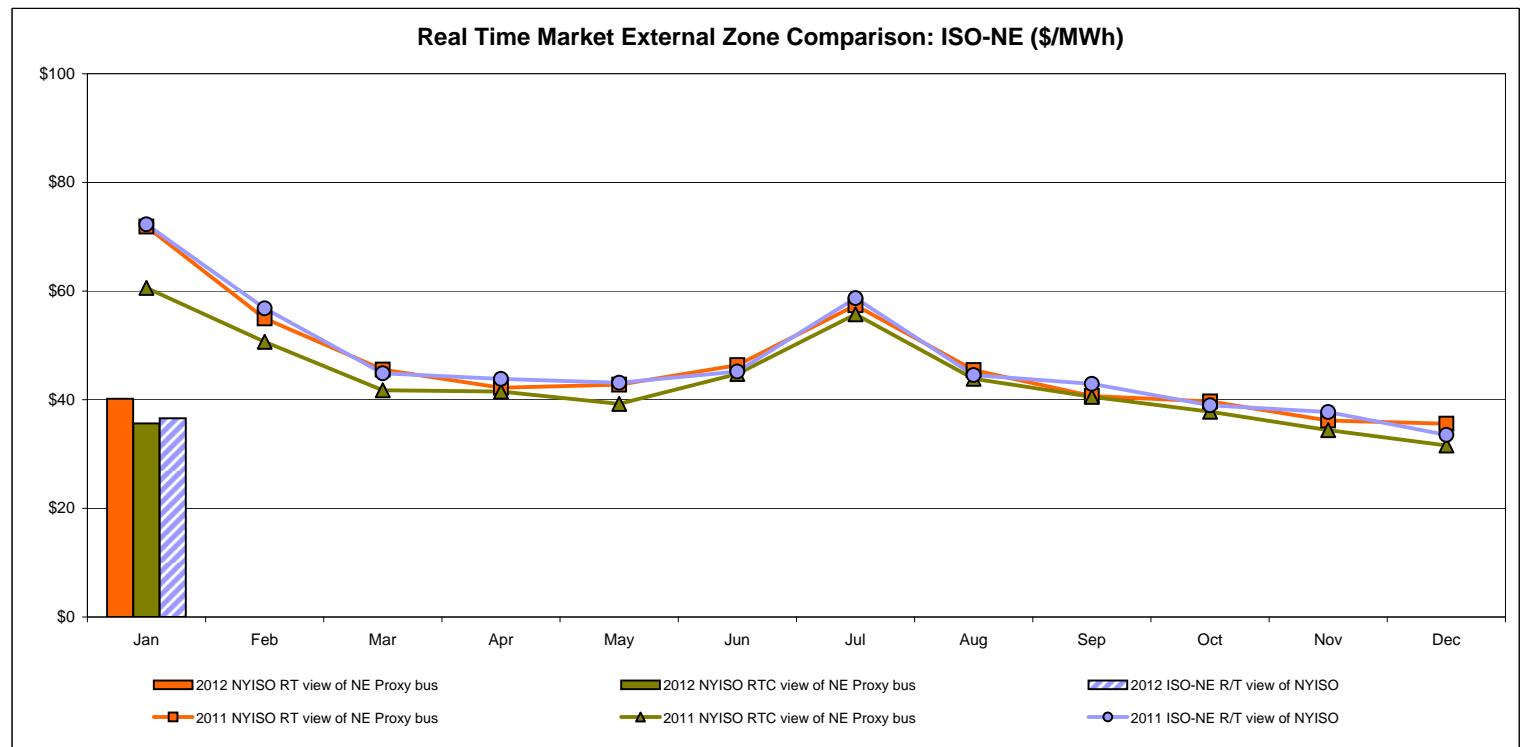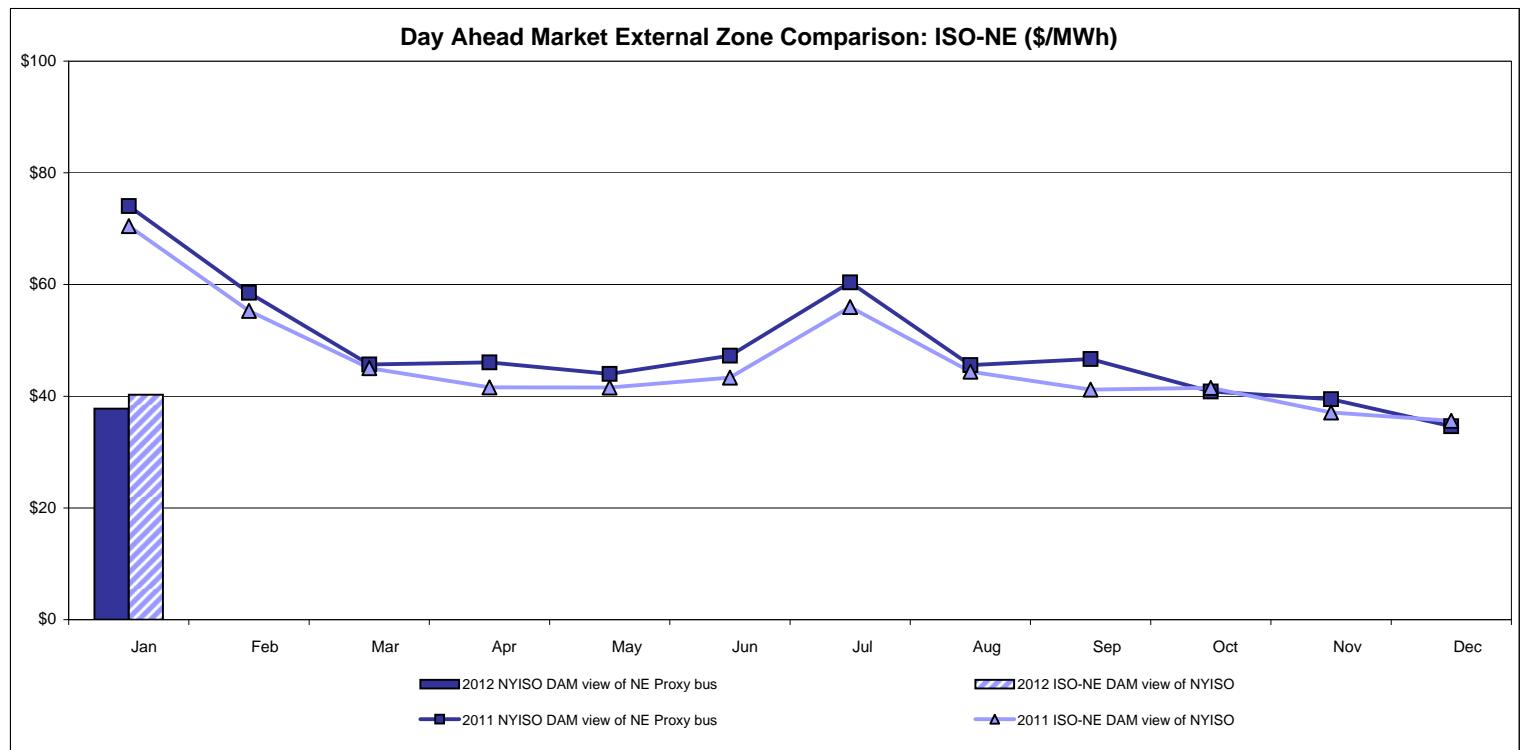


External Comparison PJM


Day Ahead Market External Zone Comparison - PJM (\$/MWh)

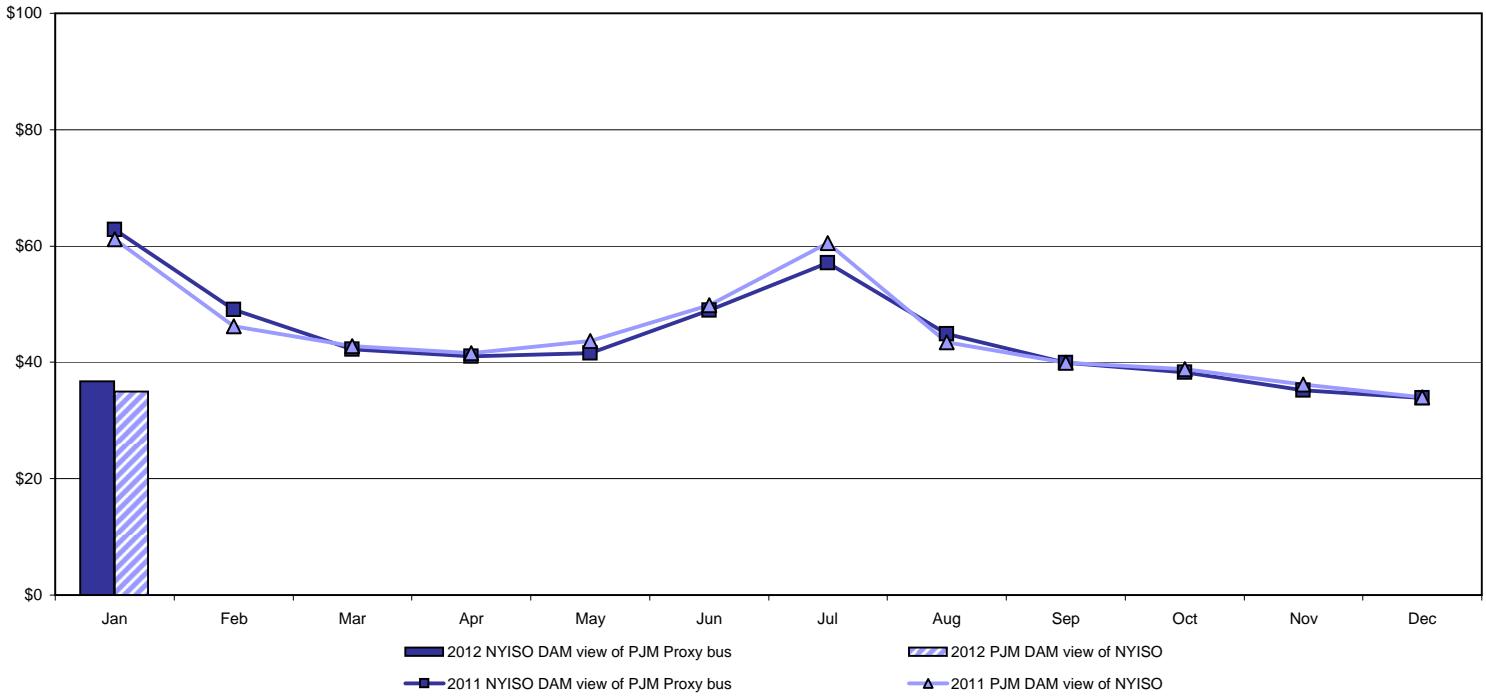

Real Time Market External Zone Comparison - PJM (\$/MWh)

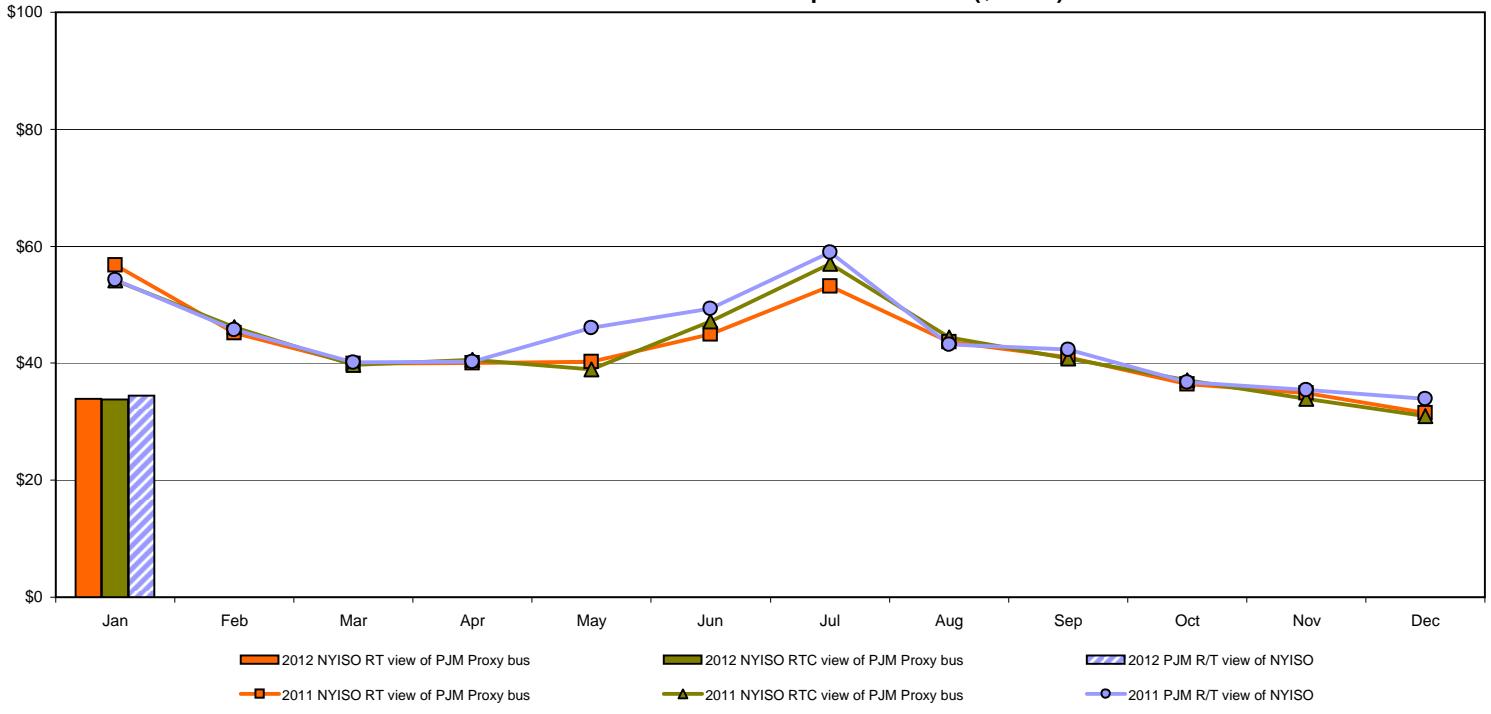

External Comparison Ontario IESO


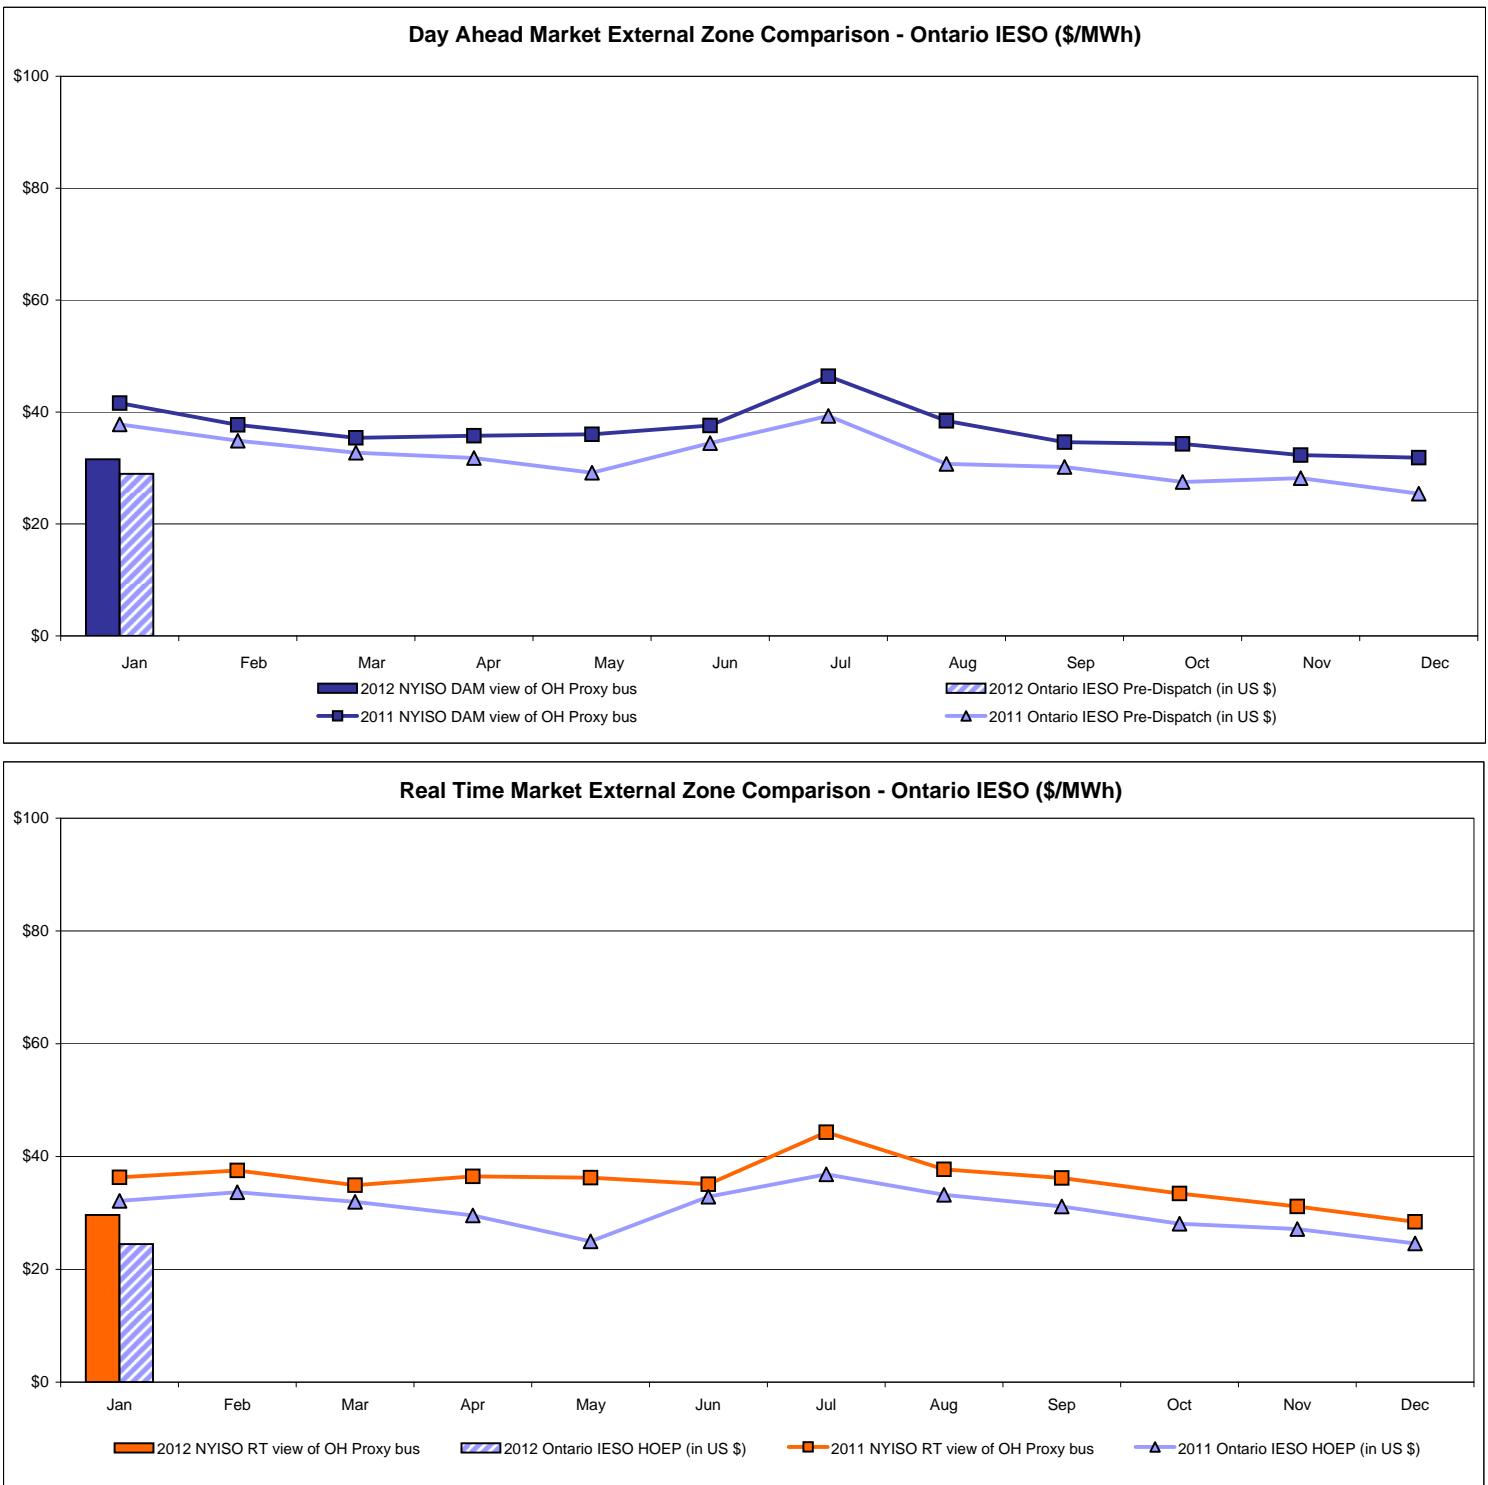


Notes: Exchange factor used for January 2012 was 0.98 to US \$

HOEP: Hourly Ontario Energy Price

Pre-Dispatch: Projected Energy Price

External Controllable Line: Cross Sound Cable (New England)

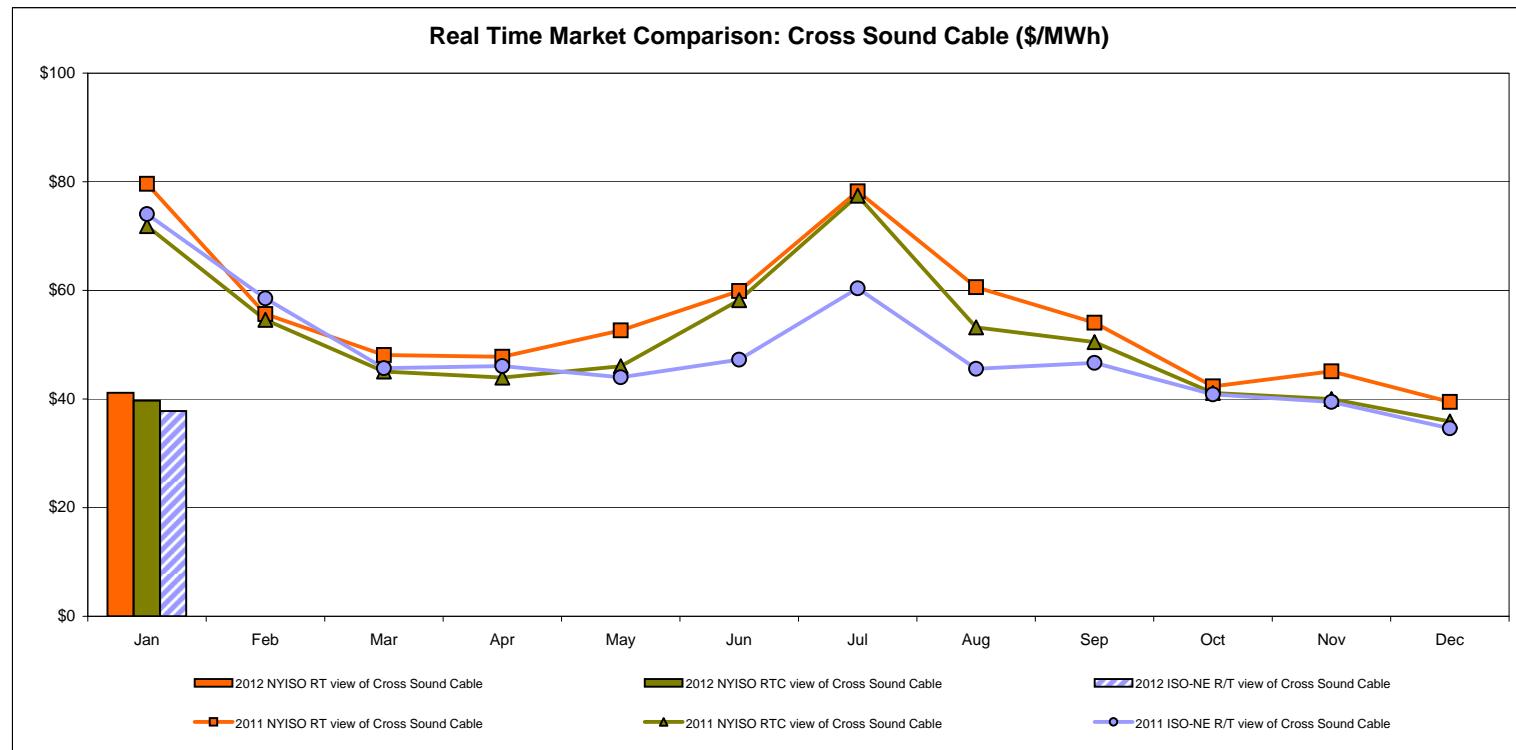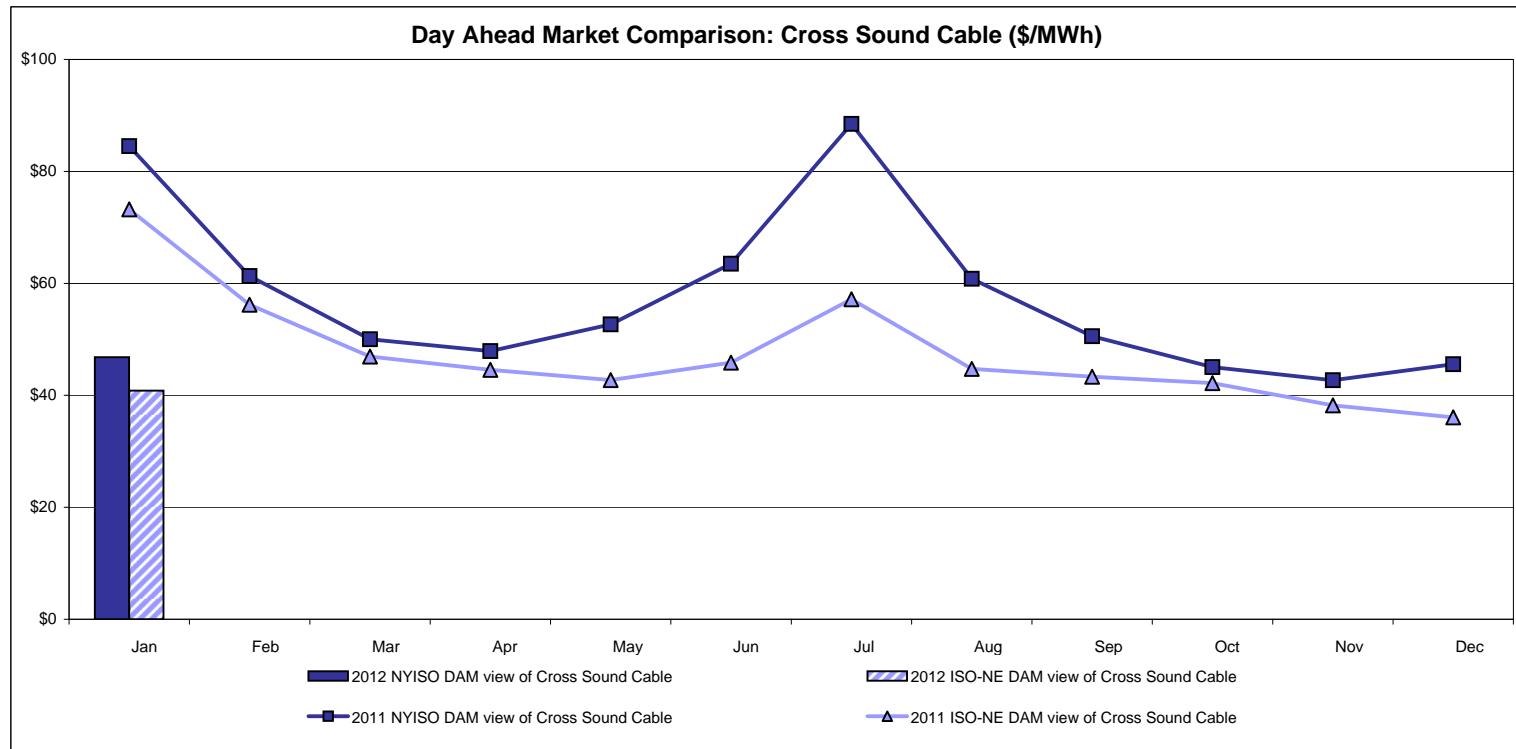



Note:

ISO-NE Forecast is an advisory posting @ 18:00 day before.

The DAM and R/T prices at the Shorham 13899 interface are used for ISO-NE.

The DAM and R/T prices at the CSC interface are used for NYISO.

External Controllable Line: Northport - Norwalk (New England)

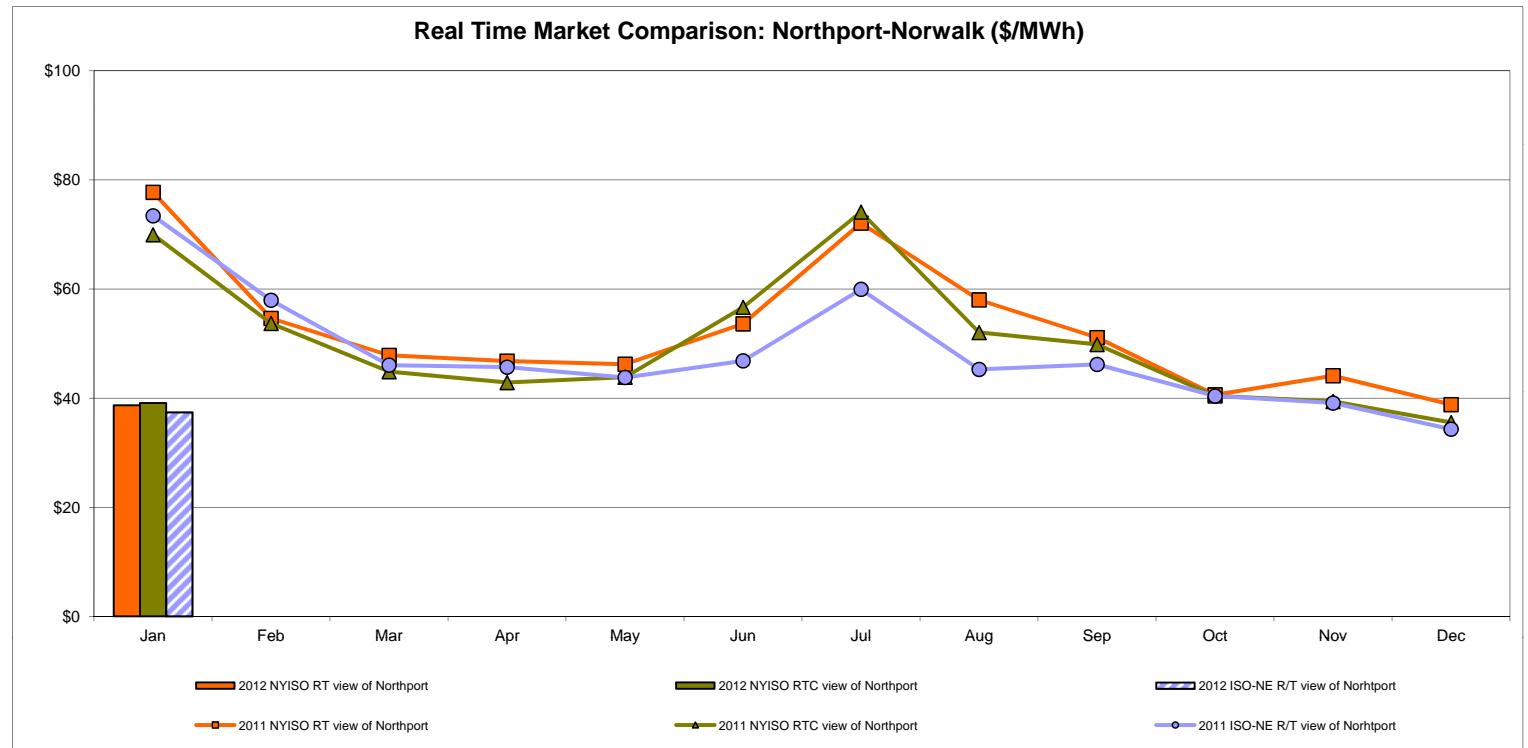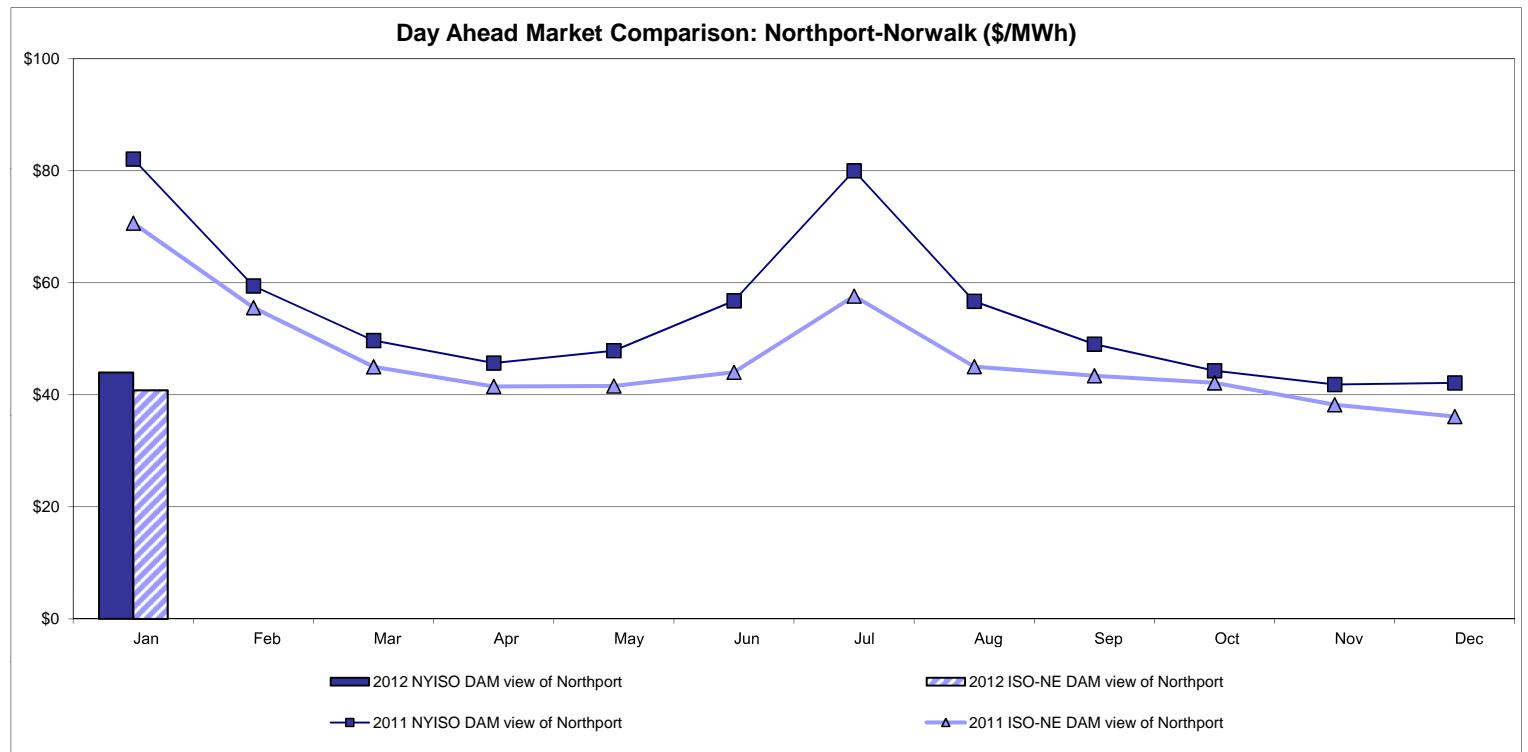

Note:


ISO-NE Forecast is an advisory posting @ 18:00 day before.

The DAM and R/T prices at the Northport 138 interface are used for ISO-NE.


The DAM and R/T prices at the 1385 interface are used for NYISO.

External Controllable Line: Neptune (PJM)



Day Ahead Market Comparison: Neptune (\$/MWh)

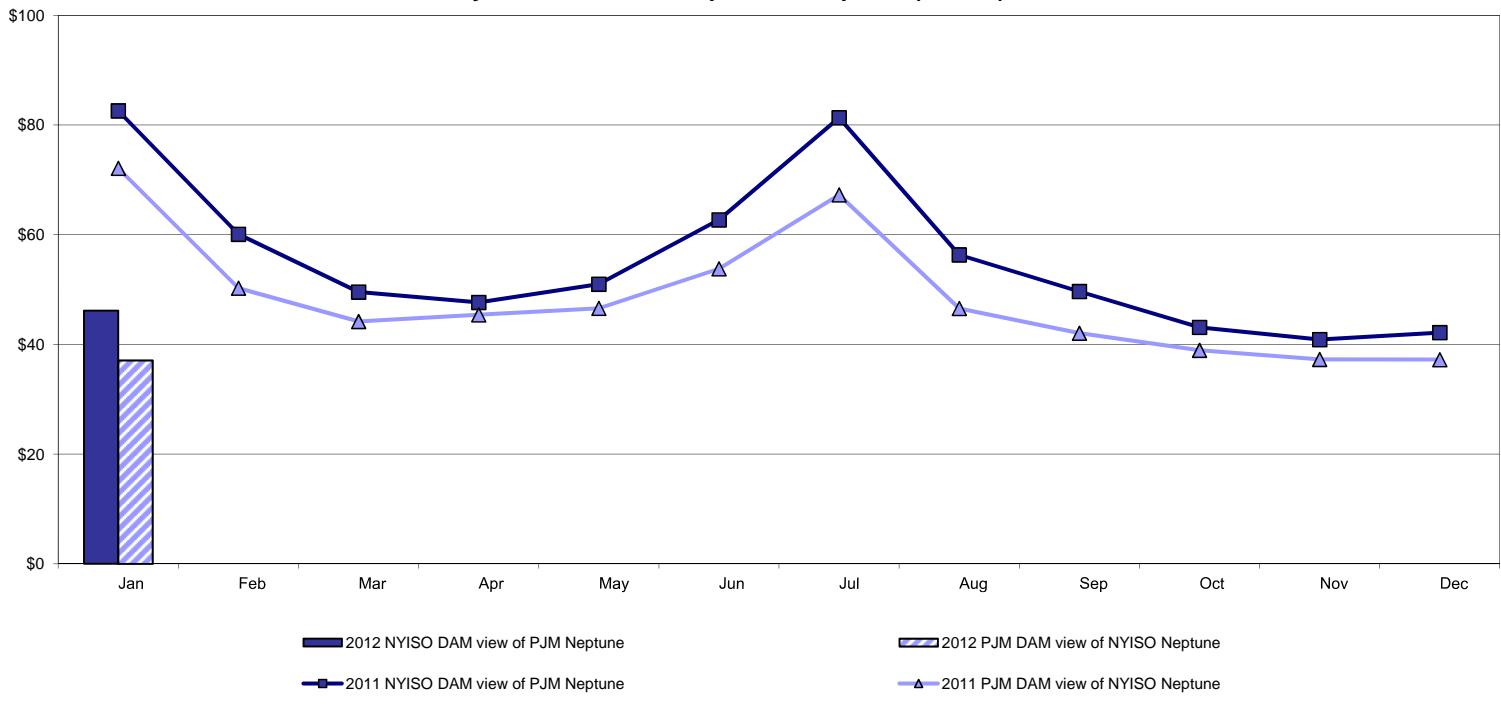

Real Time Market Comparison: Neptune (\$/MWh)

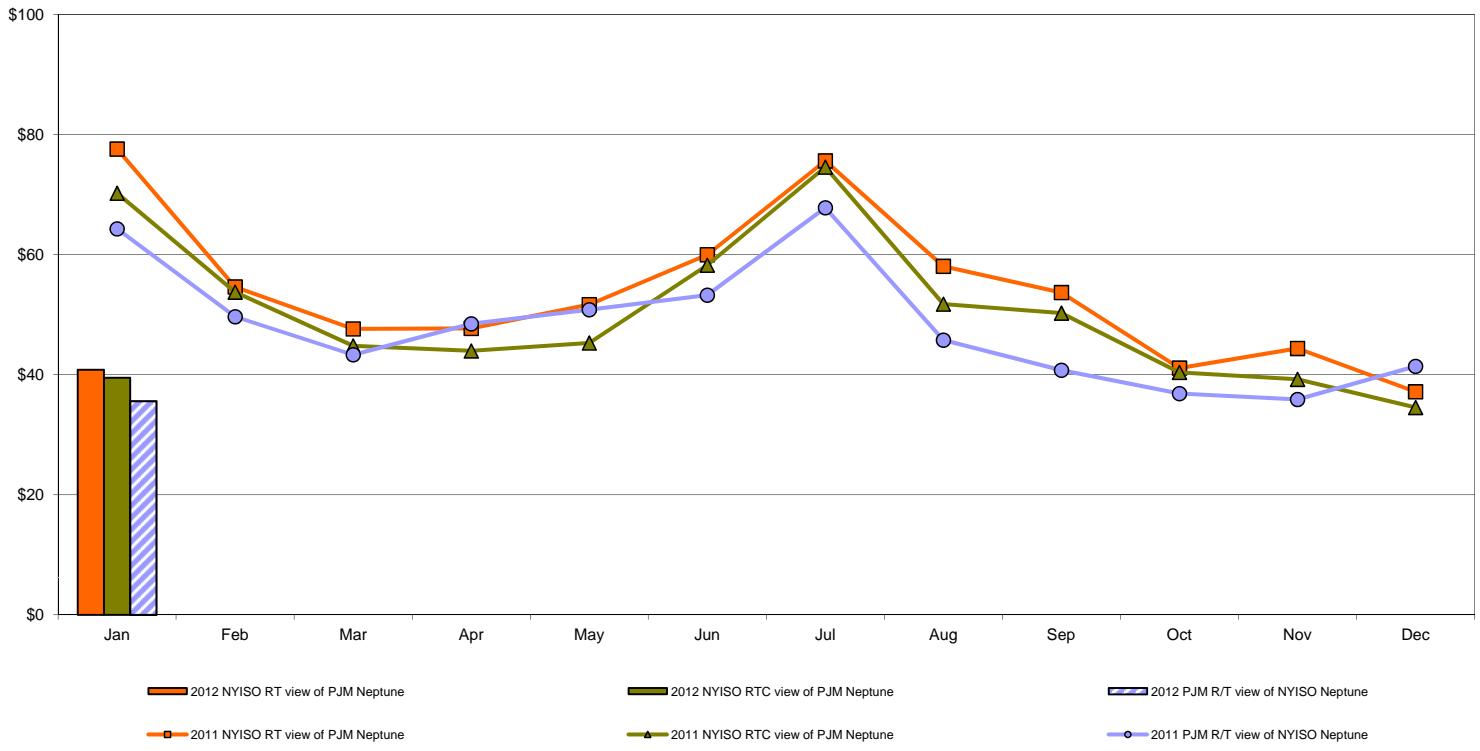

External Comparison Hydro-Quebec

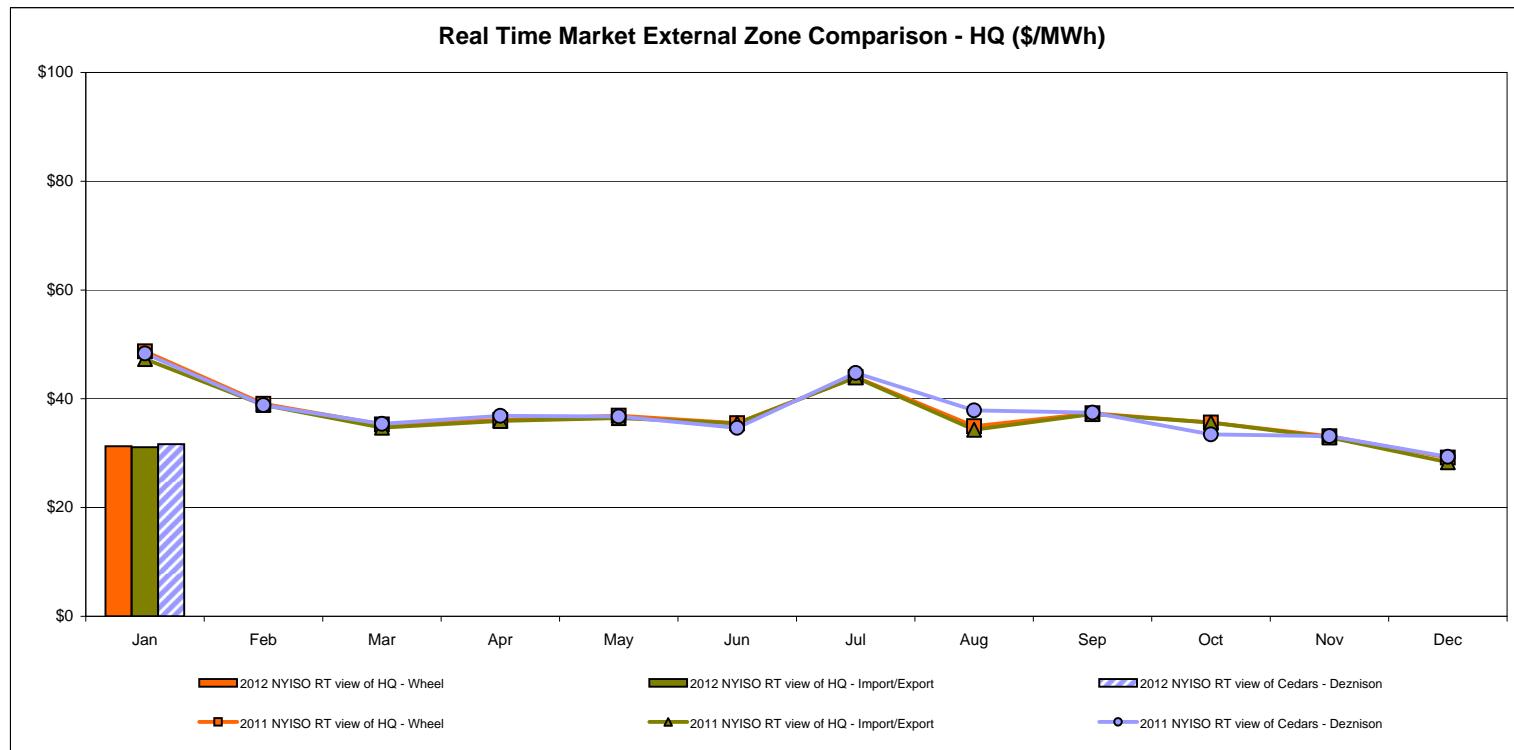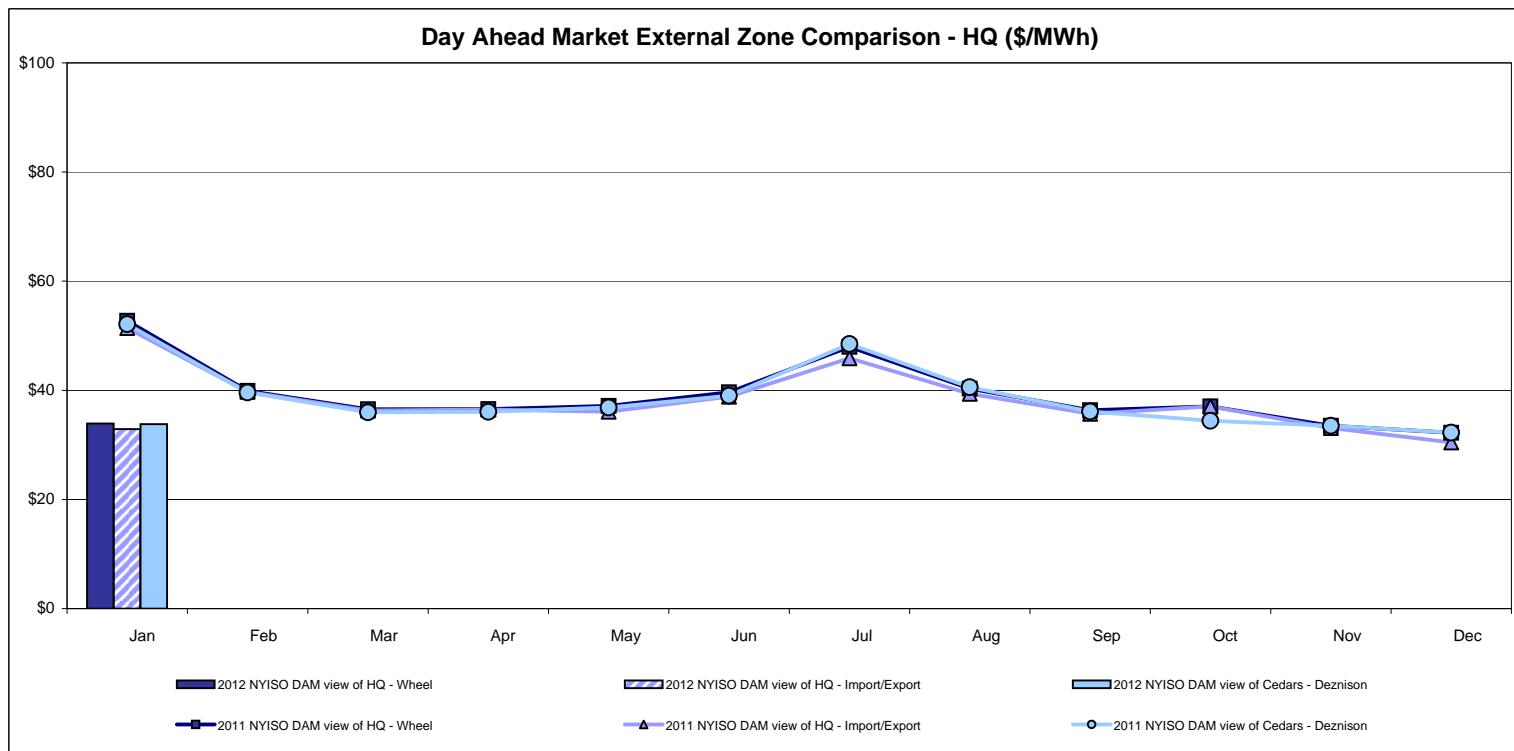


Note:


Hydro-Quebec Prices are unavailable.

External Controllable Line: Linden VFT (PJM)

Day Ahead Market Comparison: Linden VFT (\$/MWh)

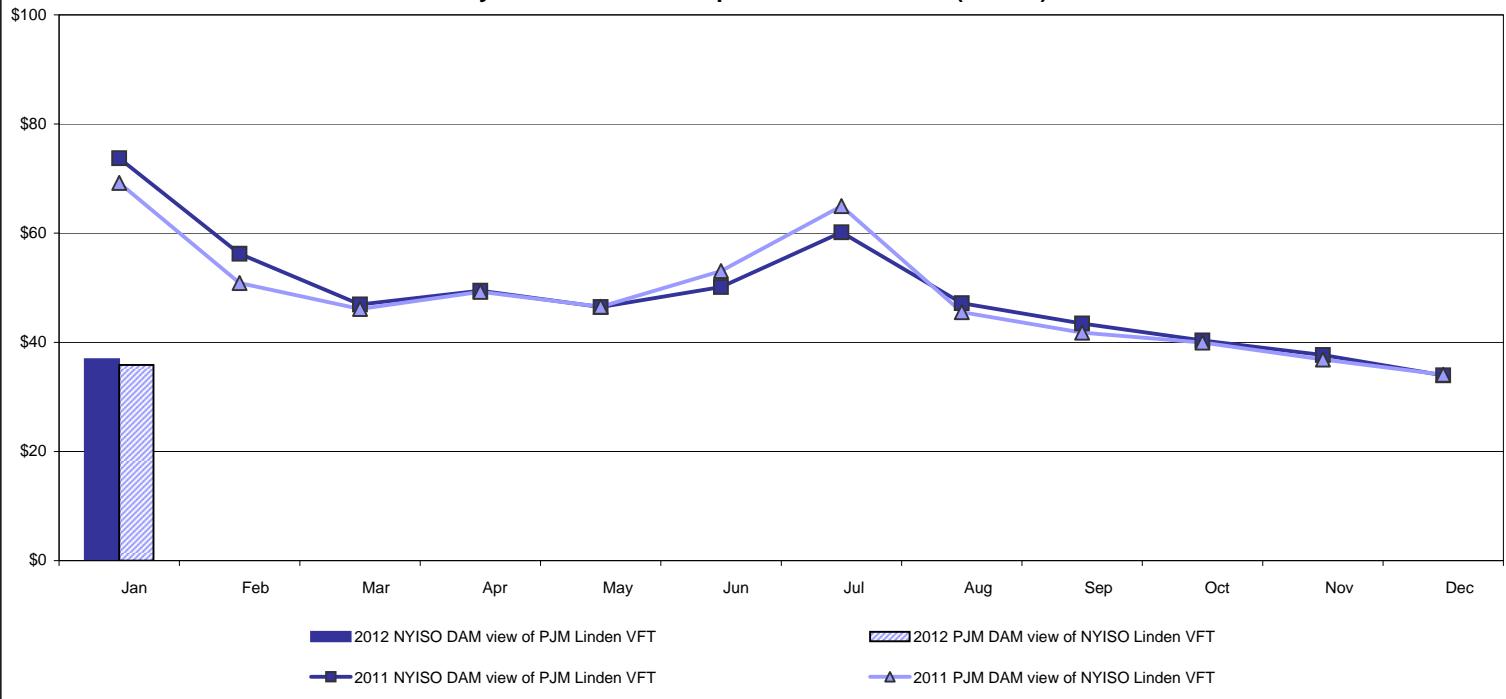



Real Time Market Comparison: Linden VFT (\$/MWh)

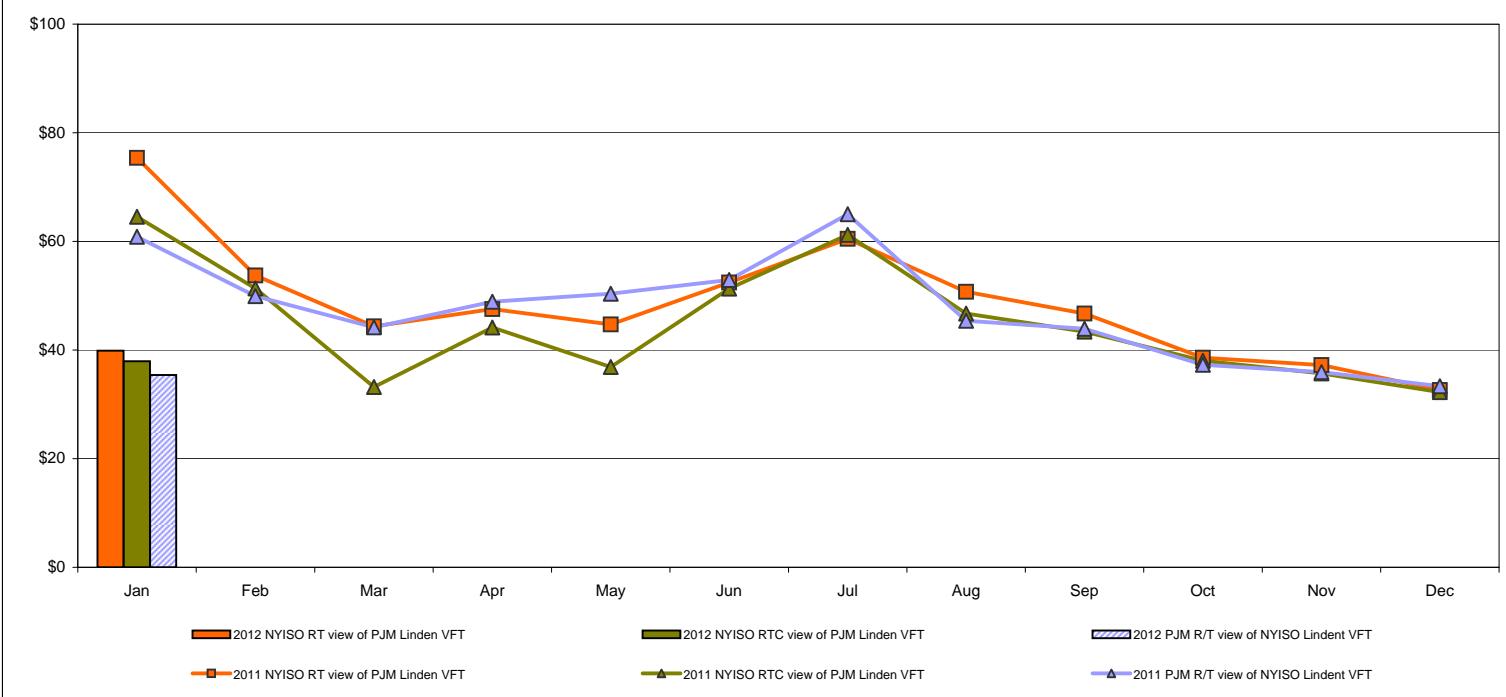

NYISO Real Time Price Correction Statistics


<u>2012</u>		<u>January</u>	<u>February</u>	<u>March</u>	<u>April</u>	<u>May</u>	<u>June</u>	<u>July</u>	<u>August</u>	<u>September</u>	<u>October</u>	<u>November</u>	<u>December</u>
<u>Hour Corrections</u>													
Number of hours with corrections	in the month	0											
Number of hours	in the month	744											
% of hours with corrections	in the month	0.00%											
% of hours with corrections	year-to-date	0.00%											
<u>Interval Corrections</u>													
Number of intervals corrected	in the month	0											
Number of intervals	in the month	8,987											
% of intervals corrected	in the month	0.00%											
% of intervals corrected	year-to-date	0.00%											
<u>Hours Reserved</u>													
Number of hours reserved	in the month	0											
Number of hours	in the month	744											
% of hours reserved	in the month	0.00%											
% of hours reserved	year-to-date	0.00%											
<u>Days to Correction *</u>													
Avg. number of days to correction	in the month	0.00											
Avg. number of days to correction	year-to-date	0.00											
<u>Days Without Corrections</u>													
Days without corrections	in the month	31											
Days without corrections	year-to-date	31											
<u>2011</u>		<u>January</u>	<u>February</u>	<u>March</u>	<u>April</u>	<u>May</u>	<u>June</u>	<u>July</u>	<u>August</u>	<u>September</u>	<u>October</u>	<u>November</u>	<u>December</u>
<u>Hour Corrections</u>													
Number of hours with corrections	in the month	1	0	1	0	12	4	6	1	0	1	0	0
Number of hours	in the month	744	672	744	720	744	720	744	744	720	744	720	744
% of hours with corrections	in the month	0.13%	0.00%	0.13%	0.00%	1.61%	0.56%	0.81%	0.13%	0.00%	0.13%	0.00%	0.00%
% of hours with corrections	year-to-date	0.13%	0.07%	0.09%	0.07%	0.39%	0.41%	0.47%	0.43%	0.38%	0.36%	0.32%	0.30%
<u>Interval Corrections</u>													
Number of intervals corrected	in the month	1	0	1	0	42	12	54	2	0	2	0	0
Number of intervals	in the month	8,938	8,049	8,924	8,671	8,939	8,661	8,967	9,021	8,678	8,940	8,671	8,954
% of intervals corrected	in the month	0.01%	0.00%	0.01%	0.00%	0.47%	0.14%	0.60%	0.02%	0.00%	0.02%	0.00%	0.00%
% of intervals corrected	year-to-date	0.01%	0.01%	0.01%	0.01%	0.10%	0.11%	0.18%	0.16%	0.14%	0.13%	0.12%	0.11%
<u>Hours Reserved</u>													
Number of hours reserved	in the month	1	0	1	0	14	6	7	6	0	13	0	0
Number of hours	in the month	744	672	744	720	744	720	744	744	720	744	720	744
% of hours reserved	in the month	0.13%	0.00%	0.13%	0.00%	1.88%	0.83%	0.94%	0.81%	0.00%	1.75%	0.00%	0.00%
% of hours reserved	year-to-date	0.13%	0.07%	0.09%	0.07%	0.44%	0.51%	0.57%	0.60%	0.53%	0.66%	0.60%	0.55%
<u>Days to Correction *</u>													
Avg. number of days to correction	in the month	3.00	0.00	0.00	0.00	0.86	0.25	3.00	0.00	0.00	0.59	0.00	0.00
Avg. number of days to correction	year-to-date	3.00	3.00	1.50	1.50	1.00	0.77	1.07	1.00	1.00	0.98	0.98	0.98
<u>Days Without Corrections</u>													
Days without corrections	in the month	30	28	30	30	24	26	29	30	30	30	30	31
Days without corrections	year-to-date	30	58	88	118	142	168	197	227	257	287	317	348

* Calendar days from reservation date.

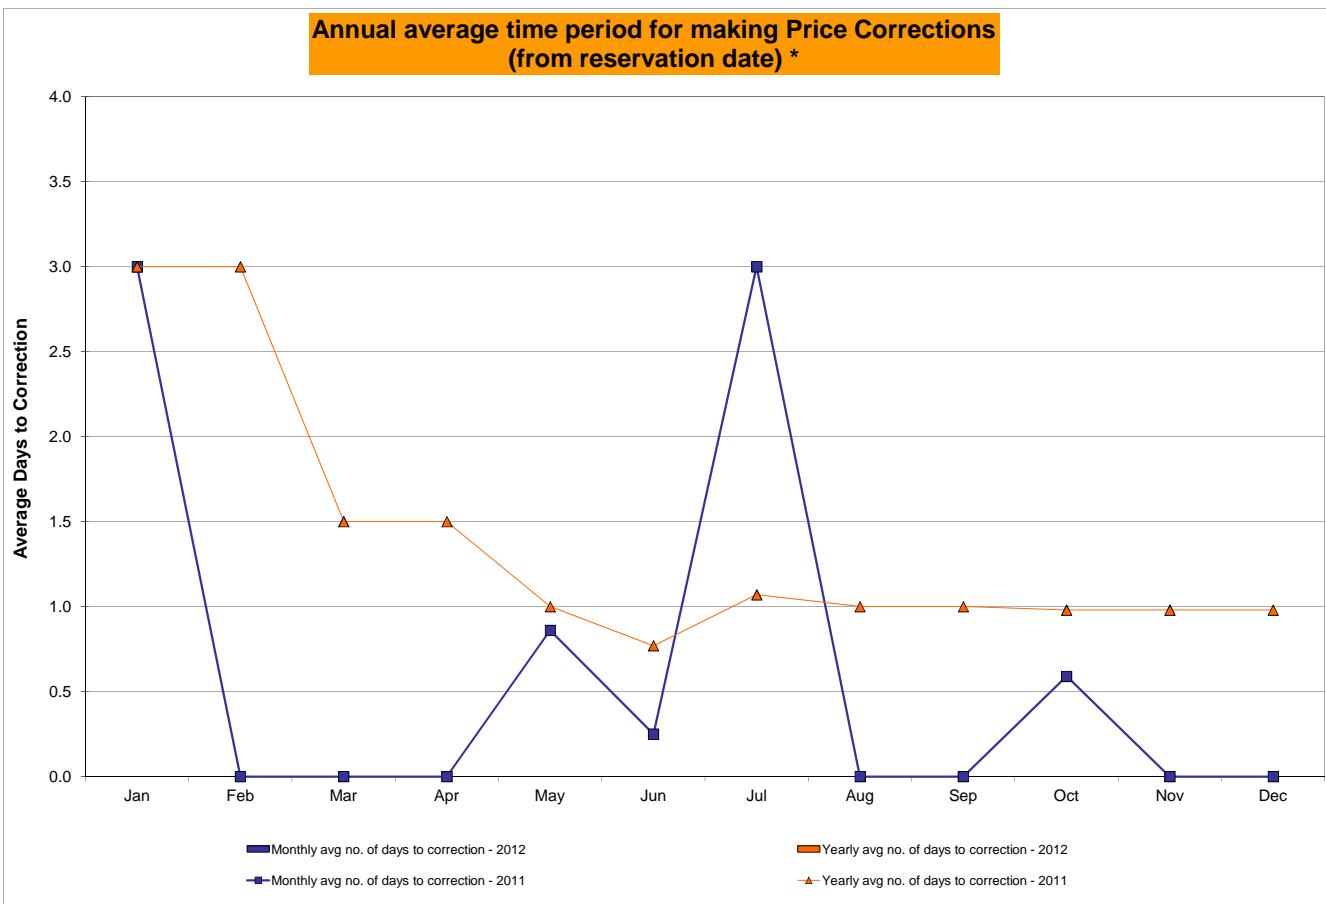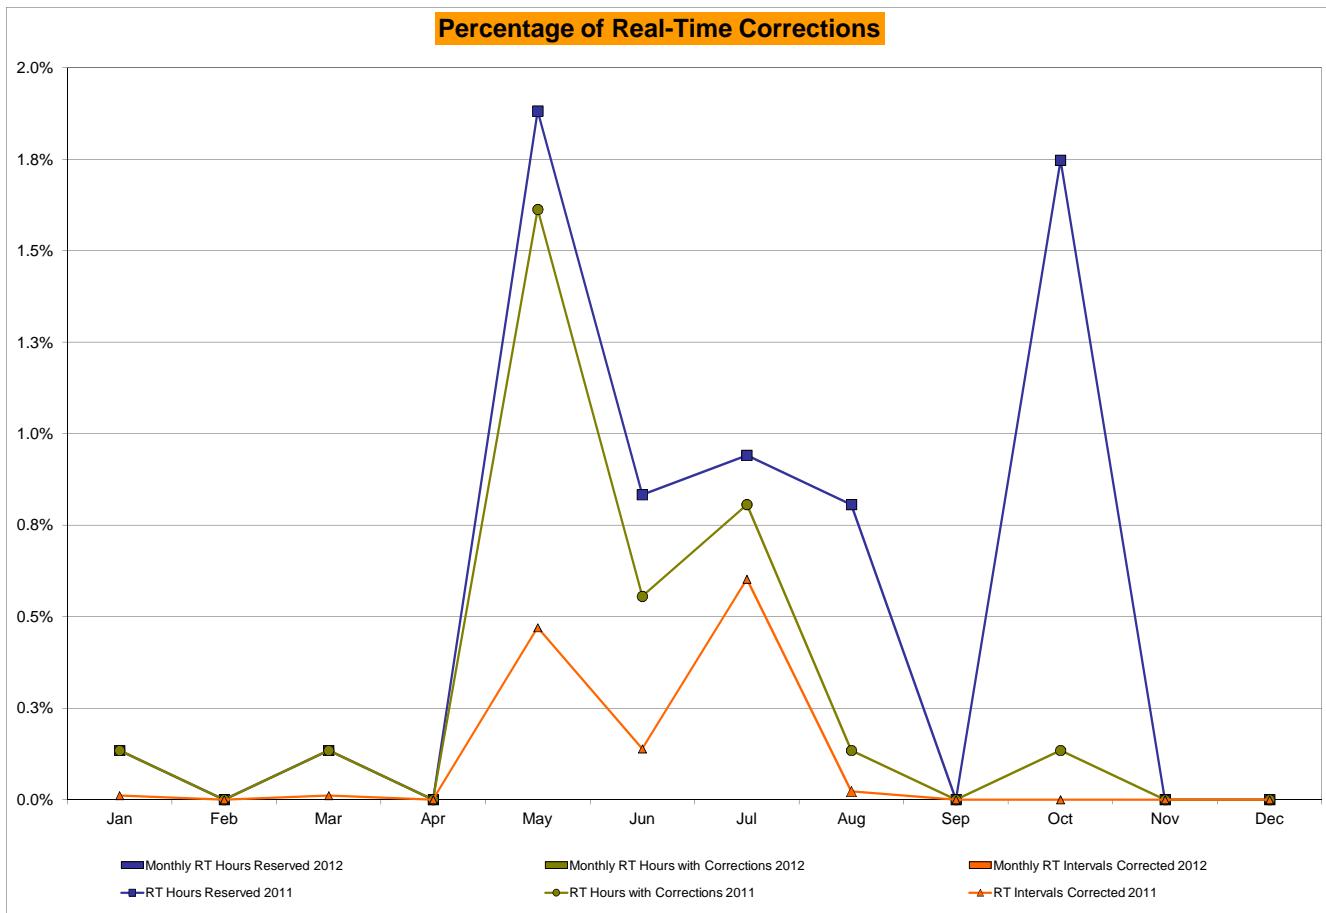


* Calendar days from reservation date.

NYISO Virtual Trading
Average MWh per day

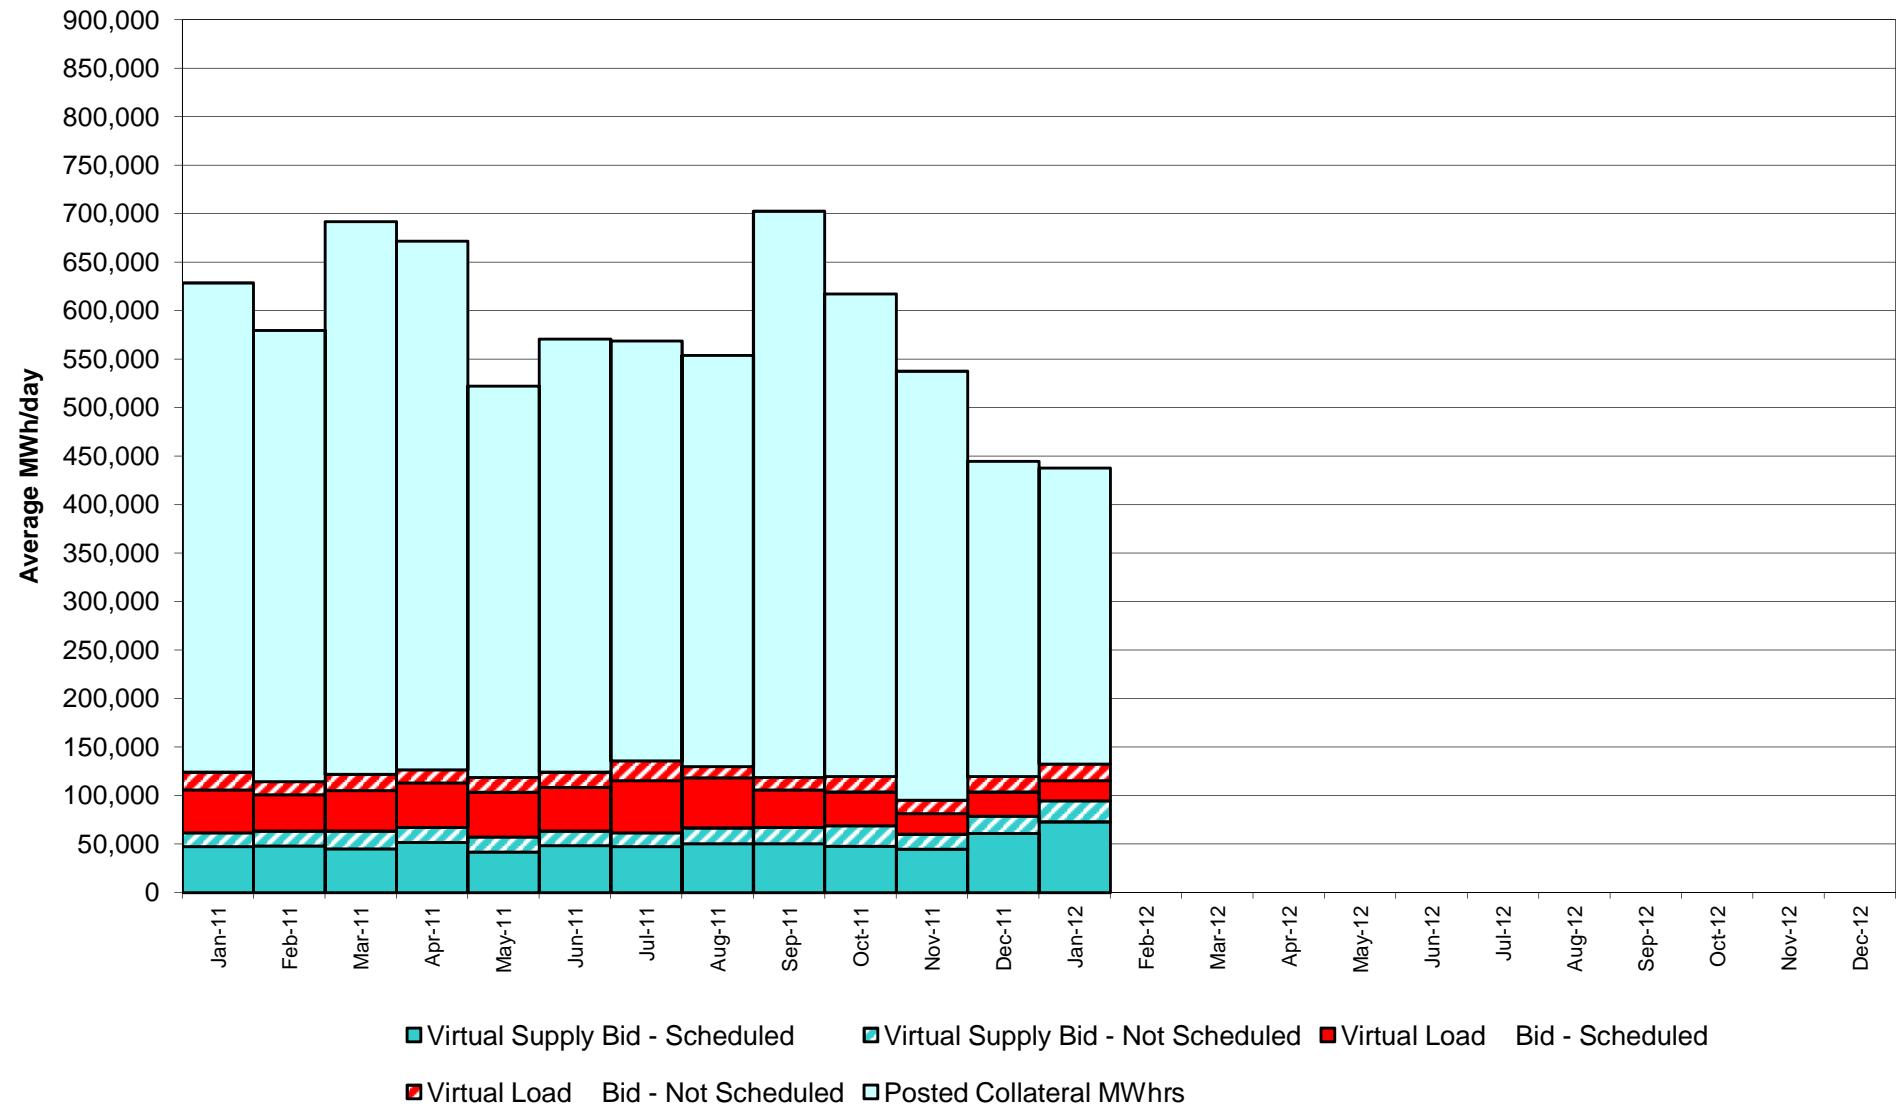


**Virtual Load and Supply Zonal Statistics
through January 31, 2012**

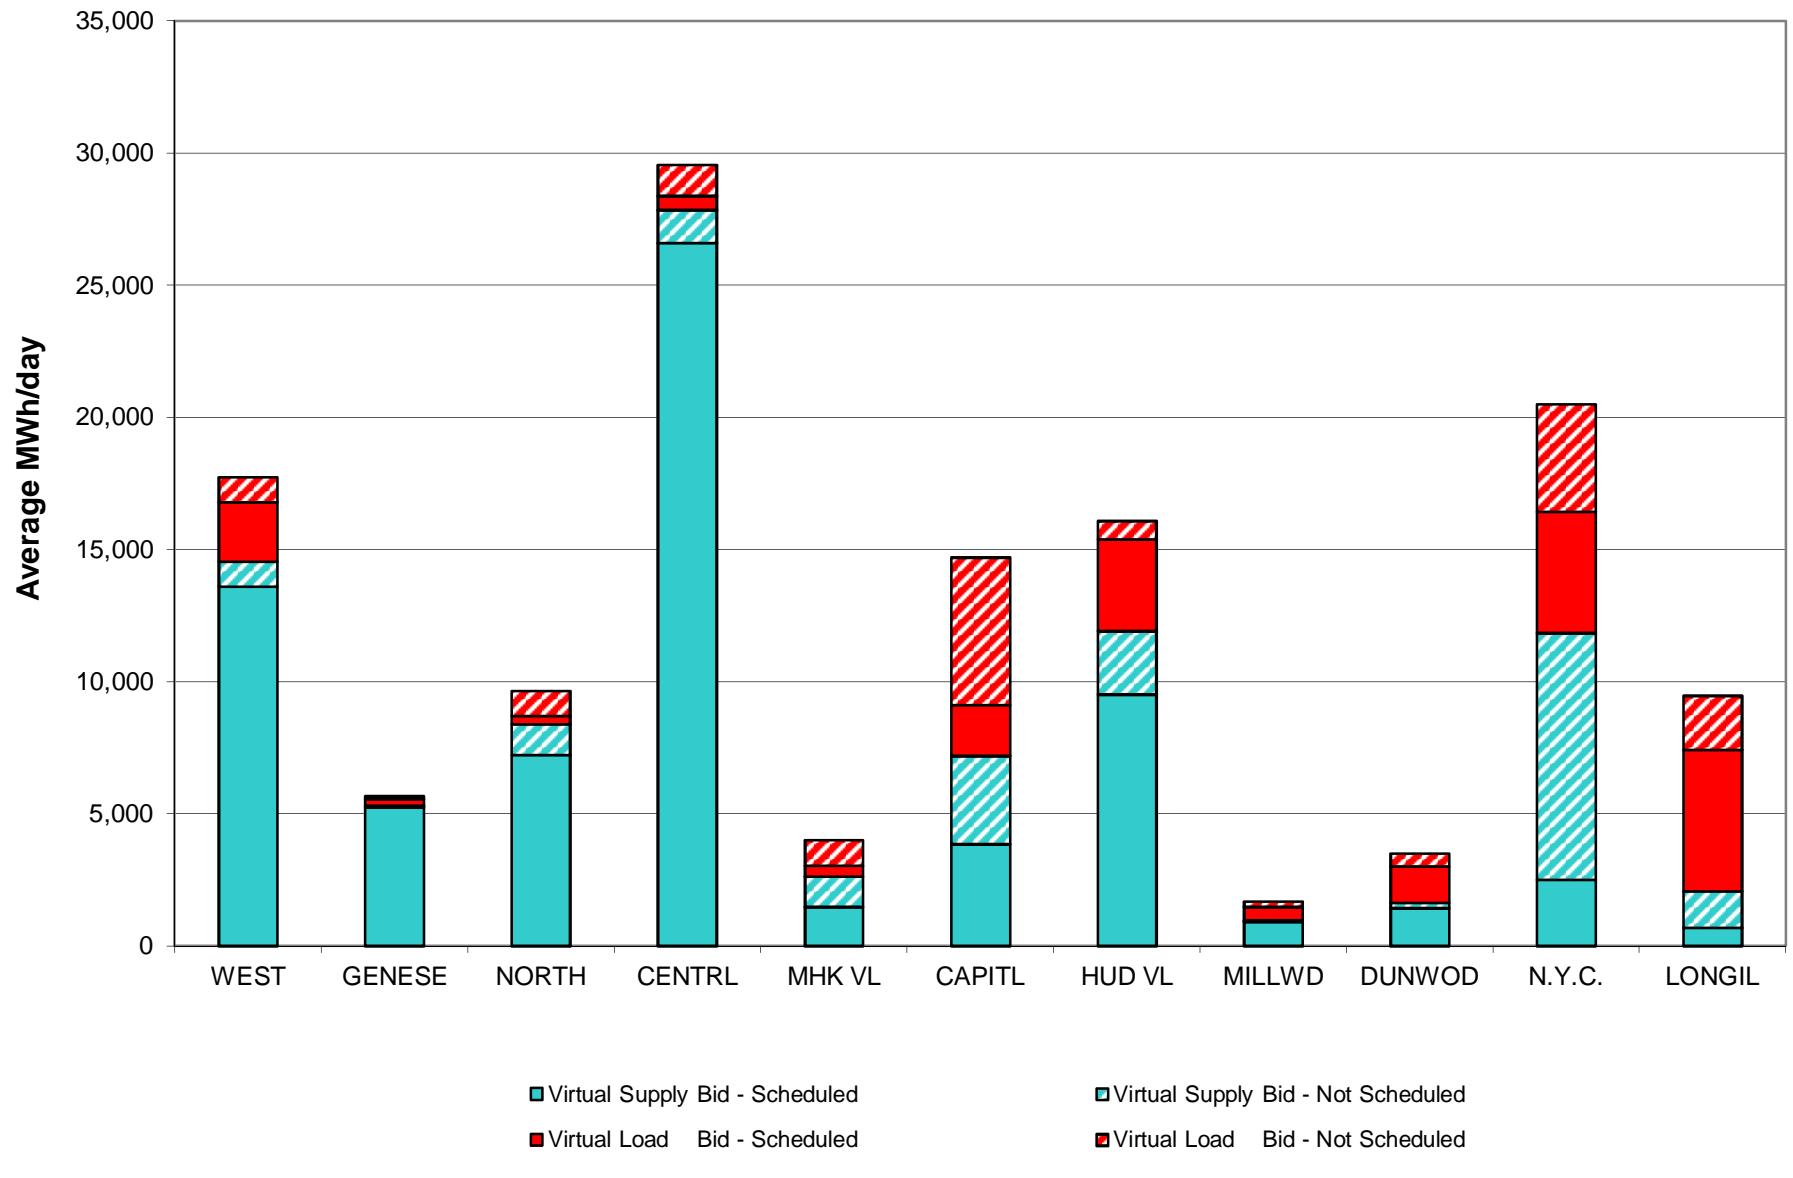


Virtual Load and Supply Zonal Statistics (Average MWh/day) - 2012

		Virtual Load Bid		Virtual Supply Bid				Virtual Load Bid		Virtual Supply Bid				Virtual Load Bid		Virtual Supply Bid					
Zone	Date	Scheduled	Not Scheduled	Scheduled	Not Scheduled	Zone	Date	Scheduled	Not Scheduled	Scheduled	Not Scheduled	Zone	Date	Scheduled	Not Scheduled	Scheduled	Not Scheduled				
WEST	Jan-12	2,246		938		13,593		956		MHK VL	Jan-12	419	967	1,488	1,127	DUNWOD	Jan-12	1,401	461	1,432	189
	Feb-12						Feb-12									Feb-12					
	Mar-12						Mar-12									Mar-12					
	Apr-12						Apr-12									Apr-12					
	May-12						May-12									May-12					
	Jun-12						Jun-12									Jun-12					
	Jul-12						Jul-12									Jul-12					
	Aug-12						Aug-12									Aug-12					
	Sep-12						Sep-12									Sep-12					
	Oct-12						Oct-12									Oct-12					
	Nov-12						Nov-12									Nov-12					
	Dec-12						Dec-12									Dec-12					
GENESE	Jan-12	257		102		5,254		64		CAPITL	Jan-12	1,903	5,590	3,842	3,364	N.Y.C.	Jan-12	4,572	4,060	2,511	9,344
	Feb-12						Feb-12									Feb-12					
	Mar-12						Mar-12									Mar-12					
	Apr-12						Apr-12									Apr-12					
	May-12						May-12									May-12					
	Jun-12						Jun-12									Jun-12					
	Jul-12						Jul-12									Jul-12					
	Aug-12						Aug-12									Aug-12					
	Sep-12						Sep-12									Sep-12					
	Oct-12						Oct-12									Oct-12					
	Nov-12						Nov-12									Nov-12					
	Dec-12						Dec-12									Dec-12					
NORTH	Jan-12	289		967		7,215		1,189		HUD VL	Jan-12	3,466	693	9,513	2,413	LONGIL	Jan-12	5,372	2,036	684	1,383
	Feb-12						Feb-12									Feb-12					
	Mar-12						Mar-12									Mar-12					
	Apr-12						Apr-12									Apr-12					
	May-12						May-12									May-12					
	Jun-12						Jun-12									Jun-12					
	Jul-12						Jul-12									Jul-12					
	Aug-12						Aug-12									Aug-12					
	Sep-12						Sep-12									Sep-12					
	Oct-12						Oct-12									Oct-12					
	Nov-12						Nov-12									Nov-12					
	Dec-12						Dec-12									Dec-12					
CENTRL	Jan-12	526		1,178		26,589		1,270		MILLWD	Jan-12	505	206	929	50	NYISO	Jan-12	20,956	17,198	73,050	21,349
	Feb-12						Feb-12									Feb-12					
	Mar-12						Mar-12									Mar-12					
	Apr-12						Apr-12									Apr-12					
	May-12						May-12									May-12					
	Jun-12						Jun-12									Jun-12					
	Jul-12						Jul-12									Jul-12					
	Aug-12						Aug-12									Aug-12					
	Sep-12						Sep-12									Sep-12					
	Oct-12						Oct-12									Oct-12					
	Nov-12						Nov-12									Nov-12					
	Dec-12						Dec-12									Dec-12					


NYISO Multi Hour Block Transactions Monthly Total MWh

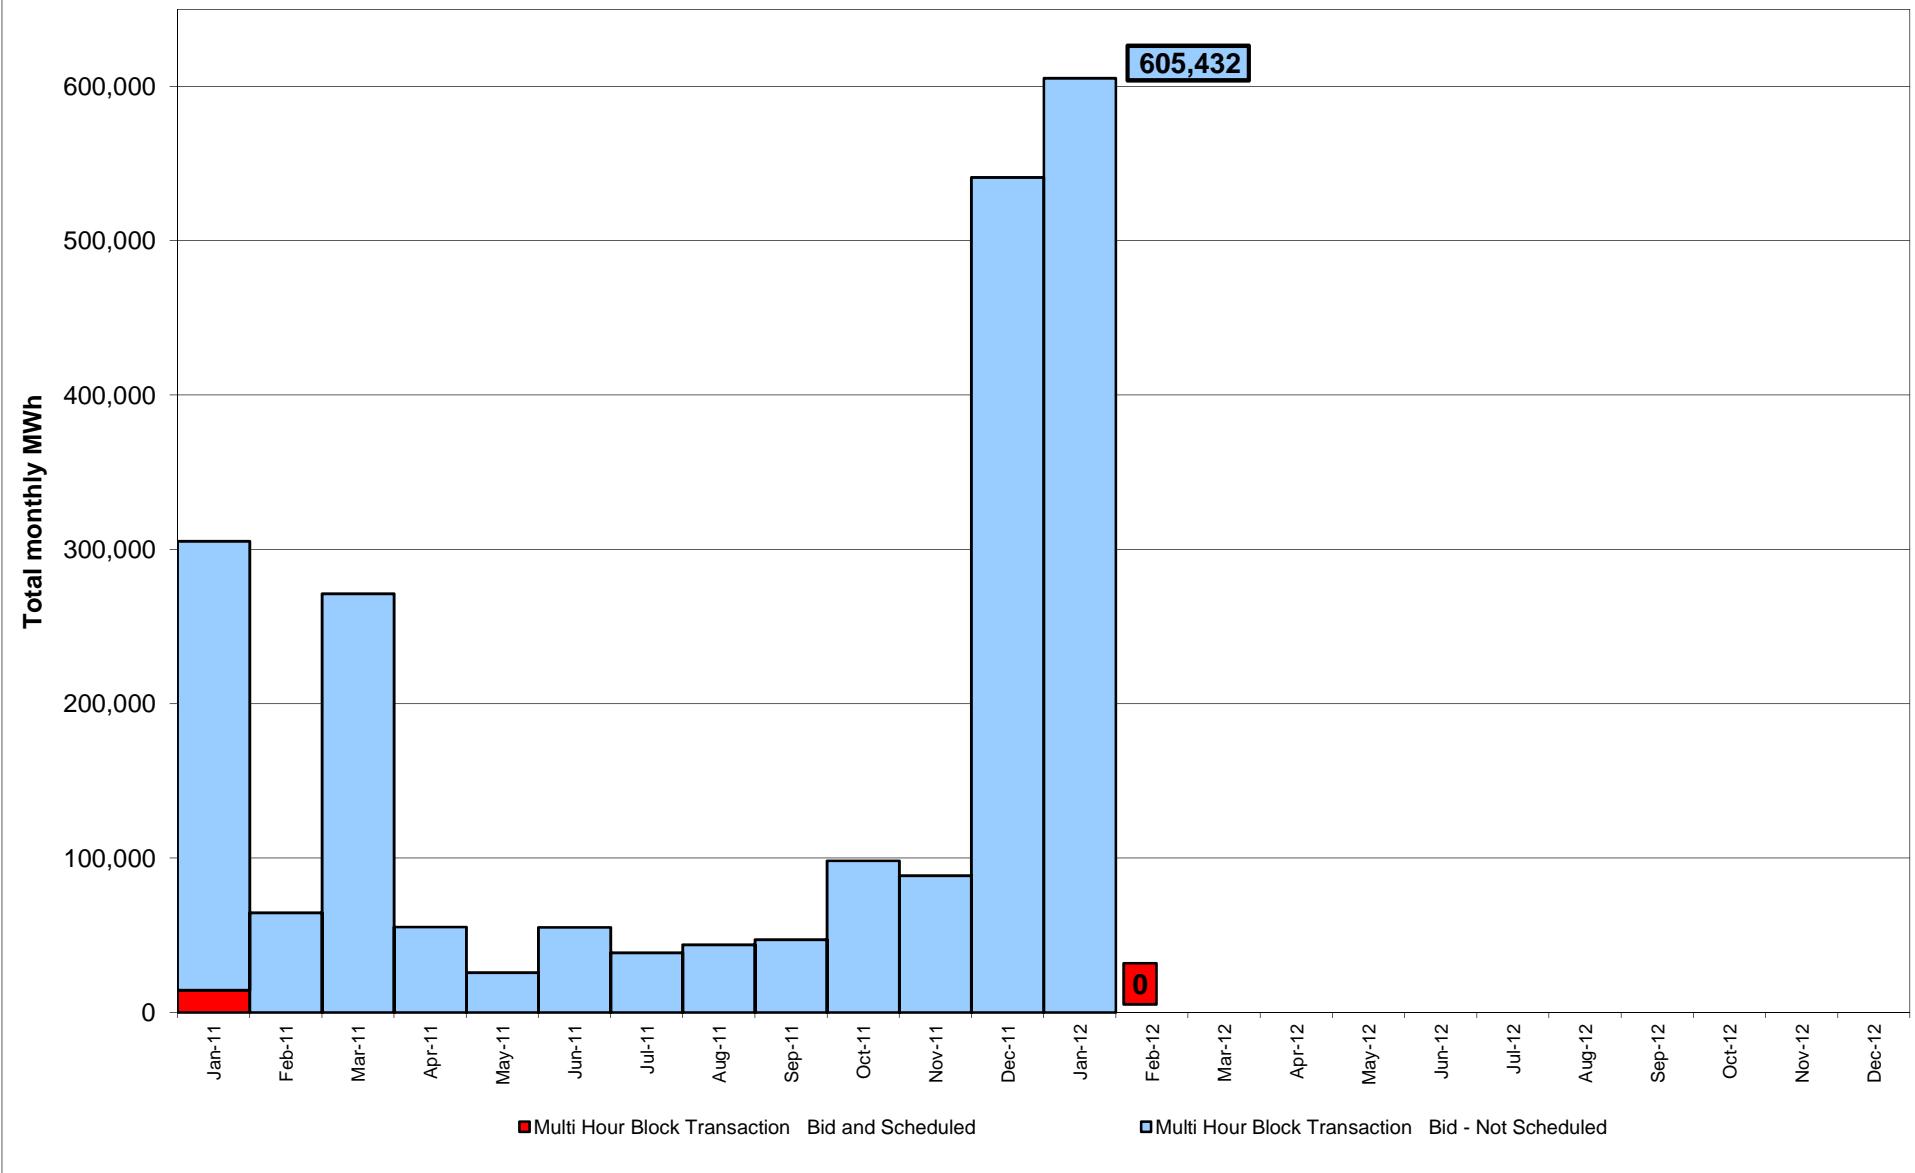


NYISO Monthly Average Ancillary Service Prices Day Ahead Market 2011 - 2012

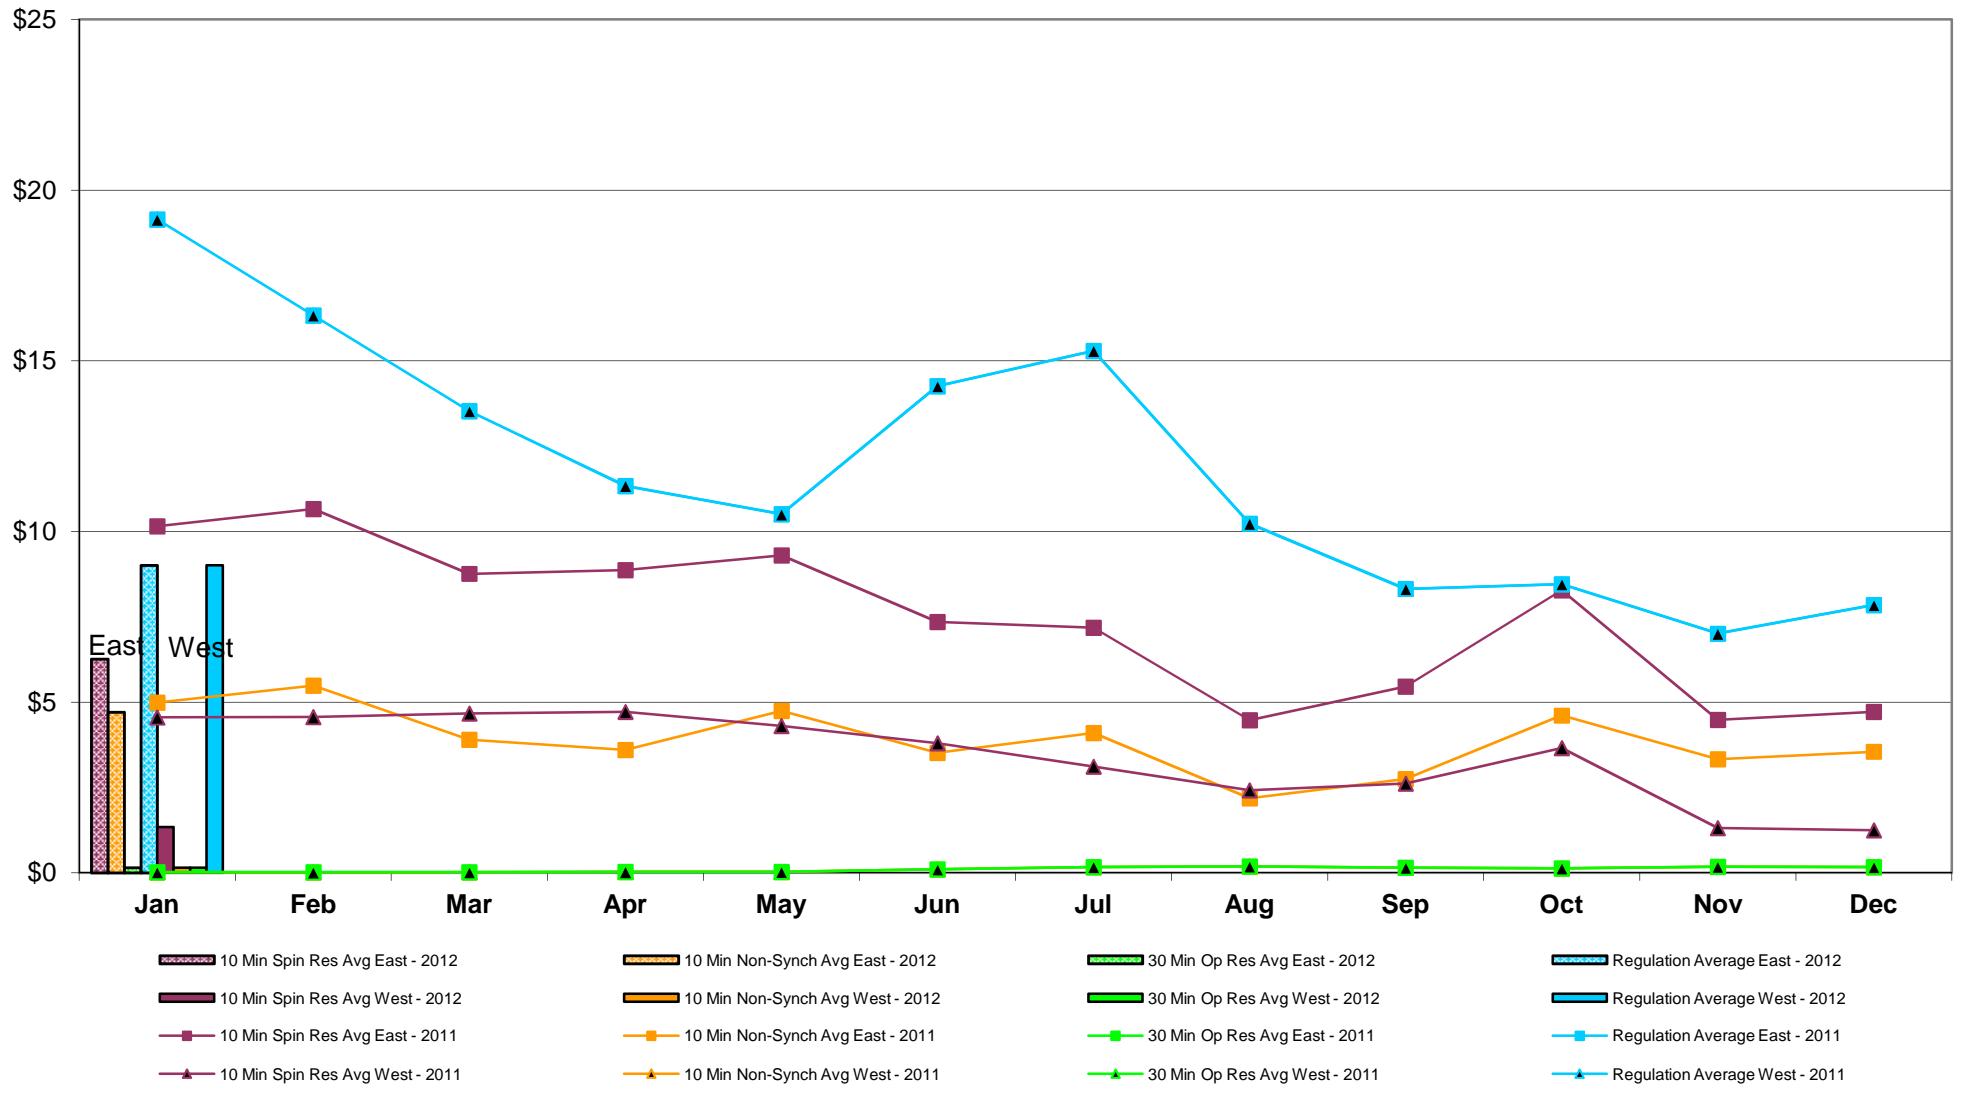

NYISO Monthly Average Ancillary Service Prices RTC Market 2011 - 2012

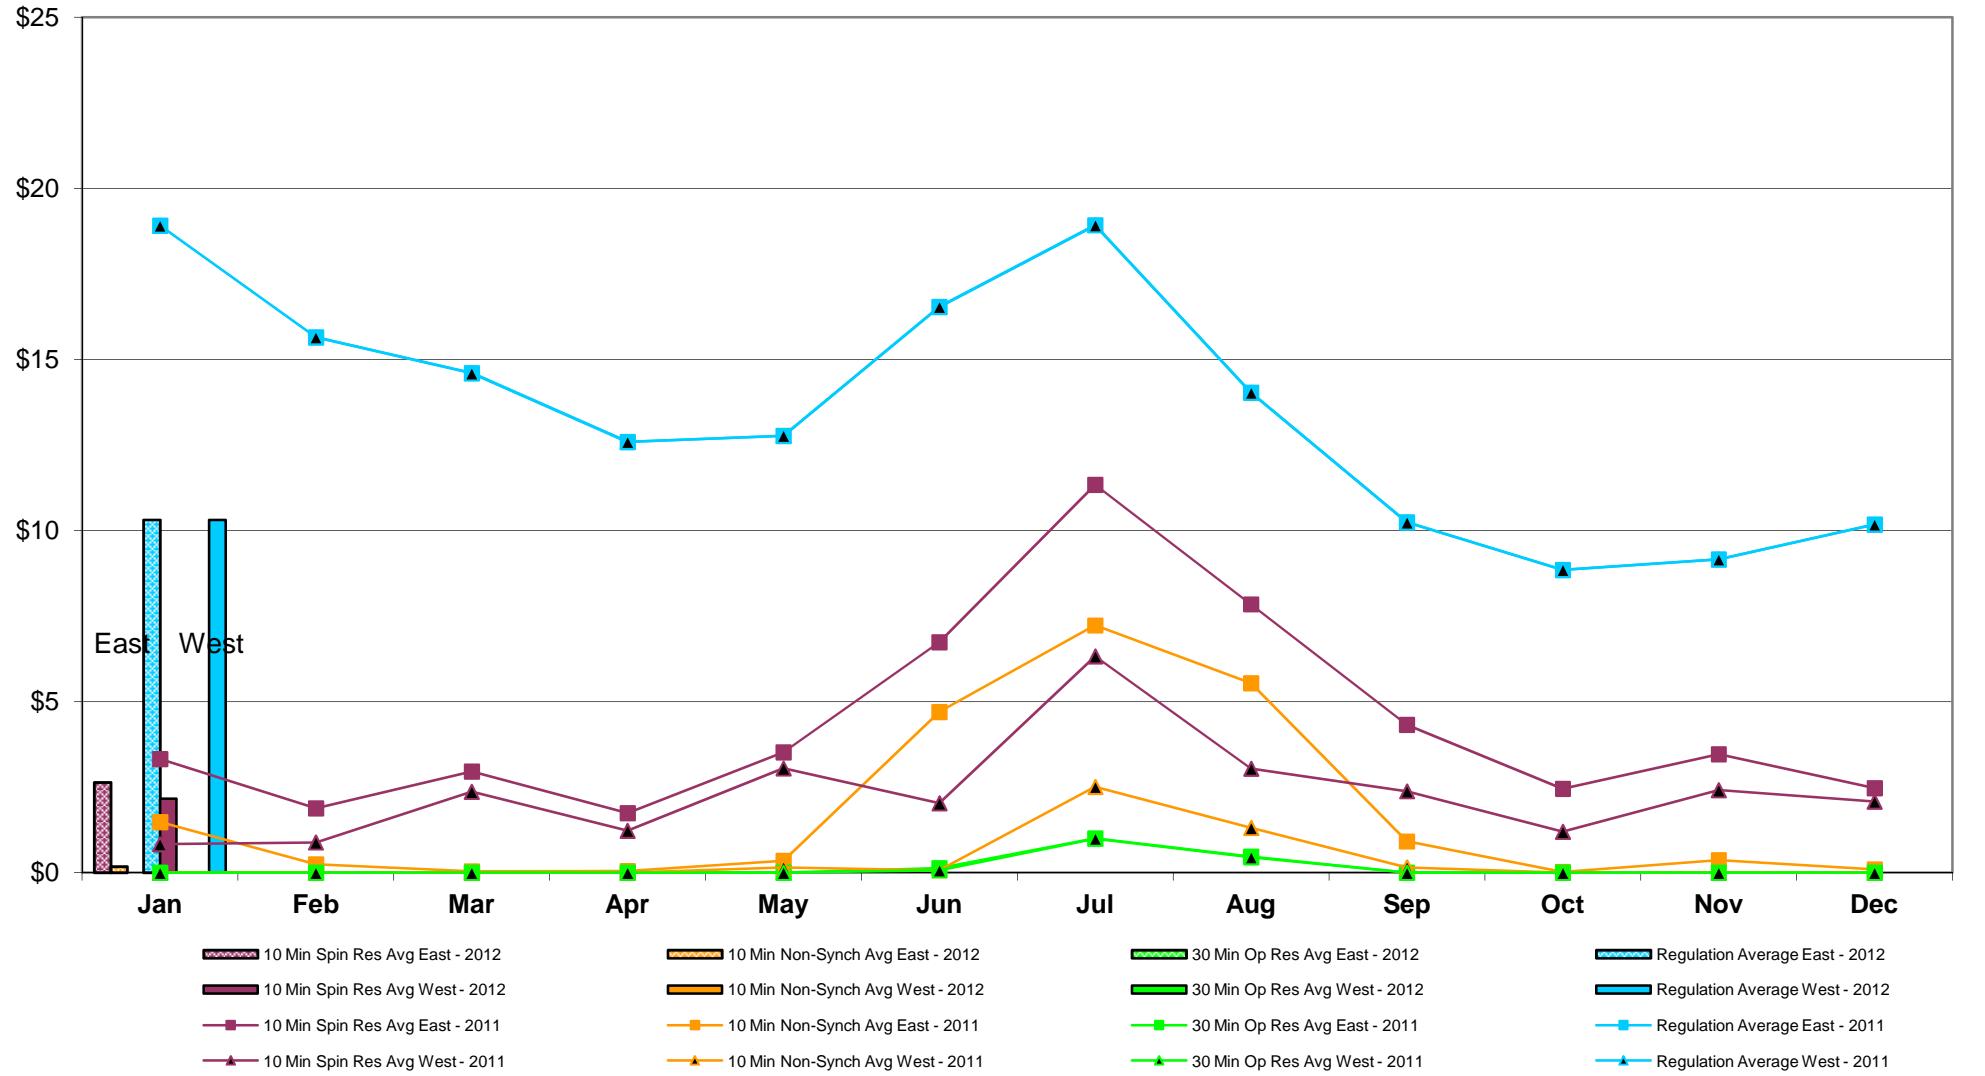

**NYISO Monthly Average Ancillary Service Prices
Real Time Market 2011 - 2012**

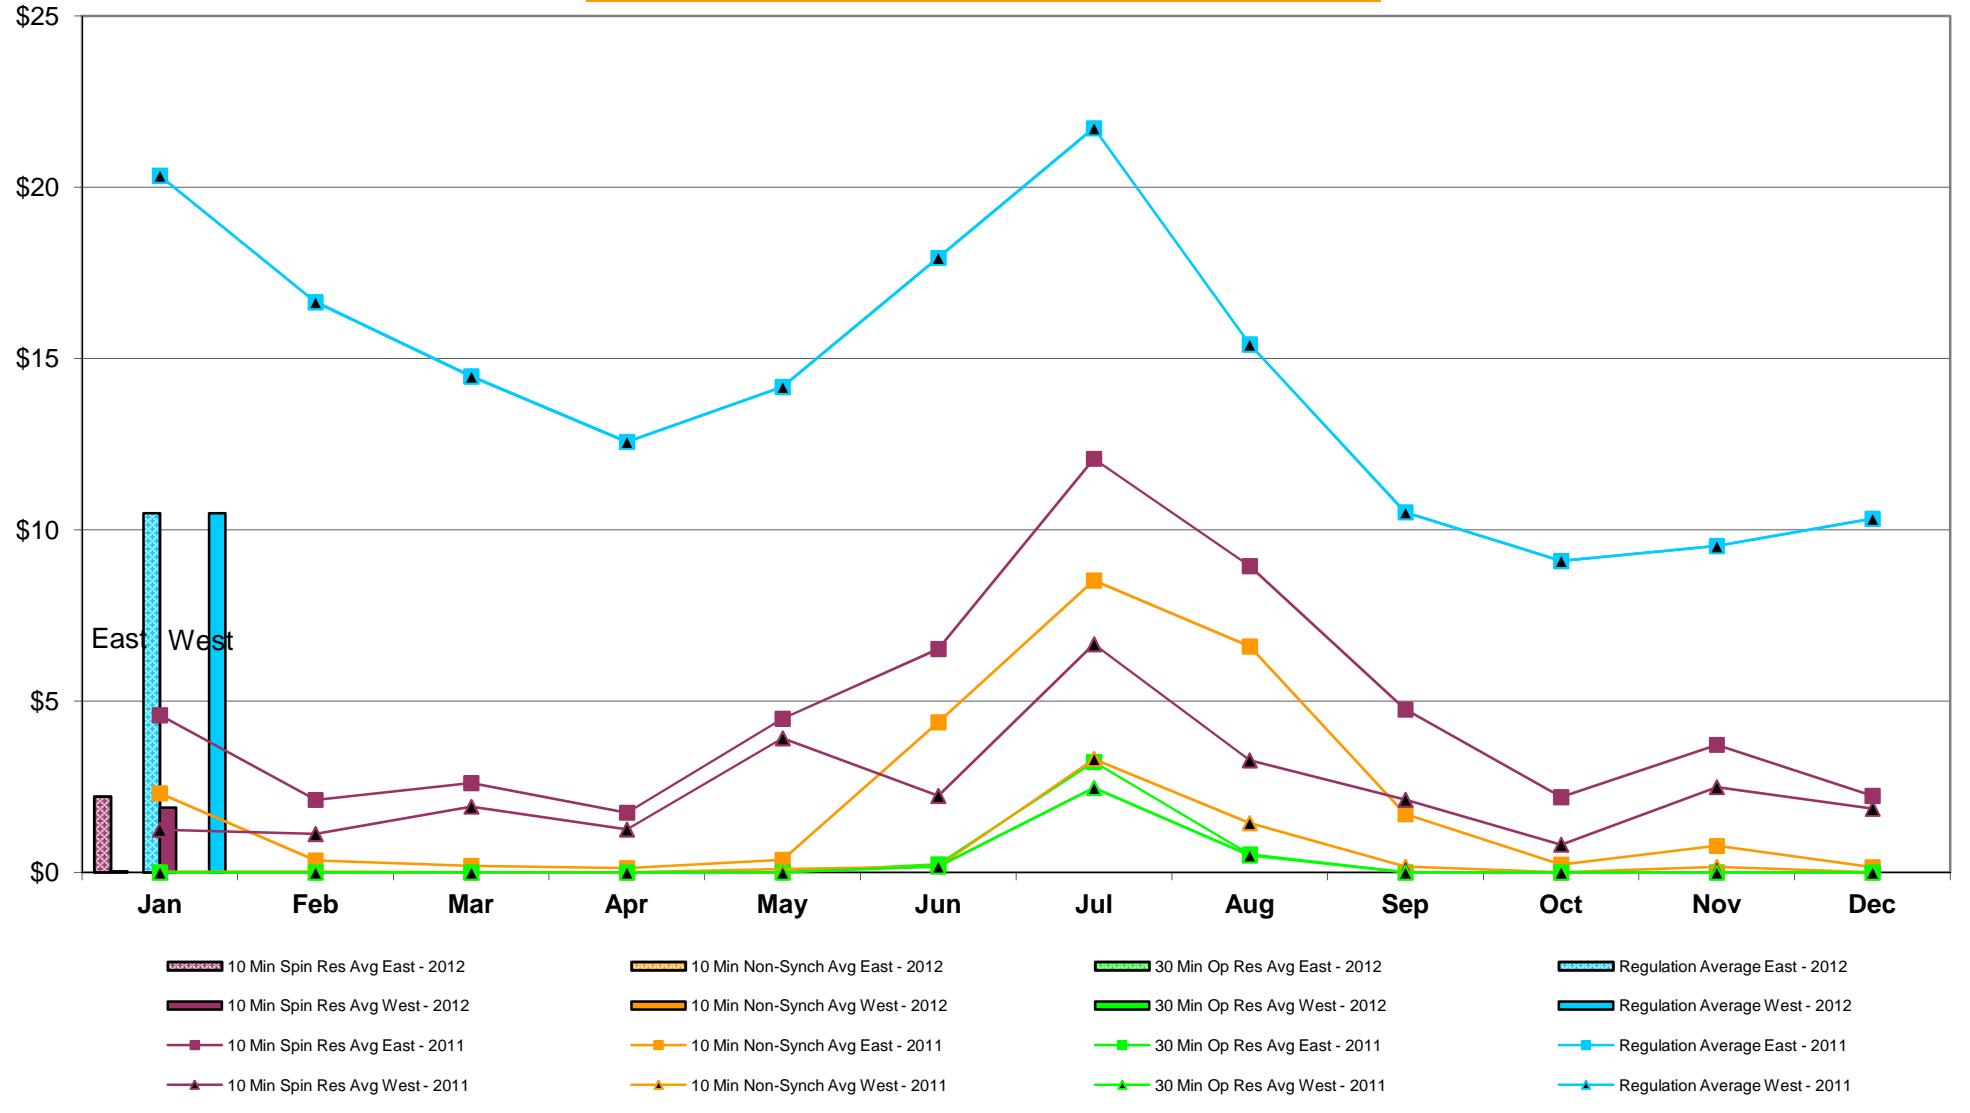


NYISO Markets Ancillary Services Statistics - Unweighted Price (\$/MWH)


<u>2012</u>	<u>January</u>	<u>February</u>	<u>March</u>	<u>April</u>	<u>May</u>	<u>June</u>	<u>July</u>	<u>August</u>	<u>September</u>	<u>October</u>	<u>November</u>	<u>December</u>
<u>Day Ahead Market</u>												
10 Min Spin East	6.26											
10 Min Spin West	1.34											
10 Min Non Synch East	4.71											
10 Min Non Synch West	0.15											
30 Min East	0.15											
30 Min West	0.15											
Regulation East	9.01											
Regulation West	9.01											
<u>RTC Market</u>												
10 Min Spin East	2.64											
10 Min Spin West	2.16											
10 Min Non Synch East	0.17											
10 Min Non Synch West	0.00											
30 Min East	0.00											
30 Min West	0.00											
Regulation East	10.31											
Regulation West	10.31											
<u>Real Time Market</u>												
10 Min Spin East	2.21											
10 Min Spin West	1.89											
10 Min Non Synch East	0.03											
10 Min Non Synch West	0.00											
30 Min East	0.00											
30 Min West	0.00											
Regulation East	10.49											
Regulation West	10.49											
<u>2011</u>	<u>January</u>	<u>February</u>	<u>March</u>	<u>April</u>	<u>May</u>	<u>June</u>	<u>July</u>	<u>August</u>	<u>September</u>	<u>October</u>	<u>November</u>	<u>December</u>
<u>Day Ahead Market</u>												
10 Min Spin East	10.15	10.66	8.76	8.87	9.30	7.35	7.18	4.47	5.46	7.76	4.48	4.72
10 Min Spin West	4.55	4.56	4.67	4.72	4.30	3.80	3.12	2.42	2.62	3.15	1.32	1.25
10 Min Non Synch East	4.99	5.48	3.90	3.60	4.75	3.51	4.10	2.19	2.75	4.62	3.33	3.55
10 Min Non Synch West	0.02	0.02	0.02	0.03	0.03	0.10	0.17	0.19	0.15	0.14	0.18	0.17
30 Min East	0.02	0.02	0.02	0.03	0.03	0.10	0.17	0.19	0.15	0.14	0.18	0.17
30 Min West	0.02	0.02	0.02	0.03	0.03	0.10	0.17	0.19	0.15	0.14	0.18	0.17
Regulation East	19.14	16.33	13.53	11.34	10.51	14.26	15.29	10.23	8.32	8.02	7.01	7.85
Regulation West	19.14	16.33	13.53	11.34	10.51	14.26	15.29	10.23	8.32	8.02	7.01	7.85
<u>RTC Market</u>												
10 Min Spin East	3.32	1.88	2.96	1.74	3.52	6.74	11.34	7.84	4.33	3.84	3.46	2.47
10 Min Spin West	0.83	0.89	2.37	1.23	3.05	2.03	6.33	3.04	2.38	2.23	2.41	2.08
10 Min Non Synch East	1.48	0.25	0.04	0.05	0.35	4.69	7.23	5.54	0.91	0.10	0.37	0.09
10 Min Non Synch West	0.00	0.00	0.00	0.00	0.15	0.07	2.51	1.31	0.16	0.00	0.01	0.00
30 Min East	0.00	0.00	0.00	0.00	0.00	0.13	1.01	0.47	0.00	0.00	0.00	0.00
30 Min West	0.00	0.00	0.00	0.00	0.00	0.07	1.00	0.45	0.00	0.00	0.00	0.00
Regulation East	18.91	15.65	14.60	12.59	12.77	16.54	18.93	14.03	10.24	9.62	9.16	10.18
Regulation West	18.91	15.65	14.60	12.59	12.77	16.54	18.93	14.03	10.24	9.62	9.16	10.18
<u>Real Time Market</u>												
10 Min Spin East	4.59	2.12	2.61	1.74	4.49	6.52	12.08	8.94	4.75	3.03	3.72	2.24
10 Min Spin West	1.25	1.12	1.92	1.26	3.92	2.23	6.66	3.27	2.12	1.50	2.49	1.86
10 Min Non Synch East	2.31	0.35	0.19	0.13	0.37	4.38	8.52	6.60	1.71	0.21	0.77	0.15
10 Min Non Synch West	0.02	0.02	0.00	0.00	0.10	0.18	3.31	1.44	0.17	0.00	0.16	0.00
30 Min East	0.00	0.00	0.00	0.00	0.00	0.24	3.22	0.52	0.00	0.00	0.00	0.00
30 Min West	0.00	0.00	0.00	0.00	0.00	0.18	2.47	0.50	0.00	0.00	0.00	0.00
Regulation East	20.34	16.65	14.48	12.57	14.17	17.94	21.72	15.41	10.51	9.34	9.53	10.32
Regulation West	20.34	16.65	14.48	12.57	14.17	17.94	21.72	15.41	10.51	9.34	9.53	10.32


NYISO In City Energy Mitigation - AMP (NYC Zone) 2011 - 2012

Percentage of committed unit-hours mitigated

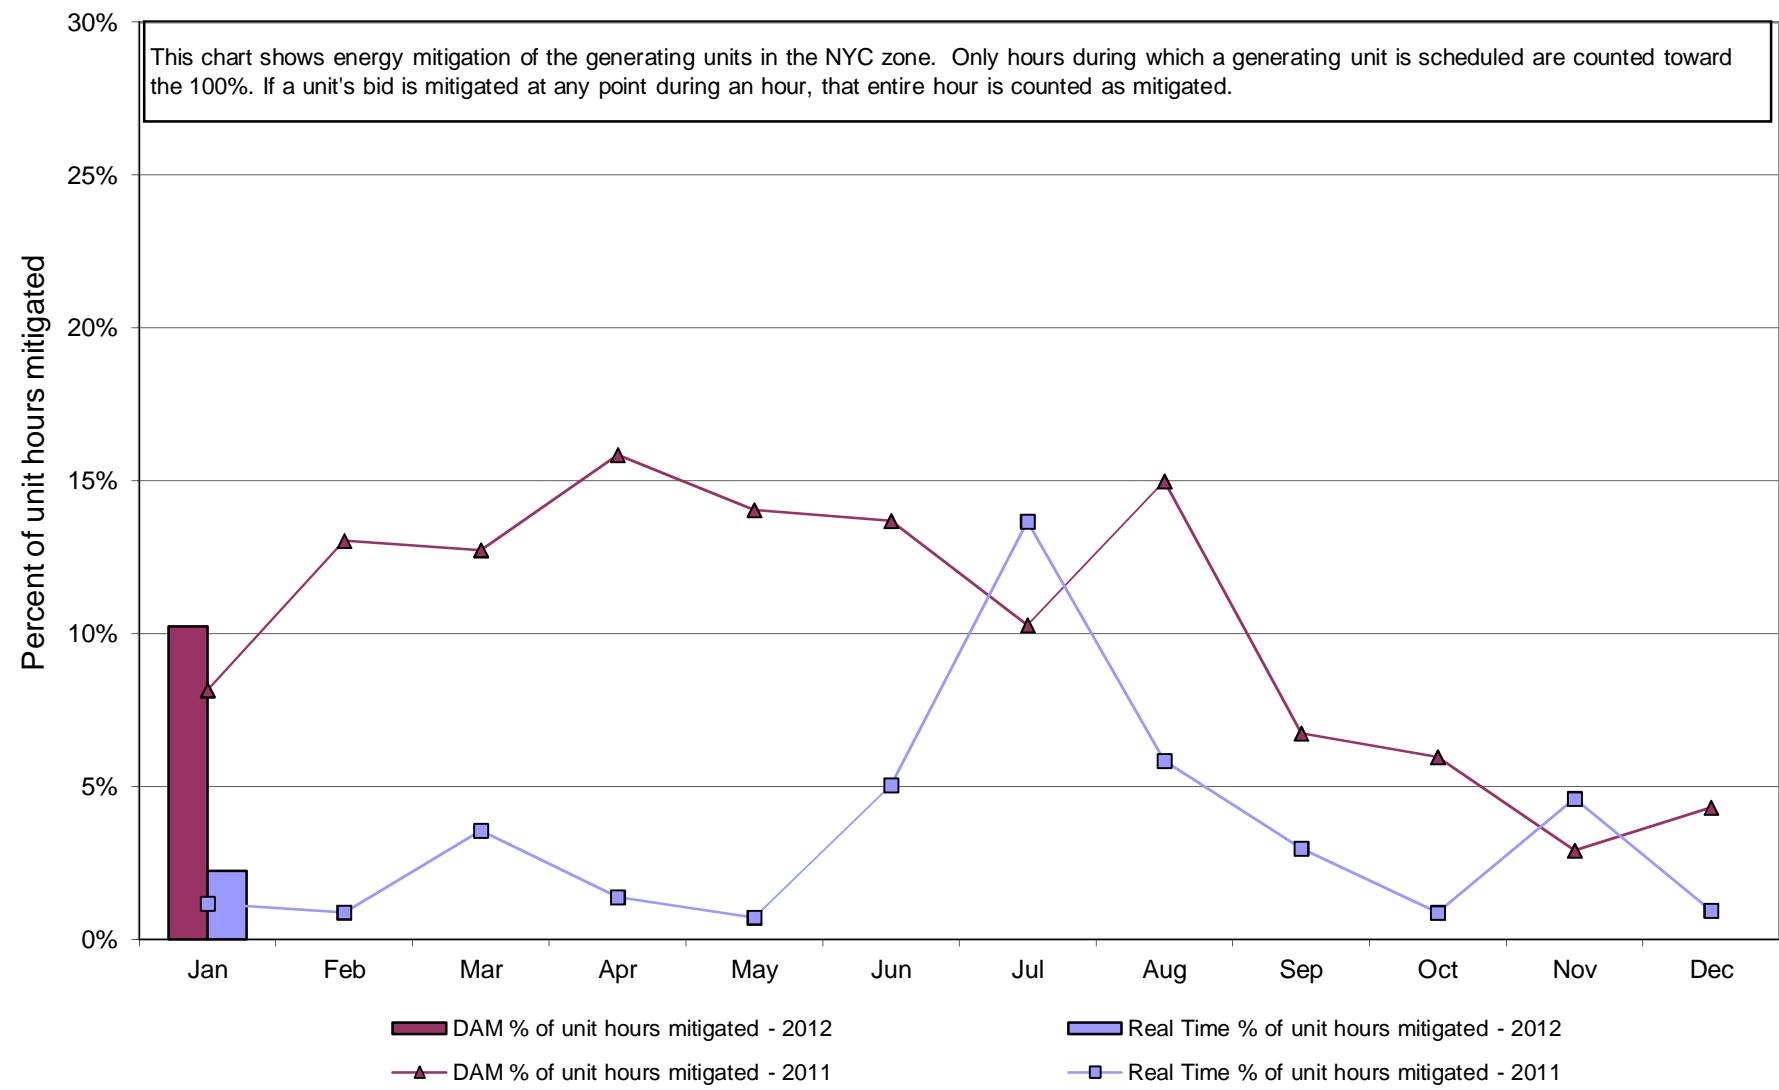


NYISO In City Energy Mitigation (NYC Zone) 2011 - 2012
Monthly megawatt hours mitigated

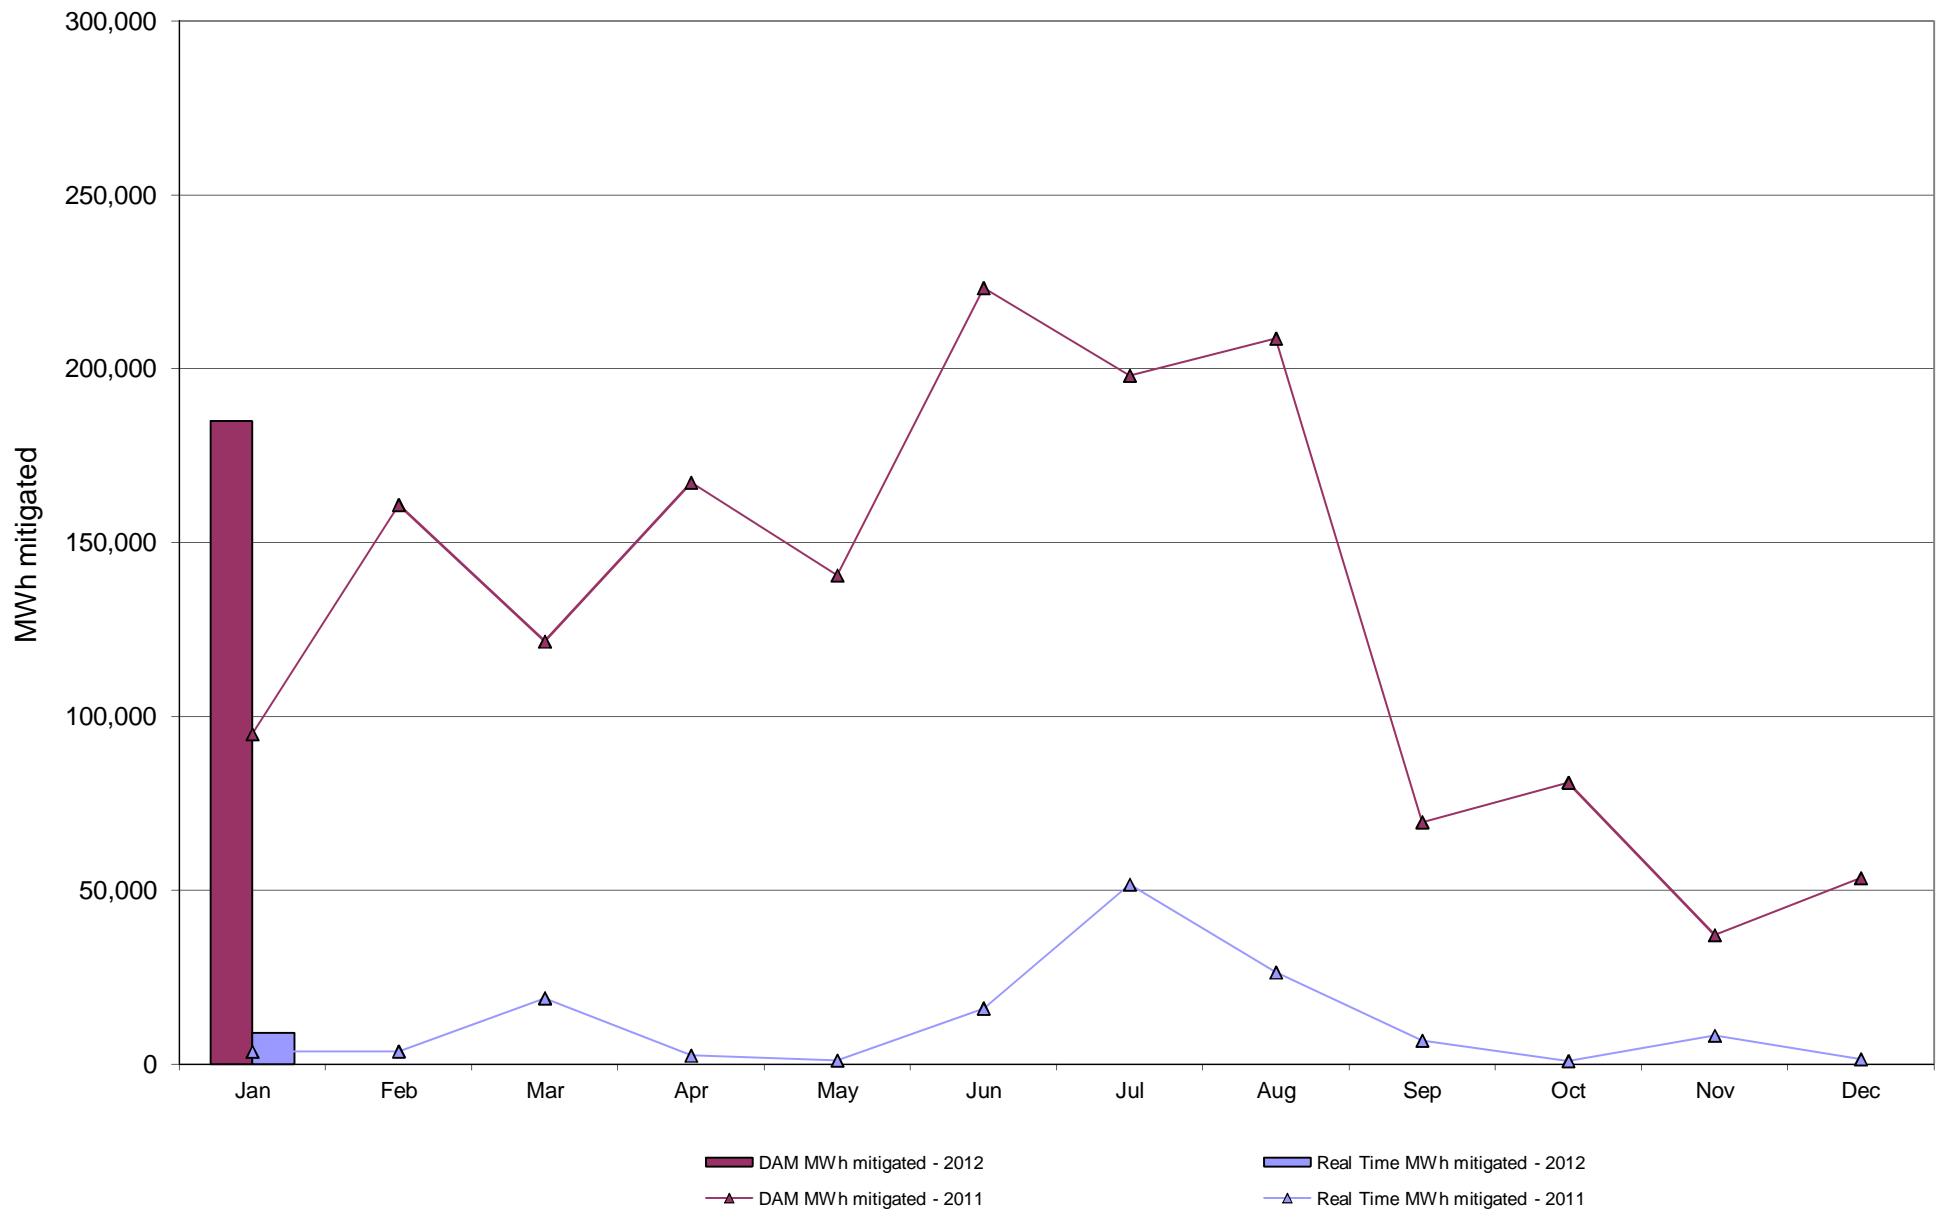


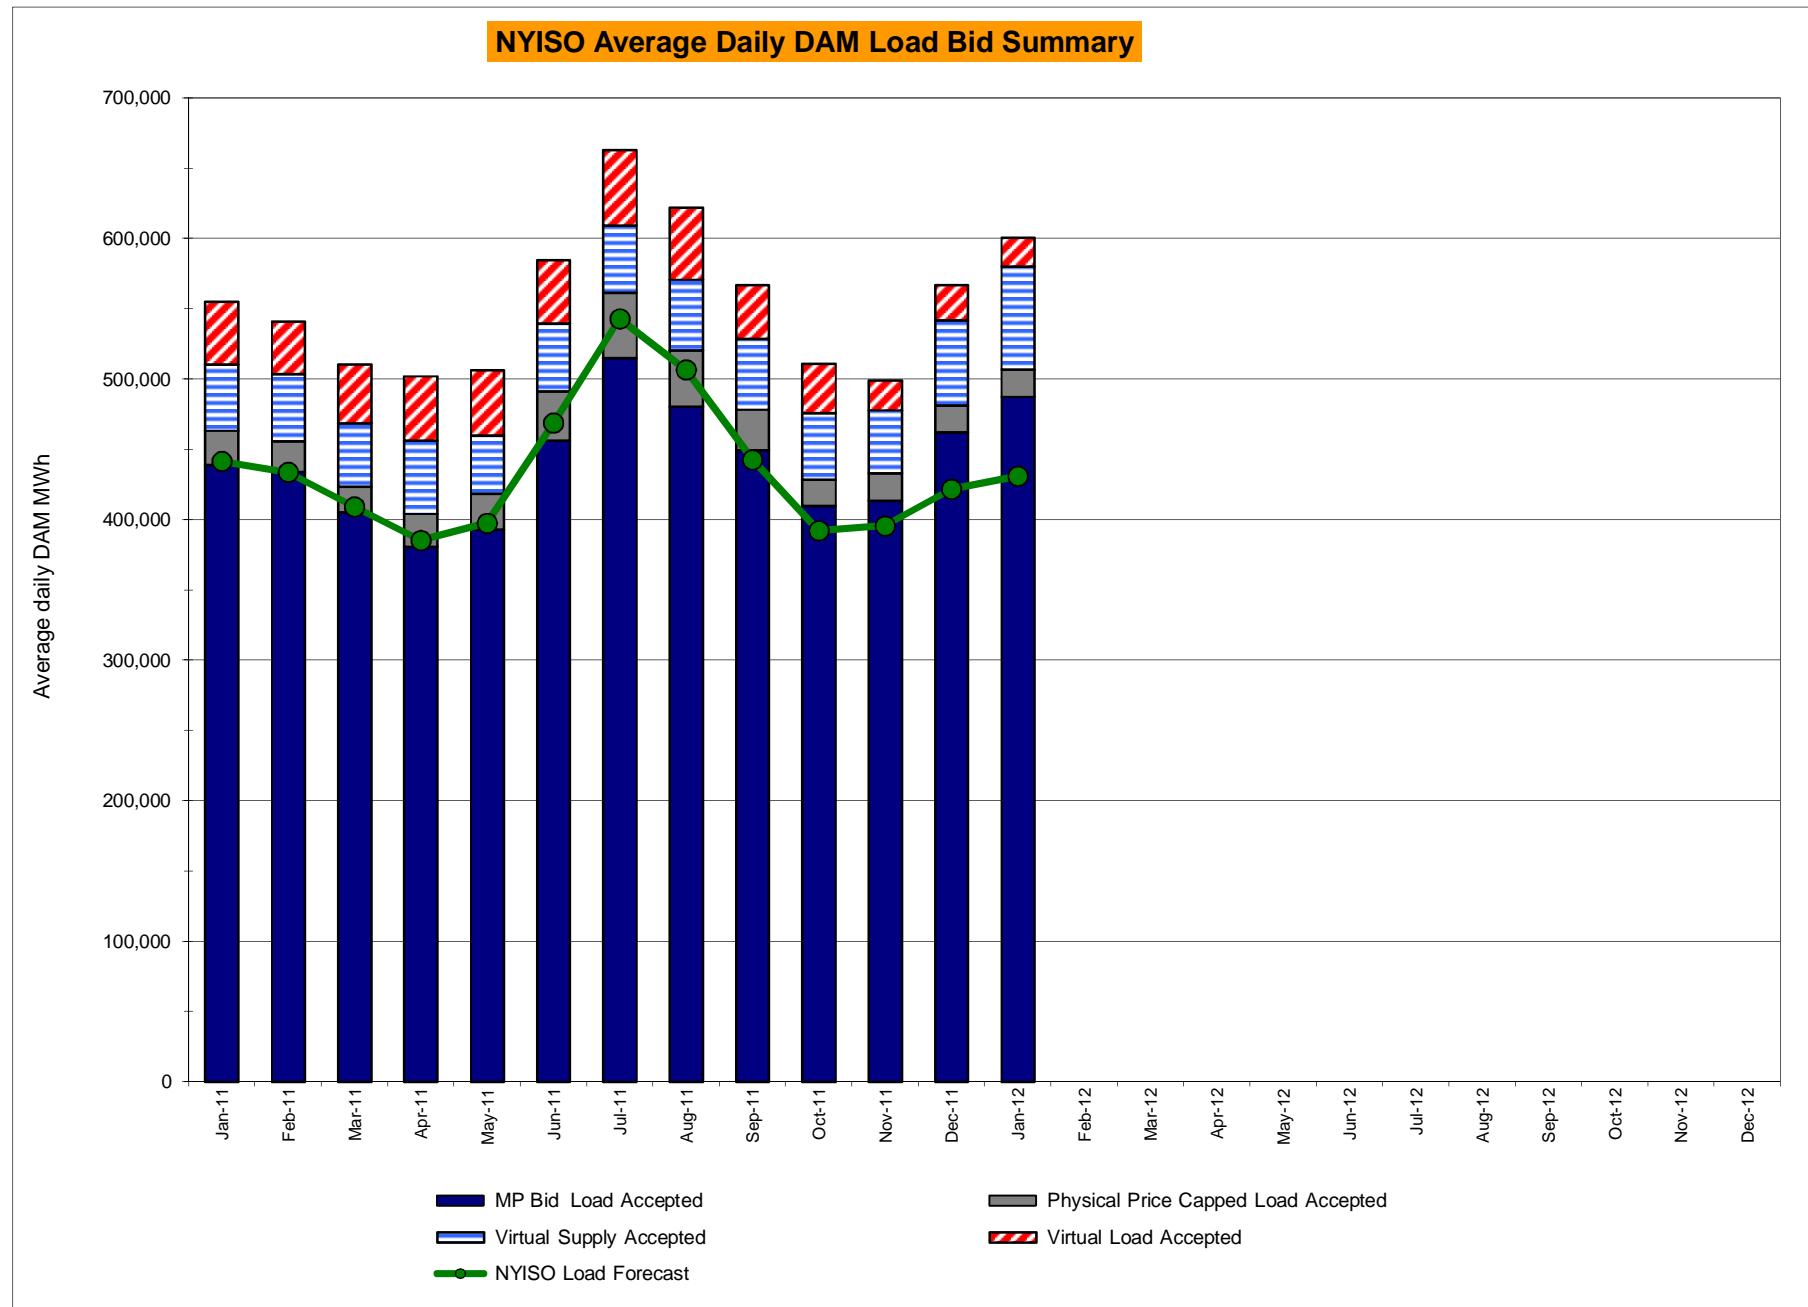

Monthly Implied Heat Rate 2011-2012

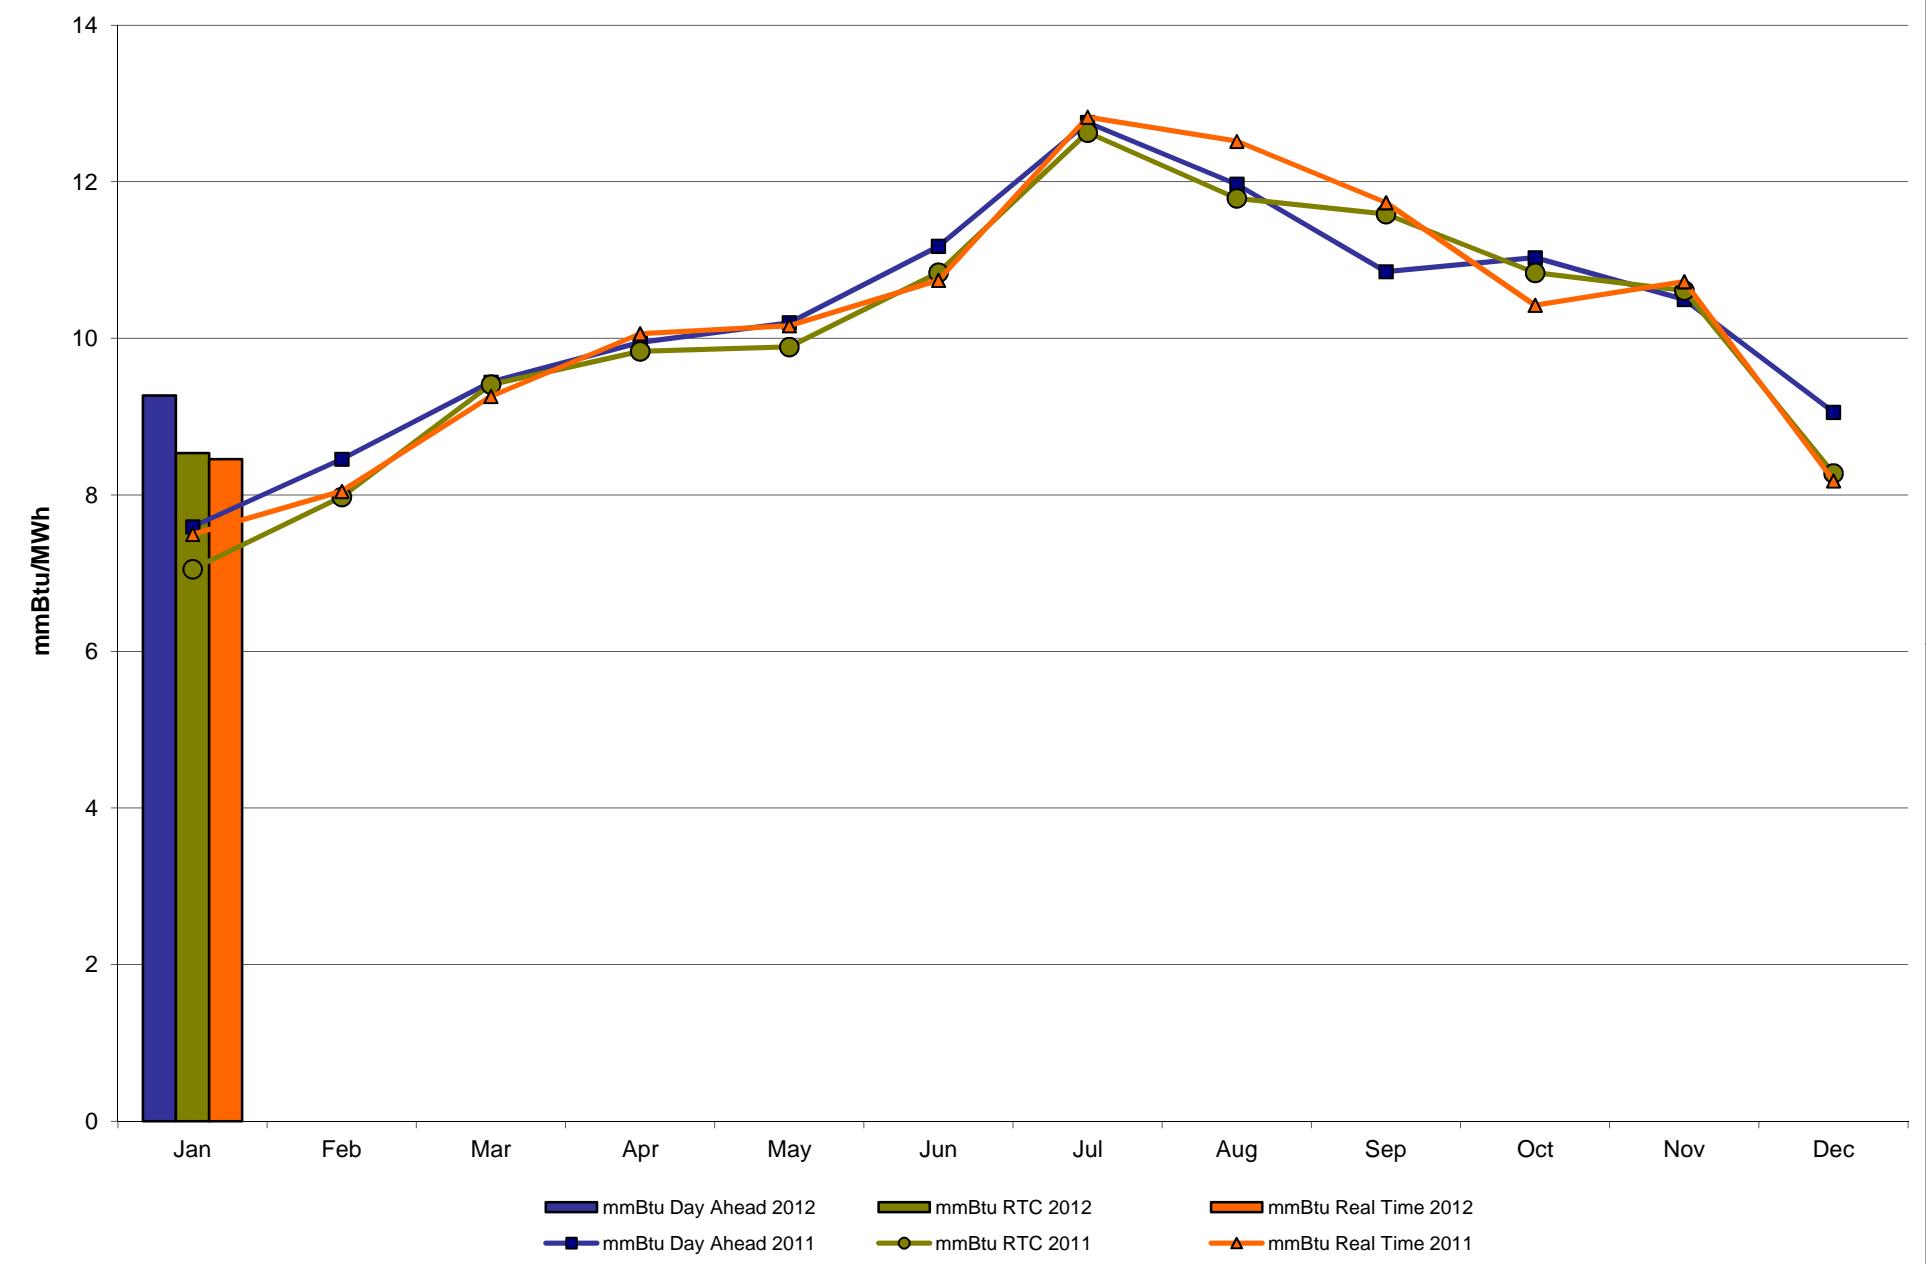

NYISO LBMP ZONES

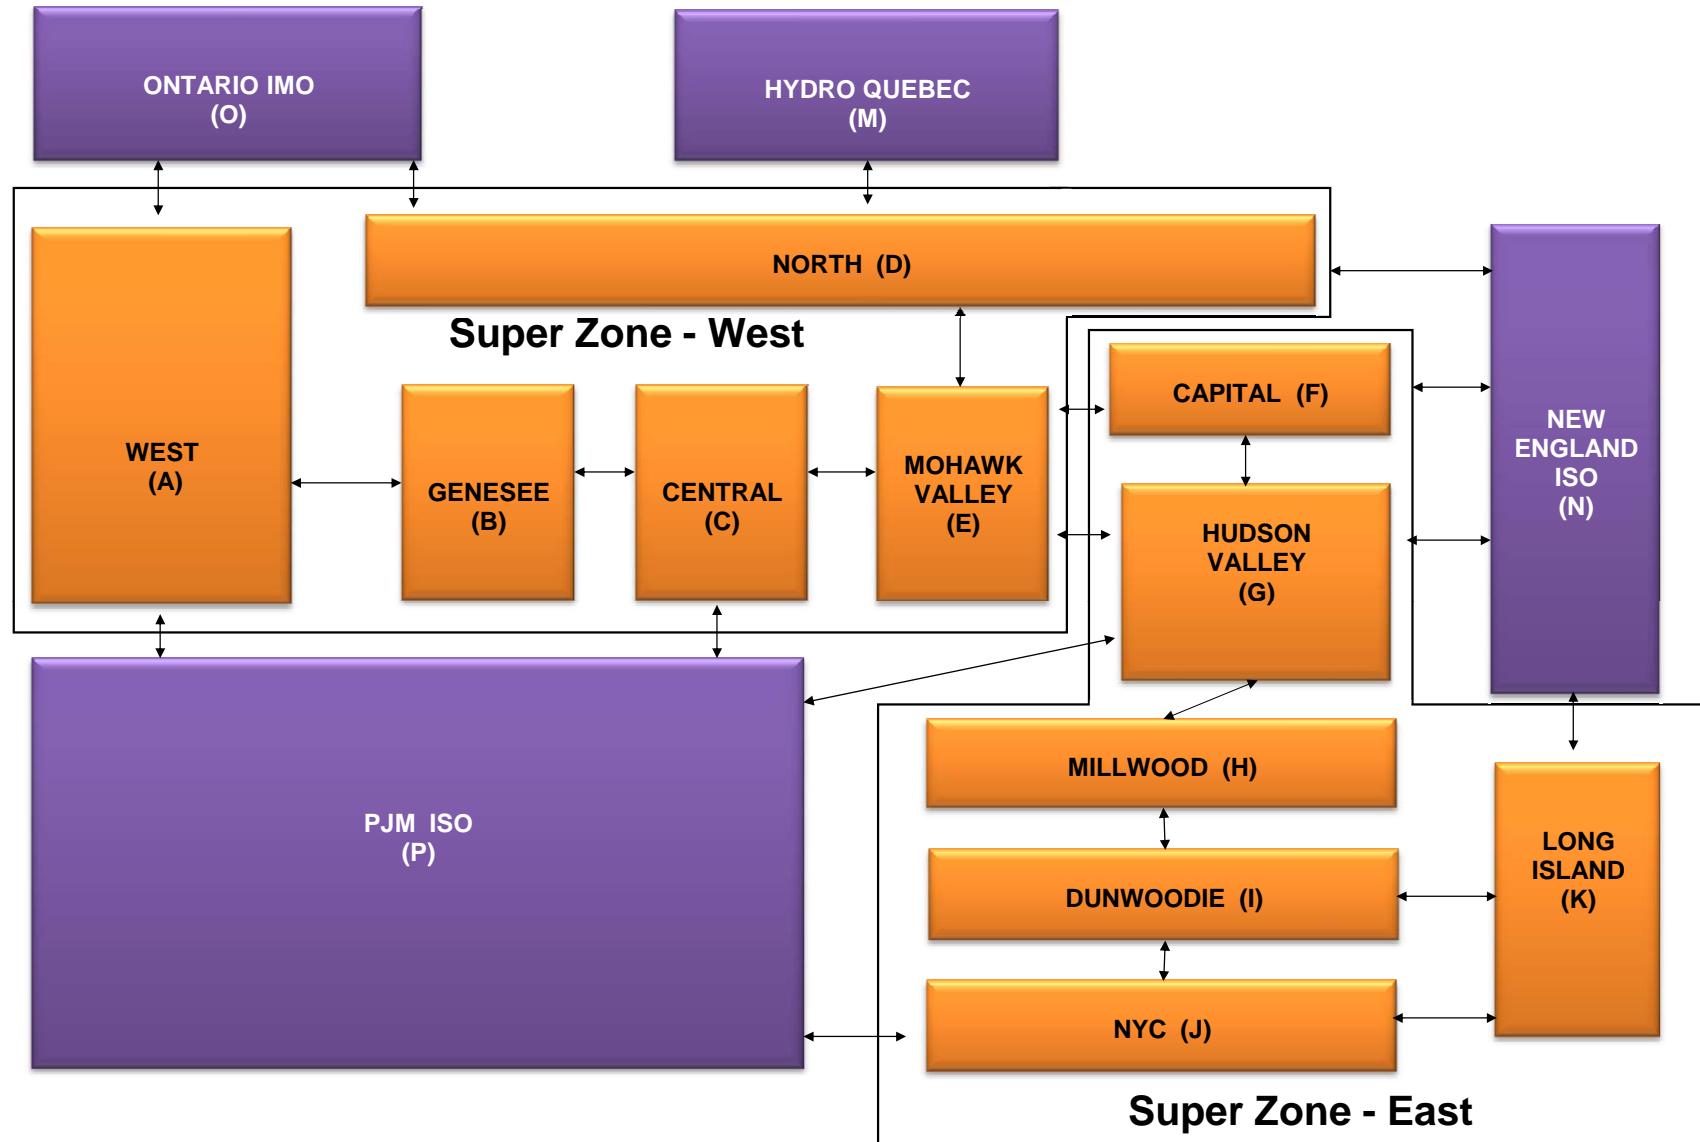


Billing Codes for Chart 4-C

Chart 4-C Category Name	Billing Code	Billing Category Name
Bid Production Cost Guarantee Balancing	81203	Balancing NYISO Bid Production Cost Guarantee - Internal Units
Bid Production Cost Guarantee Balancing	81204	Balancing NYISO Bid Production Cost Guarantee - External Units
Bid Production Cost Guarantee Balancing	81205	Balancing NYISO Bid Production Cost Guarantee Expenditure due to Curtailed Imports
Bid Production Cost Guarantee Balancing	81208	Balancing NYISO Bid Production Cost Guarantee - Internal Units
Bid Production Cost Guarantee Balancing	81209	Balancing NYISO Bid Production Cost Guarantee - External Units
Bid Production Cost Guarantee Balancing	81213	Balancing NYISO Bid Production Cost Guarantee Expenditure due to Curtailed Imports
Bid Production Cost Guarantee DAM	81201	DAM NYISO Bid Production Cost Guarantee - Internal Units
Bid Production Cost Guarantee DAM	84001	EDRP/SCR Demand Response - Local
Bid Production Cost Guarantee DAM	84101	EDRP/SCR Demand Response - NYISO Wide
Bid Production Cost Guarantee DAM	81401	DAM Price Responsive Load Program
Bid Production Cost Guarantee DAM	81202	DAM NYISO Bid Production Cost Guarantee - External Units
Bid Production Cost Guarantee DAM	81206	DAM NYISO Bid Production Cost Guarantee - Internal Units
Bid Production Cost Guarantee DAM	81207	DAM NYISO Bid Production Cost Guarantee - External Units
Bid Production Cost Guarantee DAM Virtual	81501	DAM Virtual Bid Production Cost Guarantee
DAM Contract Balancing	81315	DAM Contract Balancing
DAM Contract Balancing	81317	DAM Contract Balancing
Local Reliability Balancing	81002	Balancing Local Reliability Bid Production Cost Guarantee
Local Reliability Balancing	83901	Margin Restoration (MOB) Revenue
Local Reliability DAM	81001	DAM Local Reliability Bid Production Cost Guarantee
NYISO Cost of Operations	80901	NYISO Cost Of Operations
NYISO Cost of Operations	80902	NYISO Cost Of Operations
NYISO Cost of Operations	83501	NYISO Cost Of Operations
NYISO Cost of Operations	83502	NYISO Cost Of Operations
Residuals Balancing	81302	Balancing Market Energy Residual
Residuals Balancing	81304	Balancing Market Loss Residual
Residuals Balancing	81305	Balancing Market Congestion Balancing
Residuals Balancing	81306	Emergency Energy Purchases
Residuals Balancing	81307	Emergency Energy Sales
Residuals Balancing	81309	Balancing Market Energy Residual
Residuals Balancing	81311	Balancing Market Loss Residual
Residuals Balancing	81312	Balancing Market Congestion Balancing
Residuals Balancing	81313	Emergency Energy Purchases
Residuals Balancing	81314	Emergency Energy Sales
Residuals DAM	81301	Day Ahead Market Energy Residual
Residuals DAM	81303	Day Ahead Market Loss Residual
Residuals DAM	81308	Day Ahead Market Energy Residual
Residuals DAM	81310	Day Ahead Market Loss Residual


NYISO Daily Peak Load - January 2012
Actual vs Weather-Adjusted Forecast




NYISO Daily Peak Load - January 2012
Actual vs Forecast

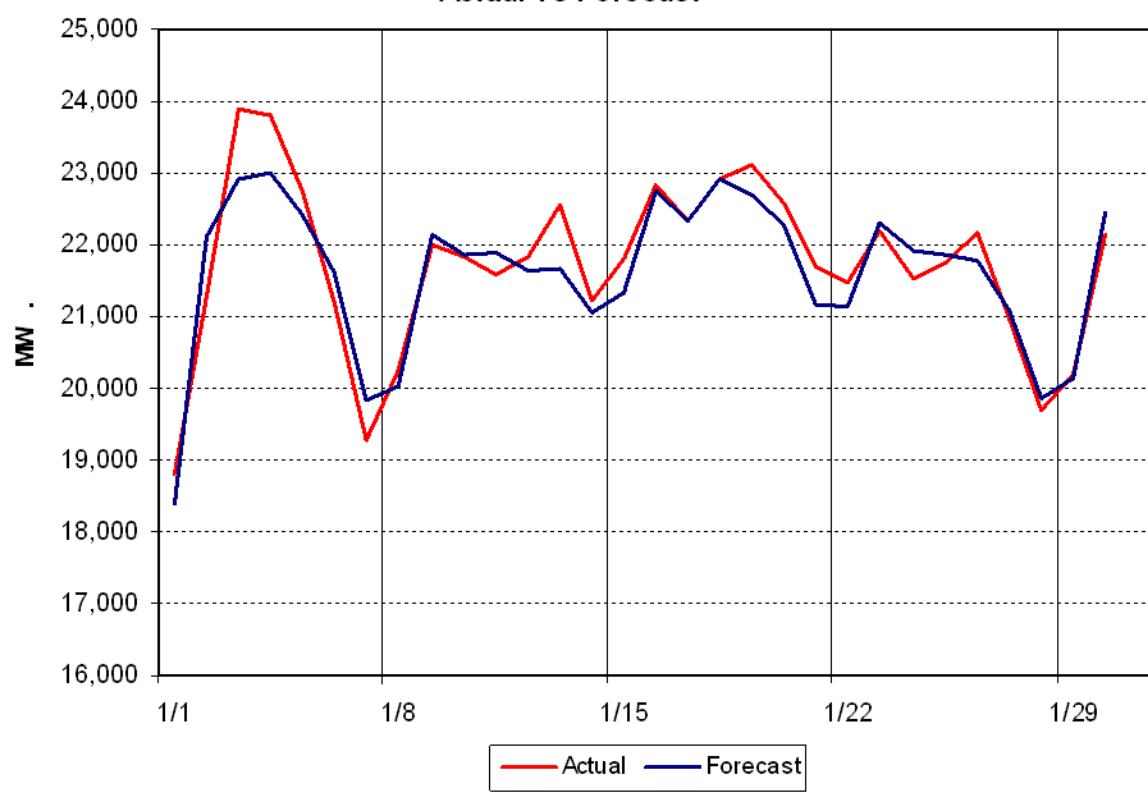

Day Ahead Forecast - January 2012 Percent Error - Actual & Weather Adjusted

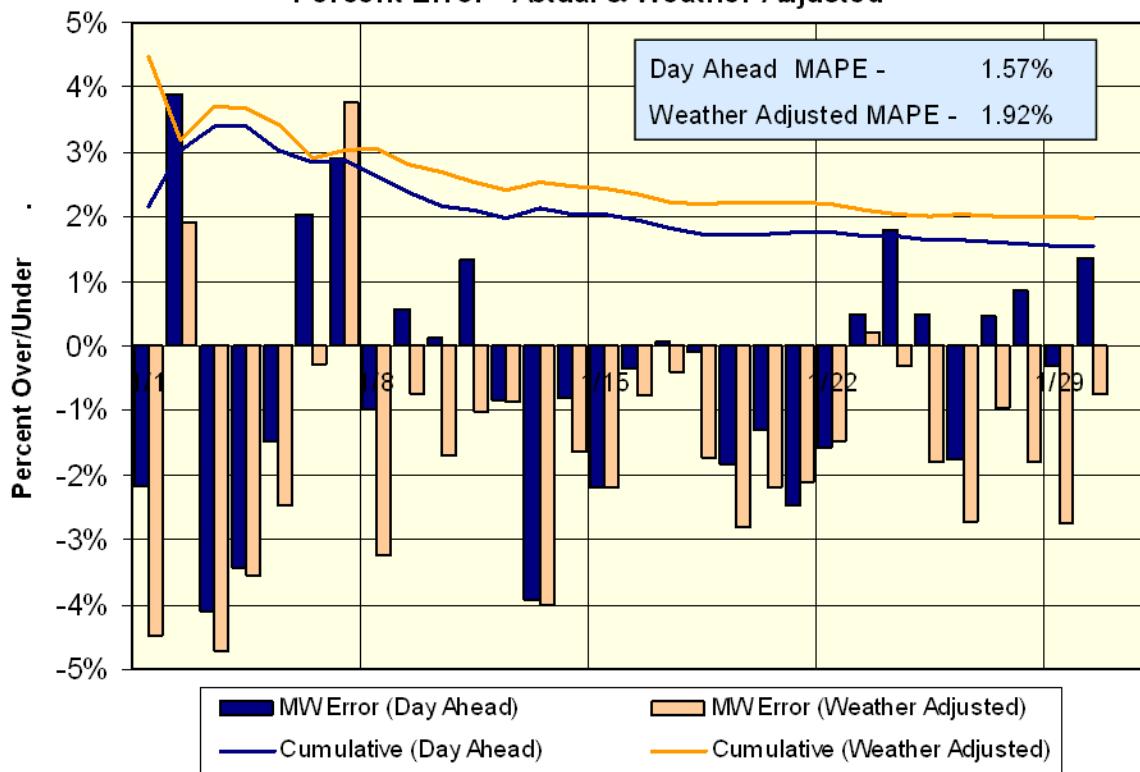

Day-Ahead Forecast Accuracy - Cumulative Performance 2012 Year-to-Date

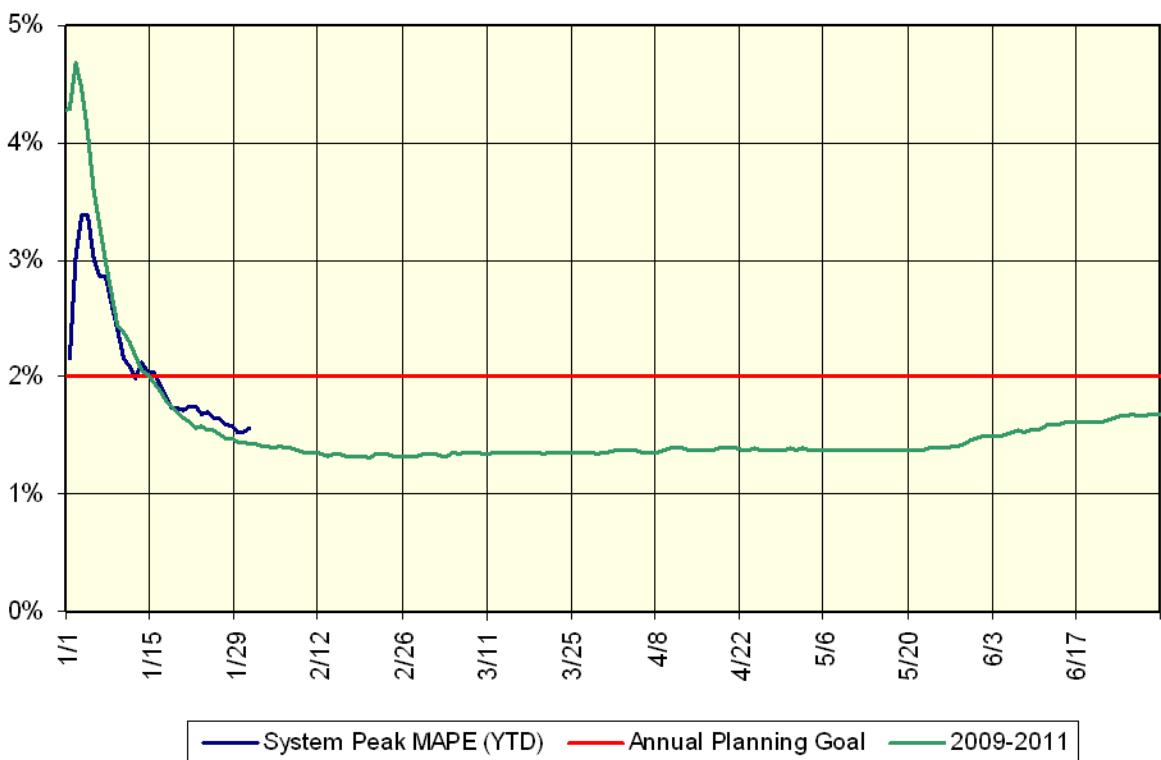



2012 Major Product Enhancements

Project	Status and Milestone Deliverables
Business Intelligence Products	
Market and Settlement Data Management Phase I: Broader Regional Markets	<p>Status: Broader Regional Markets (BRM) initiatives will require reporting and analysis on historical BMS and MIS data beginning in 2012. Analysis will need to be performed over a large time span of data. BMS data that is currently retained for only ten days will be retained for up to five years for analysis. This deployment is scheduled for the 4th quarter in support of Market to Market with PJM.</p> <p>Deliverables: To achieve BRM reporting and analysis requirements, this project will provide a platform for analytics and reporting as well as analytics of other control area data that may be required.</p>
eTariff Public Website Module	<p>Status: This project will add the eTariff Public Website module to www.nyiso.com. This deployment is targeted for the 2nd quarter.</p> <p>Deliverables: The 2012 project will provide Market Participants with new functionality that allows searching and viewing capabilities for NYISO tariffs, filings and docket numbers.</p>
Public Website: Publishing Process	<p>Status: The NYISO public website uses several older systems to maintain the content on the website. This deployment is scheduled for the 4th quarter.</p> <p>Deliverables: This project will replace the current content management technology and the portal technology with a single, more efficient, and cost-effective solution using Microsoft SharePoint to maintain and post documents to the public website.</p>
Capacity Market Products	
Additional Capacity Zones	<p>Status: The NYISO and stakeholders developed the rationale in 2010 for creating additional capacity zones, identified as a recommendation in the 2009 State of the Market report. NYISO submitted a FERC compliance filing in January 2011 to define the criteria for creating new capacity zones. The Market Design Concept was discussed with stakeholders in late October 2011 and the compliance filing was submitted in November 2011. Deployment is scheduled for 2014 consistent with the next Demand Curve Reset. Completion of the functional requirements specification is scheduled for the end of 1st quarter 2012.</p> <p>Deliverables: The 2012 project will focus on completing the functional requirements specification for additional capacity zones and initiating the software development process.</p>



2012 Major Product Enhancements

Project	Status and Milestone Deliverables
Demand Response Products	
DSASP Direct Communication Phase 2	<p>Status: Based on the NYISO's response to FERC Order 719, in 2010 NYISO and stakeholders discussed the changes needed to accommodate aggregated small demand response resources providing ancillary services (DSASP). The Market Design Concept to treat aggregations in the same manner as individual DSASP resources was proposed and approved by Market Participants at the December 2010 BIC. Functional requirements for direct communications were successfully completed and communicated to the Market Participants in 2011. Market rule changes and software changes are required to support the implementation of DSASP Aggregations. The deployment is targeted for 2nd Q 2012.</p> <p>Deliverables: The focus of the 2012 project is the implementation of the required rule changes and software changes.</p>
Demand Response Information System: Event Notification	<p>Status: NYISO currently handles event notification for Demand Response through a vendor who is no longer reliable in delivering notification, which has resulted in NYISO Operations having to utilize manual processes for sending event notification to stakeholders. Replacement of NYISO's existing event notification system with DRIS will enhance reliability by ensuring that demand response aggregators receive notifications in a consistent and timely manner. Integration with DRIS reduces duplication of event information and facilitates event response reporting. This deployment is targeted for 2nd quarter 2012.</p> <p>Deliverables: The focus of the project in 2012 is the implementation of a replacement of the event notification vendor to allow for integration with the Demand Response Information System (DRIS).</p>
Demand Response – Real Time Energy Market	<p>Status: NYISO will focus on the development of market rules and identification of software changes required to permit demand response entities to participate in the NYISO's real-time energy market. Market Design approval is targeted for 4th quarter 2012.</p> <p>Deliverables: Market Design Approval is the focus of the project in 2012.</p>
Order 745 – Day Ahead Demand Response Program (DADRP) Compliance	<p>Status: NYISO will implement the net benefits test based on the compliance filing submitted in 2011. Also, as part of the compliance obligation, NYISO will conduct a study to evaluate the feasibility of incorporating a dynamic net benefits test into the day-ahead and real-time unit commitment and scheduling processes. Implementation of the net benefits test is targeted for the end of 1st quarter 2012. A compliance filing detailing the results of the feasibility study is due to FERC on September 21, 2012.</p> <p>Deliverables: The focus of this project in 2012 is the implementation of the Net Benefits test as filed with FERC in 2011 and completion of the dynamic net benefits study.</p>

Project	Status and Milestone Deliverables
Energy Markets Products	
Ancillary Services Mitigation	<p>Status: Per recommendation of NYISO's Market Advisor, NYISO should modify two mitigation provisions that may limit competitive 10-minute reserves offers in the day-ahead market. A market design concept was presented to stakeholders in the 4th quarter of 2011. Tariff changes and software changes are planned for 4th quarter 2012.</p> <p>Deliverables: This project will focus on implementation of required tariff changes and software changes to support the market design.</p>
Market to Market Coordination - PJM	<p>Status: In late-2006, PJM approached NYISO, interested in developing a program to allow inter-control area dispatch to help manage congestion. PJM has implemented a program with MISO. In 2007, NYISO initiated discussions with PJM to further understand the MISO program and begin to outline a conceptual straw proposal for a similar program between PJM and NY. NYISO has continued to define the details of a Market to Market (formerly known as Congestion Management) protocol between NYISO and PJM. In 2009, NYISO worked with PJM and NYISO stakeholders to develop a Market to Market protocol. Protocol development was not completed in 2009. The question of entitlement rights on coordinated flow gates could not be addressed until the NYISO had developed or procured a market flow calculator. In 2011 the NYISO implemented the market flow calculator and continued to work with PJM to meet the 2010 FERC Order to implement Market to Market coordination. The software deployment is targeted for 4th quarter 2012.</p> <p>Deliverables: The focus of this project in 2012 is to deploy all of the required software changes to enable Market to Market coordination between PJM and NY.</p>
Interregional Transaction Coordination Phases I and III	<p>Status: Interregional Transaction Coordination is a Broader Regional Markets initiative that provides more frequent scheduling of external energy transactions with the interfaces. Currently, energy transactions between NY and other control areas are evaluated economically once for the hour. The 2008 and 2009 State of the Market recommendation #2 is, "NYISO continue its work with neighboring control areas to better utilize the transfer capability between regions." Phase I of this project will enable more frequent scheduling with Hydro Quebec (HQ). Phase III will enable more frequent scheduling with PJM. Phase I is complete. Phase III is targeted for deployment in June 2012.</p> <p>Deliverables: The focus of this project in 2012 is to deliver the necessary software enhancements and tools to implement intra-hour energy transaction scheduling with PJM.</p>
Interregional Transaction Coordination Phase IV – ISO-NE Intra-hour Transaction Scheduling (IRIS)	<p>Status: This project expands upon the work completed in Phases I and III by implementing Intra-hour energy transaction scheduling capabilities with ISO-NE. The 2008 and 2009 State of the Market recommendation #2 is, "NYISO continue its work with neighboring control areas to better utilize the transfer capability between regions." The tariff filing was submitted in 4th Q 2011. The Architectural Design Specification is targeted for 4th quarter 2012.</p> <p>Deliverables: The focus of the project in 2012 is to complete the Architectural Design Specification.</p>
Interregional Transaction Coordination	<p>Status: This project expands upon the work of Phase 4 by leveraging the designs with New England on Coordinated</p>



2012 Major Product Enhancements

Project	Status and Milestone Deliverables
Phase V – PJM Coordinated Transaction Scheduling	<p>Transaction Scheduling. PJM is hoping to evolve transaction scheduling with the NYISO to gain full efficiencies for both regions. A market design concept is targeted for the 4th quarter 2012.</p> <p>Deliverables: The focus of this project in 2012 is the proposal of a market design concept.</p>
Order 755: Regulation Compensation	<p>Status: FERC issued Order 755 in October 2011 with a compliance filing detailing design and implementation plan due in April 2012, followed by implementation in October 2012. This project is targeted for deployment in the 4th quarter 2012.</p> <p>Deliverables: The focus of this project in 2012 is the deployment of software changes necessary to support NYISO's compliance filing due in April 2012.</p>
Scheduling and Pricing: Enhanced Scarcity Pricing	<p>Status: The 2010 State of the Market recommends the NYISO investigate the possibility of more efficient price setting when energy within the NYCA is scarce. The NYISO will evaluate the causes for the pricing inefficiency and, if necessary, develop and review with stakeholders potential market enhancements that will best capture most efficient price for periods with scarce energy.</p> <p>Deliverables: The focus of this project in 2012 is stakeholder approval of the market design.</p>
Enterprise Technology Products	
Ranger Messaging Integration	<p>Status: Market to Market Coordination requires near real-time business messages to be exchanged between NYISO and the market systems of its external partners in support of the flow gate coordination process. This project will augment existing integration capabilities to include secure near real-time exchange of structured business data between NYISO's market system, PJM, and other partners. Near real-time messaging will increase as NYISO processes increasingly interact with external partners and customers. Deployment of ranger messaging integration is targeted for 4th quarter 2012 in support of Market to Market Coordination with PJM.</p> <p>Deliverables: The focus of this project in 2012 is to implement a new platform to enable near real-time message exchange.</p>
Enterprise Project Management (EPM) Platform: Phase I	<p>Status: This initiative will deliver Microsoft Project 2010 in a robust, hosted environment that will provide NYISO with up-to-date project scheduling and tracking tools, centralized and consistent project reporting for improved portfolio management, and improved project team collaboration. This platform will also enable future enhancements to NYISO's project resource planning and management process. Phase I is scheduled for implementation in 2nd quarter 2012.</p> <p>Deliverables: The focus of Phase I is implementation of the hosted solution combined with training and updated business process to effectively utilize the platform.</p>
Finance Products	



2012 Major Product Enhancements

Project	Status and Milestone Deliverables
Bad Debt Processing Flexibility	<p>Status: This project will provide NYISO the ability to place Bad Debt Losses on any invoice (Flexible Invoice Period [FIP] or Monthly) to reduce exposure and aid in timely recovery of funds. Currently, bad debt losses can only be applied to a monthly invoice, creating a potential delay of 3-4 weeks should a bad debt loss occur shortly after monthly invoice issuance. This project would reduce the length of time funds are borrowed from Working Capital and reduce credit risk exposure. The software deployment is targeted for end of 1st Quarter 2012.</p> <p>Deliverables: The focus of this project is implementation of the required software changes.</p>
ICAP Weekly Invoicing Automation	<p>Status: This project will automate the process of assessing ICAP charges/credits on Flexible Invoicing Period (FIP) and Monthly invoices. This is a manually intensive process today spanning multiple departments. This project would eliminate the need for manual entry and reduce the potential for errors associated with manual processes. The software deployment of these changes is planned for January 2012. This project is complete.</p> <p>Deliverables: The focus of this project is the automation of the existing manual process.</p>
Transaction Credit Enhancements	<p>Status: Enhancements to the CMS application are needed to better align the credit requirements for external transactions (imports, exports, wheels) to the evolving market design for transactions occurring as part of the Broader Regional Markets initiatives. Market rules have been approved by stakeholders and detailed requirements are complete. Completion of the software development is scheduled for 4th quarter 2012 with plans to implement in 1st quarter 2013.</p> <p>Deliverables: The focus of this project in 2012 is to complete all of the software development.</p>
Operations & Reliability Products	
Energy Management System (EMS) Visualization	<p>Status: This is a multi-year project to determine the requirements, design and to implement the necessary situational awareness, data redundancy and communication infrastructure to facilitate operational control from the new Krey Primary Control Center. The Architectural Design is scheduled for completion in the 3rd quarter.</p> <p>Deliverables: The focus of this project in 2012 is completion of the Architectural Design.</p>
Phase I Meter Upgrade	<p>Status: The focus of this project is to move existing and new circuits to a new configuration and to add the new building to the network, which is required in order to fully support Phase I data needs in the new control center. The Architectural Design is scheduled for completion in the 3rd quarter.</p> <p>Deliverables: The focus of this project in 2012 is completion of the Architectural Design.</p>

Project	Status and Milestone Deliverables
Hudson Transmission Partners (HTP) Controllable Tie Line	<p>Status: This project would support the implementation of a new controllable tie line from PJM into NYCA. Targeted commercial date is early 2013. Software changes are targeted for 4th quarter 2012.</p> <p>Deliverables: The focus of this project in 2012 is to deploy the required software changes in support of the targeted commercial operation date.</p>
Rest of State (ROS) DAM Mitigation Automation	<p>Status: Currently MMA monitors for ROS DAM BPCG mitigation in a very labor intensive and time consuming manner. All other BPCG mitigation has been automated (i.e. DAM and RT for NYC and RT for ROS). The implementation of ROS DAM BPCG is the last remaining tariff defined full threshold BPCG mitigation that needs to be automated. Approval of the market design is targeted for 4th quarter 2012.</p> <p>Deliverables: The focus of this project in 2012 is stakeholder approval of the market design.</p>
Planning and TCC Market Products	
TCC Multi-Duration/Non-Historic Fixed-Price TCC Phase I	<p>Status: This project continues the 2010 efforts to provide for TCC Auction 'End State' functionality; in 2010 NYISO implemented functionality for MPs to sell TCCs in any round. Continuing efforts will focus on the implementation of Non-Historic Fixed Price TCCs, multi-duration capability period auctions, and balance of period TCCs. NYISO completed the functional requirements in 2011 as planned. NYISO is targeting a 4th quarter software deployment to support offering Non-Historic Fixed Price TCCs beginning with the Spring 2013 Capability Period Auction.</p> <p>Deliverables: The focus of this project is a software deployment in support of NYISO's Non-Historic Fixed-Price TCC Compliance Filing.</p>
High Performance Computing for Planning Studies Phase II	<p>Status: This is a project to put in place the infrastructure required to enable System Resource Planning to conduct large, data intensive planning studies. The solution for MARs was successfully deployed in August 2011. Phase II of this project will deploy MAPS on the High Performance Computing platform. This deployment is targeted for 3rd quarter 2012.</p> <p>Deliverables: The focus of this project in 2012 is the implementation of the solution for MAPS.</p>
Siemens PTI Model-on-Demand Phase II	<p>Status: The second phase of this project will focus on maintenance and consulting for implementation of the Siemens PTI Model-on-Demand (MOD) web portal, which will allow TOs and MPs to review and approve data in a structured, interactive manner. The software design is targeted for completion in the 4th quarter 2012.</p> <p>Deliverables: The focus of this project in 2012 is the completion of the software design.</p>

Summary Description of FERC Regulatory Filings, Investigations and Rulemakings and Related Orders in NYISO Matters January 2012

Filing Date	Filing Summary	Docket	Order Date	Order Summary
12/05/2011	NYISO compliance filing of tariff revisions regarding ATC definition and compliance with NAESB WEQ standards	ER11-3881-002	01/31/2012	Letter Order accepting compliance filing effective 12/5/11 as requested
Filing Date	Filing Summary	Docket	Order Date	Order Summary
01/06/2012	NYISO motion for summary disposition of Seneca Power Partners complaint v. NYISO	EL12-6-000		
01/11/2012	NYISO filing of its 4 th Quarter 2011 EQR report	ER02-2001-000	None	No order to be issued.
01/12/2012	NYISO motion for leave to answer and answer re: TC Ravenswood's black start issue	EL12-9-000		
01/12/2012	NYISO answer in support of the NYTOs' January 11th answer to ITC/MISO's answer regarding the NYISO's motion to dismiss re: PAR cost allocation.	ER11-1844-000		
01/13/2012	NYISO errata filing re: CTS filing	ER12-701-000		
01/13/2012	NYISO Motion for 90 days Extension Re: ISO/RTO Order 741 Credit Reform Compliance Filing re: ISO/RTO ability to offset market obligations in bankruptcy	RM10-13-000, ER11-3949-000		
01/17/2012	NYISO filing of its annual report on Demand Side Management programs	ER01-3001-000		
01/25/2012	NYISO errata to its January 17, 2012 filed Annual Report on NYISO Demand Side Management Programs	ER01-3001-000		
01/25/2012	NYISO joint comments with ISO/RTO Council re: NOPR concerning Enhancement of Electricity Market Surveillance and Analysis through Ongoing Electronic Delivery of Data from RTOs and ISOs	RM11-17-000		
01/27/2012	NYISO Response to the PJM MMU's Protest of the NYISO's 12/22/11 Interface Pricing Compliance Notice	ER08-1281-005		

Filing Date	Filing Summary	Docket	Order Date	Order Summary
1/30/2012	NYISO Tenth Non-Public Quarterly Audit Report to FERC Division of Audits	PA08-3-000		
01/31/2012	NYISO filing of its 11 th semi-annual price validation informational report	ER06-1014-000		